



Reserved for permit stamp

100 South Jackson St. Suite 800
Park City, Utah 84302
+12062419700
www.olsonkundig.com

Olson Kundig

PROJECT
SOMMET BLANC
9300 Mainway Ave (B2 East Parcel)
Park City, Utah 84300

ASPEN GROUP
Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Crowder H2O
2096 N University Ave, Suite 200
Provo, UT 84604

Landscape Architect
EPG Design
6849 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Main Street
Middlebury, VT

Code Consultant
Holmes
800 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Leitch Bates
1815 North Cross Parkway, Suite 304
Bohemia, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1201 5th Ave, Suite 2200
Seattle, WA 98101

Lighting Designer
O
1519 SE 8th Ave, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1801 Fourth Ave, Suite 3100
Seattle, WA 98154

principal architect _____
project manager _____
drawn by _____

checked by Checker
job no. _____
date 11/18/2022

revisions:

no. _____ date _____ by _____

ISSUE FOR CONSTRUCTION
11/18/2022

TOWER C - LVL P1
MECHANICAL DUCT
PLAN


M2.2C.01

SHEET NOTES:



- A. REFER TO M2.4 SERIES FOR ENLARGED UNIT PLANS.
- B. FIREPLACE FLUE ROUTING SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING AND SIZING DETAIL.
- C. MECHANICAL EQUIPMENT AS SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR DETAIL.
- D. UNLESS OTHERWISE NOTED, MEDIUM PRESSURE DUCT RUNOUTS TO TERMINAL BOXES SHALL BE THE SAME SIZE AS TERMINAL BOX INLET. DUCT RUNOUTS TO TERMINAL BOXES SHALL BE 2" LARGER THAN INLET IF RUNOUT IS GREATER THAN 15'
- E. ALL DUCT BRANCHES LEADING TO DIFFUSERS ARE TO MATCH NECK SIZE OF DIFFUSER UNLESS NOTED OTHERWISE.

NUMBERED NOTES:

- 1. THIS SPACE TO MAINTAIN POSITIVE PRESSURE RELATIVE TO THE GARAGE.
- 2. SEE ARCHITECTURAL DRAWINGS FOR INTAKE WELL INFORMATION.
- 3. ALL DUCTS AND EQUIPMENT LOCATED IN THE GARAGE SHALL BE INSTALLED TIGHT TO UNDERSIDE OF THE SLAB TO MAINTAIN 8'-6" CLEARANCES FOR VEHICLES.

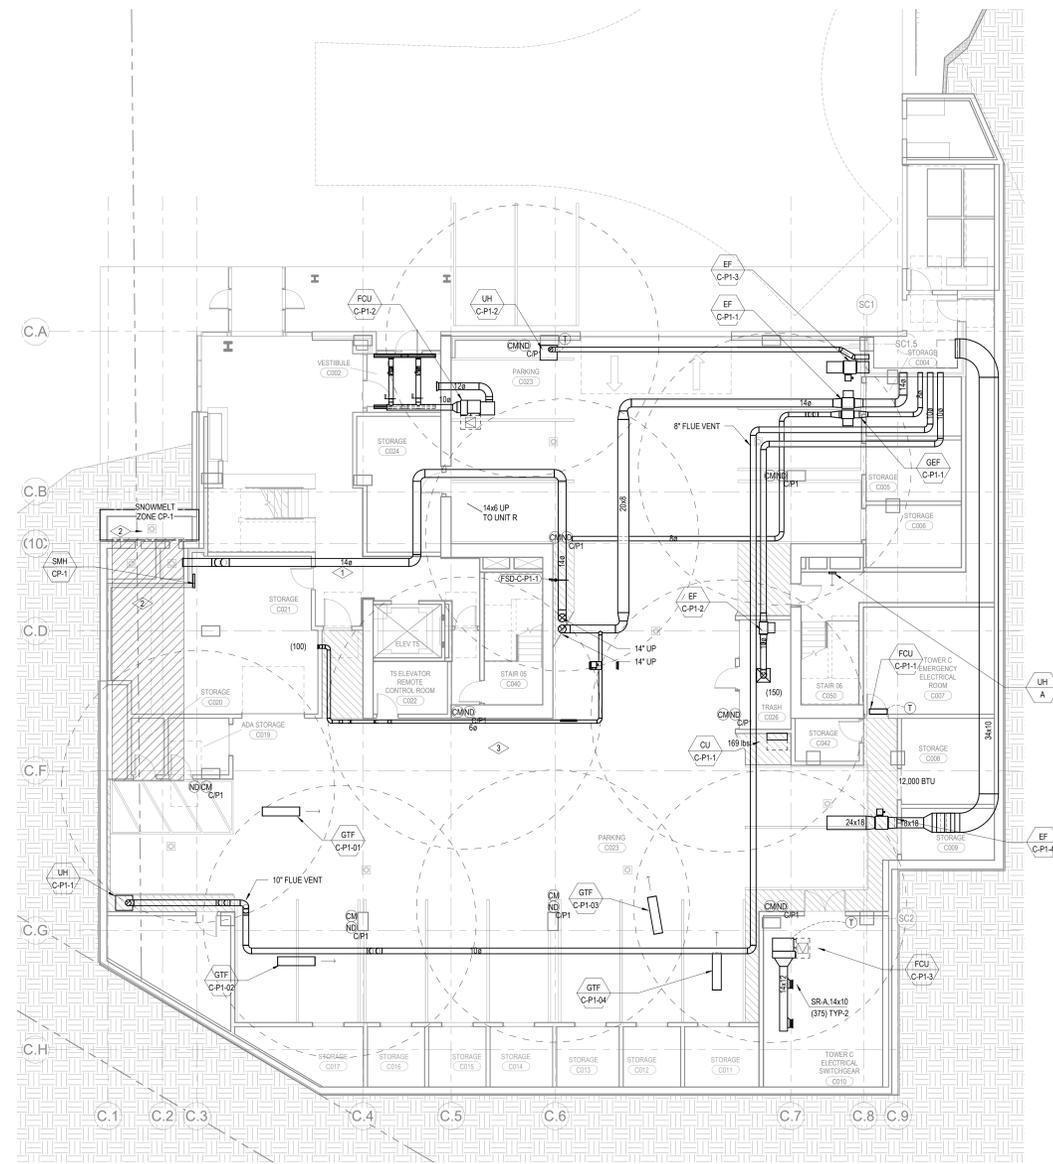

1 TOWER C - PARKING LEVEL MECHANICAL DUCT PLAN
SCALE: 1/8" = 1'-0"





Reserved for permit stamp

100 South Jackson St. Suite 800
Park City, Utah 84302
+12062619700
www.olsonkundig.com

Olson Kundig

PROJECT
SOMMET BLANC
9300 Marneac Ave (B2 East Parcel)
Park City, Utah 84300

ASPEN GROUP
Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Project Consultant
Crowder H2O
2096 N University Ave, Suite 200
Provo, UT 84604

Landscape Architect
EPG Design
6849 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainmill Road
Middlebury, VT

Code Consultant
Holmes
800 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Leitch Bates
18115 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1201 5th Ave, Suite 2200
Seattle, WA 98101

Lighting Designer
O
1319 SE 8th Ave, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1801 Fourth Ave, Suite 3100
Seattle, WA 98154

principal architect _____
project manager _____
drawn by _____

checked by Checker
job no. _____
date 11/18/2022

revisions:

no. _____ date _____ by _____

ISSUE FOR CONSTRUCTION
11/18/2022

TOWER C - LVL 1
MECHANICAL DUCT
PLAN


M2.2C.11

SHEET NOTES:


- A. REFER TO M2.4 SERIES FOR ENLARGED UNIT PLANS.
- B. FIREPLACE FLUE ROUTING SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING AND SIZING DETAIL.
- C. MECHANICAL EQUIPMENT SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR DETAIL.
- D. ARCHITECT SHALL PROVIDE 1 SQFT NFA OPENINGS IN ALL FULL HEIGHT, NON-RATED WALLS FOR RETURN AIR PATHS IF NO DUCT TRANSFER IS SHOWN.
- E. ALL EQUIPMENT, INSULATION, WIRING, AND INFRASTRUCTURE IN THE PLENUM SHALL BE PLENUM RATED.
- F. FLEX DUCT SHALL NOT BE INSTALLED ABOVE FINISHED HARD-LID CEILINGS.
- G. PROVIDE BUTTON TYPE TEMPERATURE SENSOR IN PUBLIC AREAS. SEE DETAIL-13, SHEET M5.04.
- H. PROVIDE REMOTE CABLE DAMPER OPERATOR IN DIFFUSERS ABOVE HARD-LID CEILINGS. SEE DETAIL-5, SHEET M5.04.

NUMBERED NOTES:

- 1. DUCT RISERS SHALL BE ROUTED IN RATED SHAFT.
- 2. PROVIDE ENERVEK SMD5-8 MODULATING DAMPER OFF BOILER EXHAUST STACK.

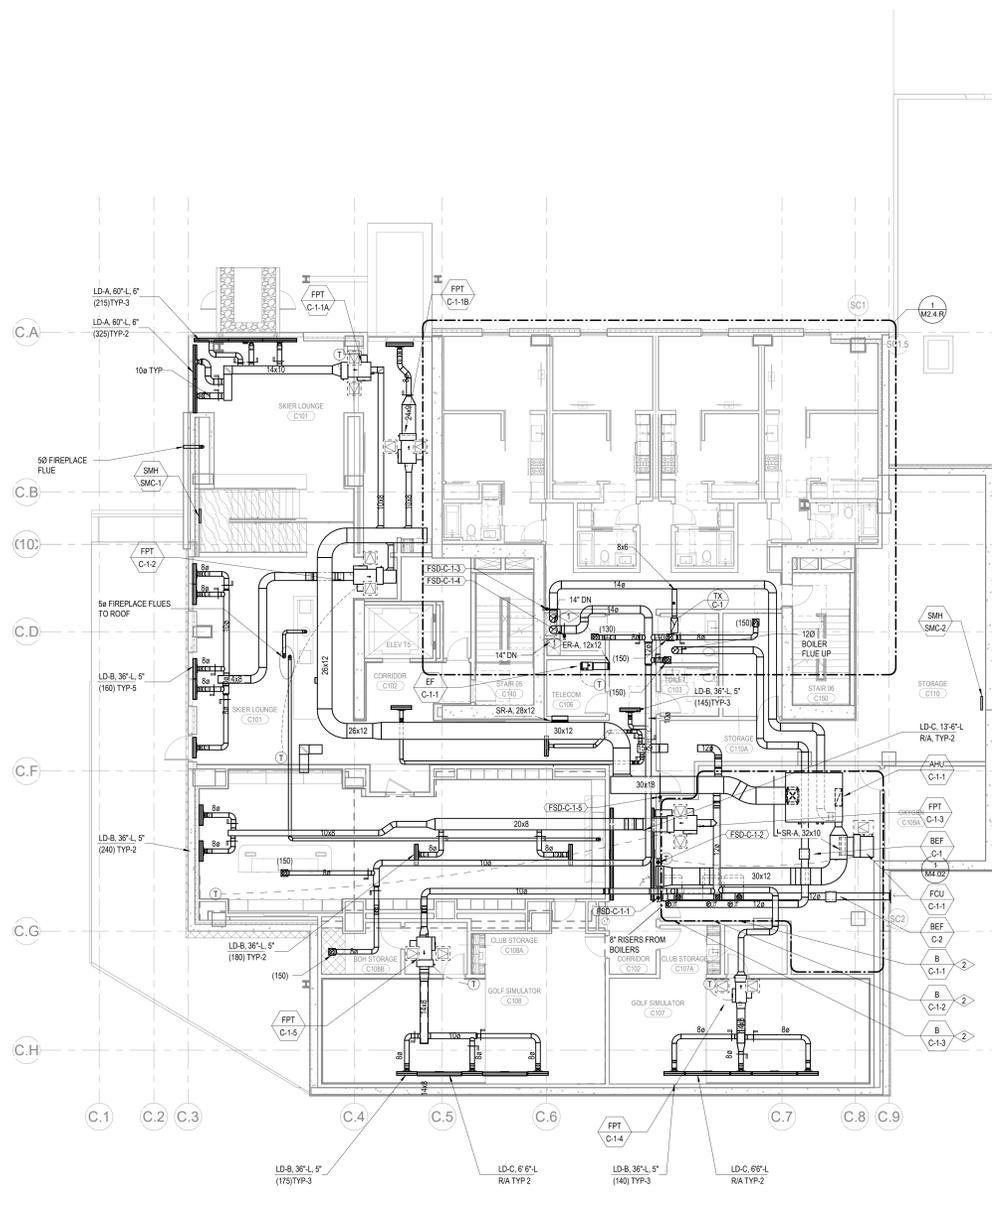

1 TOWER C - LEVEL 1 MECHANICAL DUCT PLAN
SCALE: 1/8" = 1'-0"





Reserved for permit stamp

195 South Jackson St. Suite 800
Park City, Utah 84302
+1 208 261 9700
www.olsonkundig.com

Olson Kundig

PROJECT
SOMMET BLANC
9300 Marzac Ave (B2 East Parcel)
Park City, Utah 84300



Aspen Group USA LLC
PO Box 980022
Park City, Utah 84098

- Pool Consultant**
Crowder H2O
2696 N University Ave, Suite 200
Provo, UT 84604
- Landscape Architect**
EPG Design
6849 South High Tech Drive, Suite 100
Midvale, Utah 84047
- Specifications Writer**
Friday Group
88 Main Hill Road
Middlebury, VT
- Code Consultant**
Holmes
800 1st Avenue, Suite 200A
Seattle, WA 98104
- Fire Protection Engineer**
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581
- Vertical Transportation Consultant**
Lerch Bates
1815 North Creek Parkway, Suite 304
Bothell, WA 98011
- Structural Engineer**
Magnusson Klemencic Associates
1201 2nd Ave, Suite 3200
Seattle, WA 98101
- Lighting Designer**
O
1319 SE 8th Ave, Suite 210
Portland, Oregon 97219
- Building Envelope Consultant**
RDH
2101 N 34th St
Seattle, WA 98103
- Accessibility Consultant**
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109
- MEP Engineer**
WSP USA
1821 Fourth Ave, Suite 3100
Seattle, WA 98154

principal architect _____
 project manager _____
 drawn by _____
 checked by _____ Checker _____
 job no. _____
 date 11/18/2022

revisions:

no. _____ date _____ by _____

ISSUE FOR CONSTRUCTION
11/18/2022


TOWER C - LVL 6
MECHANICAL DUCT
PLAN

M2.2C.16


SHEET NOTES:

- A. REFER TO M2.4 SERIES FOR ENLARGED UNIT PLANS
- B. FIREPLACE FLUE ROUTING SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING AND SIZING DETAIL.
- C. MECHANICAL EQUIPMENT SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR DETAIL.
- D. ALL RESIDENTIAL TOILET EXHAUST, DRYER EXHAUST, AND KITCHEN RANGE HOOD EXHAUST TO BE PART OF A SUB-DUCT EXHAUST SYSTEM.

NUMBERED NOTES:

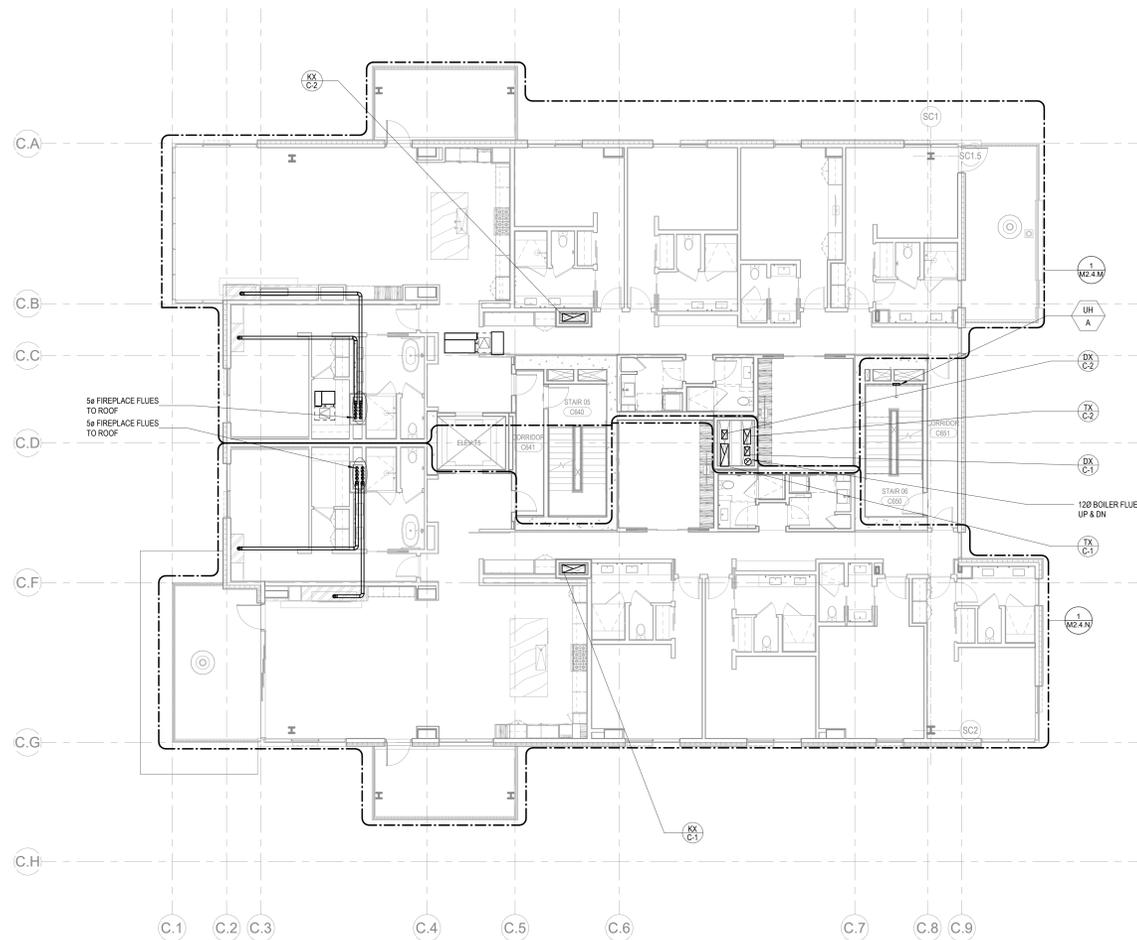

1 TOWER C - LEVEL 6 MECHANICAL DUCT PLAN
SCALE: 1/8" = 1'-0"





Reserved for permit stamp

195 South Jackson St. Suite 800
Provo, UT 84601
+1 202 624 9770
www.olsonkundig.com

Olson Kundig

PROJECT
SOMMET BLANC
9300 Marzac Ave (B2 East Parcel)
Park City, Utah 84300



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

- Pool Consultant**
Crowder H2O
2696 N University Ave, Suite 200
Provo, UT 84604
- Landscape Architect**
EPG Design
6649 South High Tech Drive, Suite 100
Midvale, Utah 84047
- Specifications Writer**
Friday Group
88 Mainland Road
Middlebury, VT
- Code Consultant**
Holmes
800 1st Avenue, Suite 200A
Seattle, WA 98104
- Fire Protection Engineer**
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581
- Vertical Transportation Consultant**
Lerch Bates
1815 North Creek Parkway, Suite 304
Bothell, WA 98011
- Structural Engineer**
Magnusson Klemencic Associates
1201 5th Ave, Suite 2200
Seattle, WA 98101
- Lighting Designer**
O
1319 SE 8th St, Suite 210
Portland, Oregon 97219
- Building Envelope Consultant**
RDH
2101 N 34th St
Seattle, WA 98103
- Accessibility Consultant**
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109
- MEP Engineer**
WSP USA
1821 Fourth Ave, Suite 3100
Seattle, WA 98154

principal architect _____
 project manager _____
 drawn by _____
 checked by _____ Checker _____
 job no. _____
 date 11/18/2022

revisions:


no. _____ date _____ by _____

ISSUE FOR CONSTRUCTION
11/18/2022

TOWER C - ROOF MECHANICAL DUCT PLAN
M2.2C.R

- SHEET NOTES:**
- A. REFER TO M2.4 SERIES FOR ENLARGED UNIT PLANS
 - B. FIREPLACE FLUE ROUTING SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING AND SIZING DETAIL.
 - C. MECHANICAL EQUIPMENT SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR DETAIL.

NUMBERED NOTES:

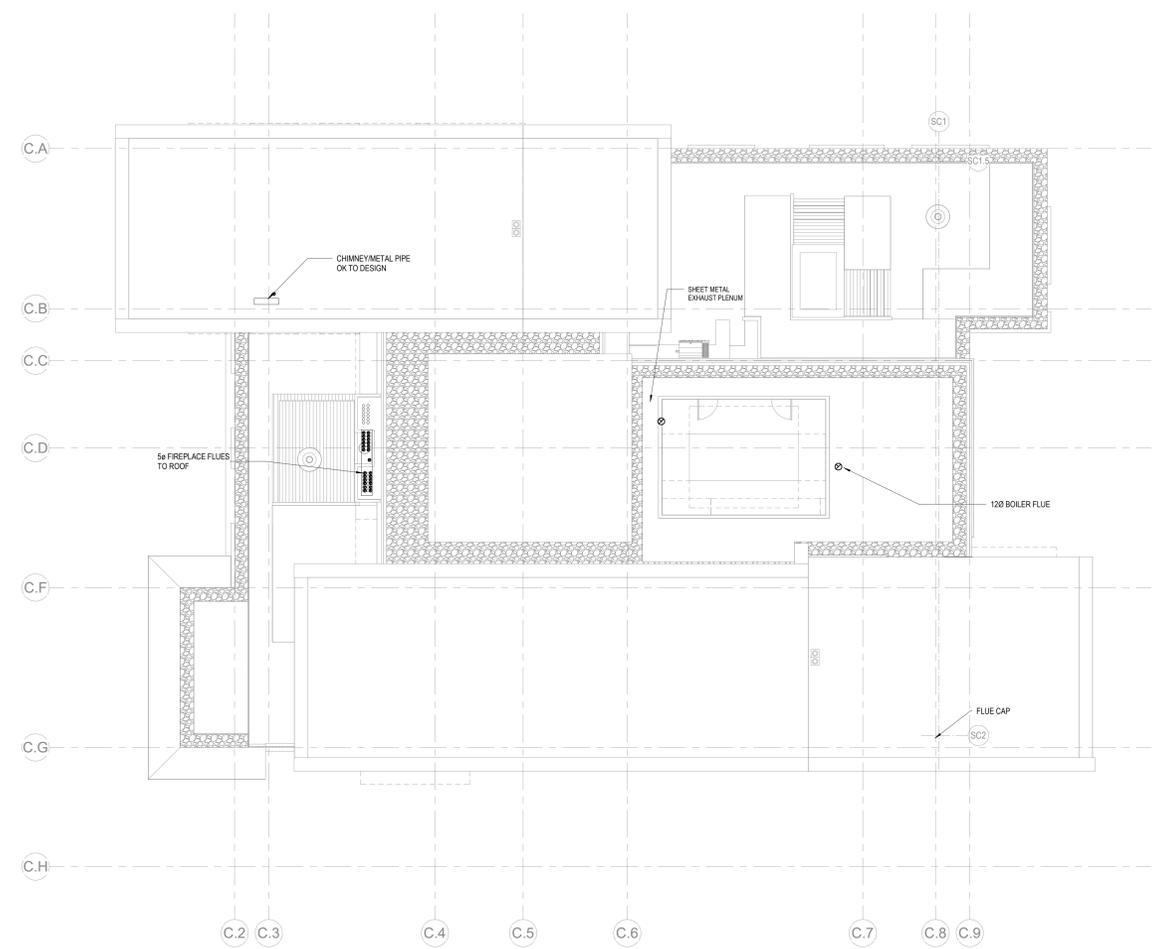

1 TOWER C - ROOF MECHANICAL DUCT PLAN
SCALE: 1/8" = 1'-0"

