

1 RCP - TOWER A/B - UNIT A
SCALE: 1/4" = 1'-0"

RCP GENERAL NOTES


1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. TYPICAL LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.

RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- | | |
|--|--|
| | C10 - WOOD CEILING |
| | C11 - SUSPENDED GYPSUM WALL BOARD |
| | C12 - STONE TILE |
| | C14 - ACOUSTICAL CEILING TILE |
| | SQUARE RECESSED DOWNLIGHT |
| | DECORATIVE SCONCE |
| | DECORATIVE CUSTOM CHANDELIER |
| | ROUND PENDANT LIGHT |
| | J-BX |
| | LENSED LINEAR UTILITY STRIP |
| | CONCEALED LINEAR UNDERCABINET STRIP |
| | TRACK / RAIL / LINEAR LED |
| | SURFACE-MOUNTED LIGHT BAR |
| | SURFACE MOUNT PANEL |
| | SPRINKLER |
| | SMOKE DETECTOR |
| | COMBINATION SMOKE / CARBON MONOXIDE DETECTOR |
| | FIRE ALARM SPEAKER |
| | FIRE ALARM STROBE |
| | FIRE ALARM COMBINATION SPEAKER / STROBE |
| | COMBINATION SMOKE / HEAT DETECTOR |
| | EXIT SIGN |
| | SECURITY CAMERA |
| | WIRELESS ACCESS POINT |
| | AV SPEAKER |
| | MOTORIZED SINGLE ROLLER SHADE - EQ-02.00 |
| | MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01 |
| | CEILING FAN - MECH EXHAUST |
| | MECHANICAL LINEAR GRILLE |
| | CEILING ACCESS PANEL |
| | CEILING CONTROL POINT |

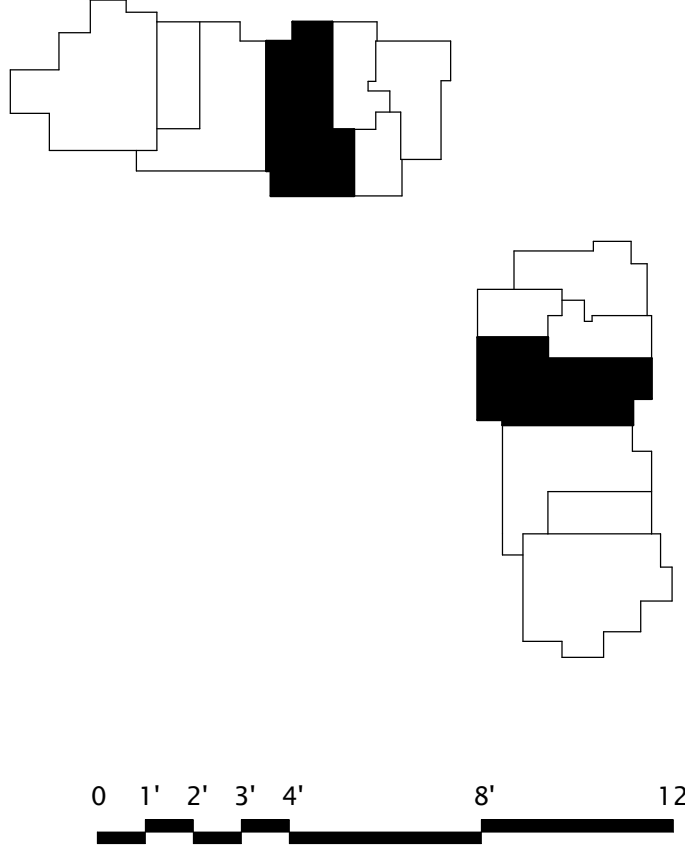

100 South Jackson St. Suite 600
Seattle, Washington 98104 USA
+1 206 454 1000 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAU AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6940 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainell Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
1915 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
OP
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK, KM
project manager TM, JB, LB, MD
drawn by SK, SS, JR, CP, AL
NH, EK, BD, ER

checked by JB
job no. 2052
date 11/18/2022

revisions:

no. date by

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER AB - UNIT
A

A6.2.A

RCP GENERAL NOTES

1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. TYPICAL LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.


RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- | | |
|--|--|
| | C10 - WOOD CEILING |
| | C11 - SUSPENDED GYPSUM WALL BOARD |
| | C12 - STONE TILE |
| | C14 - ACOUSTICAL CEILING TILE |
| | SQUARE RECESSED DOWNLIGHT |
| | DECORATIVE CUSTOM CHANDELIER |
| | ROUND PENDANT LIGHT |
| | J-BX |
| | LENSED LINEAR UTILITY STRIP |
| | CONCEALED LINEAR UNDERCABINET STRIP |
| | TRACK / RAIL / LINEAR LED |
| | SURFACE-MOUNTED LIGHT BAR |
| | SURFACE MOUNT PANEL |
| | SPRINKLER |
| | SMOKE DETECTOR |
| | COMBINATION SMOKE / CARBON MONOXIDE DETECTOR |
| | FIRE ALARM SPEAKER |
| | FIRE ALARM STROBE |
| | FIRE ALARM COMBINATION SPEAKER / STROBE |
| | COMBINATION SMOKE / HEAT DETECTOR |
| | EXIT SIGN |
| | SECURITY CAMERA |
| | WIRELESS ACCESS POINT |
| | AV SPEAKER |
| | MOTORIZED SINGLE ROLLER SHADE - EQ-02.00 |
| | MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01 |
| | CEILING FAN - MECH EXHAUST |
| | MECHANICAL LINEAR GRILLE |
| | CEILING ACCESS PANEL |
| | CEILING CONTROL POINT |



1 RCP - TOWER A/B - UNIT B
SCALE: 1/4" = 1'-0"

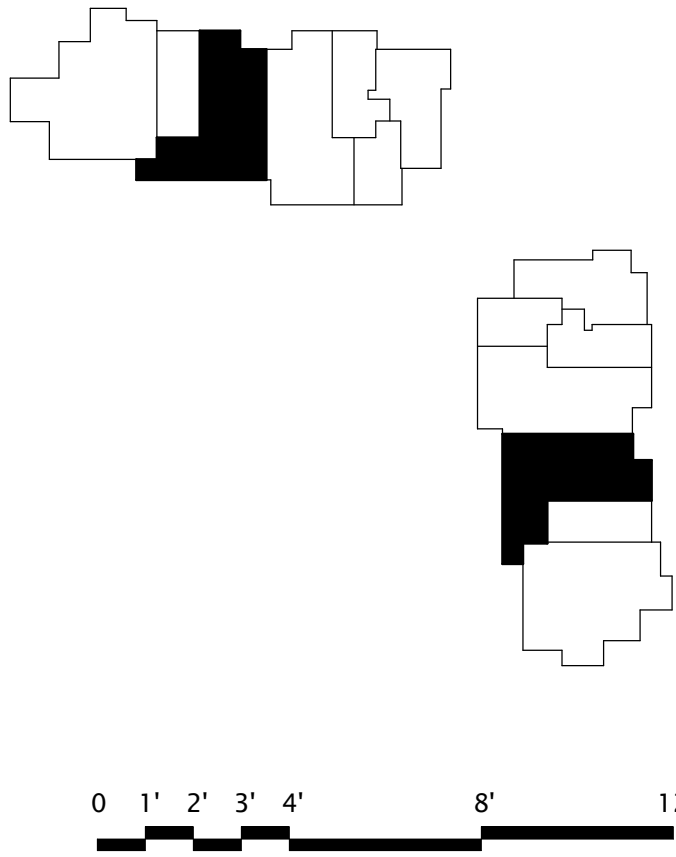

0 1' 2' 3' 4' 8' 12'

100 South Jackson St, Suite 800
Seattle, Washington 98104 USA
+1 206 454 1800 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSA CAVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6940 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainell Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O
319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK, KM
project manager TM, JB, LS, MD
drawn by SK, SS, JR, CP, AL
NH, EK, BD, ER

checked by JB
job no. 2052
date 11/18/2022

revisions:

no. date by

ISSUED FOR
CONSTRUCTION
11/18/2022




RCP - TOWER AB - UNIT
B


A6.2.B


1. SPOT LIGHTINGS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH FLOOR. ALL SPOTS 9"Ø AFF U.N.O.
2. ALL CEILINGS ASSUME 8'0" AFF U.N.O.
3. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET 6 INCHES
7. KITCHENS, BATHS, TOILETS, CLOSET, PANTRY, BREAKFAST ROOMS, KITCHENS, KITCHENS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
8. SEE SHEET A0.10 AND A0.11 FOR FLOORCEILING ASSEMBLIES
9. MECHANICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL LIGHTING FIXTURES SHALL BE OF THE FOLLOWING MINIMUM LUMINOUS INTENSITY LEVELS TO PROVIDE A MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS SHALL BE DETERMINED BY THE ELECTRICAL ENGINEER. TELEPHONE DRAWINGS PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. ALL DOWNLIGHTS OR LIGHT FIXTURES SHALL BE INSTALLED IN A MANNER THAT AVOIDS DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOORCEILING.
15. ALL DOWNLIGHT OR ALL LIGHT FIXTURES SHALL BE INSTALLED IN A MANNER THAT AVOIDS DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
16. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
17. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS, PRELIMINARY INSTALLATION OF ANY OF THESE SYSTEMS.


ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.


HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION


 C10 - WOOD CEILING
 C11 - SUSPENDED GYPSUM WALL BOARD
 C12 - STONE TILE


 C14 - ACOUSTICAL CEILING TILE


 SQUARE RECESSED DOWNLIGHT


 DECORATIVE SCONCE


 DECORATIVE CUSTOM CHANDELIER


 ROUND PENDANT LIGHT


 J BOX


 LENSED LINEAR UTILITY STRIP


 CONCEALED LINEAR UNDERCABINET STRIP


 TRACK / RAIL / LINEAR LED


 SURFACE-MOUNTED LIGHT BAR


 SURFACE MOUNT PANEL


 SPRINKLER


 SMOKE DETECTOR


 COMBINATION SMOKE / CARBON MONOXIDE DETECTOR


 FIRE ALARM SPEAKER


 FIRE ALARM STROBE


 FIRE ALARM COMBINATION SPEAKER / STROBE


 COMBINATION SMOKE / HEAT DETECTOR


 EXIT SIGN


 SECURITY CAMERA


 WIRELESS ACCESS POINT


 AV SPEAKER


 MOTORIZED SINGLE ROLLER SHADE - EQ-02.00

 MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01

 CEILING FAN - MECH EXHAUST

 MECHANICAL LINEAR GRILLE

 CEILING ACCESS PANEL

 CEILING CONTROL POINT

159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 oleonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Costa Mesa, CA 92626

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98102

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, A NH, EK, BD, EB

checked by JB
job no. 20052
date 11/18/2022


revisions

no.	date	by
-----	------	----


ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER AB - UNIT
C

A6.2.C

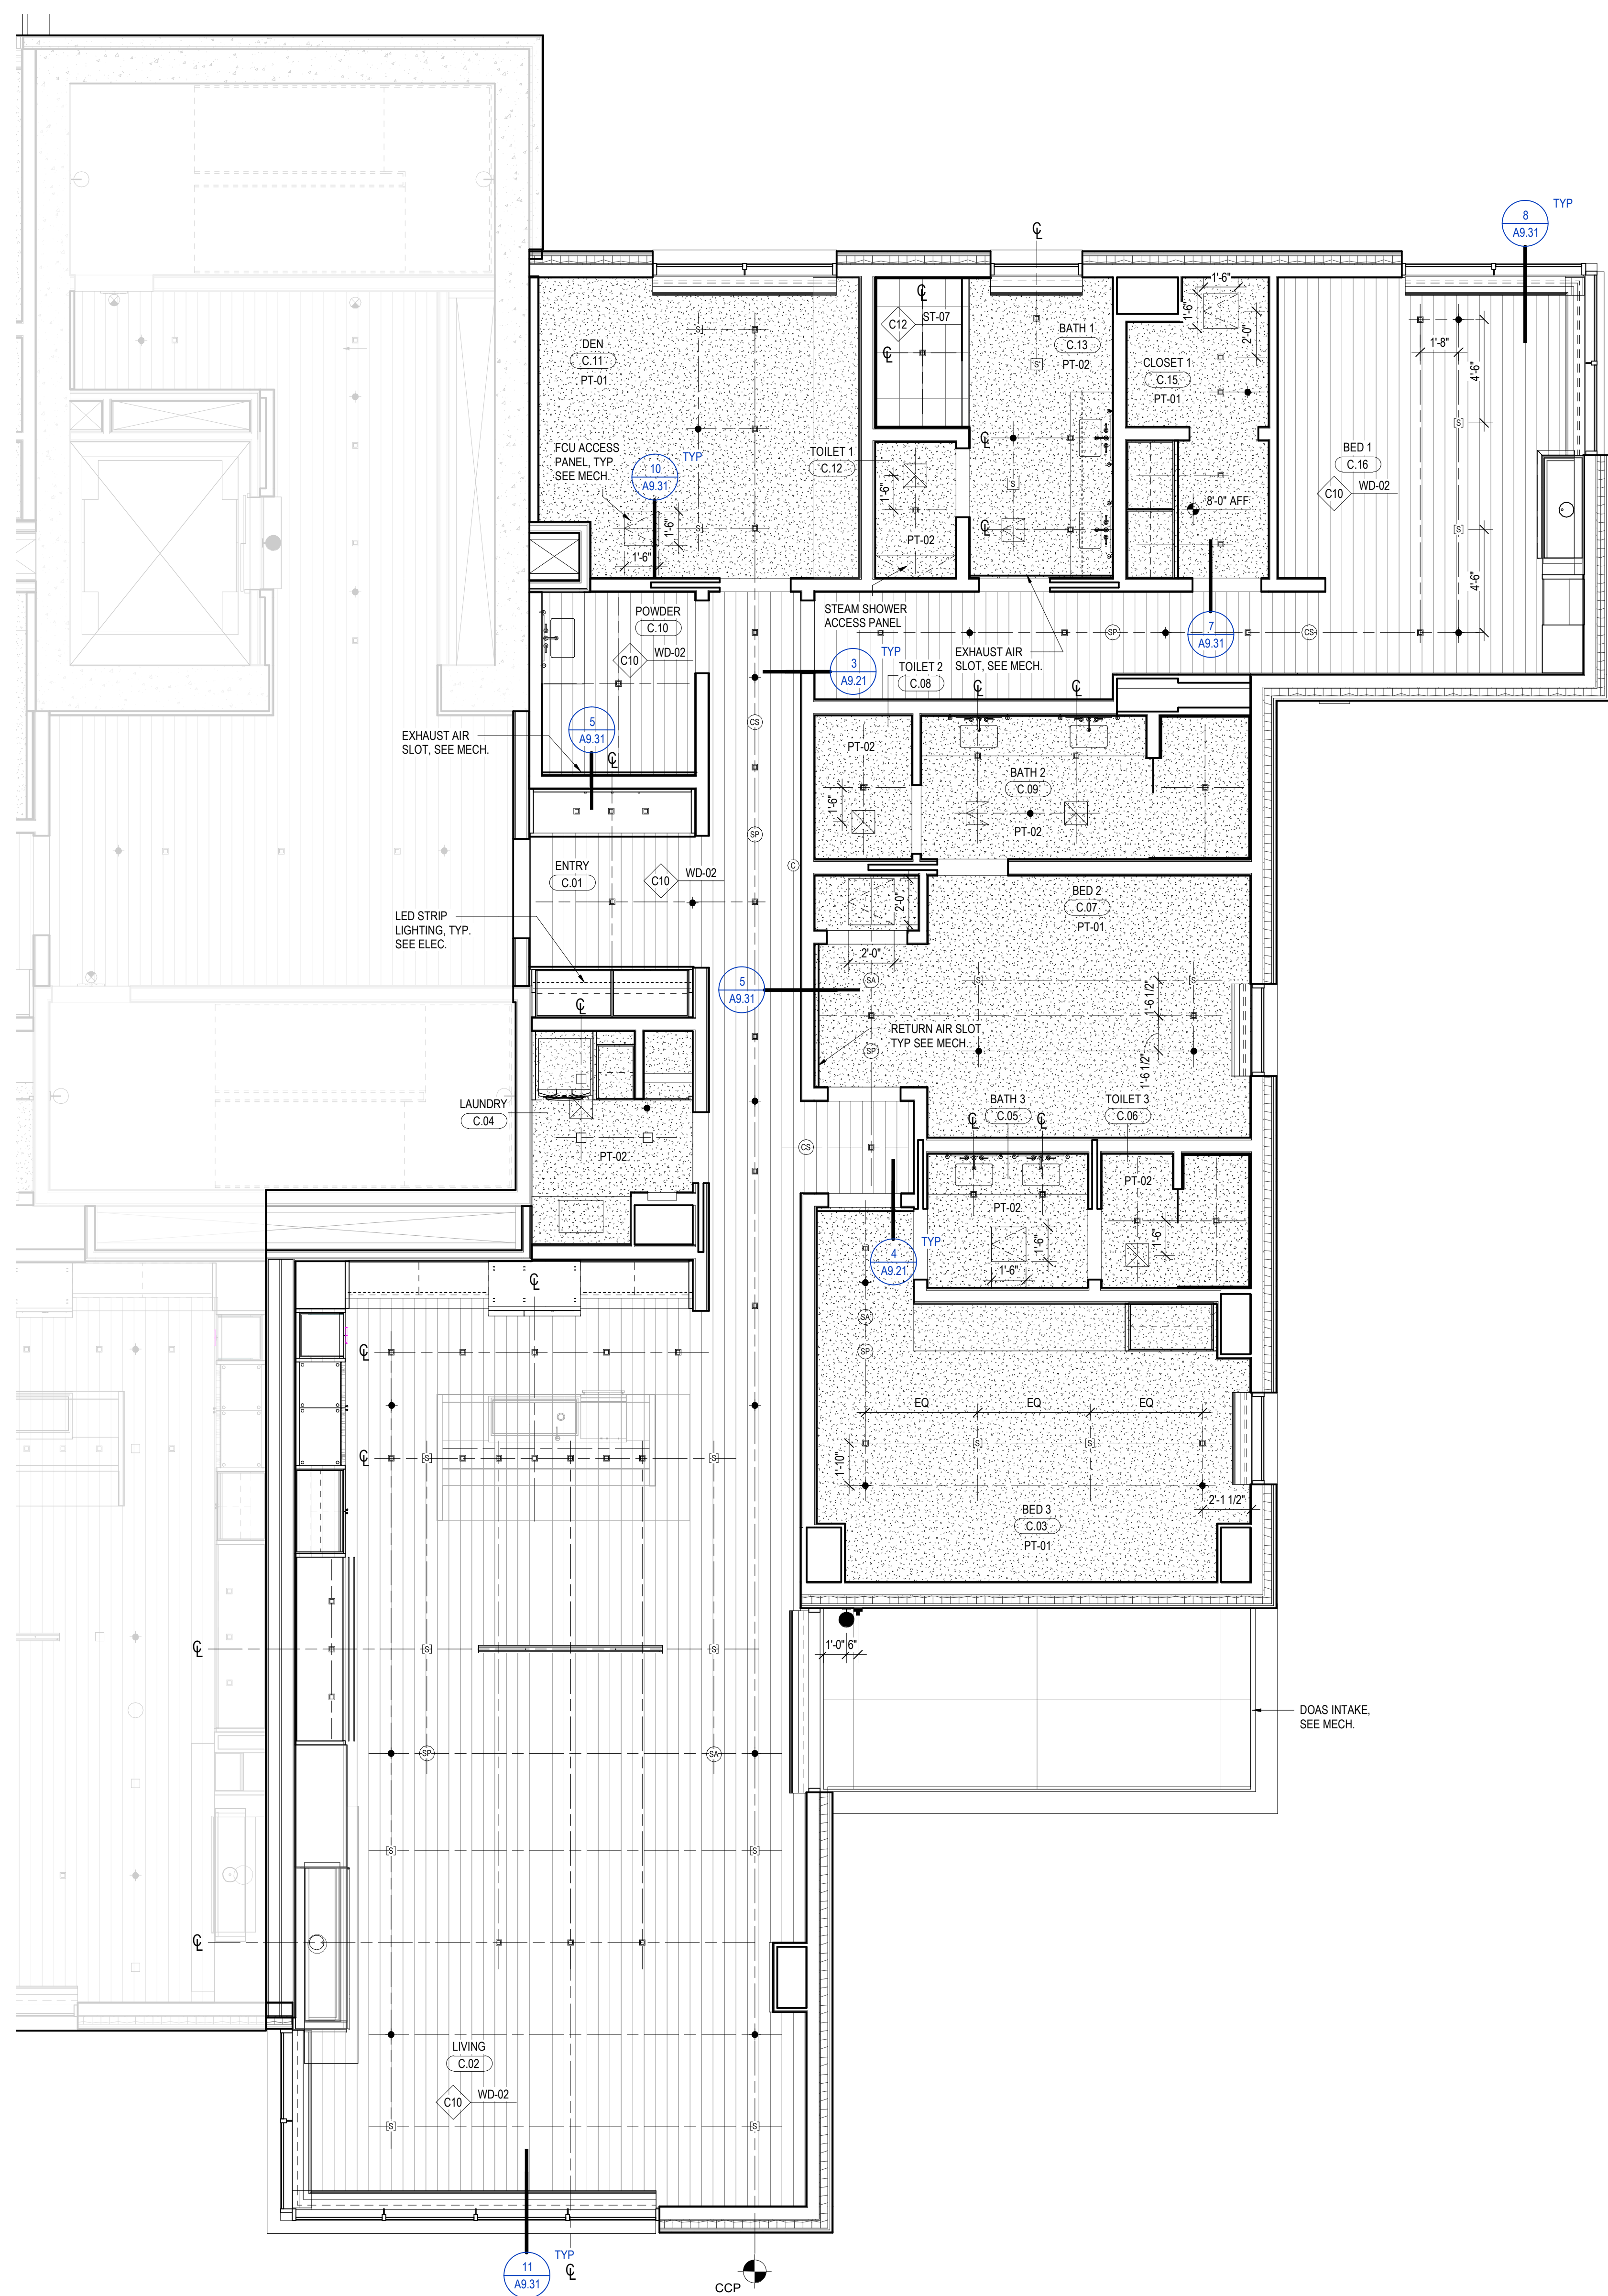

1 RCP - TOWER A/B - UNIT C
SCALE: 1/4" = 1'-0"

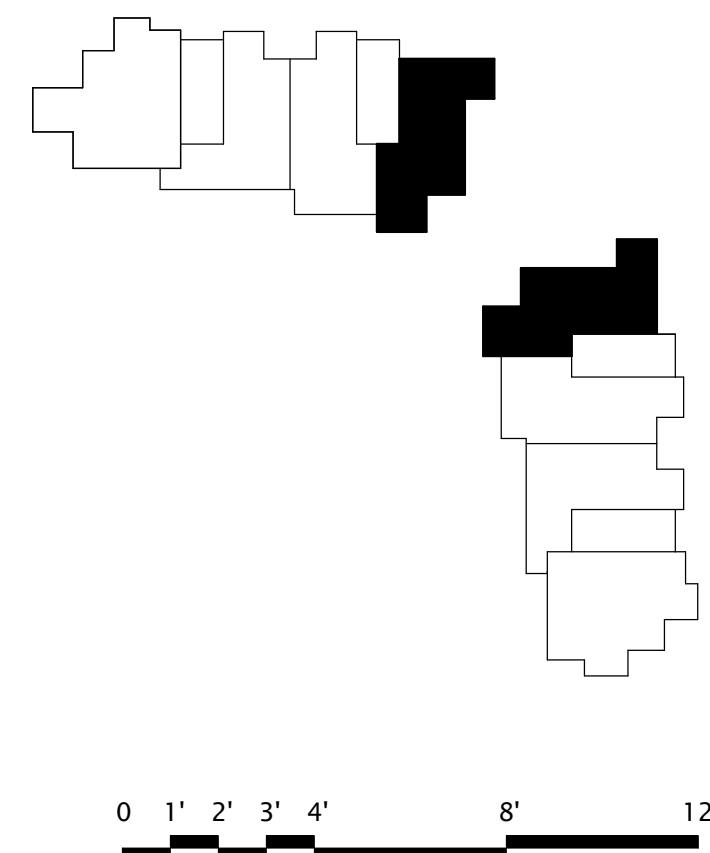

0 1' 2' 3' 4' 8' 12'

1. SPOT LEVELINGS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTH OF FINISH FLOOR AND CEILING 9'-0" AFF. U.O.
2. ALL CEILINGS ASSUMED TO BE 12' U.O.
3. ALL CEILINGS ASSUMED TO BE 12' U.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 8'0" U.O. ALL OTHER ROOMS, STORAGE ROOMS, KITCHENS, BATHS, MECHANICAL ROOMS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7' FEET.
7. SEE SHEET AO 10 AND AO 11 FOR FLOORCEILING ASSEMBLIES.
8. MECHANICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND OTHER LEVELS TO PROJECT AT LEAST 12" FROM WALL. FACE OF WALL TO BE USED TO DETERMINE OF THE FIXTURE LOCATION.
11. SMOKE DETECTOR SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTOR LOCATIONS. LOCATIONS TO BE DETERMINED WITH APPROVED RCP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR WHERE THERE IS FASTENING TO THE STRUCTURE. SEE REQUIRED SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOORCEILING JUNCTION. FIRESTOP PENETRATIONS AT FURRED OUT FLOORCEILING ASSEMBLIES.
15. PROVIDE A DUCT PULLING PLAN TO BE DETERMINED WITH APPROVED RCP DRAWINGS FOR ADDITIONAL INSTALLATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS AND SOME MECHANICAL ACCESS POINTS. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

RCP LEGEND

C10 - WOOD CEILING

C11 - SUSPENDED GYPSUM WALL BOARD

C12 - STONE TILE

C14 - ACOUSTICAL CEILING TILE

SQUARE RECESSED DOWNLIGHT

DECORATIVE SCONCE

DECORATIVE CUSTOM CHANDELIER

ROUND PENDANT LIGHT

J-BOX

LENSED LINEAR ULTRAVIOLET STRIP

CONCEALED LINEAR UNDERCABINET STRIP

TRACK / RAIL / LINEAR LED

SURFACE-MOUNTED LIGHT BAR

SURFACE MOUNT PANEL

SPRINKLER

SMOKE DETECTOR

COMBINATION SMOKE / CARBON MONOXIDE DETECTOR

FIRE ALARM SPEAKER

FIRE ALARM STROBE

FIRE ALARM COMBINATION SPEAKER / STROBE

COMBINATION SMOKE / HEAT DETECTOR

EXIT SIGN

SECURITY CAMERA

WIRELESS ACCESS POINT

AV SPEAKER

MOTORIZED SINGLE ROLLER SHADE - EQ-02.00

MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01

CEILING FAN - MECH EXHAUST


MECHANICAL LINEAR GRILLE

CEILING ACCESS PANEL

CEILING CONTROL POINT

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060

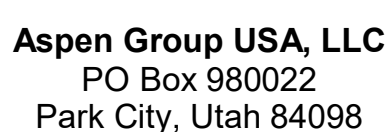


MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154


no.	date	by
-----	------	----


RCP - TOWER AB - UNIT
D

A6.2.D

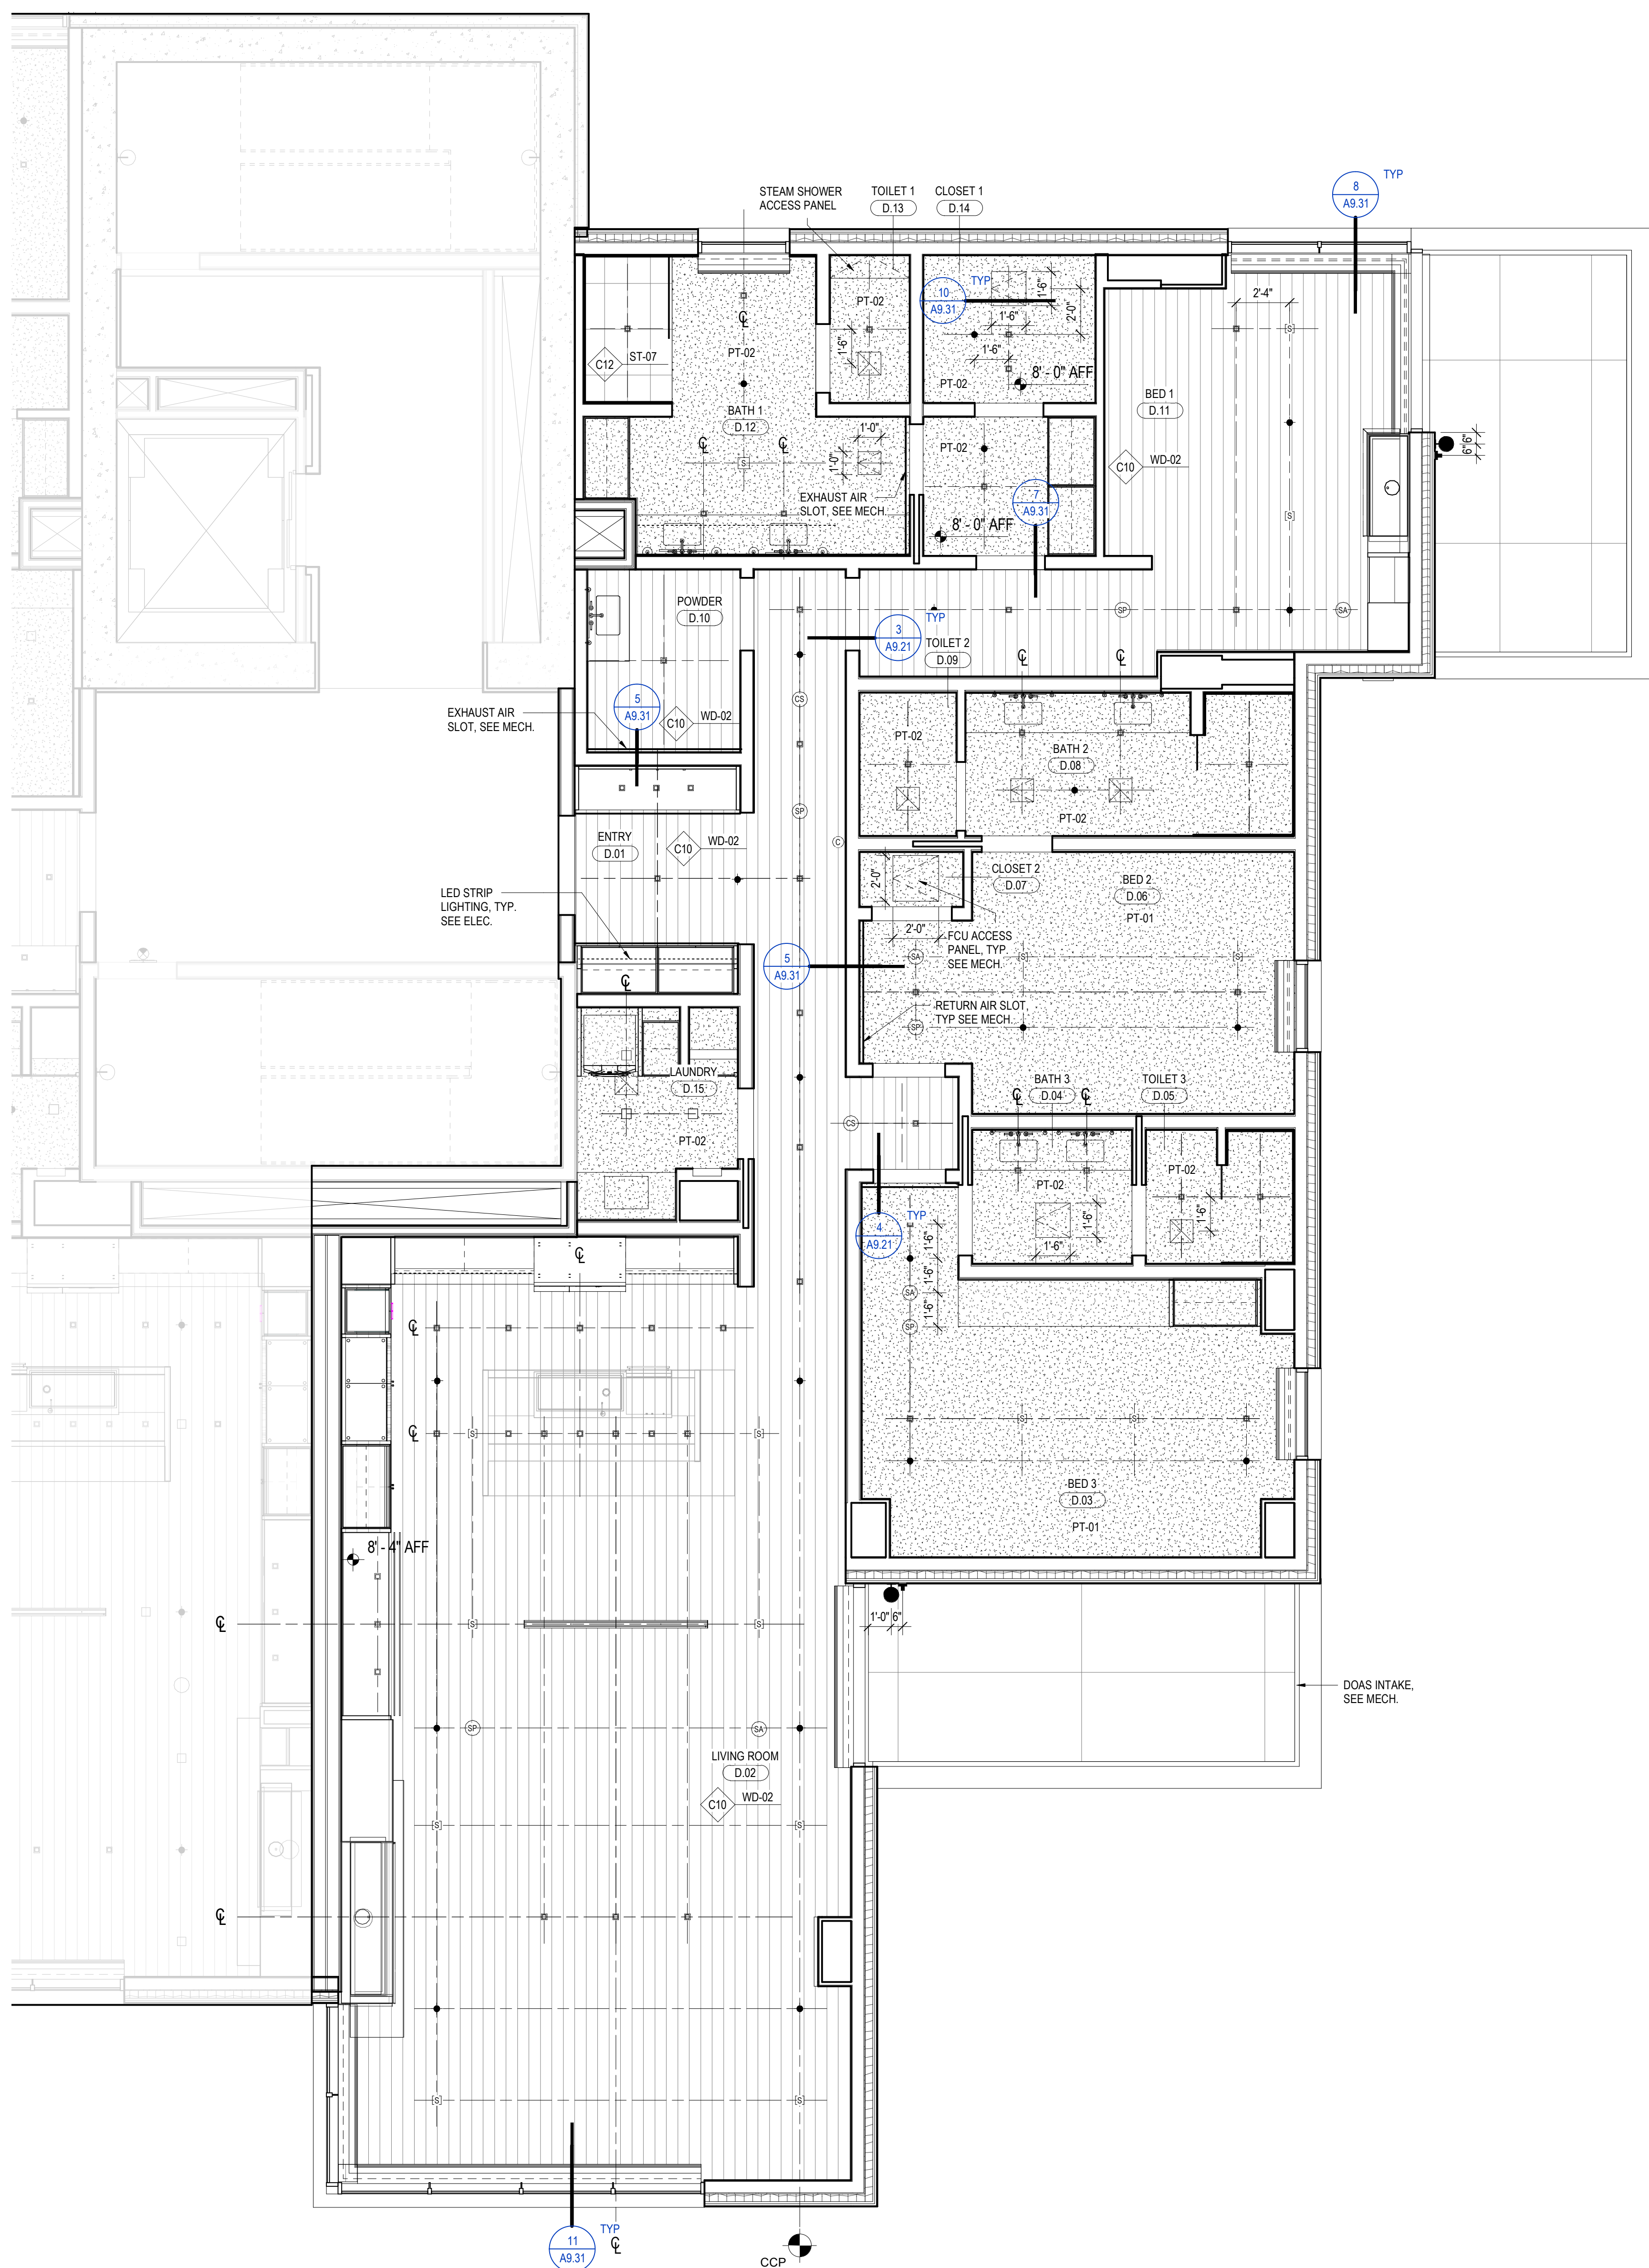


1 RCP - TOWER A/B - UNIT D
SCALE: 1/4" = 1'-0"

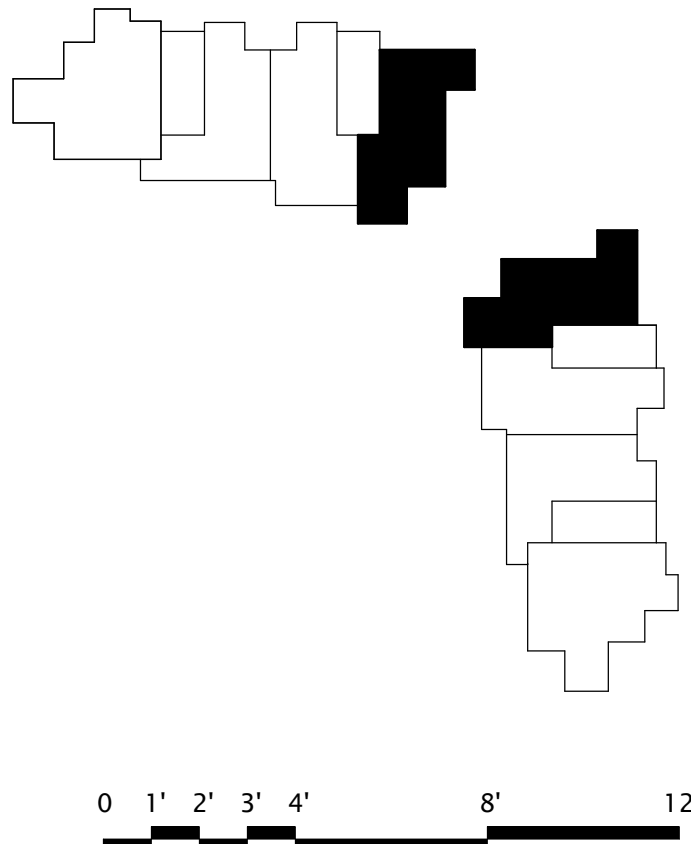

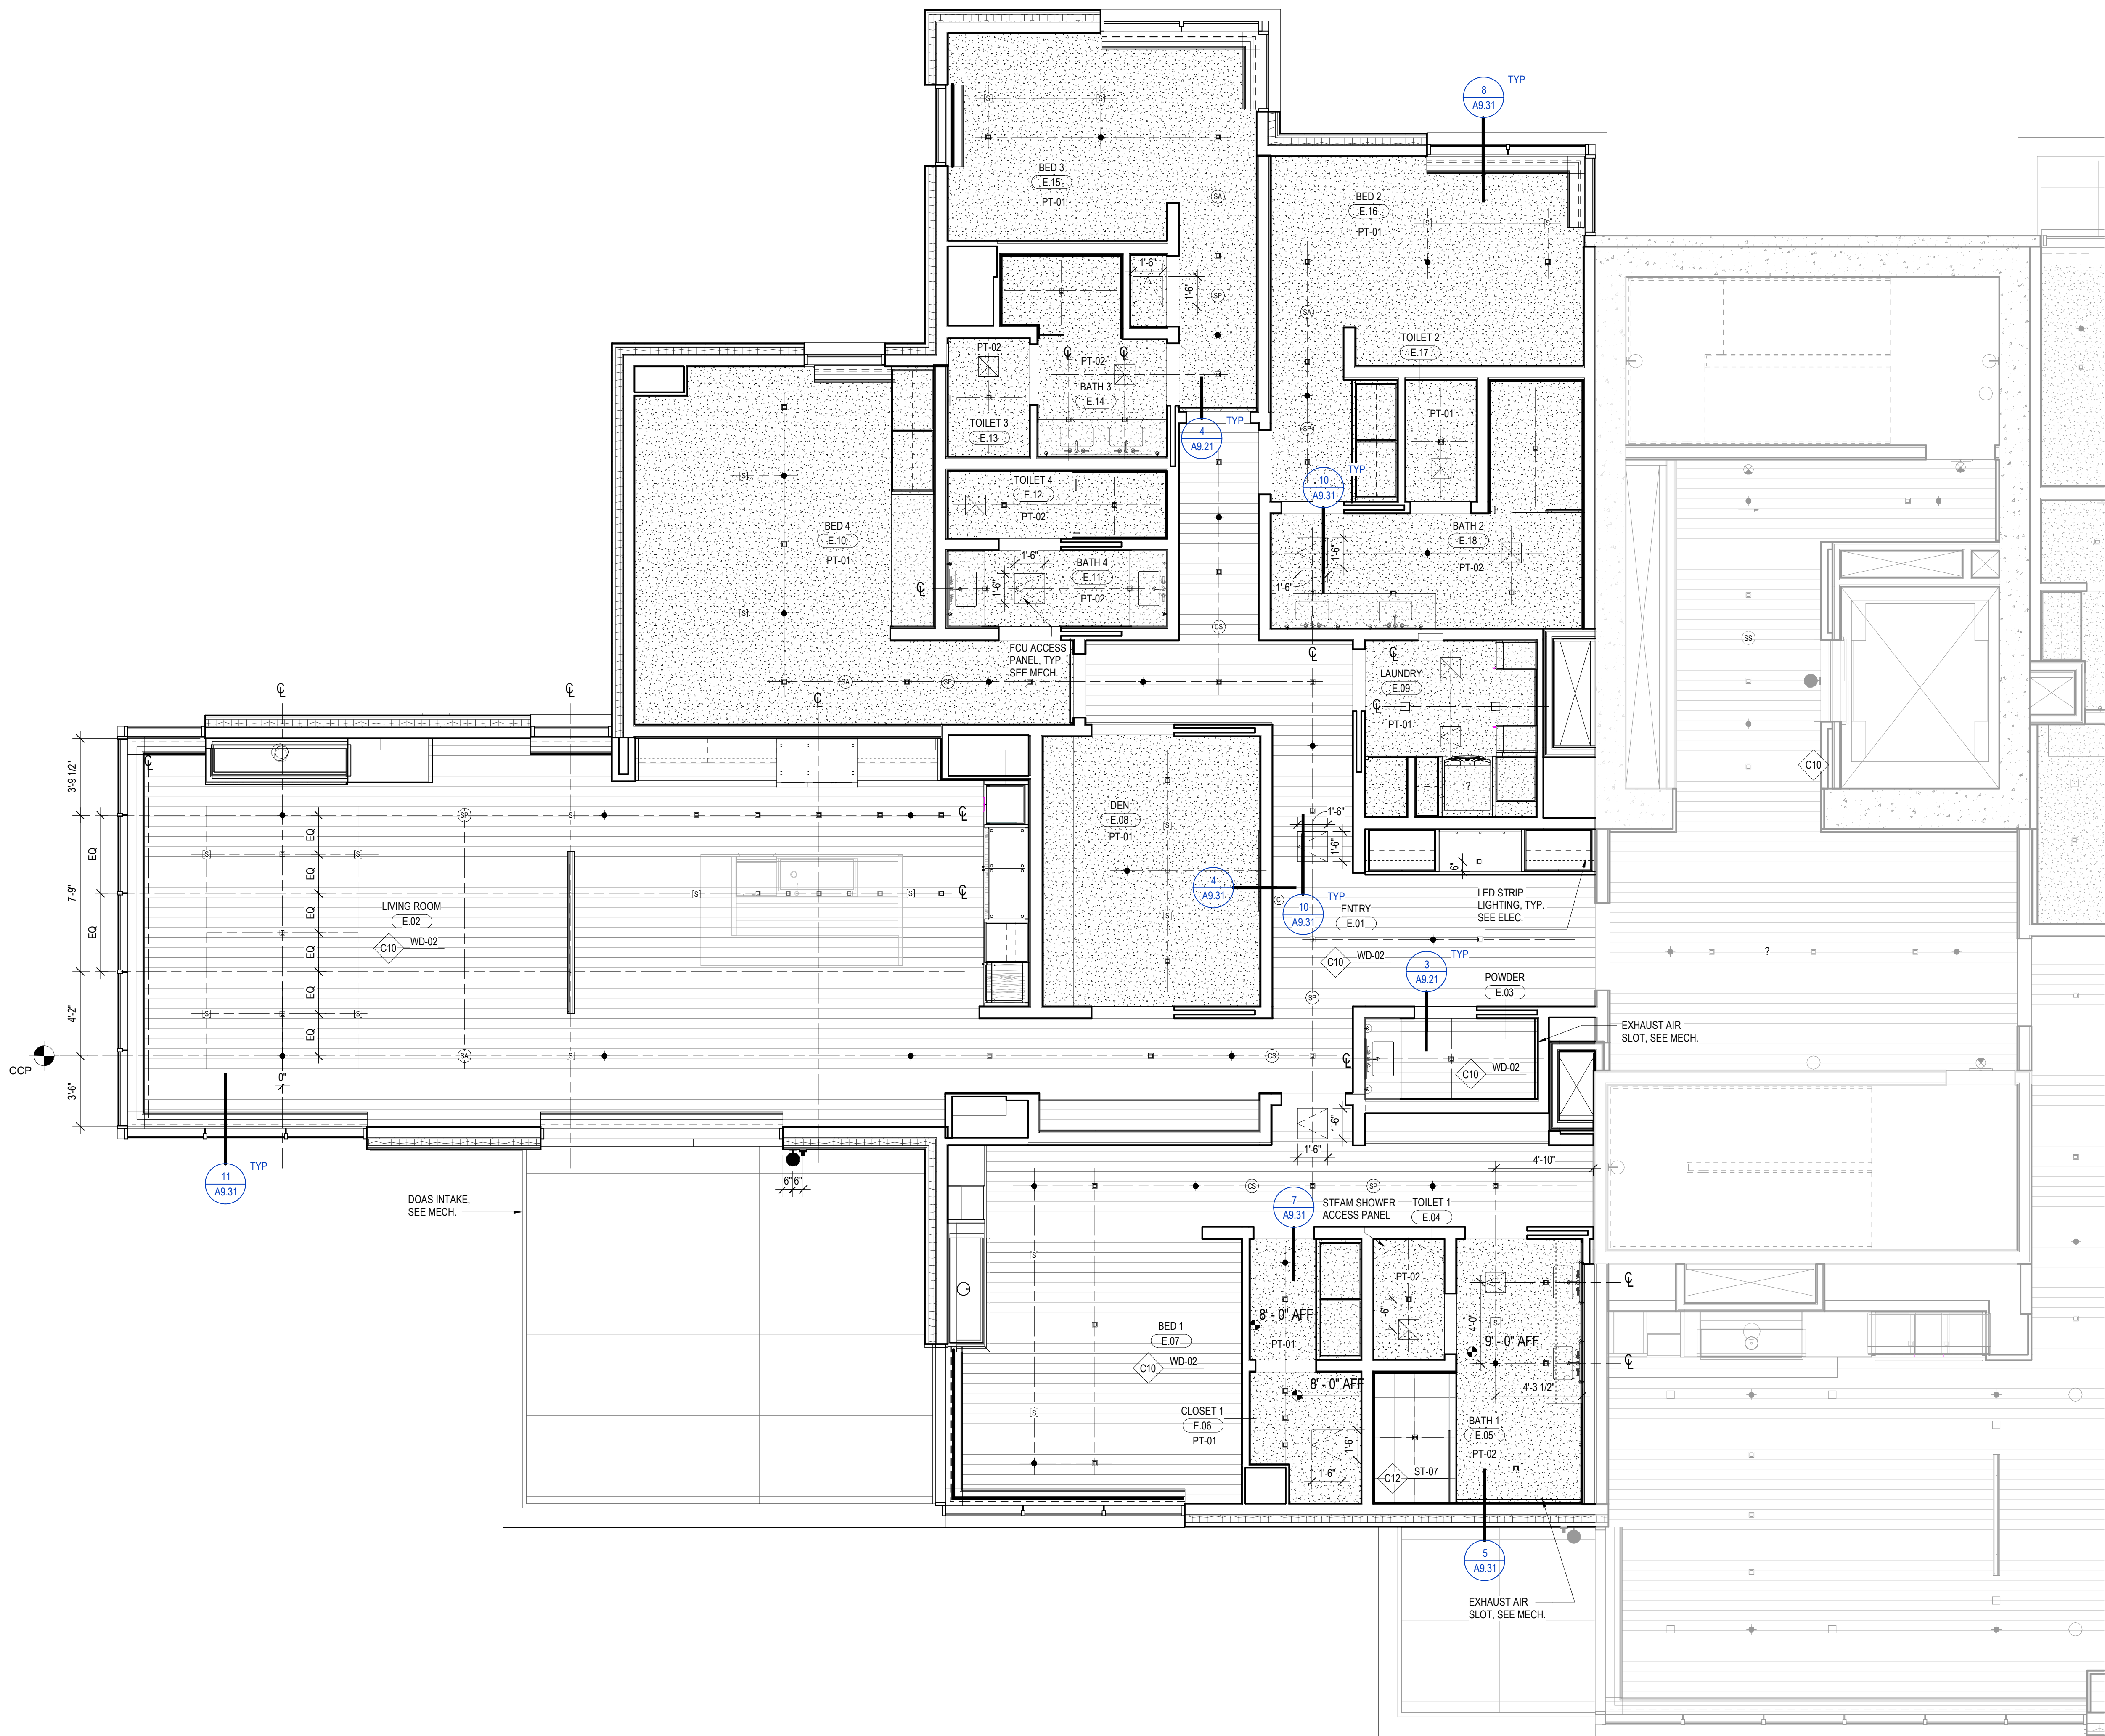

1 RCP - TOWER A/B - UNIT E
SCALE: 1/4" = 1'-0"

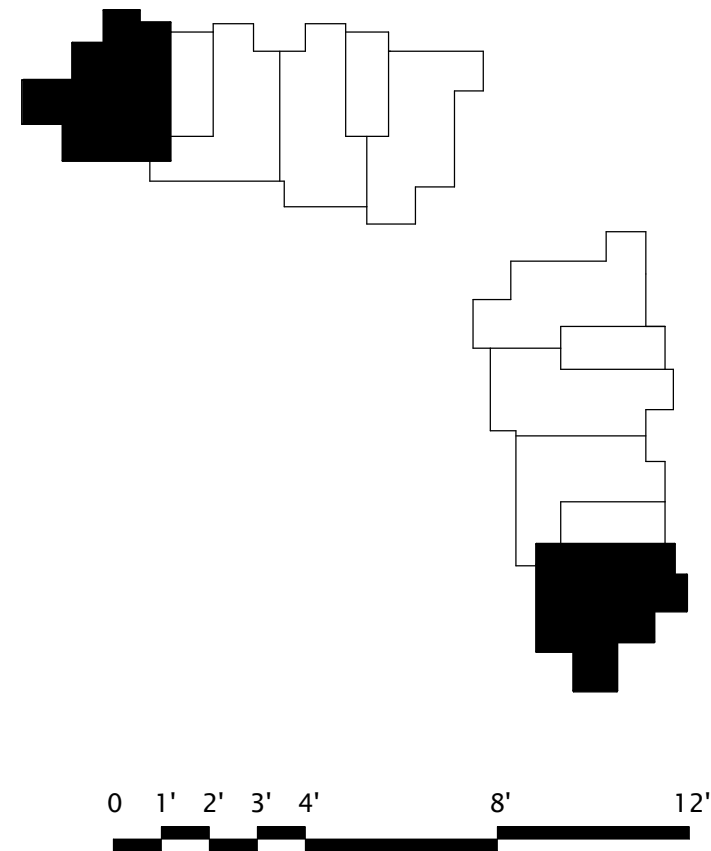

RCP GENERAL NOTES

1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS, TYPICAL. LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.

RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- | | |
|--|--|
| | C10 - WOOD CEILING |
| | C11 - SUSPENDED GYPSUM WALL BOARD |
| | C12 - STONE TILE |
| | C14 - ACOUSTICAL CEILING TILE |
| | SQUARE RECESSED DOWNLIGHT |
| | DECORATIVE CUSTOM CHANDELIER |
| | ROUND PENDANT LIGHT |
| | J-BX |
| | LENSED LINEAR UTILITY STRIP |
| | CONCEALED LINEAR UNDERCABINET STRIP |
| | TRACK / RAIL / LINEAR LED |
| | SURFACE-MOUNTED LIGHT BAR |
| | SURFACE MOUNT PANEL |
| | SPRINKLER |
| | SMOKE DETECTOR |
| | COMBINATION SMOKE / CARBON MONOXIDE DETECTOR |
| | FIRE ALARM SPEAKER |
| | FIRE ALARM STROBE |
| | FIRE ALARM COMBINATION SPEAKER / STROBE |
| | COMBINATION SMOKE / HEAT DETECTOR |
| | EXIT SIGN |
| | SECURITY CAMERA |
| | WIRELESS ACCESS POINT |
| | AV SPEAKER |
| | MOTORIZED SINGLE ROLLER SHADE - EQ-02-00 |
| | MOTORIZED DOUBLE ROLLER SHADE - EQ-02-01 |
| | CEILING FAN - MECH EXHAUST |
| | MECHANICAL LINEAR GRILLE |
| | CEILING ACCESS PANEL |
| | CEILING CONTROL POINT |

109 South Jackson St. Suite 600
Seattle, Washington 98104 USA
+1 206 458 1800 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave., Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6940 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
1615 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave., Suite 3200
Seattle, WA 98101

Lighting Designer
O
1319 SE MLK Blvd., Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK, KM
project manager TM, JB, LB, MD
drawn by SK, SS, JR, CP, AL
checked by NH, EK, BD, ER

checked by JB
job no. 2052
date 11/18/2022

revisions:

no. date by

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER AB - UNIT
E

A6.2.E

1. SPOT VENTILATORS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.O. IN
3. ALL CEILINGS ASSEMBLY C/U U.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 8'-0" FROM FINISH FLOOR TO FINISH CEILING
7. STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7'-0".
8. SEE SHEET NO. 10 AND 11 FOR FLOORCEILING ASSEMBLIES.
9. ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING FIXTURES, ROUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
10. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
11. PROVIDE 1'-0" COUNTERSINK FOR SPRINKLER AND EXTINGUISHER LEVELS TO PROJECT 1/2" MAXIMUM FROM WALL FACE OR BE 6"-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
12. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
13. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONTACT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR CHASES/CHASES WITH FASTENERS TO BE DETERMINED BY THE SPECIFIED RATING.
15. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/CURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOORCEILING.
16. THE FASTENERS TO THE TOP OF THE CHASES SHALL BE DETERMINED BY THE SPECIFIED RATING.
17. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
18. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

	C10 - WOOD CEILING
	C11 - SUSPENDED GYPSUM WALL BOARD
	C12 - STONE TILE
	C14 - ACOUSTICAL CEILING TILE
	SQUARE RECESSED DOWNLIGHT
	DECORATIVE SCONCE
	DECORATIVE CUSTOM CHANDELIER
	ROUND PENDANT LIGHT
	J-BOX
	LENSED LINEAR UTILITY STRIP
	CONCEALED LINEAR UNDERCABINET STRIP
	TRACK/RAIL/LINEAR LED
	SURFACE-MOUNTED LIGHT BAR
	SURFACE MOUNT PANEL
	SPRINKLER
	SMOKE DETECTOR
	COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
	FIRE ALARM SPEAKER
	FIRE ALARM STROBE
	FIRE ALARM COMBINATION SPEAKER / STROBE
	COMBINATION SMOKE / HEAT DETECTOR
	EXIT SIGN
	SECURITY CAMERA
	WIRELESS ACCESS POINT
	AV SPEAKER
	MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
	MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
	CEILING FAN - MECH EXHAUST
	MECHANICAL LINEAR GRILLE
	CEILING ACCESS PANEL
	CEILING CONTROL POINT

159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bath, ME 04404

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MILK Blvd, Suite 210

Building Envelope Consultant
RDH
2101 N 34th St

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100

368006, WA 96154

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, A NH, EK, BD, EB

checked by	Checker
job no.	20062
date	11/18/2022

revisions:

[illegible]

no.	date	by
-----	------	----


ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER AB - UN
F

A6.2.F



1 RCP - TOWER A/B - UNIT F
SCALE: 1/4" = 1'-0"

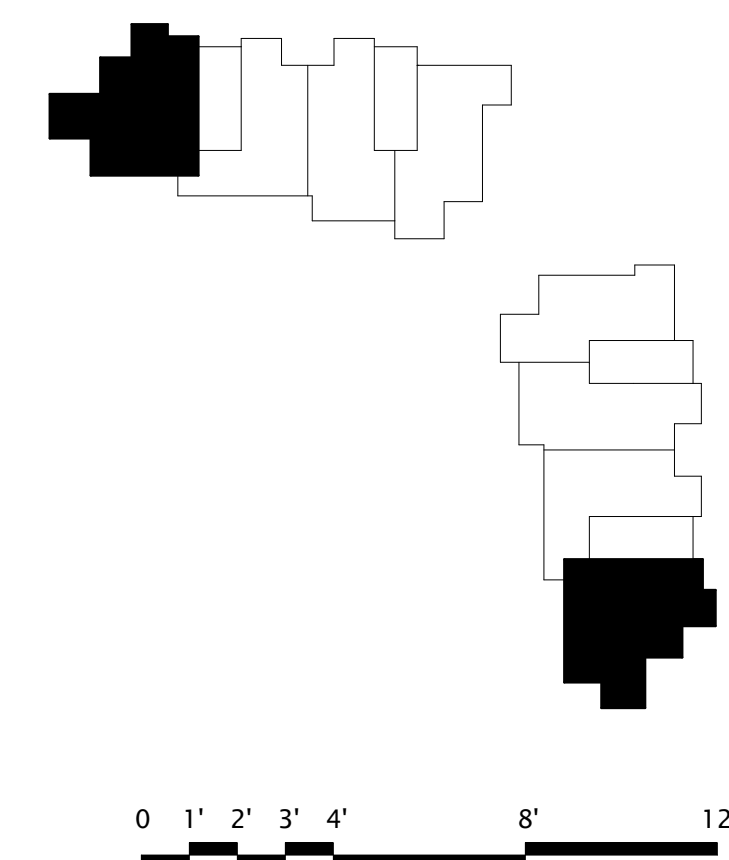


1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
ALL CEILINGS 9'-0" AFF U.N.O.
2. ALL CEILINGS ASSEMBLY C/U N.O.
3. ALL DIMENSIONS TO FACE UNLESS NOTED OTHERWISE
4. USE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
5. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT
NOT LESS THAN 8'-0" UNLESS OTHERWISE SPECIFIED. MECHANICAL ROOMS, ATTIC
STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN
7 FEET.
6. SEE SHEET 10 AND 10.11 FOR FLOORCEILING ASSEMBLIES.
7. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING FIXTURES, OUTLETS AND ADDITIONAL
INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
8. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
9. ALL AIR HANDLING EQUIPMENT SHALL BE LOCATED AT MINIMUM CEILING LEVELS TO PROVIDE AT
LEAST 18" CLEARANCE FROM WALL, FLOOR OR BE MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
10. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
11. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE
DETECTORS SHALL BE DETERMINED WITH APPROVED SHOP DRAWINGS.
12. PROVIDE SIDE ARM WORKATIONS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN
CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR
CHASES. CHASES SHALL BE FASTENED TO STRUCTURE WITH SPECIFIED RATED
FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT
SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOORCEILING
CAVITY. PROVIDE FIRE-RATED CHASE/FURD-OUT WALLS.
14. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR
ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
15. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS
POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO
INSTALLATION OF ANY OF THESE SYSTEMS.


ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

	C10 - WOOD CEILING
	C11 - SUSPENDED GYPSUM WALL BOARD
	C12 - STONE TILE
	C14 - ACOUSTICAL CEILING TILE
	SQUARE RECESSED DOWNLIGHT
	DECORATIVE SCONCE
	DECORATIVE CUSTOM CHANDELIER
	ROUND PENDANT LIGHT
	J-BOX
	LENSED LINEAR UTILITY STRIP
	CONCEALED LINEAR UNDERCABINET STRIP
	TRACK / RAIL / LINEAR LED
	SURFACE-MOUNTED LIGHT BAR
	SURFACE MOUNT PANEL
	SPRINKLER
	SMOKE DETECTOR
	COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
	FIRE ALARM SPEAKER
	FIRE ALARM STROBE
	FIRE ALARM COMBINATION SPEAKER / STROBE
	COMBINATION SMOKE / HEAT DETECTOR
	EXIT SIGN
	SECURITY CAMERA
	WIRELESS ACCESS POINT
	AV SPEAKER
	MOTORIZED SINGLE ROLLER SHADE - EQ-Q2-00
	MOTORIZED DOUBLE ROLLER SHADE - EQ-Q2-01
	CEILING FAN - MECH EXHAUST
	MECHANICAL LINEAR GRILLE
	CEILING ACCESS PANEL
	CEILING CONTROL POINT

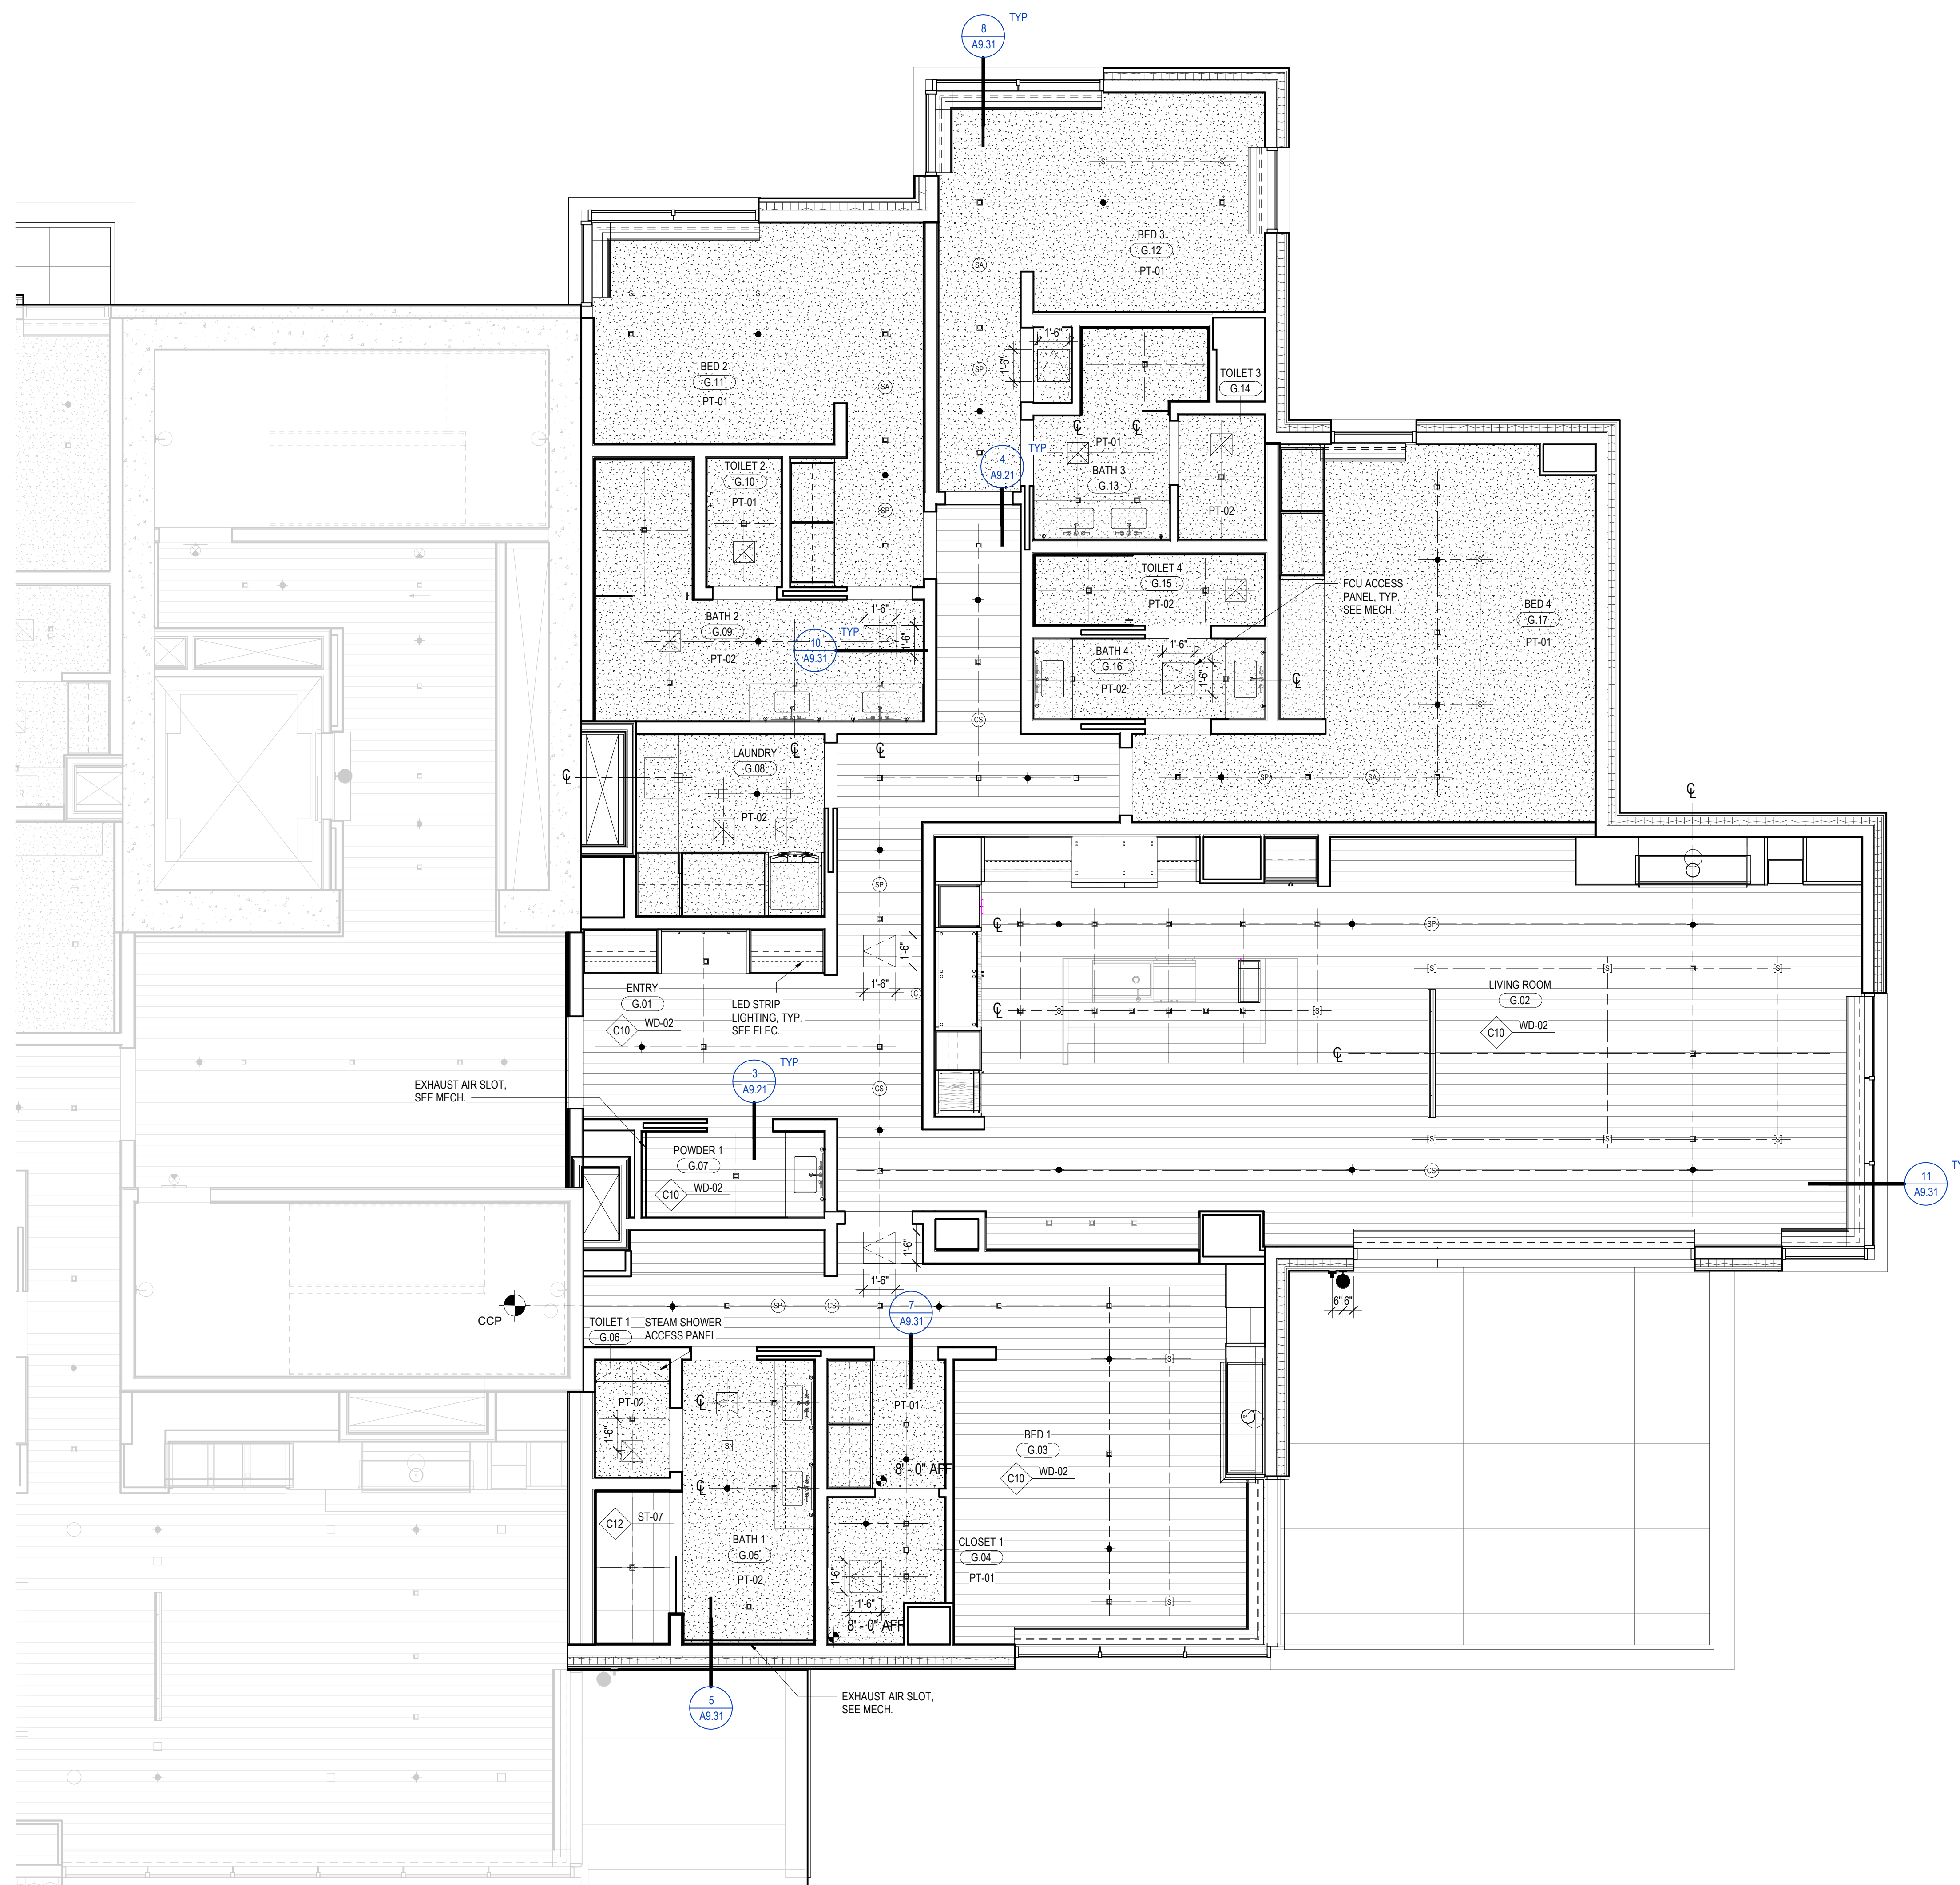

1 RCP - TOWER A/B - UNIT G
SCALE: 1/4" = 1'-0"

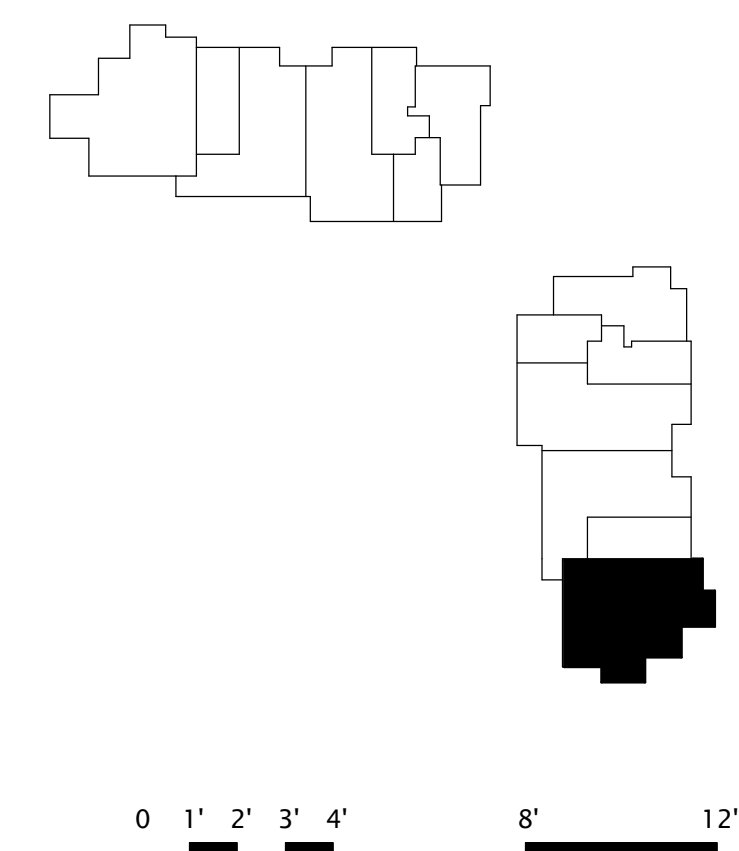

159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5870 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H20
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O*
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK, KM
project manager TM, JB, LB, MD
drawn by SK, SS, JR, CP, AL

checked by JB
job no. 20062
date 14 JUN 2006

revisions:

[illegible]

no.	date	by
-----	------	----

ISSUED FOR
CONSTRUCTION
11/18/2022
































RCP - TOWER AB - UNIT
G

A6.2.G

1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
ALL CEILINGS 9'-0" AFF U.N.O.
2. ALL CEILINGS ASSEMBLY C/U N.O.
3. ALL DIMENSIONS TO FACE UNLESS NOTED OTHERWISE
4. USE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
5. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT
NOT LESS THAN 8'-0" UNLESS OTHERWISE SPECIFIED. MECHANICAL ROOMS, ATTIC
STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN
7 FEET.
6. SEE SHEET 10 AND 10.11 FOR FLOORCEILING ASSEMBLIES.
7. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING FIXTURES, OUTLETS AND ADDITIONAL
INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
8. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
9. ALL AIR HANDLING EQUIPMENT SHALL BE LOCATED AT MINIMUM CEILING LEVELS TO PROVIDE AT
LEAST 18" CLEARANCE FROM WALL, FLOOR OR BE MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
10. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
11. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE
DETECTORS. SMOKE DETECTORS SHALL BE DETERMINED WITH APPROVED SHOP
DRAWINGS. PROVIDE SIDE ARM HEADS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE
IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
12. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR
CHASES. CHASES SHALL BE FASTENED TO STRUCTURE AT SPECIFIED RATES.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT
SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOORCEILING
CAVITY. PROVIDE FIRE-RATED FURRED-OUT WALLS AND CHASES.
14. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR
ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
15. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS
POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO
INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

	C10 - WOOD CEILING
	C11 - SUSPENDED GYPSUM WALL BOARD
	C12 - STONE TILE
	C14 - ACOUSTICAL CEILING TILE
	SQUARE RECESSED DOWNLIGHT
	DECORATIVE SCONCE
	DECORATIVE CUSTOM CHANDELIER
	ROUND PENDANT LIGHT
	J-BOX
	LENSED LINEAR UTILITY STRIP
	CONCEALED LINEAR UNDERCABINET STRIP
	TRACK/RAIL/LINEAR LED
	SURFACE-MOUNTED LIGHT BAR
	SURFACE MOUNT PANEL
	SPRINKLER
	SMOKE DETECTOR
	COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
	FIRE ALARM SPEAKER
	FIRE ALARM STROBE
	FIRE ALARM COMBINATION SPEAKER / STROBE
	COMBINATION SMOKE / HEAT DETECTOR
	EXIT SIGN
	SECURITY CAMERA
	WIRELESS ACCESS POINT
	AV SPEAKER
	MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
	MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
	CEILING FAN - MECH EXHAUST
	MECHANICAL LINEAR GRILLE
	CEILING ACCESS PANEL
	CEILING CONTROL POINT

159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 oleonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
 1319 SE MLK Blvd, Suite 210
 Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK, KM
project manager TM, JB, LB, MD
drawn by SK, SS, JR, CP, A

checked by Checker
job no. 20062

revisions:


no.	date	by
-----	------	----

ISSUED FOR
CONSTRUCTION


11/18/2022


RCP - TOWER AB - UN
H

A6 2 H

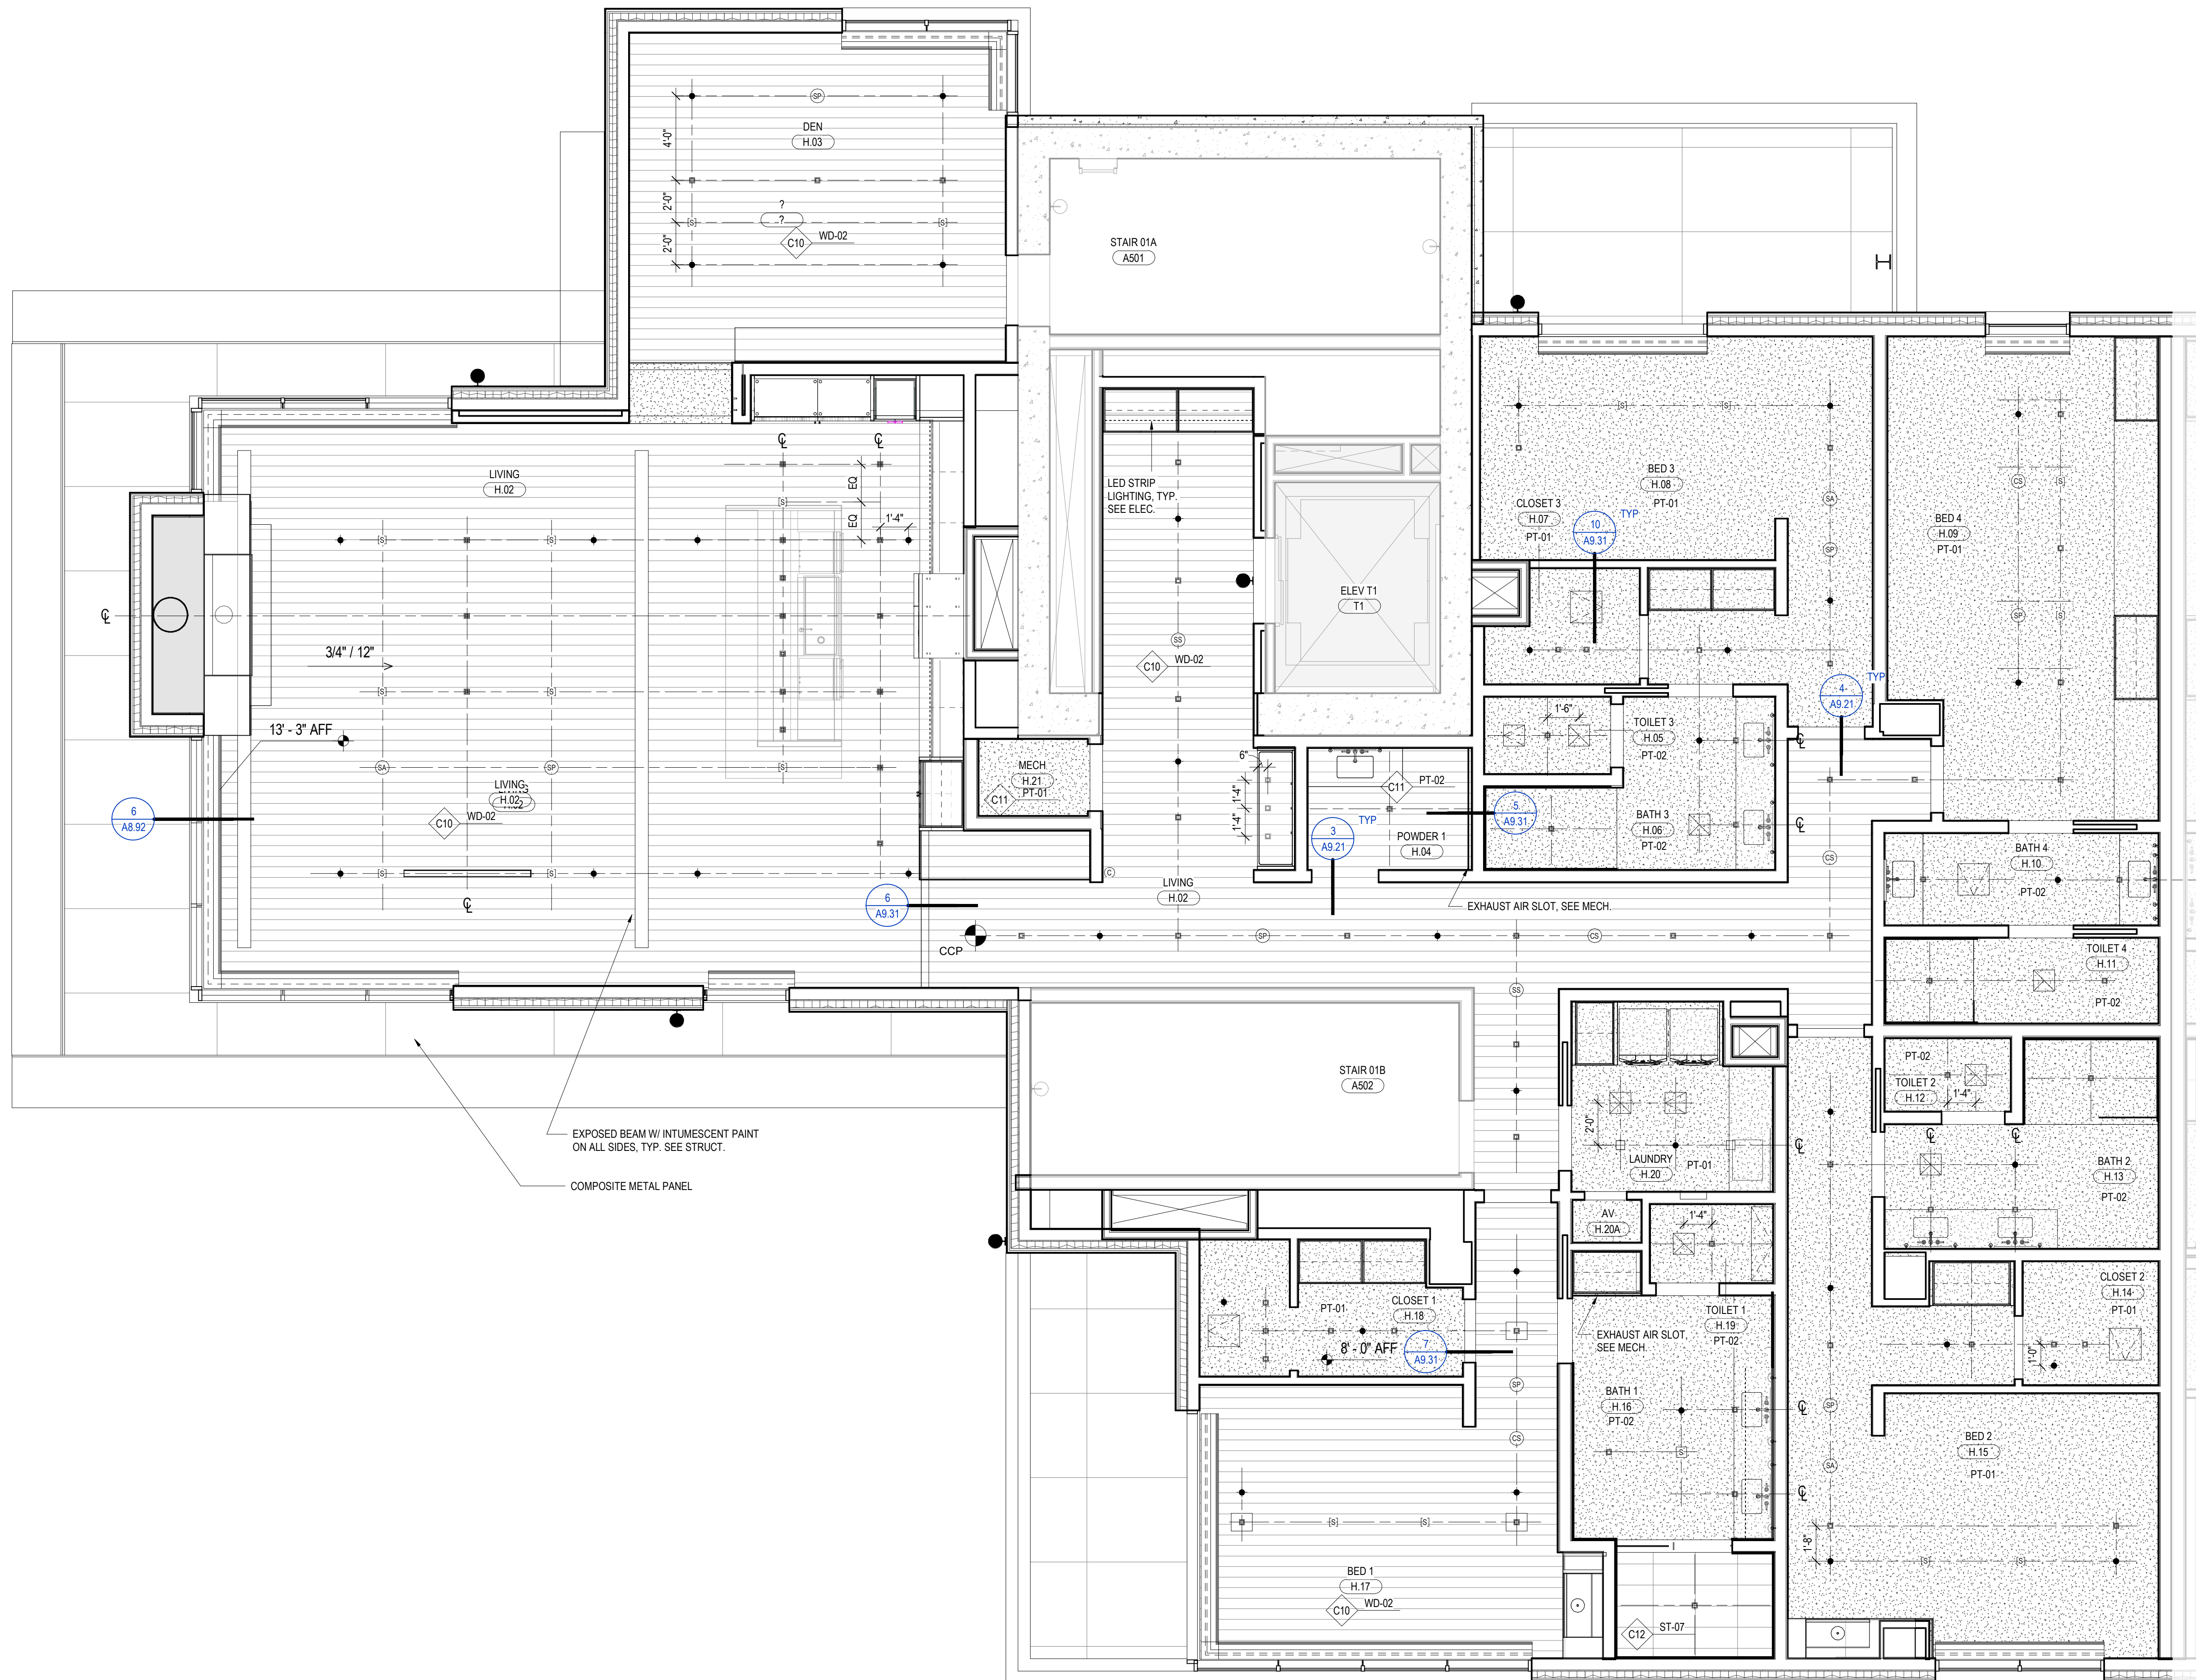

1 RCP - TOWER A/B - UNIT H
SCALE: 1/4" = 1'-0"

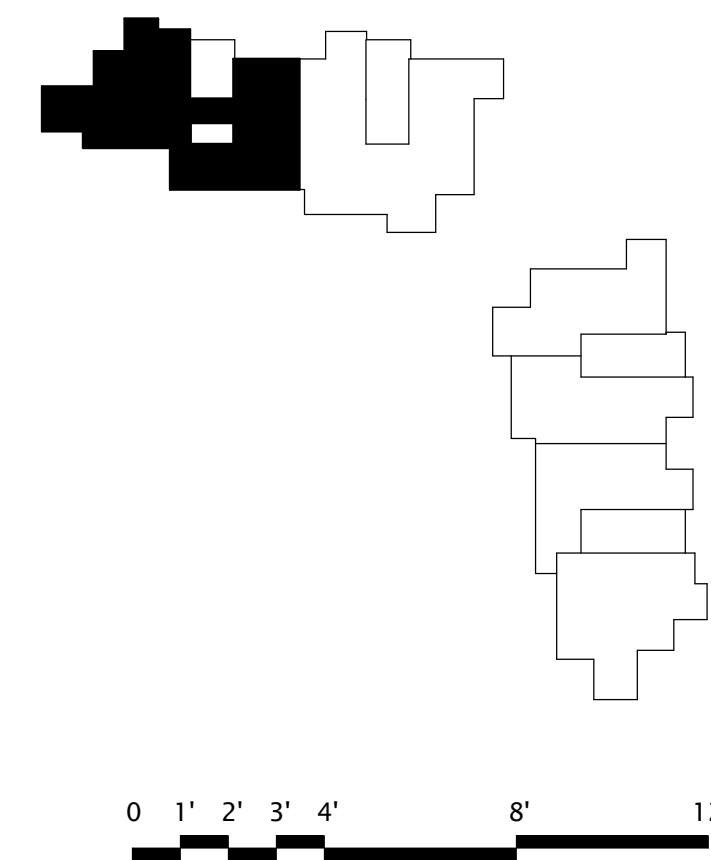RCP - TOWER AB - UN
H

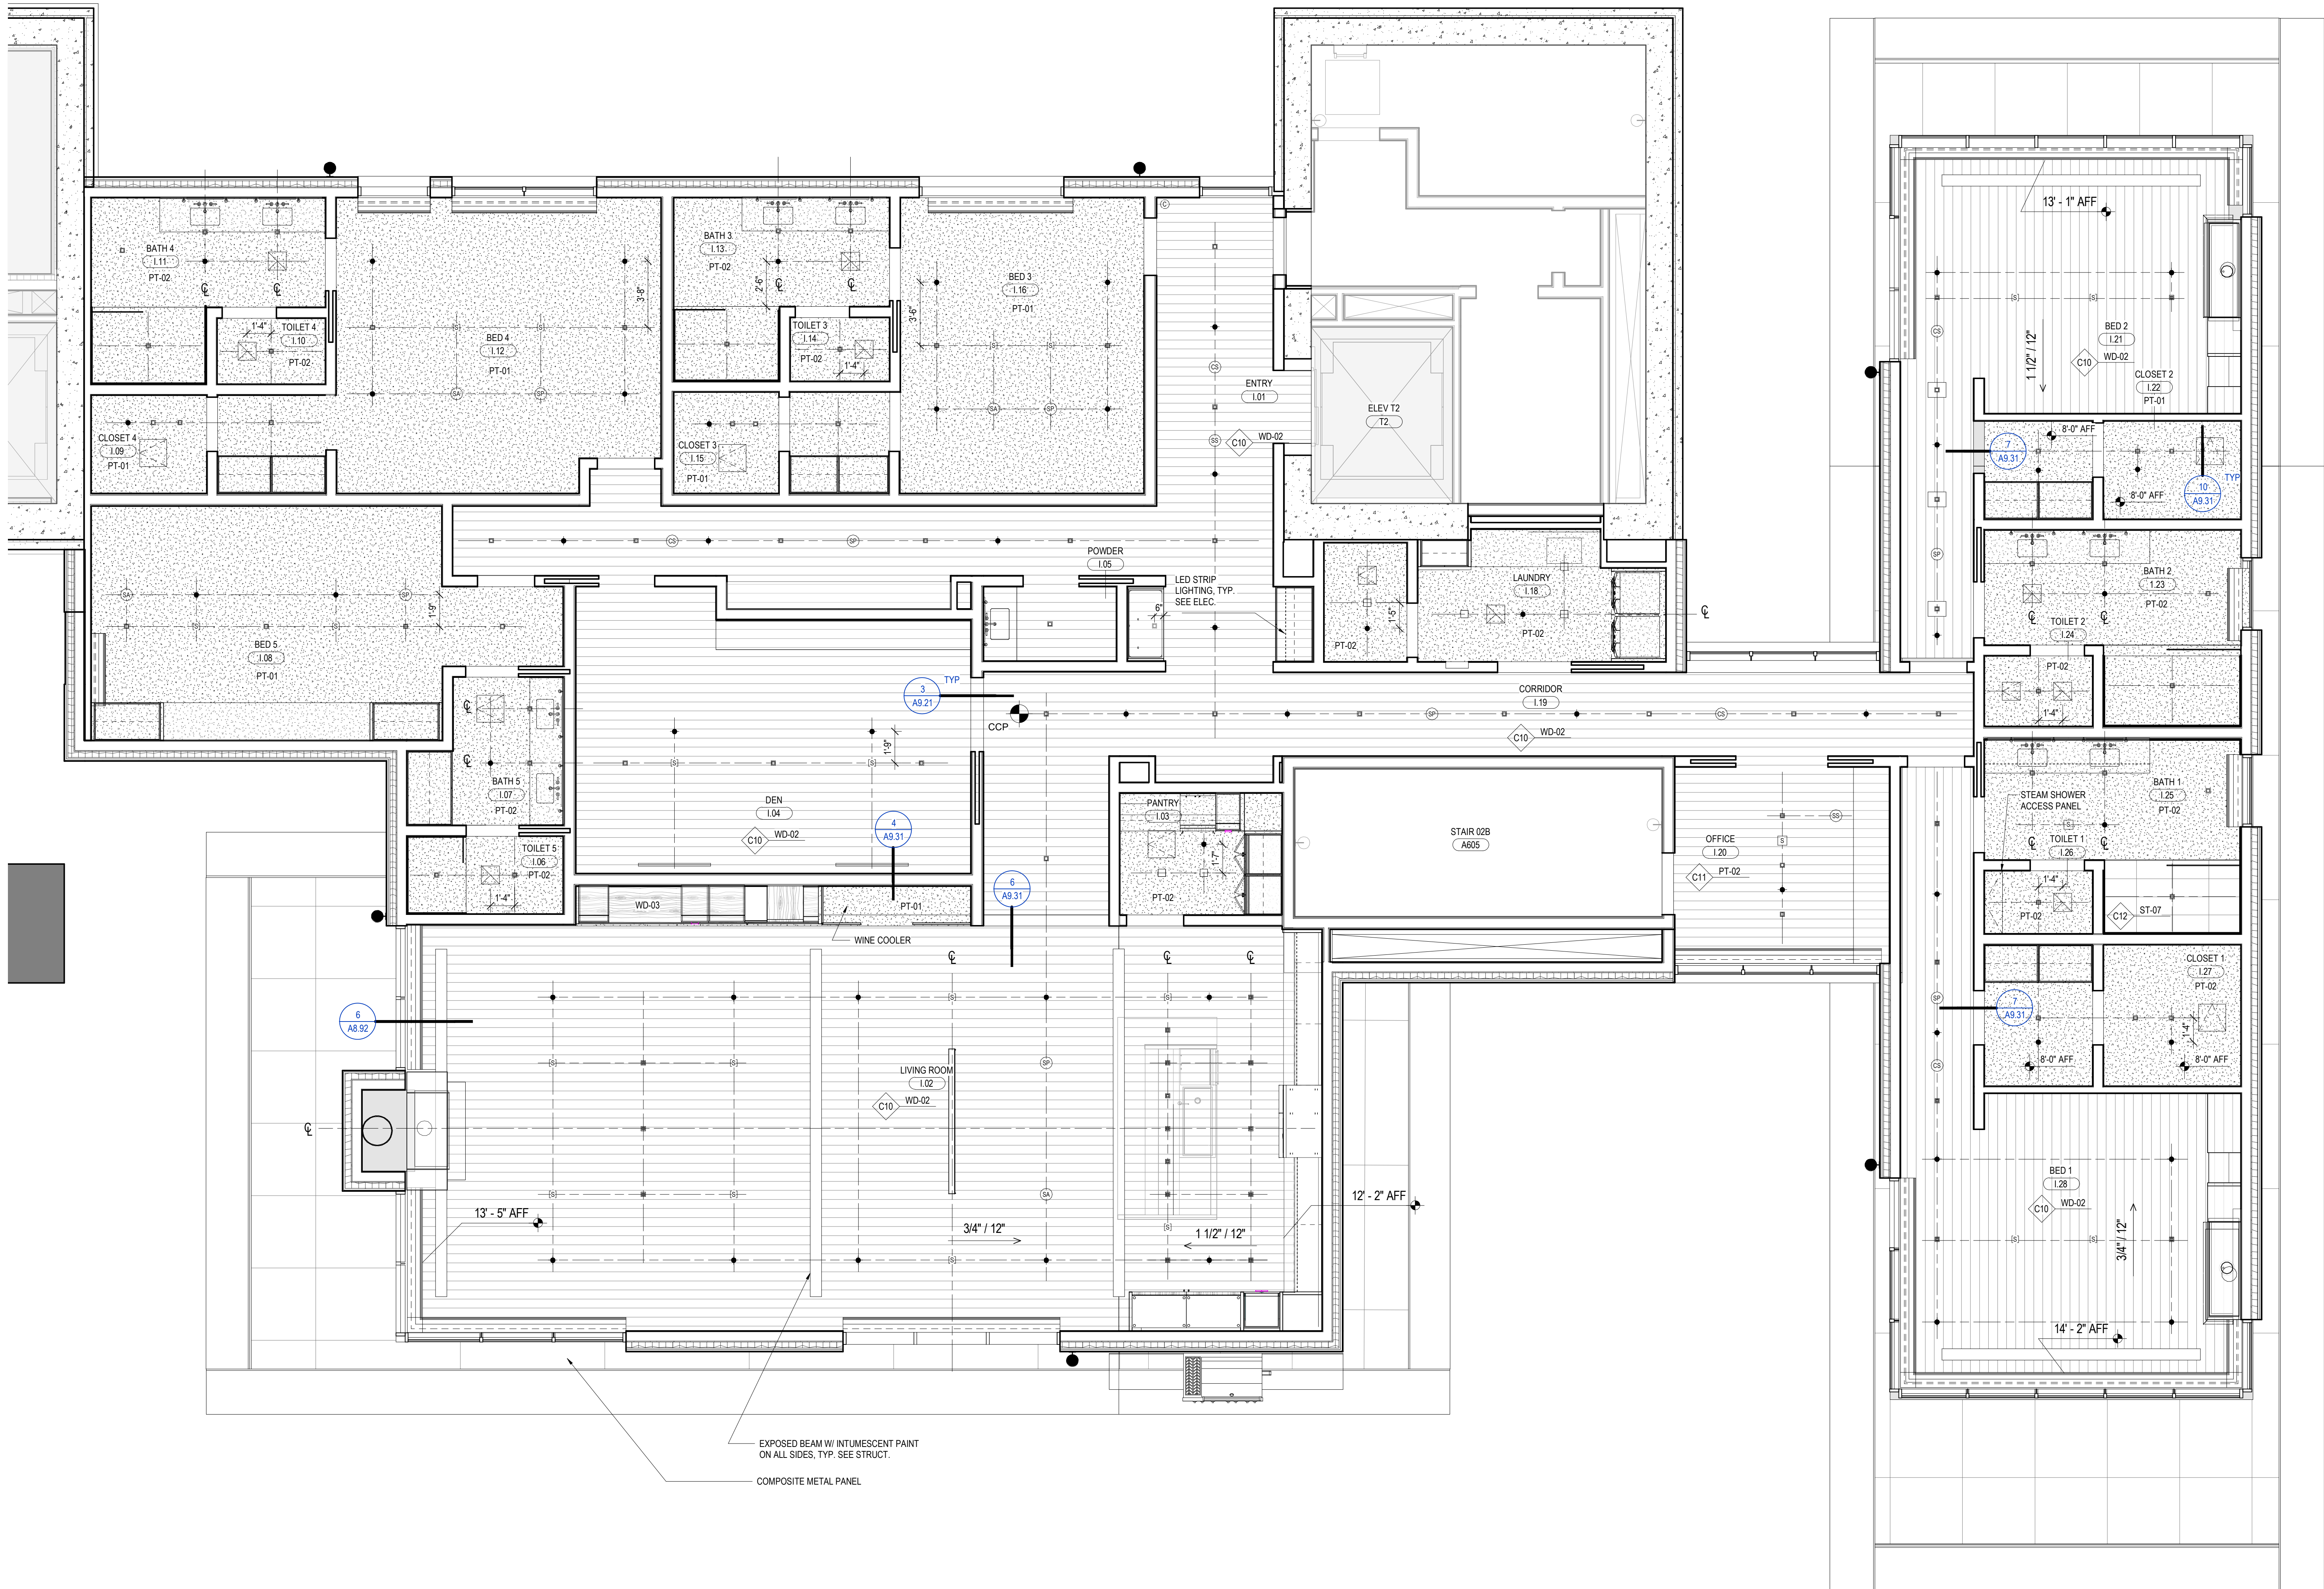

1 RCP - TOWER A/B - UNIT I
SCALE: 1/4" = 1'-0"

RCP GENERAL NOTES

1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPIABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS, TYPICAL. LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.

RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- C10 - WOOD CEILING
- C11 - SUSPENDED GYPSUM WALL BOARD
- C12 - STONE TILE
- C14 - ACOUSTICAL CEILING TILE
- SQUARE RECESSED DOWNLIGHT
- DECORATIVE SCONCE
- DECORATIVE CUSTOM CHANDELIER
- ROUND PENDANT LIGHT
- J-BOX
- LENSED LINEAR UTILITY STRIP
- CONCEALED LINEAR UNDERCABINET STRIP
- TRACK / RAIL / LINEAR LED
- SURFACE-MOUNTED LIGHT BAR
- SURFACE MOUNT PANEL
- SPRINKLER
- SMOKE DETECTOR
- COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
- FIRE ALARM SPEAKER
- FIRE ALARM STROBE
- FIRE ALARM COMBINATION SPEAKER / STROBE
- COMBINATION SMOKE / HEAT DETECTOR
- EXIT SIGN
- SECURITY CAMERA
- WIRELESS ACCESS POINT
- AV SPEAKER
- MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
- MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
- CEILING FAN - MECH EXHAUST
- MECHANICAL LINEAR GRILLE
- CEILING ACCESS PANEL
- CEILING CONTROL POINT

100 South Jackson St, Suite 800
Seattle, Washington 98104 USA
+1 206 454 1600 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6040 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainell Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
1615 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect _TK, KM
project manager _TM, JB, LB, MD
drawn by _SK, SS, JR, CP, AL
_NH, EK, BD, ER

checked by _JB
job no. 2052
date 11/18/2022

revisions:

no. date by

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER AB - UNIT I


A6.2.I

1. SPOT VENTILATORS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH FLOOR.
2. ALL CEILING 9'-0" AFF U/NO.
3. ALL CEELINGS ASSEMBLY C/1 U/NO.
4. ALL DIMENSIONS TO FACE OF FINISH U/NO.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPANCY SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 8'-0".
7. CEILING HEIGHTS IN MECHANICAL ROOMS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7'-0".
8. SEE SHEET 40.10 AND 40.11 FOR FLOORCEILING ASSEMBLIES.
9. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL, RP DRAWINGS.
10. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
11. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" FROM WALL OR W/ALL.
12. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
13. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. PROVIDE SMOKE HEADS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR CHASES. WALLS WITH FASTENED CEILING SHALL BE CONTINUOUS ABOVE DROPPED CEILING.
15. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL, CHASE/VOID FROM COMMUNICATING WITH THE FLOOR/CEILING cavity. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
16. PROVIDE MECHANICAL DRAWINGS FOR ALL MECHANICAL EQUIPMENT. PROVIDE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
17. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS AND SOME OTHER ACCESS EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

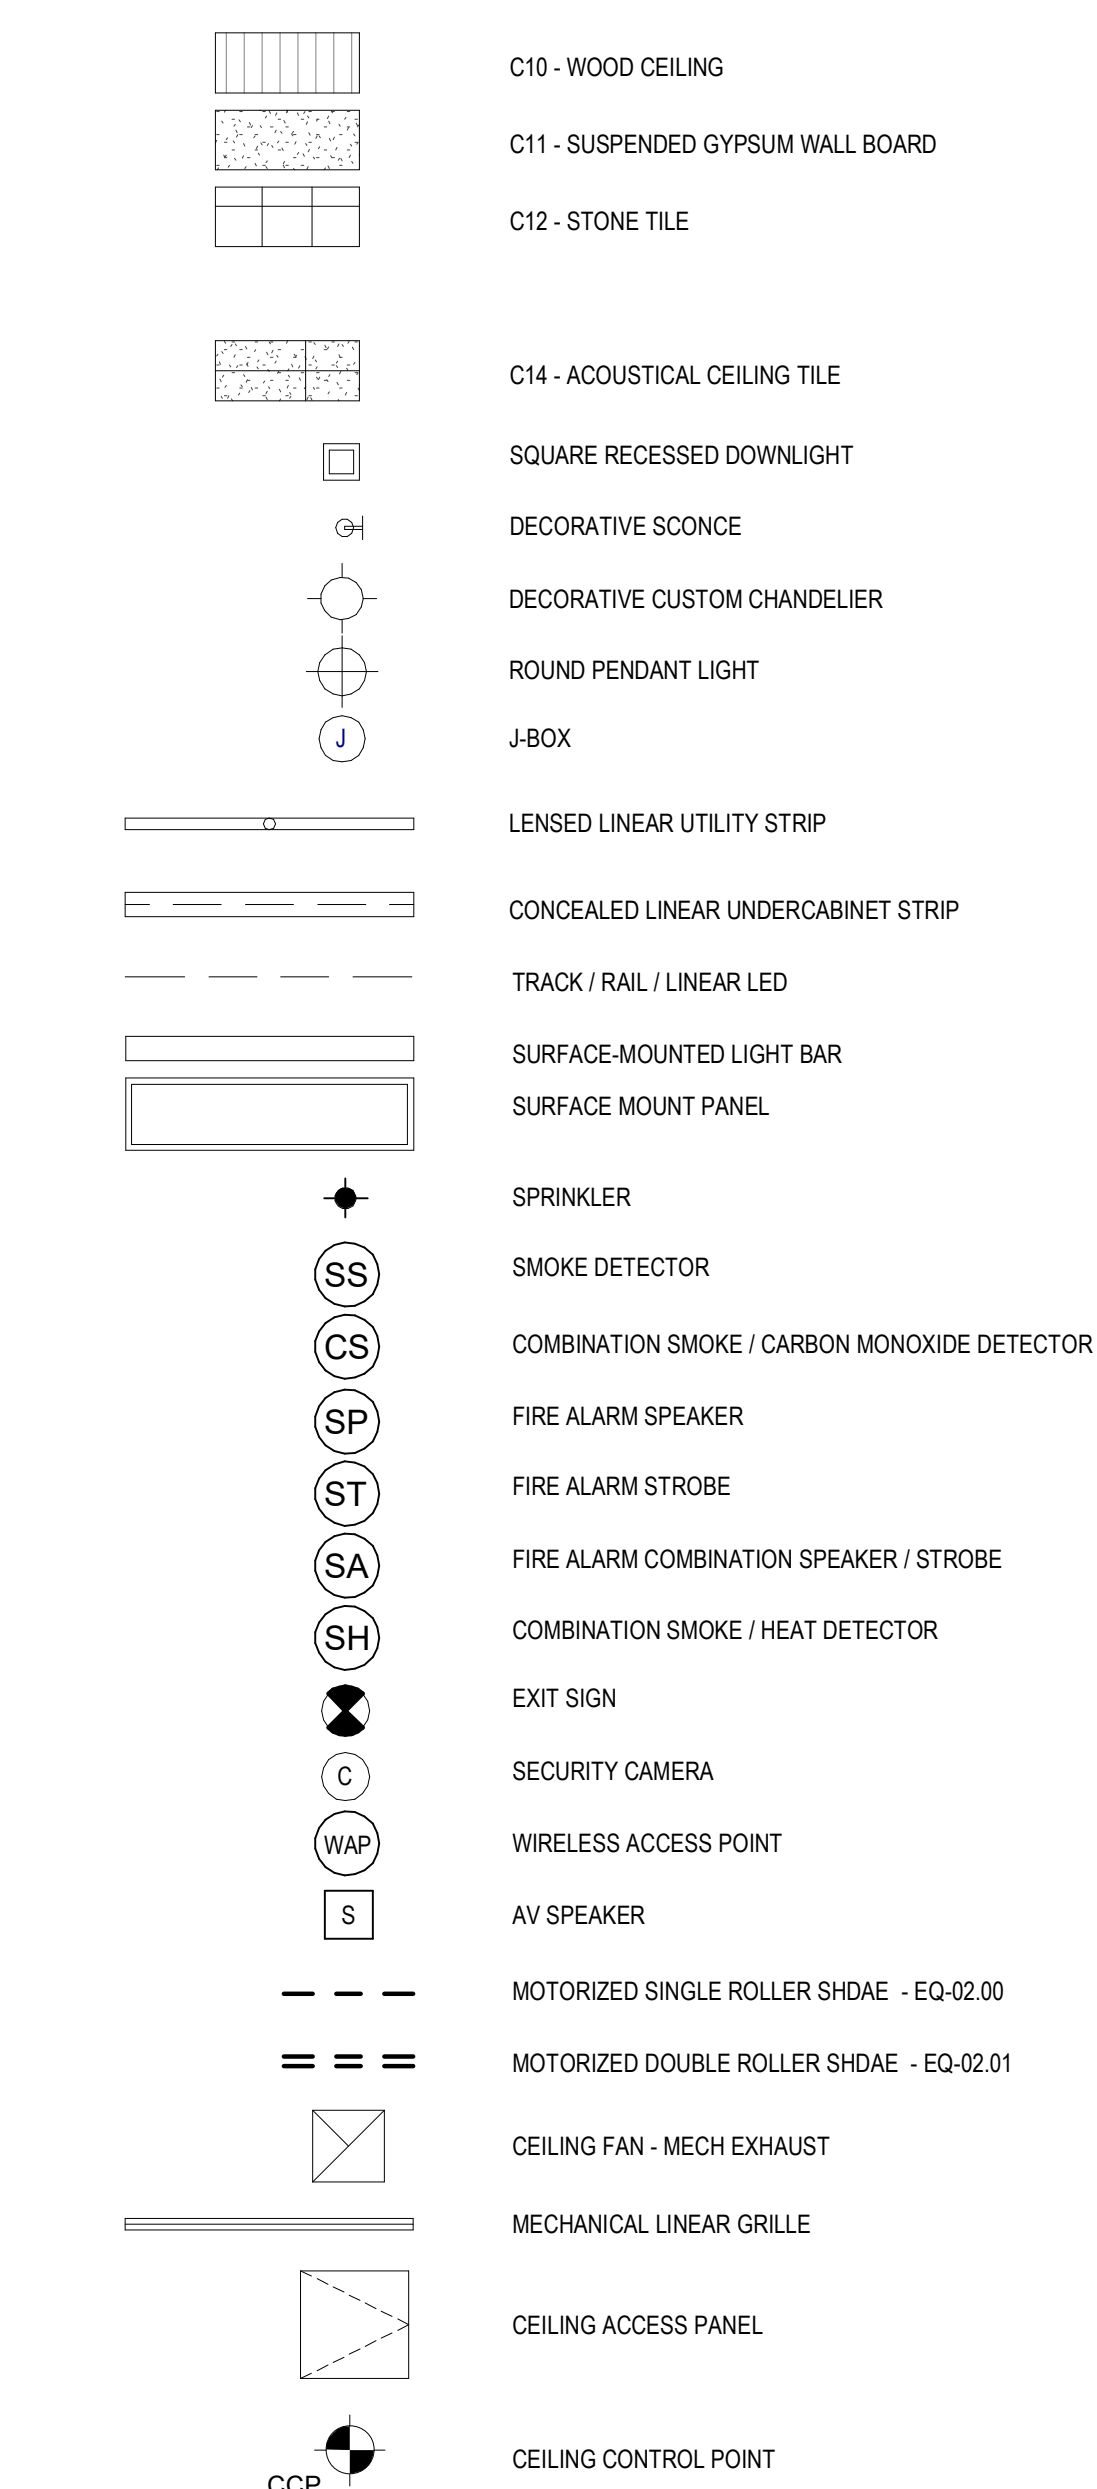

159 South Jackson St, Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant!
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, A NH, EK, BD, EB

checked by Checker
job no. 20062
date 11/18/2022

revisions:


[illegible]

no.	date	by
-----	------	----


ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER AB - UNIT
1

A6.2.J

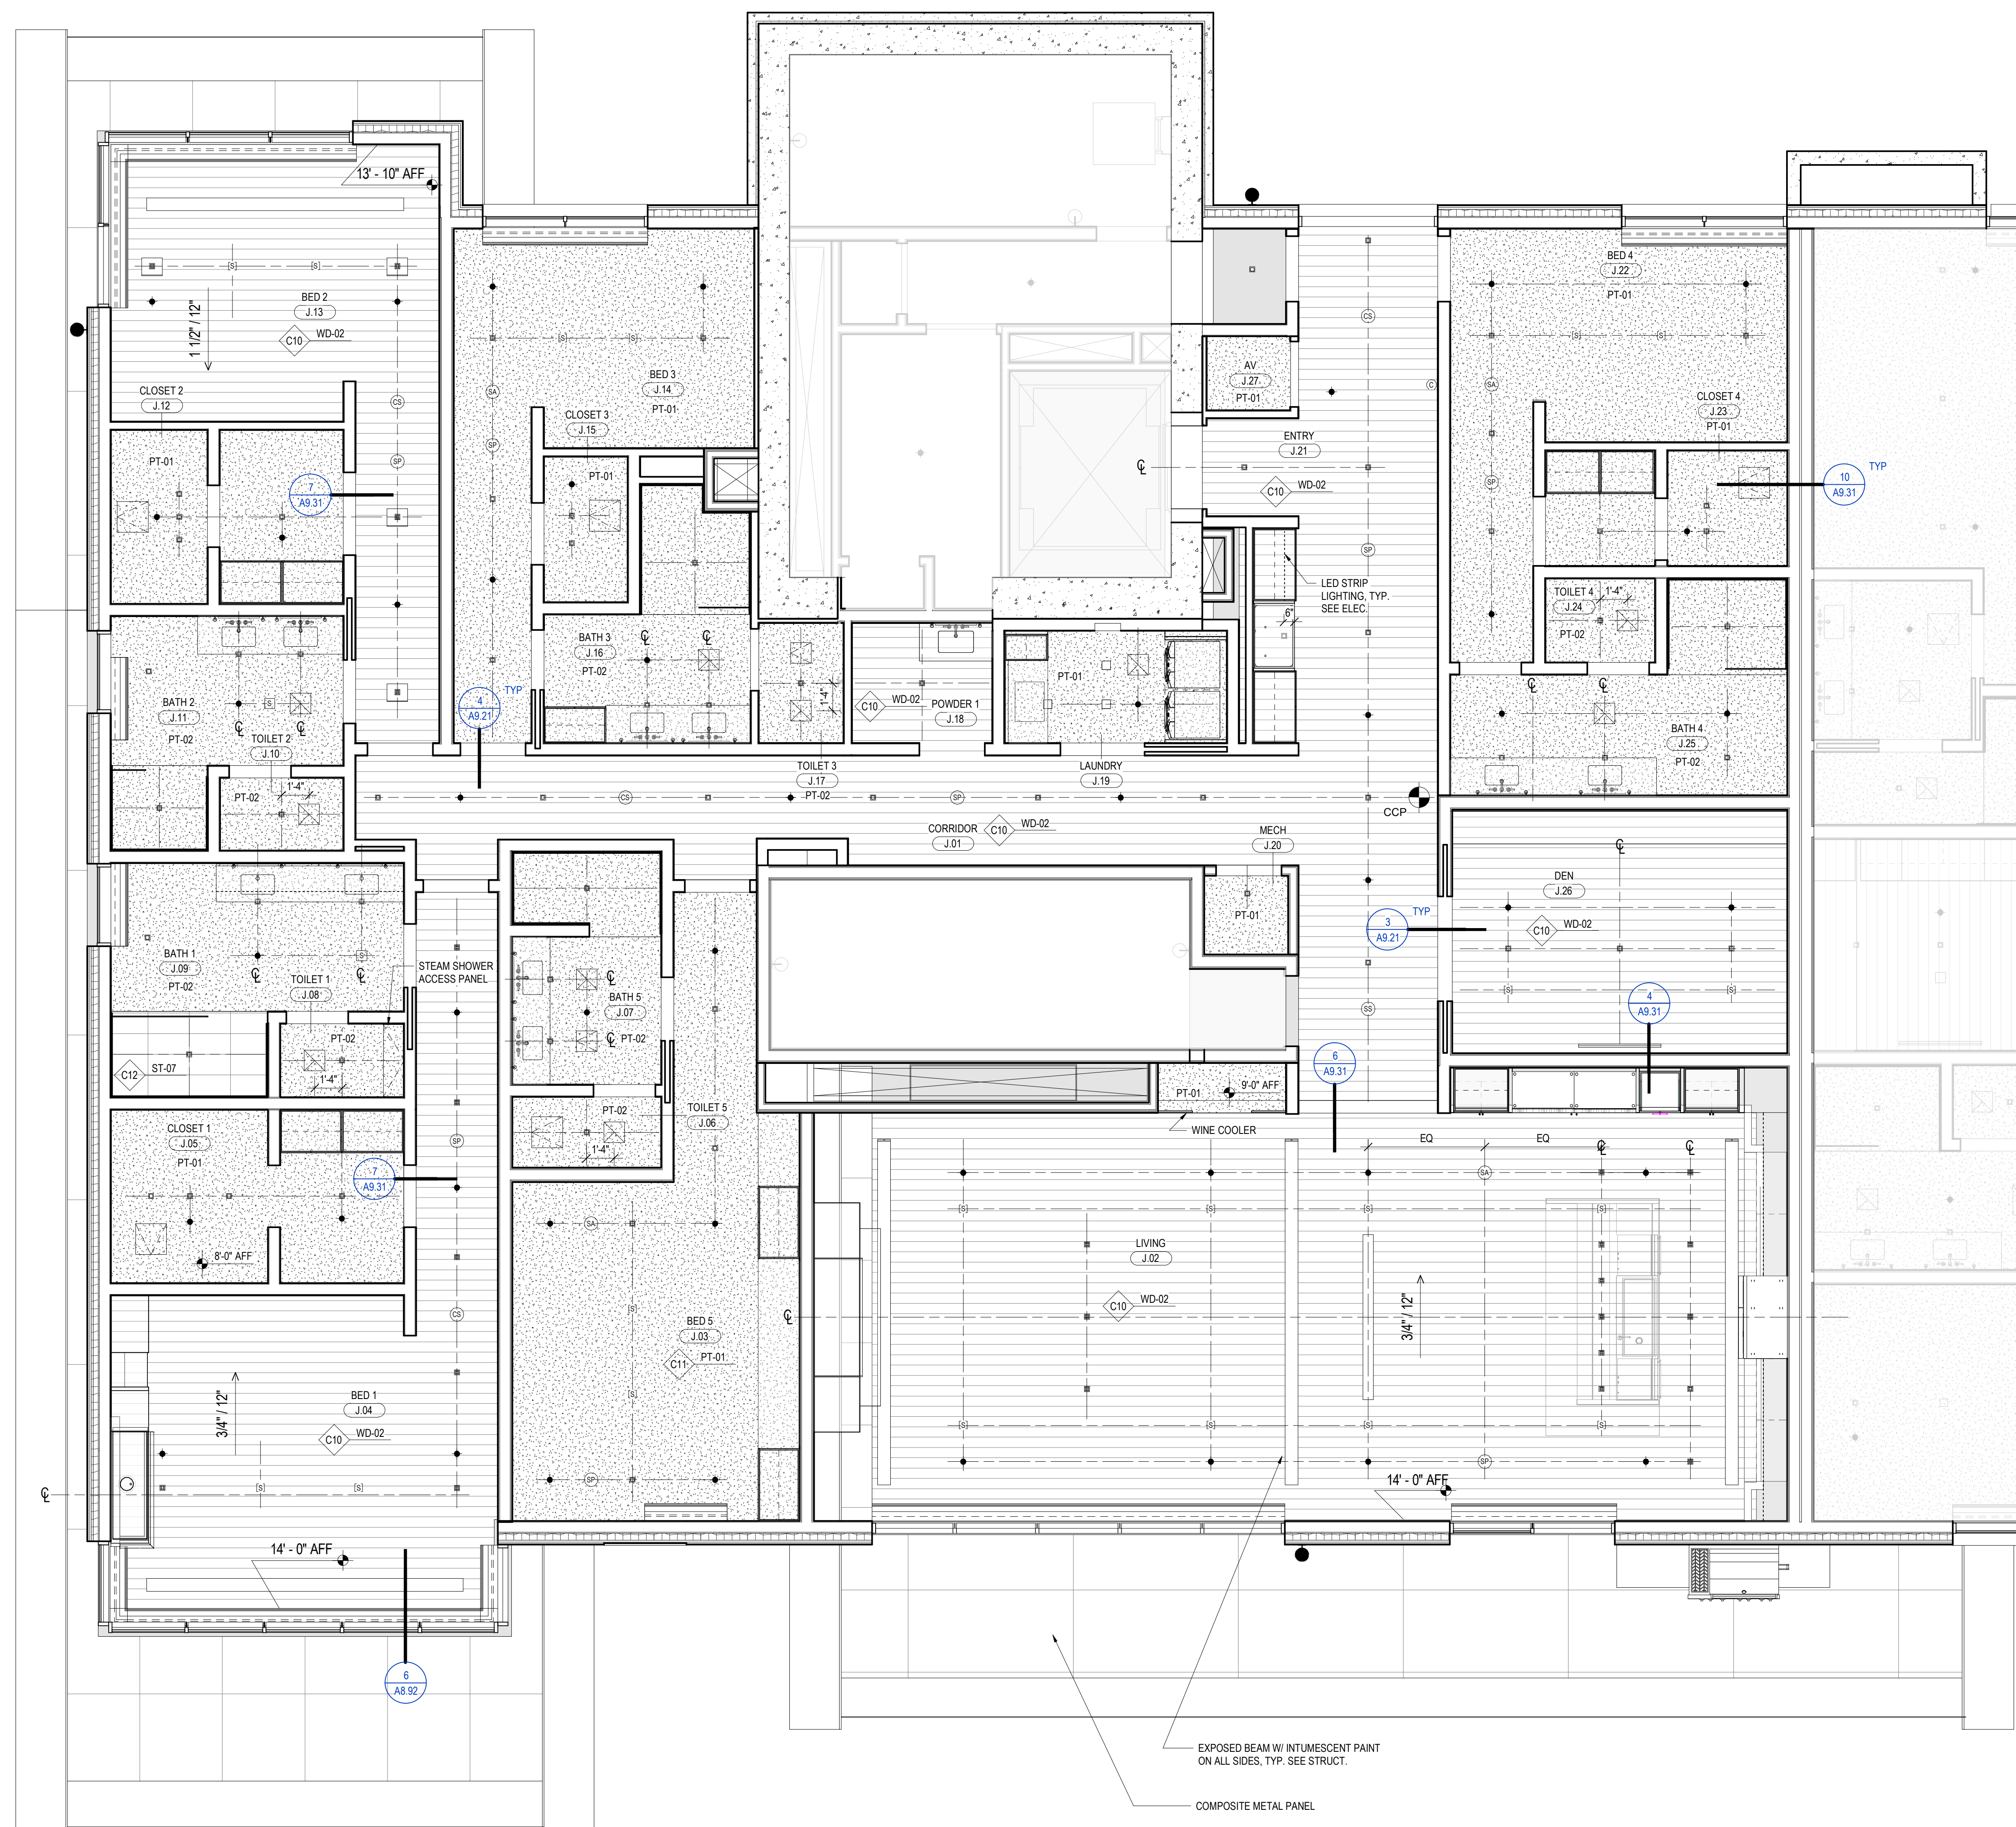

1 RCP - TOWER A/B - UNIT J
SCALE: 1/4" = 1'-0"

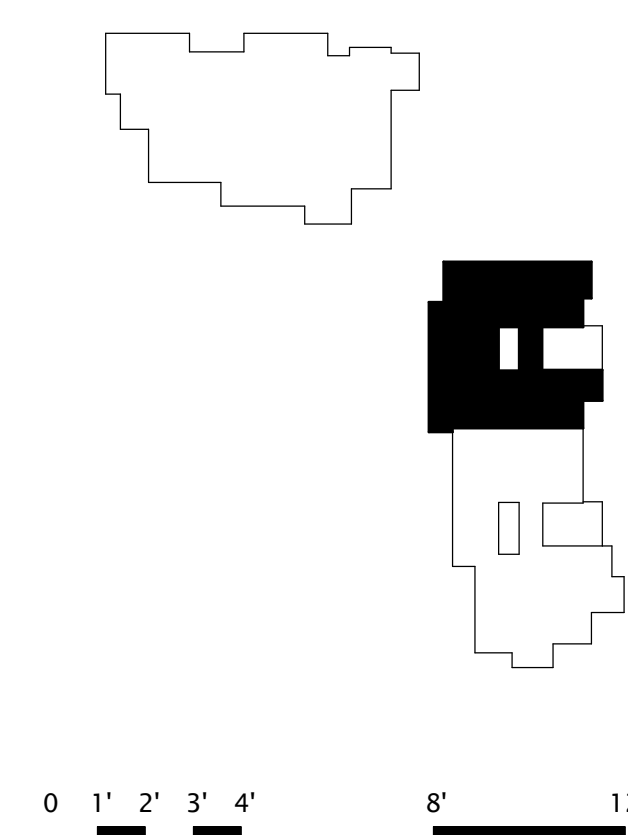

RCP GENERAL NOTES

1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. TYPICAL LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.


RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION


- | | |
|--|--|
| | C10 - WOOD CEILING |
| | C11 - SUSPENDED GYPSUM WALL BOARD |
| | C12 - STONE TILE |
| | C14 - ACOUSTICAL CEILING TILE |
| | SQUARE RECESSED DOWNLIGHT |
| | DECORATIVE SCONCE |
| | DECORATIVE CUSTOM CHANDELIER |
| | ROUND PENDANT LIGHT |
| | J-BOX |
| | LENSED LINEAR UTILITY STRIP |
| | CONCEALED LINEAR UNDERCABINET STRIP |
| | TRACK / RAIL / LINEAR LED |
| | SURFACE-MOUNTED LIGHT BAR |
| | SURFACE MOUNT PANEL |
| | SPRINKLER |
| | SMOKE DETECTOR |
| | COMBINATION SMOKE / CARBON MONOXIDE DETECTOR |
| | FIRE ALARM SPEAKER |
| | FIRE ALARM STROBE |
| | FIRE ALARM COMBINATION SPEAKER / STROBE |
| | COMBINATION SMOKE / HEAT DETECTOR |
| | EXIT SIGN |
| | SECURITY CAMERA |
| | WIRELESS ACCESS POINT |
| | AV SPEAKER |
| | MOTORIZED SINGLE ROLLER SHADE - EQ-02-00 |
| | MOTORIZED DOUBLE ROLLER SHADE - EQ-02-01 |
| | CEILING FAN - MECH EXHAUST |
| | MECHANICAL LINEAR GRILLE |
| | CEILING ACCESS PANEL |
| | CEILING CONTROL POINT |

EXPOSED BEAM W/ INTUMESCENT PAINT
ON ALL SIDES, TYP. SEE STRUCT.

COMPOSITE METAL PANEL

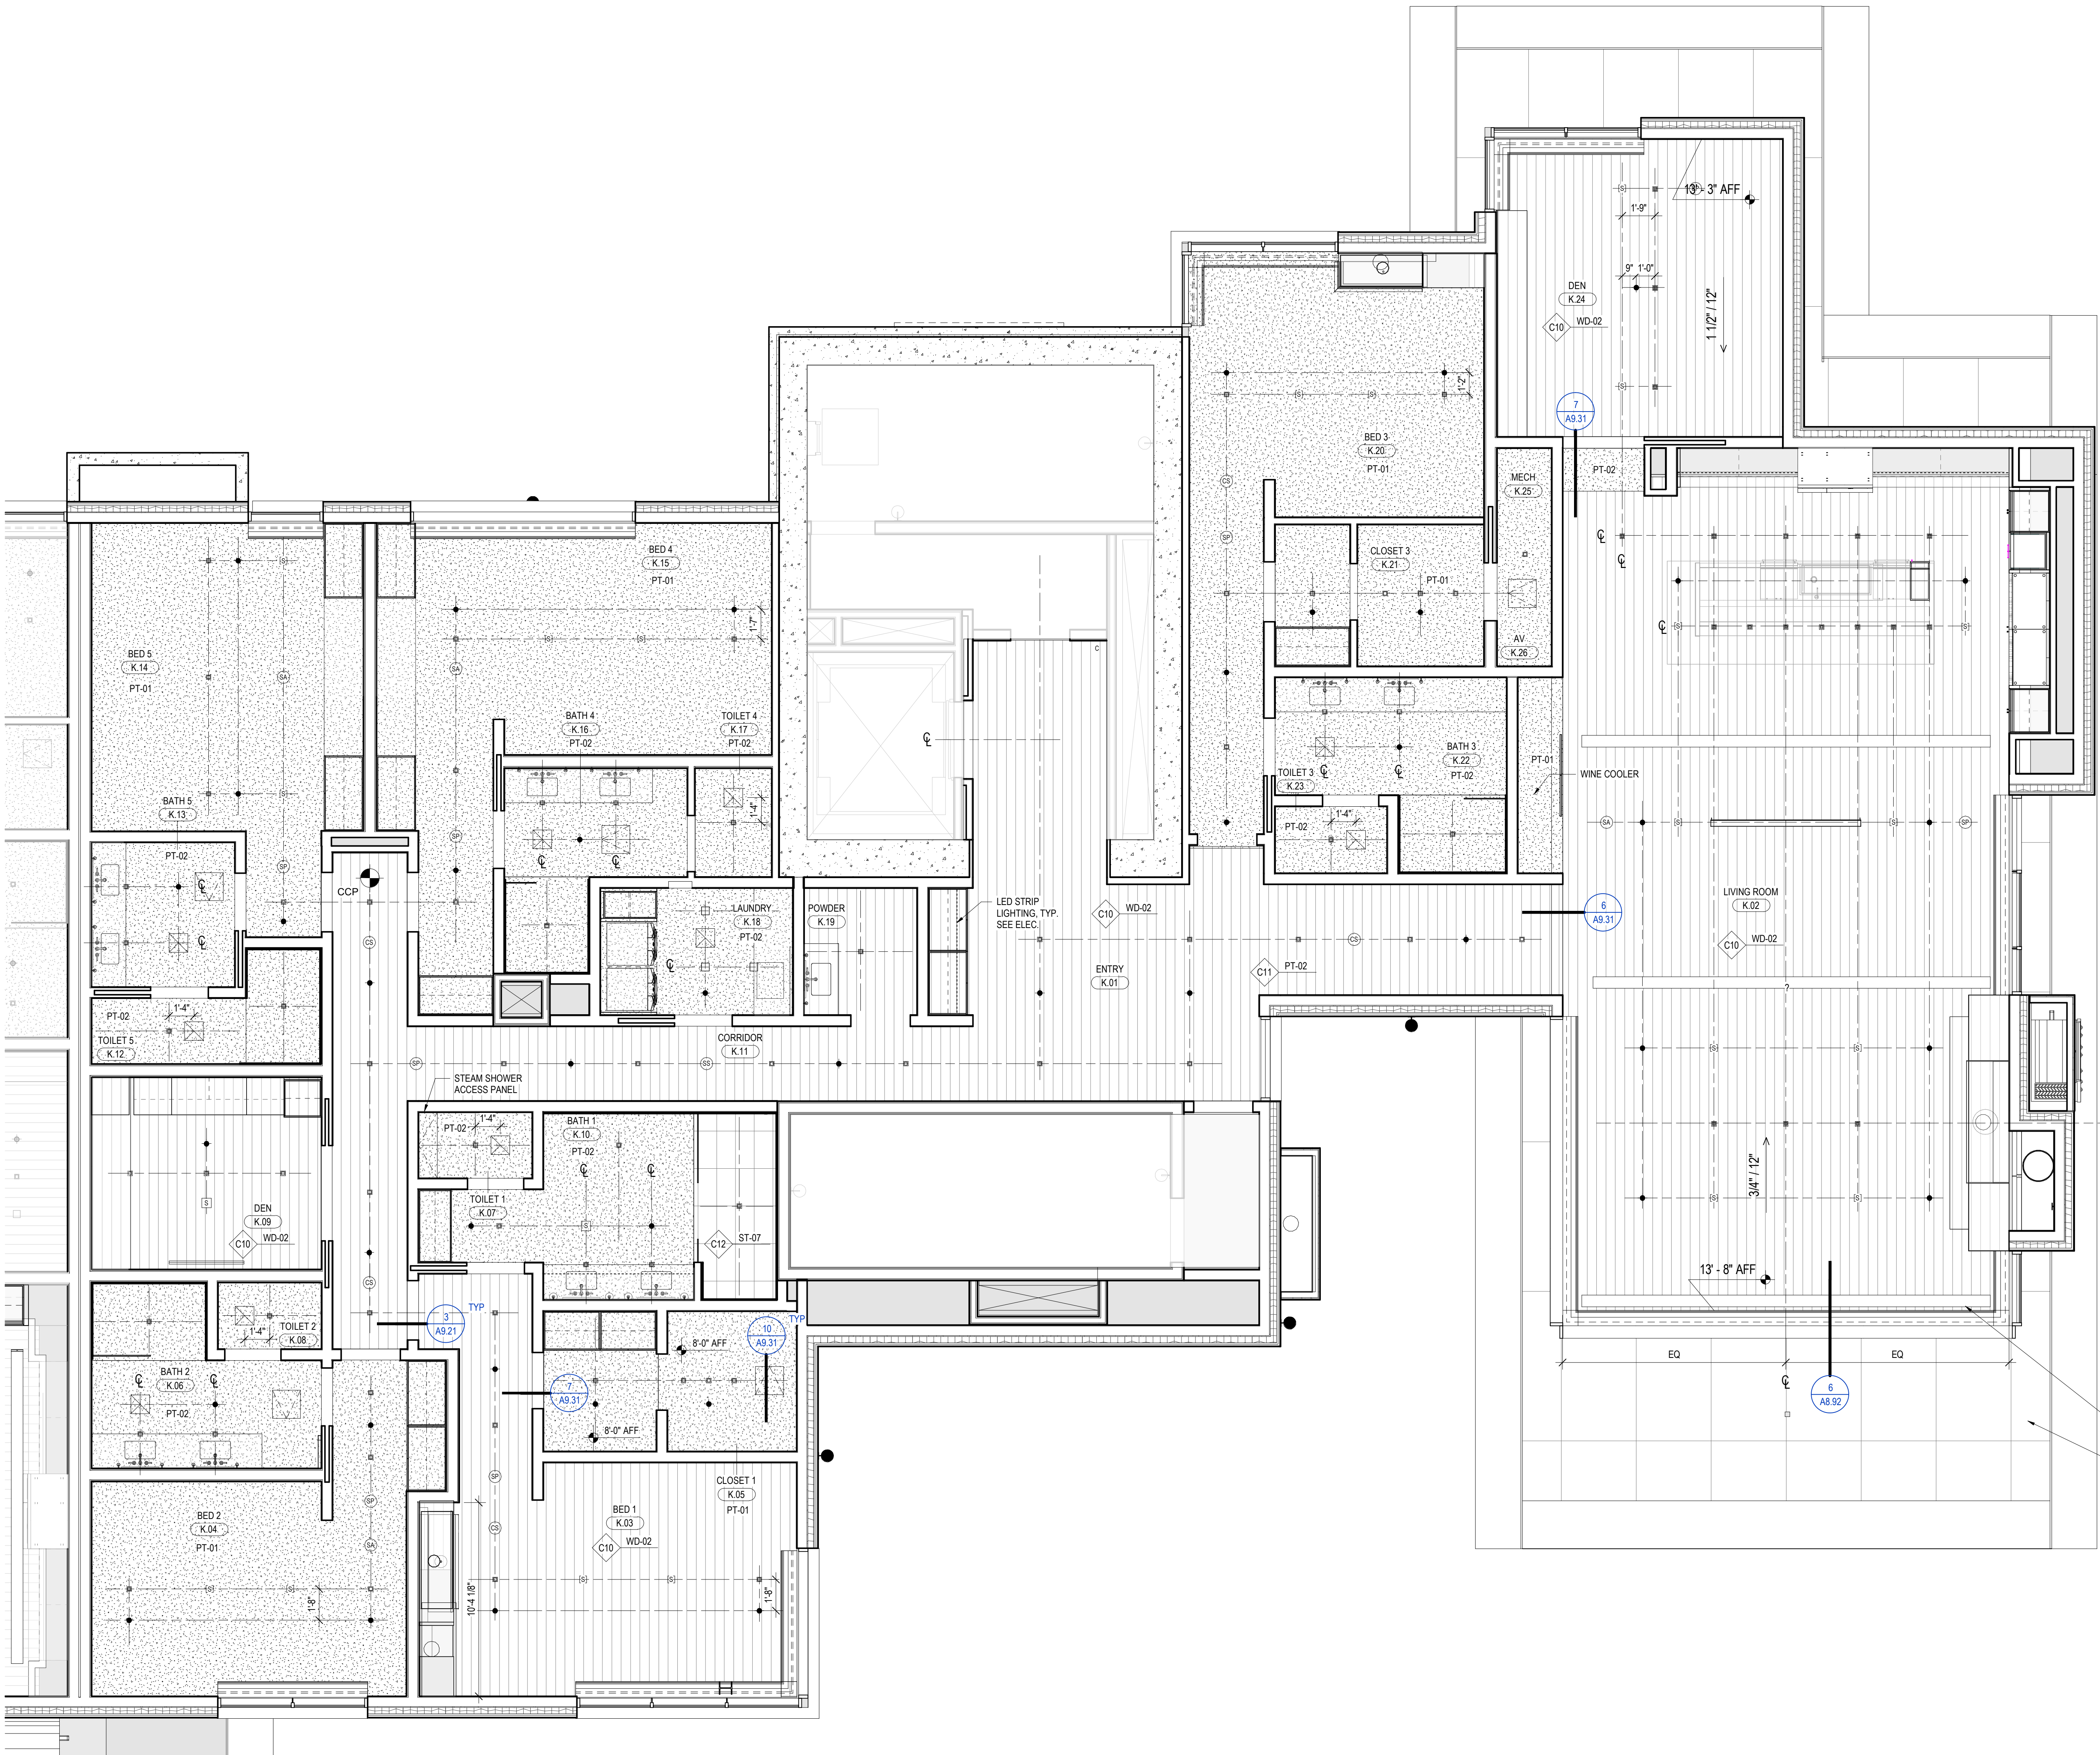

1 RCP - TOWER A/B - UNIT K
SCALE: 1/4" = 1'-0"

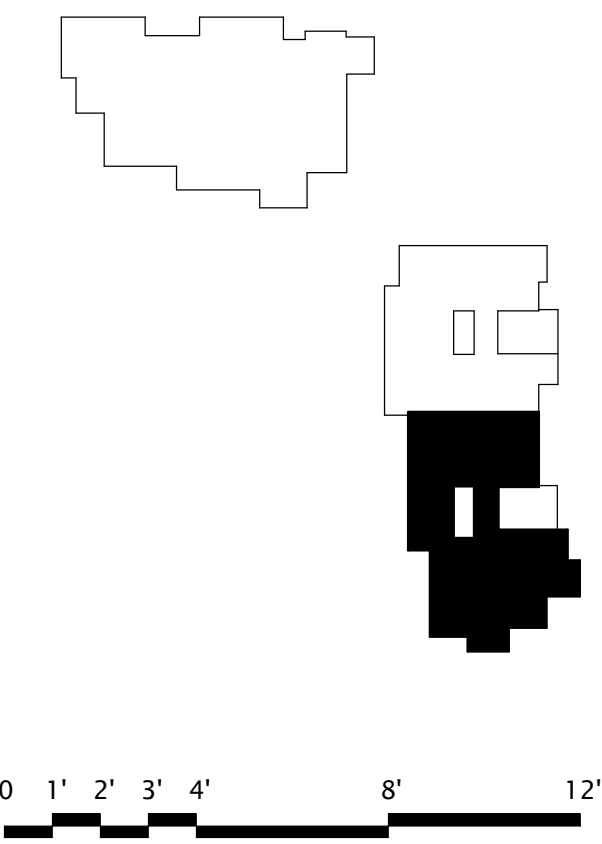

109 South Jackson St, Suite 800
Seattle, Washington 98104 USA
+1 206 424 1610 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave., Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6940 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
85 Mainell Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lorch Bates
1615 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O
319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK, KM
project manager TM, JB, LD, MD
drawn by SK, SS, JR, CP, AL
NH, EK, BD, ER

checked by JB
job no. 2052
date 11/18/2022

revisions:

no. date by

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER AB - UNIT
K

A6.2.K

RCP GENERAL NOTES


1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPIABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. TYPICAL LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.


RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- | | |
|--|--|
| | C10 - WOOD CEILING |
| | C11 - SUSPENDED GYPSUM WALL BOARD |
| | C12 - STONE TILE |
| | C14 - ACOUSTICAL CEILING TILE |
| | SQUARE RECESSED DOWNLIGHT |
| | DECORATIVE SCONCE |
| | DECORATIVE CUSTOM CHANDELIER |
| | ROUND PENDANT LIGHT |
| | J-BOX |
| | LENSED LINEAR UTILITY STRIP |
| | CONCEALED LINEAR UNDERCABINET STRIP |
| | TRACK / RAIL / LINEAR LED |
| | SURFACE-MOUNTED LIGHT BAR |
| | SURFACE MOUNT PANEL |
| | SPRINKLER |
| | SMOKE DETECTOR |
| | COMBINATION SMOKE / CARBON MONOXIDE DETECTOR |
| | FIRE ALARM SPEAKER |
| | FIRE ALARM STROBE |
| | FIRE ALARM COMBINATION SPEAKER / STROBE |
| | COMBINATION SMOKE / HEAT DETECTOR |
| | EXIT SIGN |
| | SECURITY CAMERA |
| | WIRELESS ACCESS POINT |
| | AV SPEAKER |
| | MOTORIZED SINGLE ROLLER SHADE - EQ-02.00 |
| | MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01 |
| | CEILING FAN - MECH EXHAUST |
| | MECHANICAL LINEAR GRILLE |
| | CEILING ACCESS PANEL |
| | CEILING CONTROL POINT |

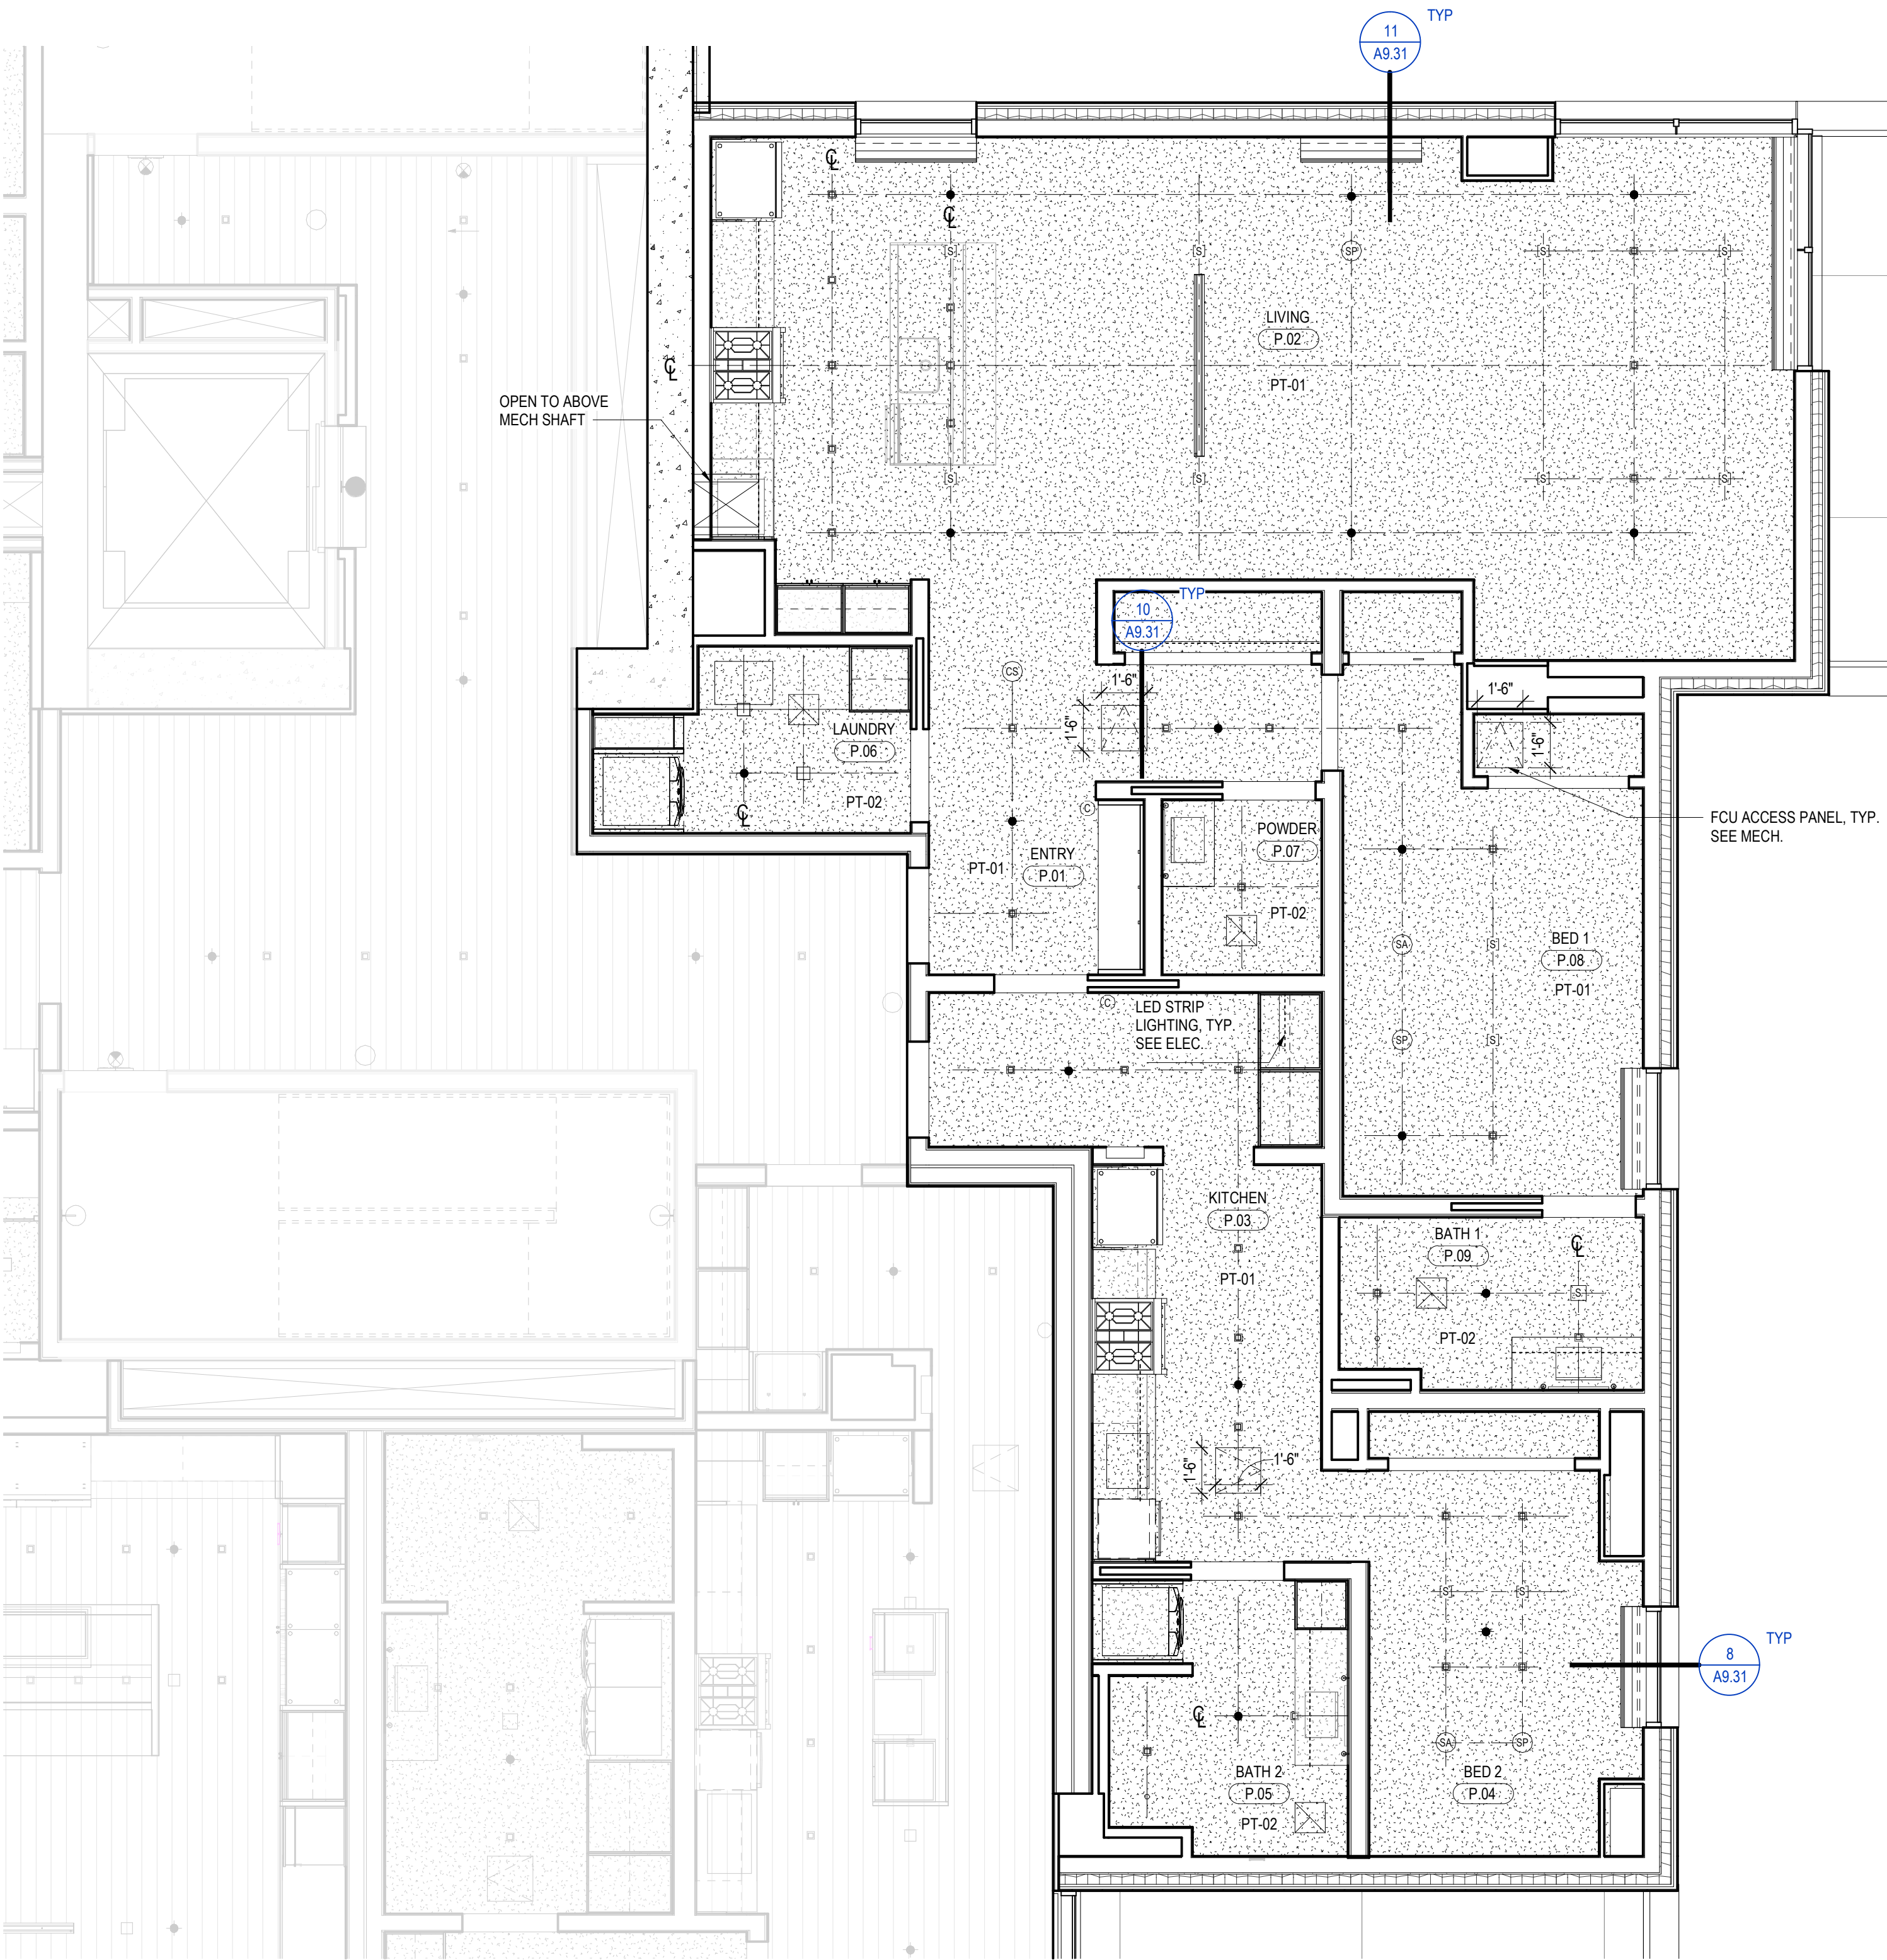

2 RCP - TOWER A/B - UNIT P
SCALE: 1/4" = 1'-0"

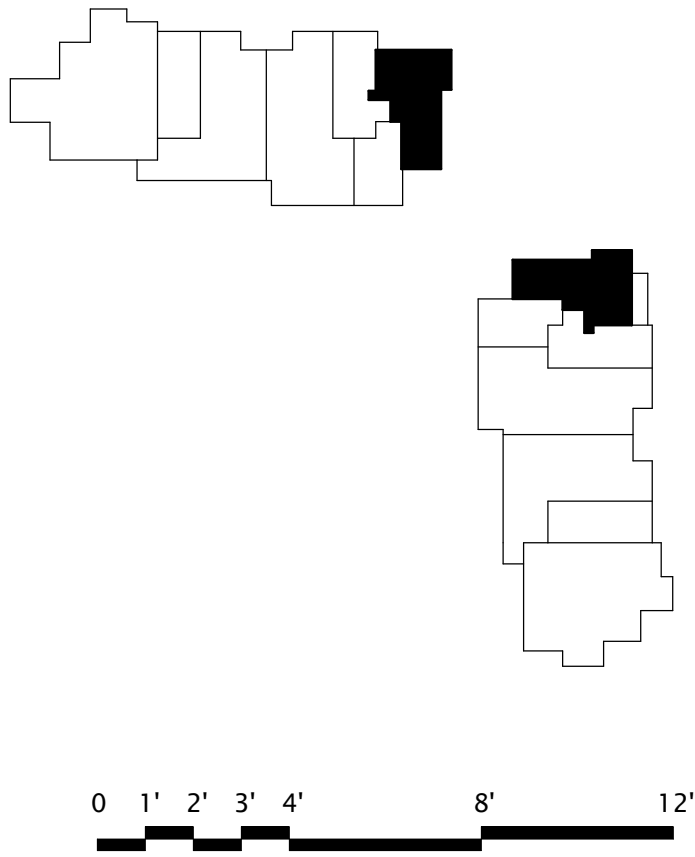

109 South Jackson St. Suite 600
Seattle, Washington 98104 USA
+1 206 454 9810 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSA C AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave., Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6940 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainell Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
1915 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave., Suite 3200
Seattle, WA 98101

Lighting Designer
Or
1319 SE MLK Blvd., Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect __TK, KM__
project manager __TM, JB, LB, MD__
drawn by __SK, SS, JR, CP, AL, NH, EK, BD, ER__

checked by __JB__
job no. 2052
date 11/18/2022

revisions:

no. date by




ISSUED FOR
CONSTRUCTION
11/18/2022












RCP - TOWER AB - UNIT
P












A6.2.P







1. SPOT LIGHTINGS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTH POSITION OF FINISH FLOOR AND CEILING 9'-0" AFF. U.O.
2. ALL CEILINGS ASSUMED TO BE 8' U.O.
3. ALL CEILINGS ASSUMED TO BE 8' U.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT NOT LESS THAN 7 FEET. BATHS, KITCHENS, HALLWAYS, ENTRYWAYS, PORCHES, PATIOS, TERRAZZOS, KITCHEN STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET AO-10 AND AO-11 FOR FLOOR/CEILING ASSEMBLIES.
8. PROVIDE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. PROVIDE DETAIL FOR SMOKE DETECTOR LOCATION AND MOUNTING LEVELS TO PROJECT AT LEAST MAXIMUM FROM WALL FACE OR BE 6"-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. PROVIDE SMOKE DETECTOR LOCATIONS TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. PROVIDE DETAIL FOR JOINTS TO BE USED TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE FASTENING AND JOINT TAP AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOORELEVATION. PROVIDE DETAIL FOR JOINTS TO BE USED TO BE DETERMINED WITH APPROVED SHOP DRAWINGS.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS AND SERVICE MEDIA PENETRATIONS. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

RCP LEGEND

 C10 - WOOD CEILING
 C11 - SUSPENDED GYPSUM WALL BOARD
 C12 - STONE TILE

 C14 - ACOUSTICAL CEILING TILE
 SQUARE RECESSED DOWNLIGHT
 DECORATIVE SCONCE
 DECORATIVE CUSTOM CHANDELIER
 ROUND PENDANT LIGHT
 J-BOX
 LENSED LINEAR UTILITY STRIP
 CONCEALED LINEAR UNDERCABINET STRIP
 TRACK / RAIL / LINEAR LED
 SURFACE-MOUNTED LIGHT BAR
 SURFACE MOUNT PANEL


 SPRINKLER
 SMOKE DETECTOR
 COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
 FIRE ALARM SPEAKER
 FIRE ALARM STROBE
 FIRE ALARM COMBINATION SPEAKER / STROBE
 COMBINATION SMOKE / HEAT DETECTOR
 EXIT SIGN
 SECURITY CAMERA
 WIRELESS ACCESS POINT
 AV SPEAKER

 MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
 MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
 CEILING FAN - MECH EXHAUST
 MECHANICAL LINEAR GRILLE
 CEILING ACCESS PANEL
 CEILING CONTROL POINT



Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060

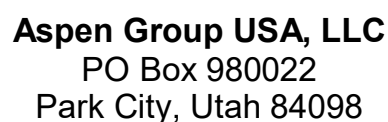

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 300
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

**Building Envelope Consultants
RDH**
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite 1
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, AL, NH, EK, BD, EB

checked by JB
job no. 20062
date 11/18/2022

revisions

no.	date	by
-----	------	----

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER AB - UNIT
Q

A6.2.Q