






1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
ALL CEILINGS 9'-0" AFF U.N.O.
2. ALL CEILINGS ASSEMBLY C/U N.O.
3. ALL DIMENSIONS TO FACE UNLESS NOTED OTHERWISE
4. USE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
5. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT
NOT LESS THAN 8'-0" UNLESS OTHERWISE SPECIFIED. MECHANICAL ROOMS, ATTIC
STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN
7 FEET.
6. SEE SHEET 10 AND 10.11 FOR FLOORCEILING ASSEMBLIES.
7. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING FIXTURES, OUTLETS AND ADDITIONAL
INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
8. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
9. ALL AIR HANDLING EQUIPMENT SHALL BE LOCATED AT MINIMUM CEILING LEVELS TO PREVENT
AIR FROM FLOWING FROM WALL OR CEILING TO MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
10. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
11. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE
DETECTORS. SMOKE DETECTORS SHALL BE DETERMINED WITH APPROVED SHOP
DRAWINGS. PROVIDE SIDE ARM HEADS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE
IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
12. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR
CHASES. CHASES SHALL BE FASTENED TO STRUCTURE AT SPECIFIED RATES.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT
SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOORCEILING
CAVITY. PROVIDE FIRE-RATED FURRED-OUT WALLS TO PREVENT THE WALL CAVITY FROM
COMMUNICATING WITH THE FLOORCEILING CAVITY.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR
ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS
POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO
INSTALLATION OF ANY OF THESE SYSTEMS.


















RCP LEGEND

C10 - WOOD CEILING

C11 - SUSPENDED GYPSUM WALL BOARD


C12 - STONE TILE

	LENSED LINEAR UTILITY STRIP
	CONCEALED LINEAR UNDERCABINET STRIP
	TRACK / RAIL / LINEAR LED
	SURFACE-MOUNTED LIGHT BAR
	SURFACE MOUNT PANEL

	SPRINKLER
	SMOKE DETECTOR
	COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
	FIRE ALARM SPEAKER
	FIRE ALARM STROBE
	FIRE ALARM COMBINATION SPEAKER / STROBE
	COMBINATION SMOKE / HEAT DETECTOR
	EXIT SIGN
	SECURITY CAMERA
	WIRELESS ACCESS POINT
	AV SPEAKER
	MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
	MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
	CEILING FAN - MECH EXHAUST
	MECHANICAL LINEAR GRILLE
	CEILING ACCESS PANEL
	CEILING CONTROL POINT

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060

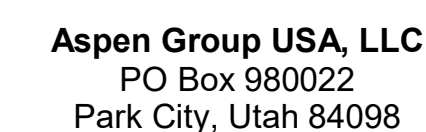

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, AL NH, EK, BD, EB

checked by JB
job no. 20052
date 11/18/2022

revisions:

no.	date	by
-----	------	----




ISSUED FOR
CONSTRUCTION
11/18/2022





























RCP - LOBBY - AREA C

A6.1AB.1c

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

 C10 - WOOD CEILING
 C11 - SUSPENDED GYPSUM WALL BOARD
 C12 - STONE TILE

	C14 - ACOUSTICAL CEILING TILE
	SQUARE RECESSED DOWNLIGHT
	DECORATIVE SCONCE
	DECORATIVE CUSTOM CHANDELIER
	ROUND PENDANT LIGHT
	J-BOX
	LENSED LINEAR UTILITY STRIP
	CONCEALED LINEAR UNDERCABINET STRIP
	TRACK / RAIL / LINEAR LED
	SURFACE-MOUNTED LIGHT BAR
	SURFACE MOUNT PANEL
	SPRINKLER
	SMOKE DETECTOR
	COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
	FIRE ALARM SPEAKER
	FIRE ALARM STROBE
	FIRE ALARM COMBINATION SPEAKER / STROBE
	COMBINATION SMOKE / HEAT DETECTOR
	EXIT SIGN
	SECURITY CAMERA
	WIRELESS ACCESS POINT
	AV SPEAKER
	MOTORIZED SINGLE ROLLER SHADE - EQ-02-00
	MOTORIZED DOUBLE ROLLER SHADE - EQ-02-01
	CEILING FAN - MECH EXHAUST
	MECHANICAL LINEAR GRILLE
	CEILING ACCESS PANEL
	CEILING CONTROL POINT

159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5870 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultants
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, A NH, EK, BD, ER

checked by JB
job no. 20052
date 11/18/2022


revisions

no.	date	by
-----	------	----

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - LOBBY - AREA C

A6.1AB.2c

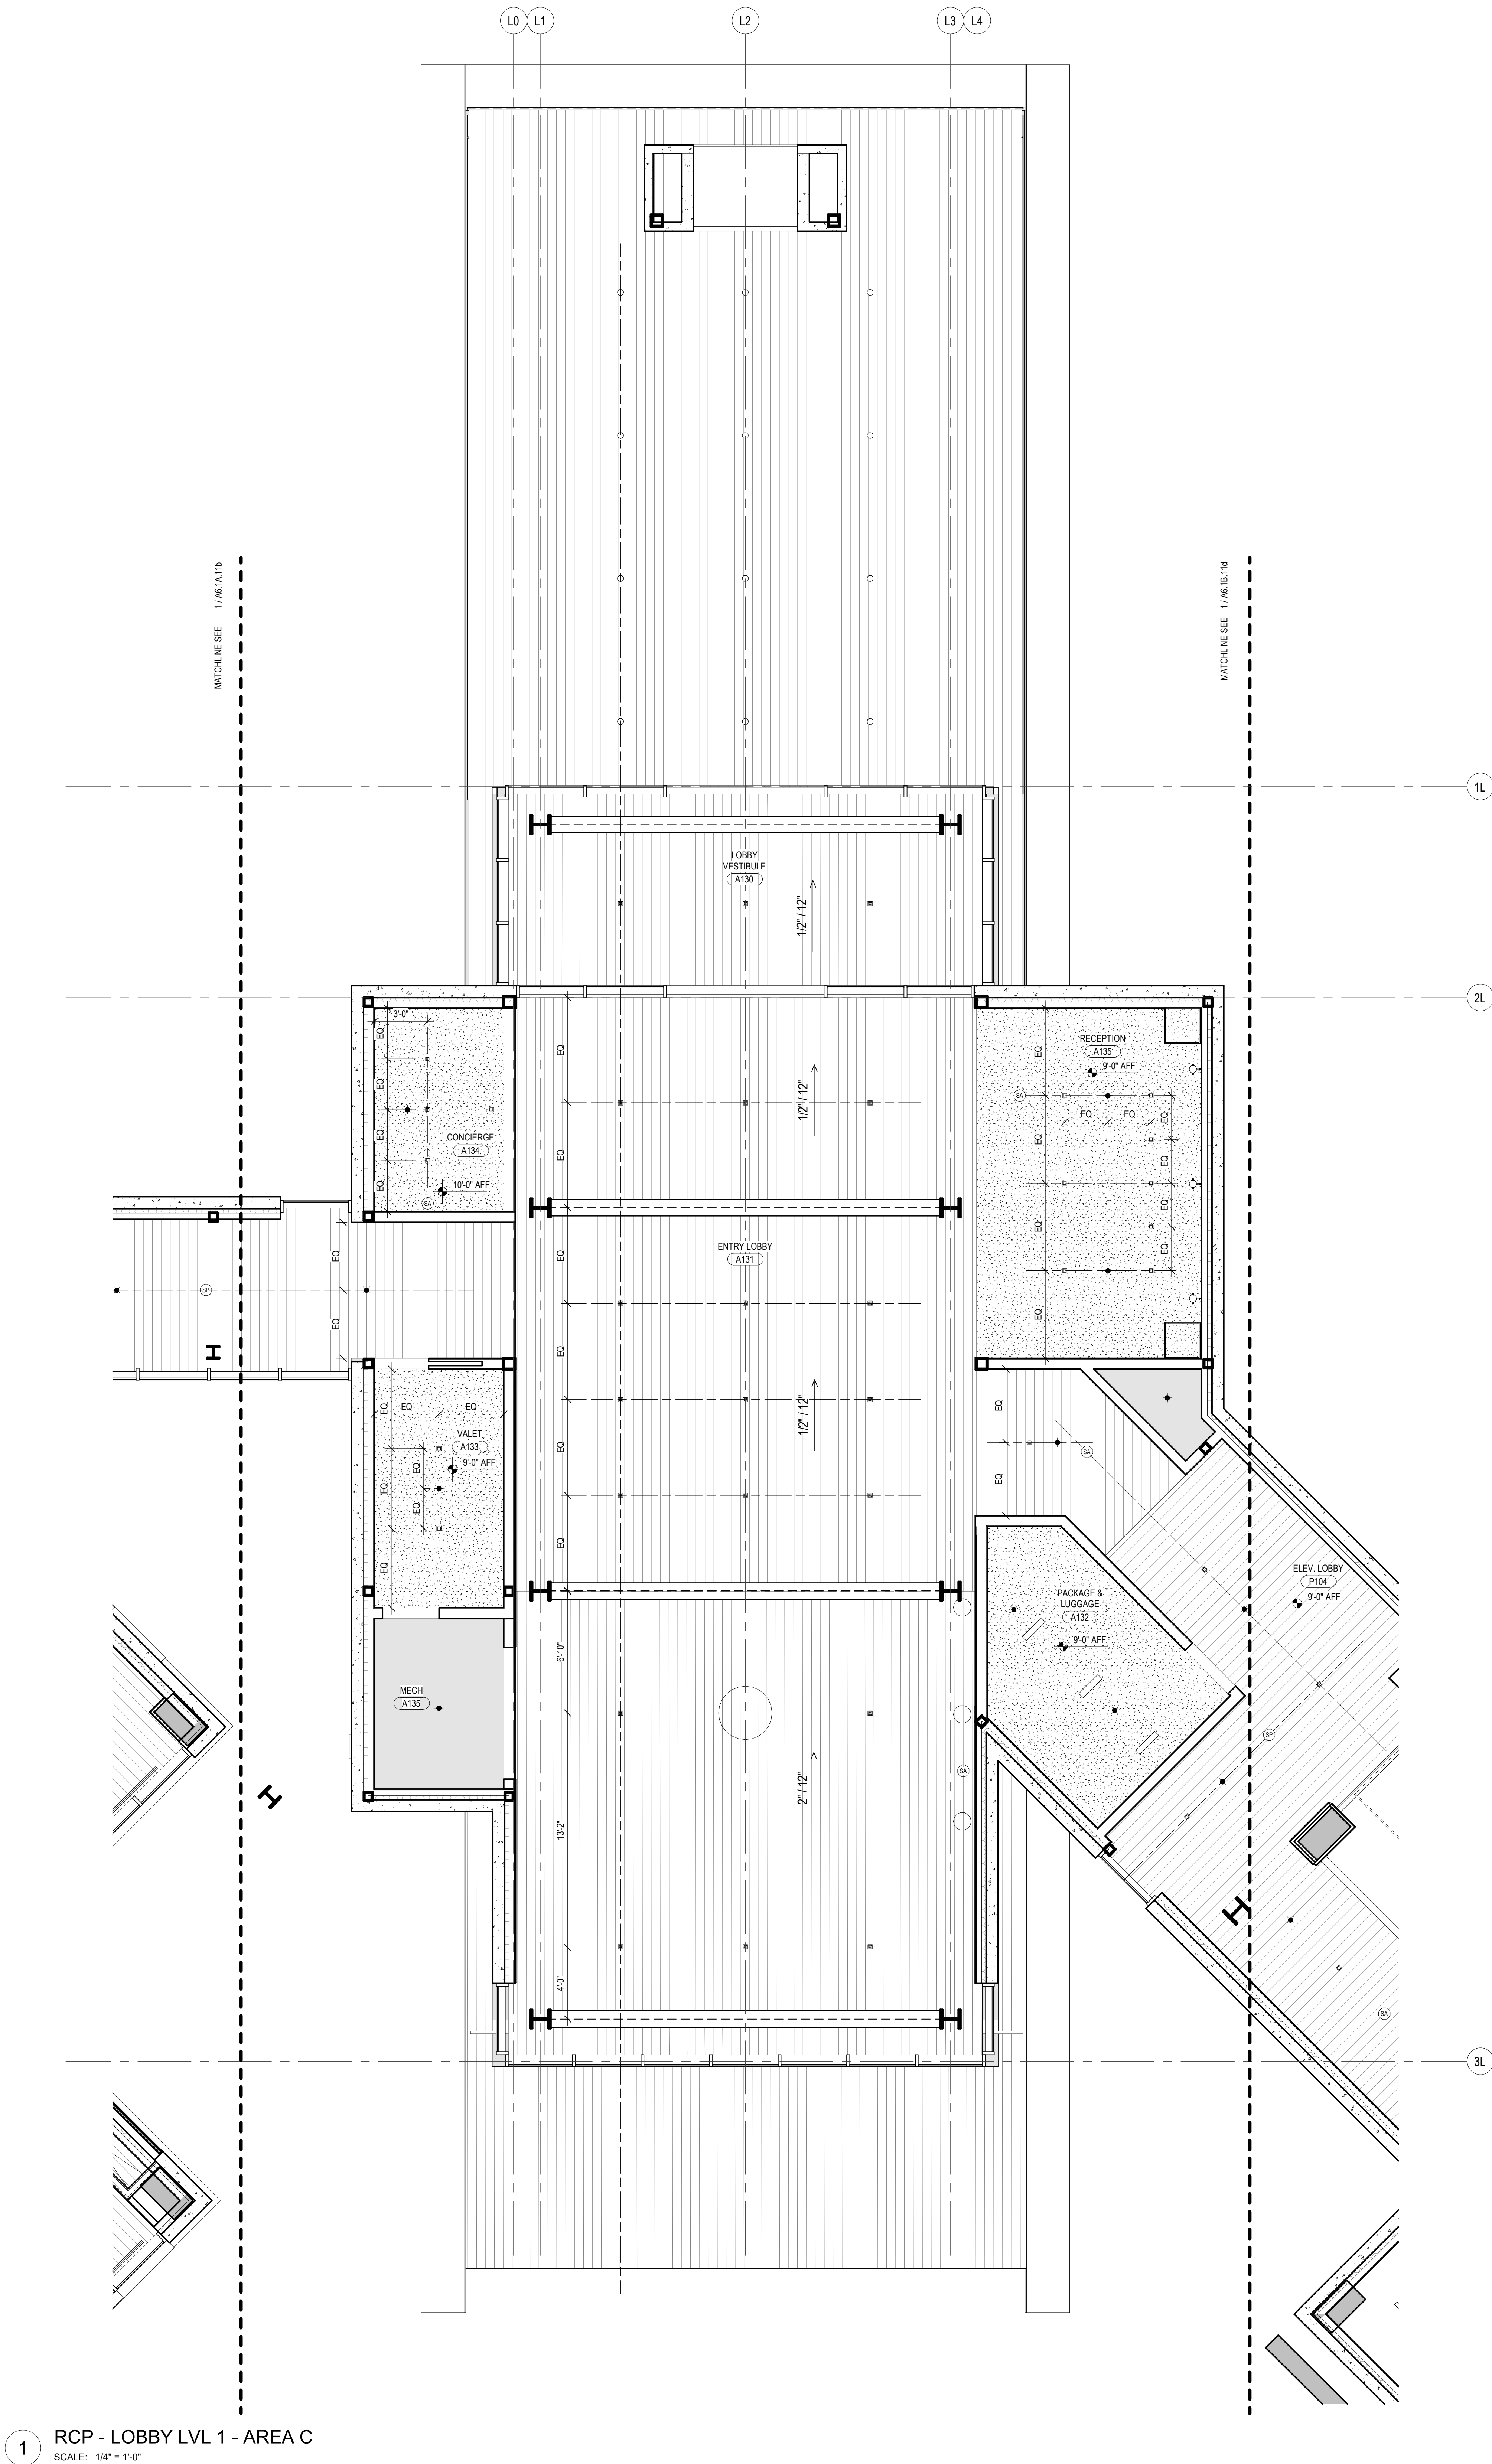

RCP GENERAL NOTES


1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS, TYPICAL. LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.



RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- C10 - WOOD CEILING
C11 - SUSPENDED GYPSUM WALL BOARD
C12 - STONE TILE
C14 - ACOUSTICAL CEILING TILE
SQUARE RECESSED DOWNLIGHT
DECORATIVE SCONCE
DECORATIVE CUSTOM CHANDELIER
ROUND PENDANT LIGHT
J-BOX
LENSED LINEAR UTILITY STRIP
CONCEALED LINEAR UNDERCABINET STRIP
TRACK / RAIL / LINEAR LED
SURFACE-MOUNTED LIGHT BAR
SURFACE MOUNT PANEL
SPRINKLER
SMOKE DETECTOR
COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
FIRE ALARM SPEAKER
FIRE ALARM STROBE
FIRE ALARM COMBINATION SPEAKER / STROBE
COMBINATION SMOKE / HEAT DETECTOR
EXIT SIGN
SECURITY CAMERA
WIRELESS ACCESS POINT
AV SPEAKER
MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
CEILING FAN - MECH EXHAUST
MECHANICAL LINEAR GRILLE
CEILING ACCESS PANEL
CEILING CONTROL POINT

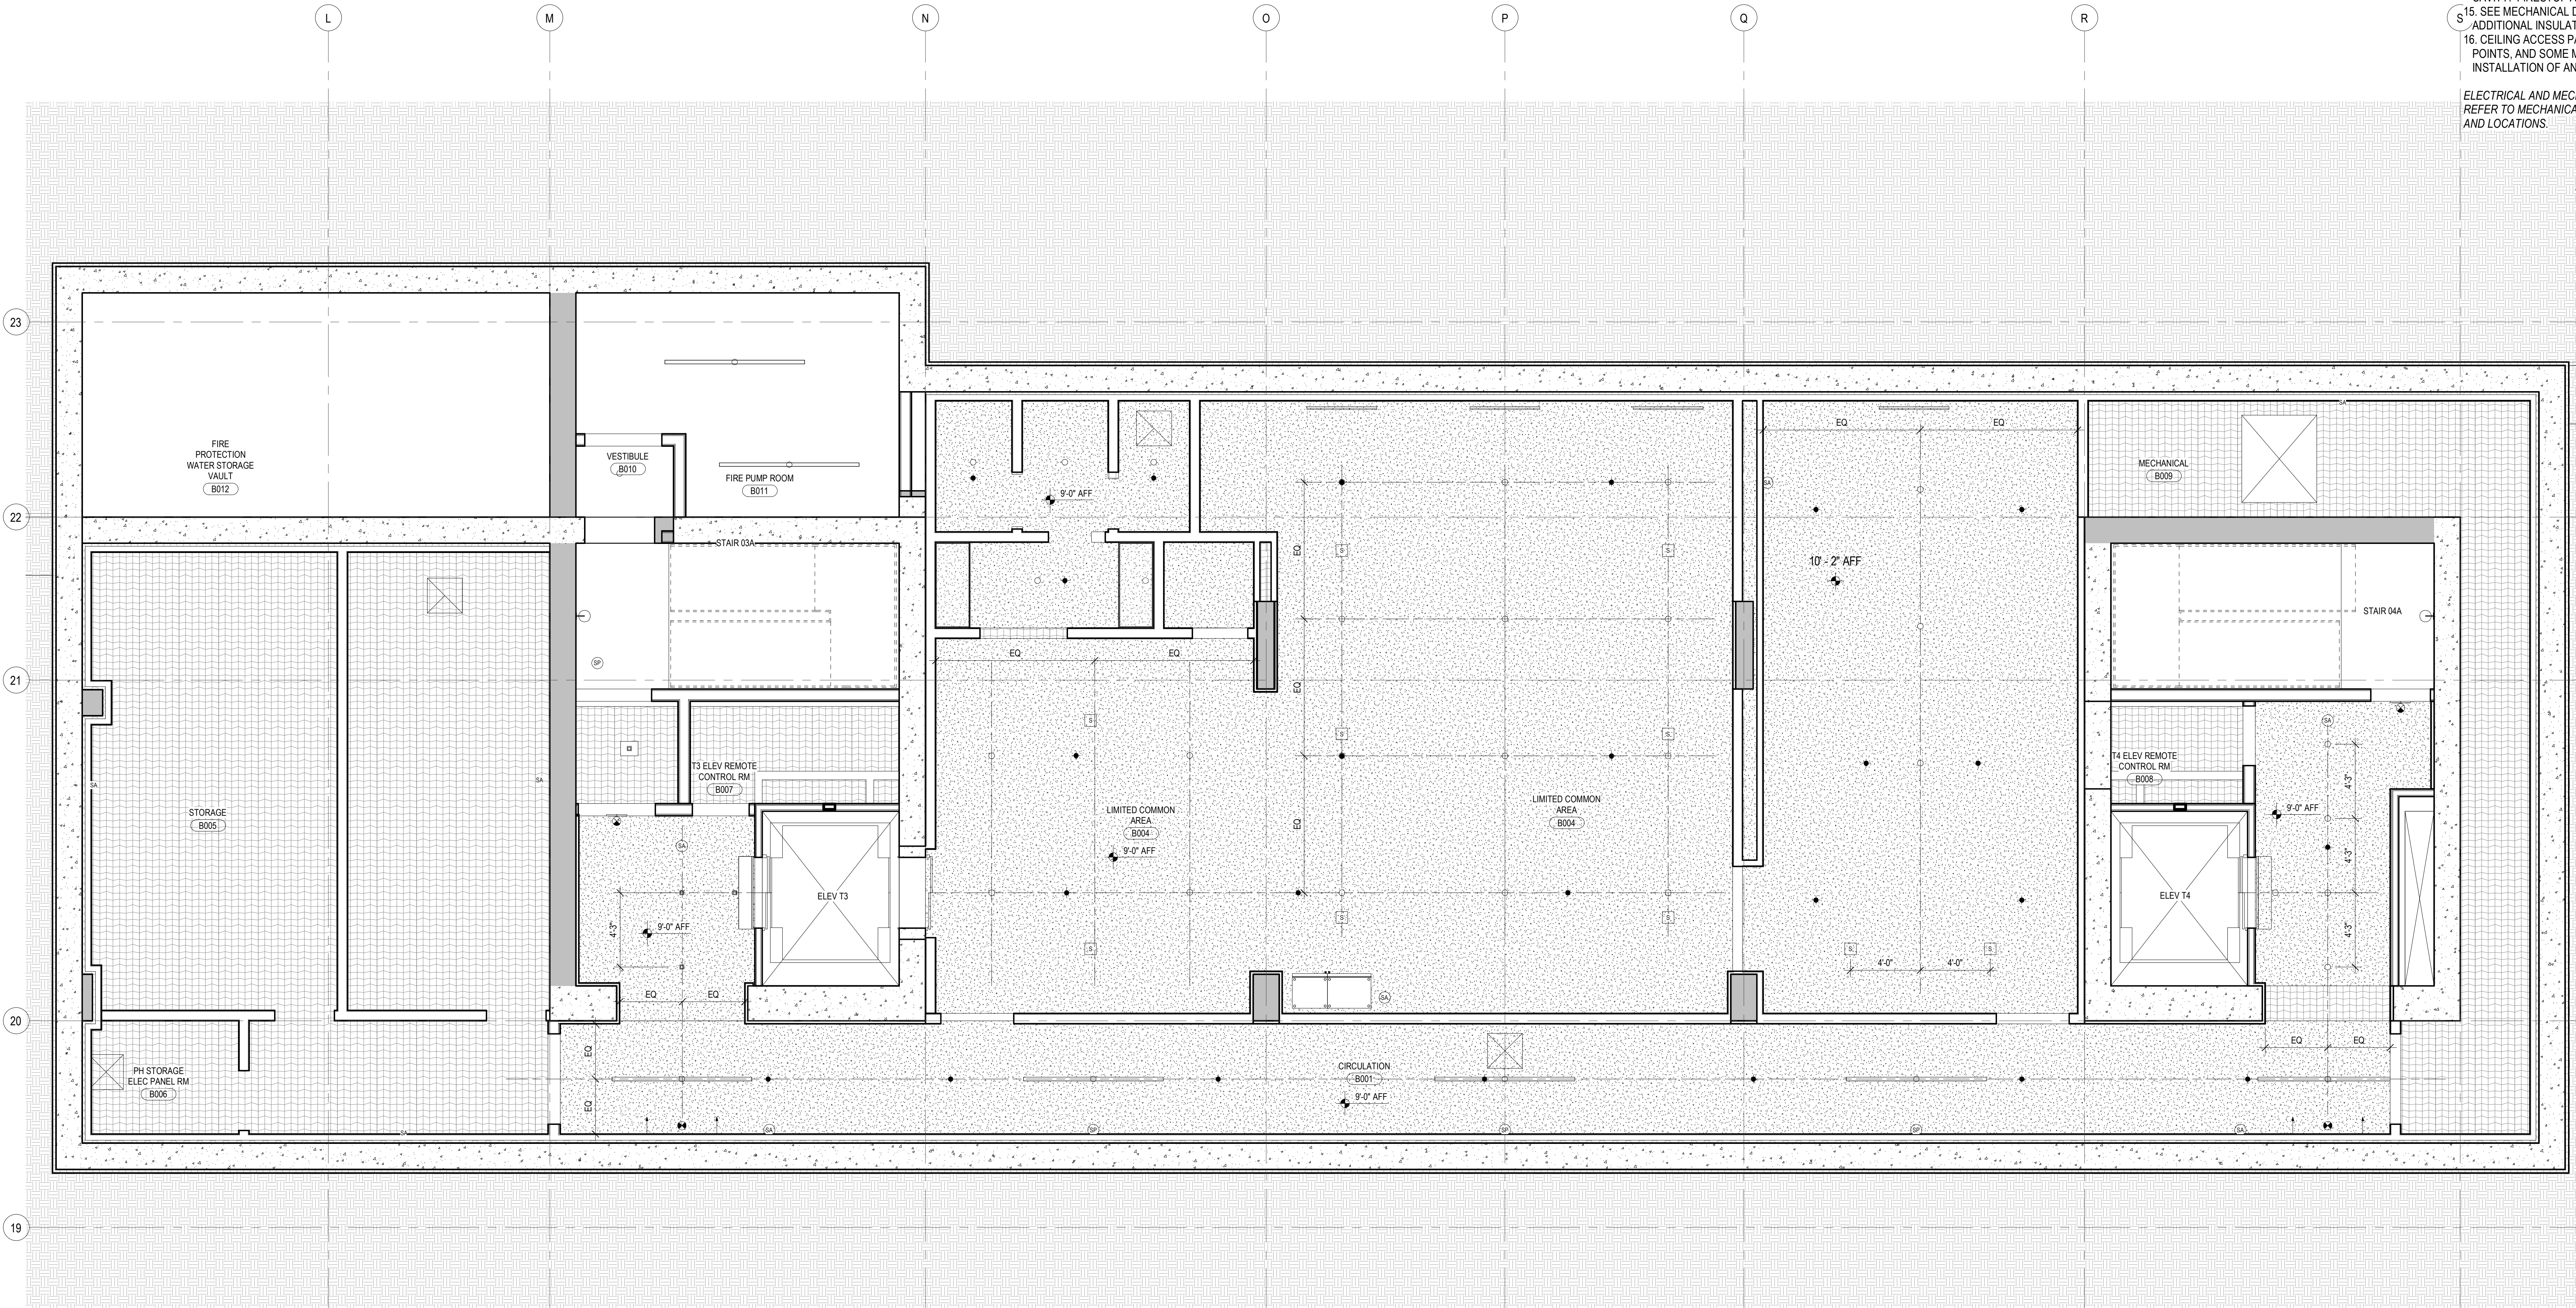

1 TOWER B LVL B
SCALE: 1/4" = 1'-0"

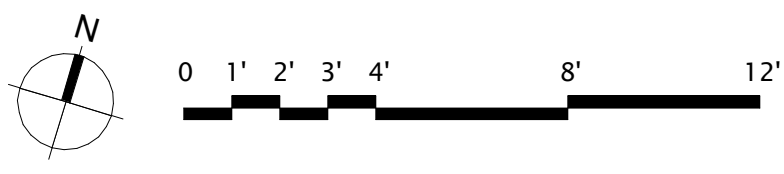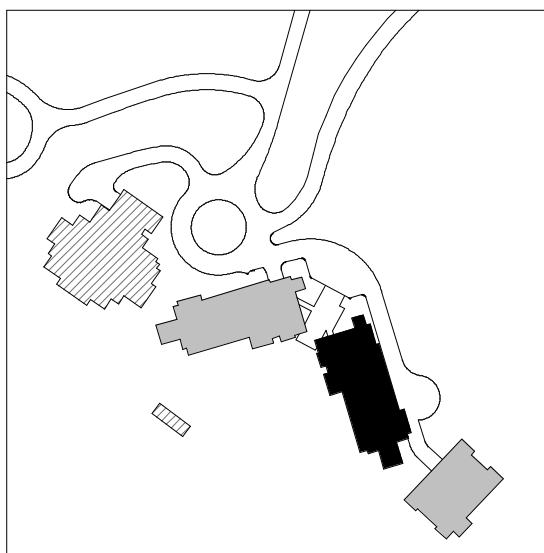

109 South Jackson St, Suite 800
Seattle, Washington 98104 USA
+1 206 454 1810 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 250
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
1615 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
Or
319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK, KM
project manager TM, JB, LB, MD
drawn by SK, SS, JR, CP, AL
NH, EK, BD, ER

checked by JB
job no. 2052
date 11/18/2022

revisions:

no. date by

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER B - LVL B

A6.1B.01

RCP GENERAL NOTES

1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS, TYPICAL. LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.

RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- | | |
|--|----------------------------------------------|
| | C10 - WOOD CEILING |
| | C11 - SUSPENDED GYPSUM WALL BOARD |
| | C12 - STONE TILE |
| | C14 - ACOUSTICAL CEILING TILE |
| | SQUARE RECESSED DOWNLIGHT |
| | DECORATIVE CUSTOM CHANDELIER |
| | ROUND PENDANT LIGHT |
| | J-BX |
| | LENSED LINEAR UTILITY STRIP |
| | CONCEALED LINEAR UNDERCABINET STRIP |
| | TRACK / RAIL / LINEAR LED |
| | SURFACE-MOUNTED LIGHT BAR |
| | SURFACE MOUNT PANEL |
| | SPRINKLER |
| | SMOKE DETECTOR |
| | COMBINATION SMOKE / CARBON MONOXIDE DETECTOR |
| | FIRE ALARM SPEAKER |
| | FIRE ALARM STROBE |
| | FIRE ALARM COMBINATION SPEAKER / STROBE |
| | COMBINATION SMOKE / HEAT DETECTOR |
| | EXIT SIGN |
| | SECURITY CAMERA |
| | WIRELESS ACCESS POINT |
| | AV SPEAKER |
| | MOTORIZED SINGLE ROLLER SHADE - EQ-02.00 |
| | MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01 |
| | CEILING FAN - MECH EXHAUST |
| | MECHANICAL LINEAR GRILLE |
| | CEILING ACCESS PANEL |
| | CEILING CONTROL POINT |

109 South Jackson St. Suite 600
Seattle, Washington 98104 USA
+1 206 454 9810
olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSA C AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave., Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6940 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middletown, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
1615 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave., Suite 3200
Seattle, WA 98101

Lighting Designer
O
319 SE MLK Blvd., Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect: TK, KM
project manager: TM, JB, LB, MD
drawn by: SK, SS, JR, CP, AL
NH, EK, BD, ER

checked by: JB
job no. 2052
date 11/18/2022


revisions:

no. date by


ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER B - LVL P2
- AREA D

A6.1B.02d

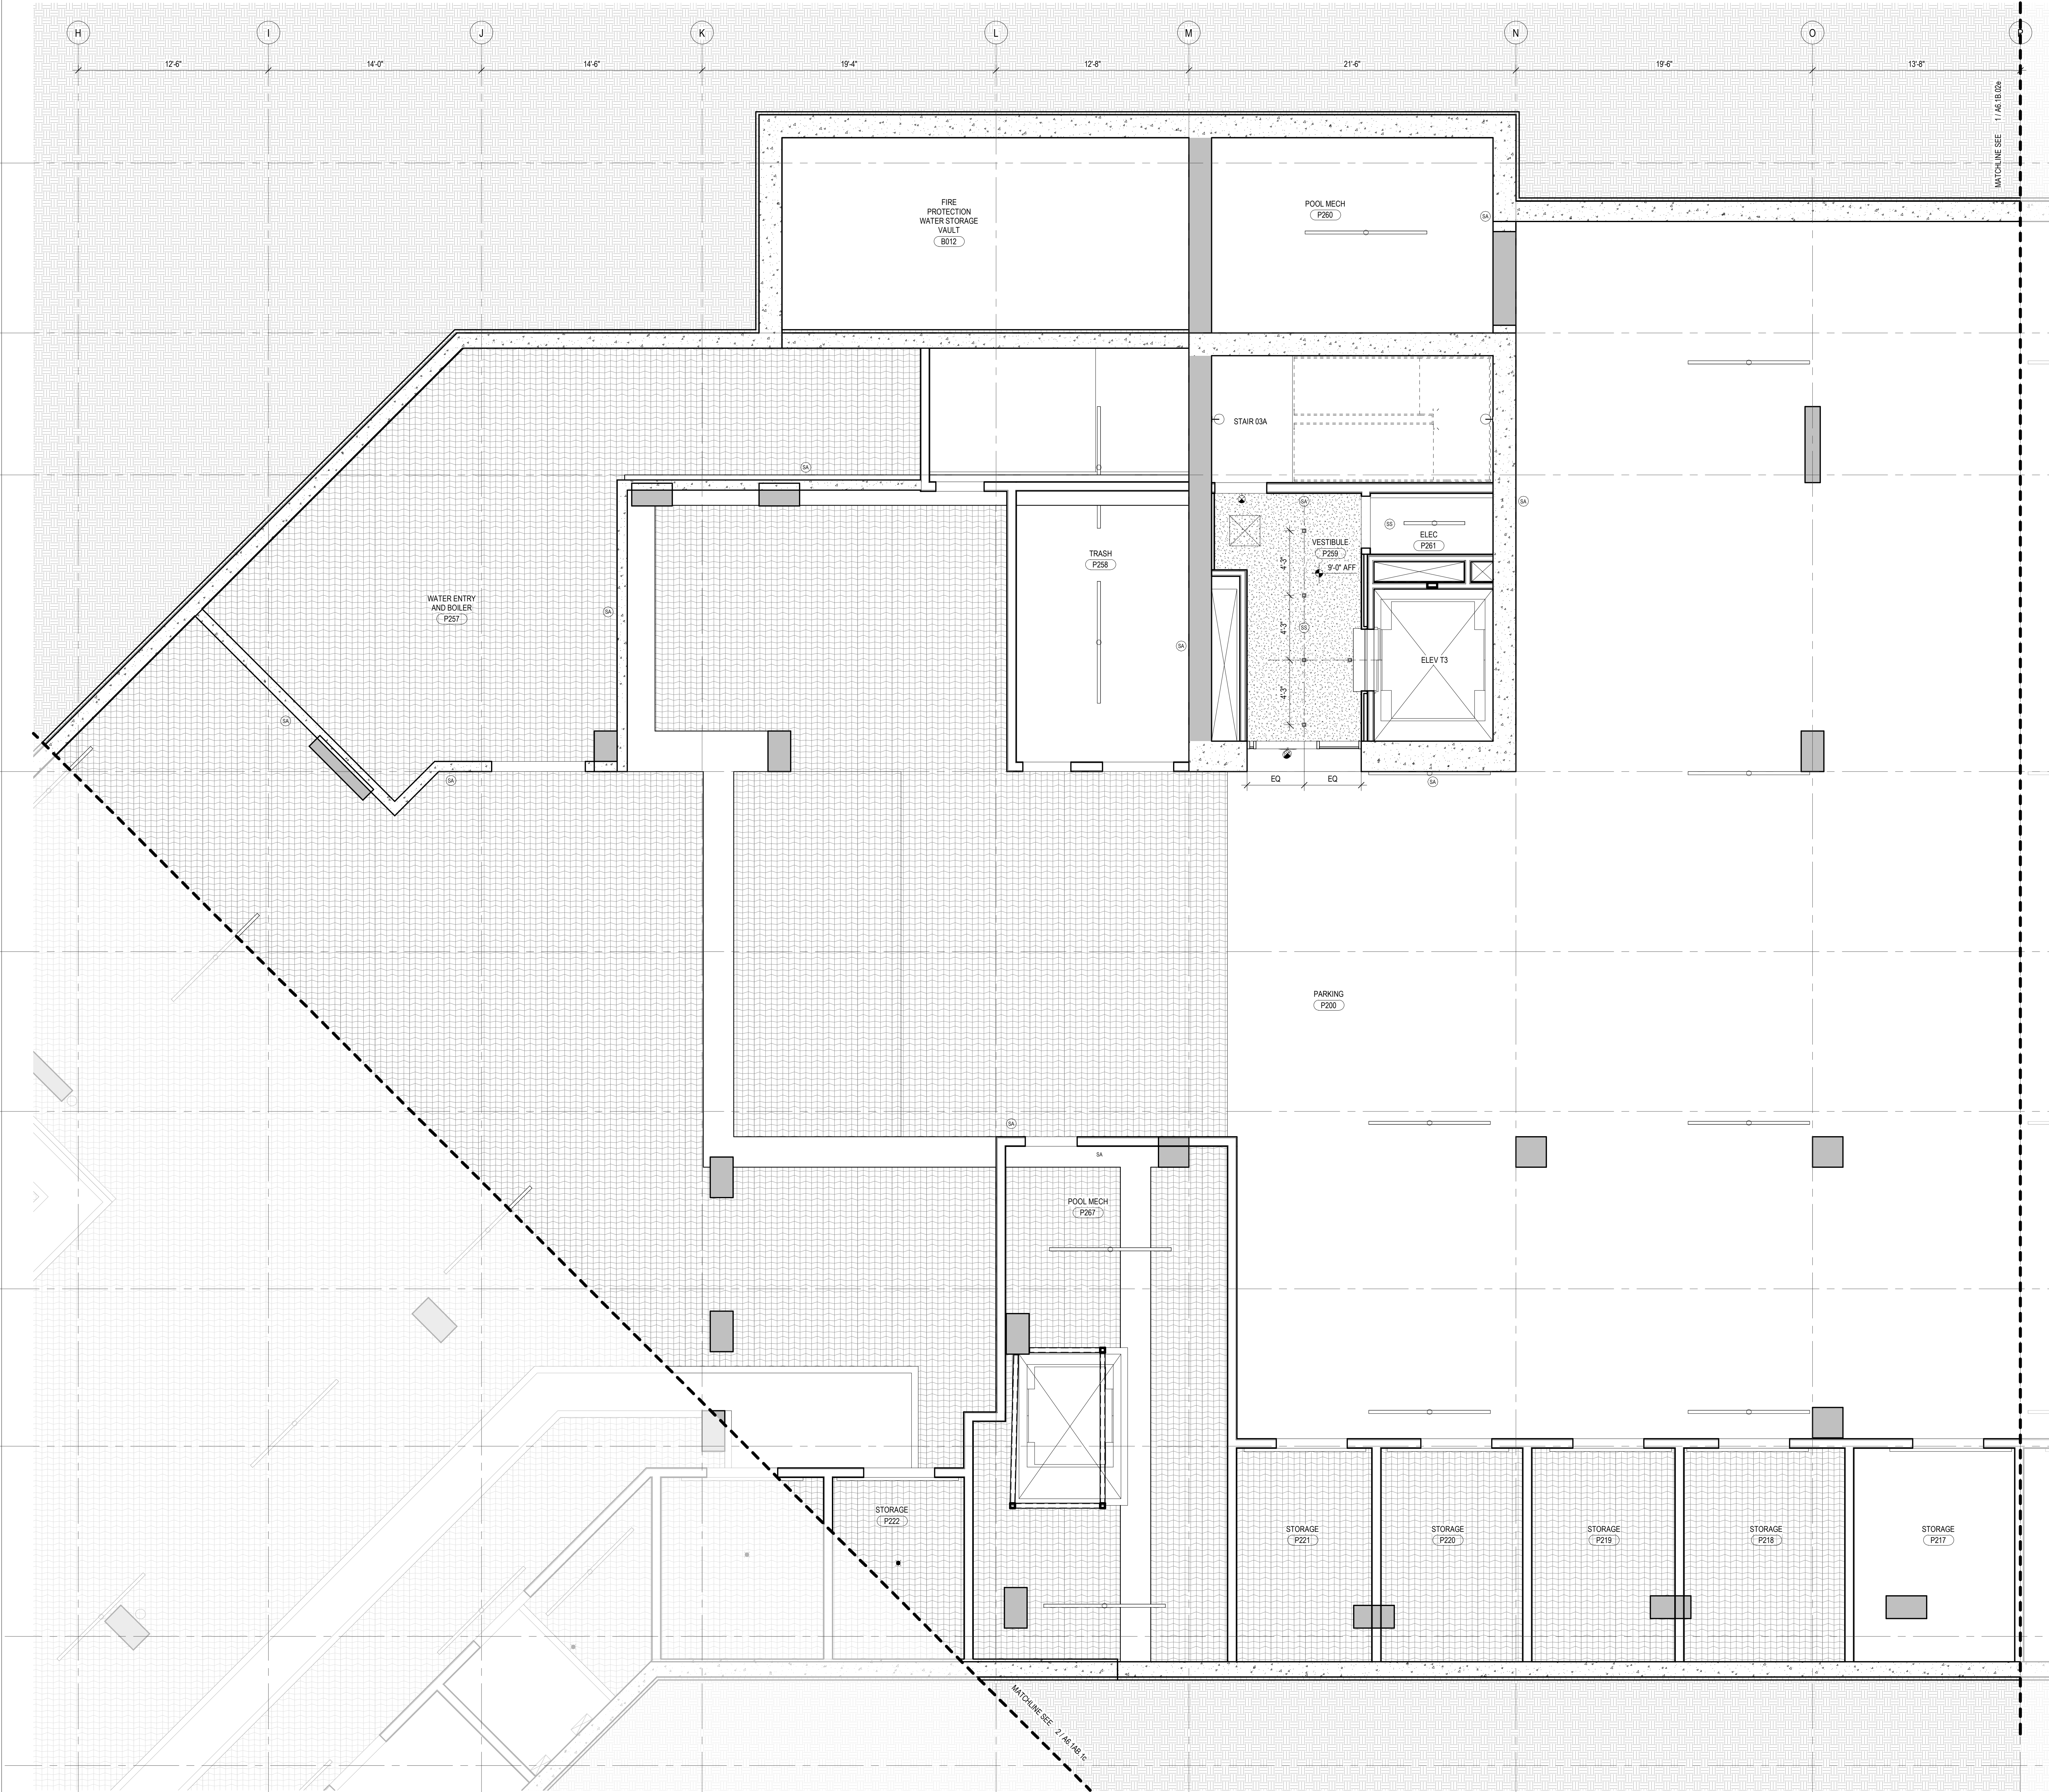

1 TOWER B LVL P2 - AREA D
SCALE: 1/4" = 1'-0"

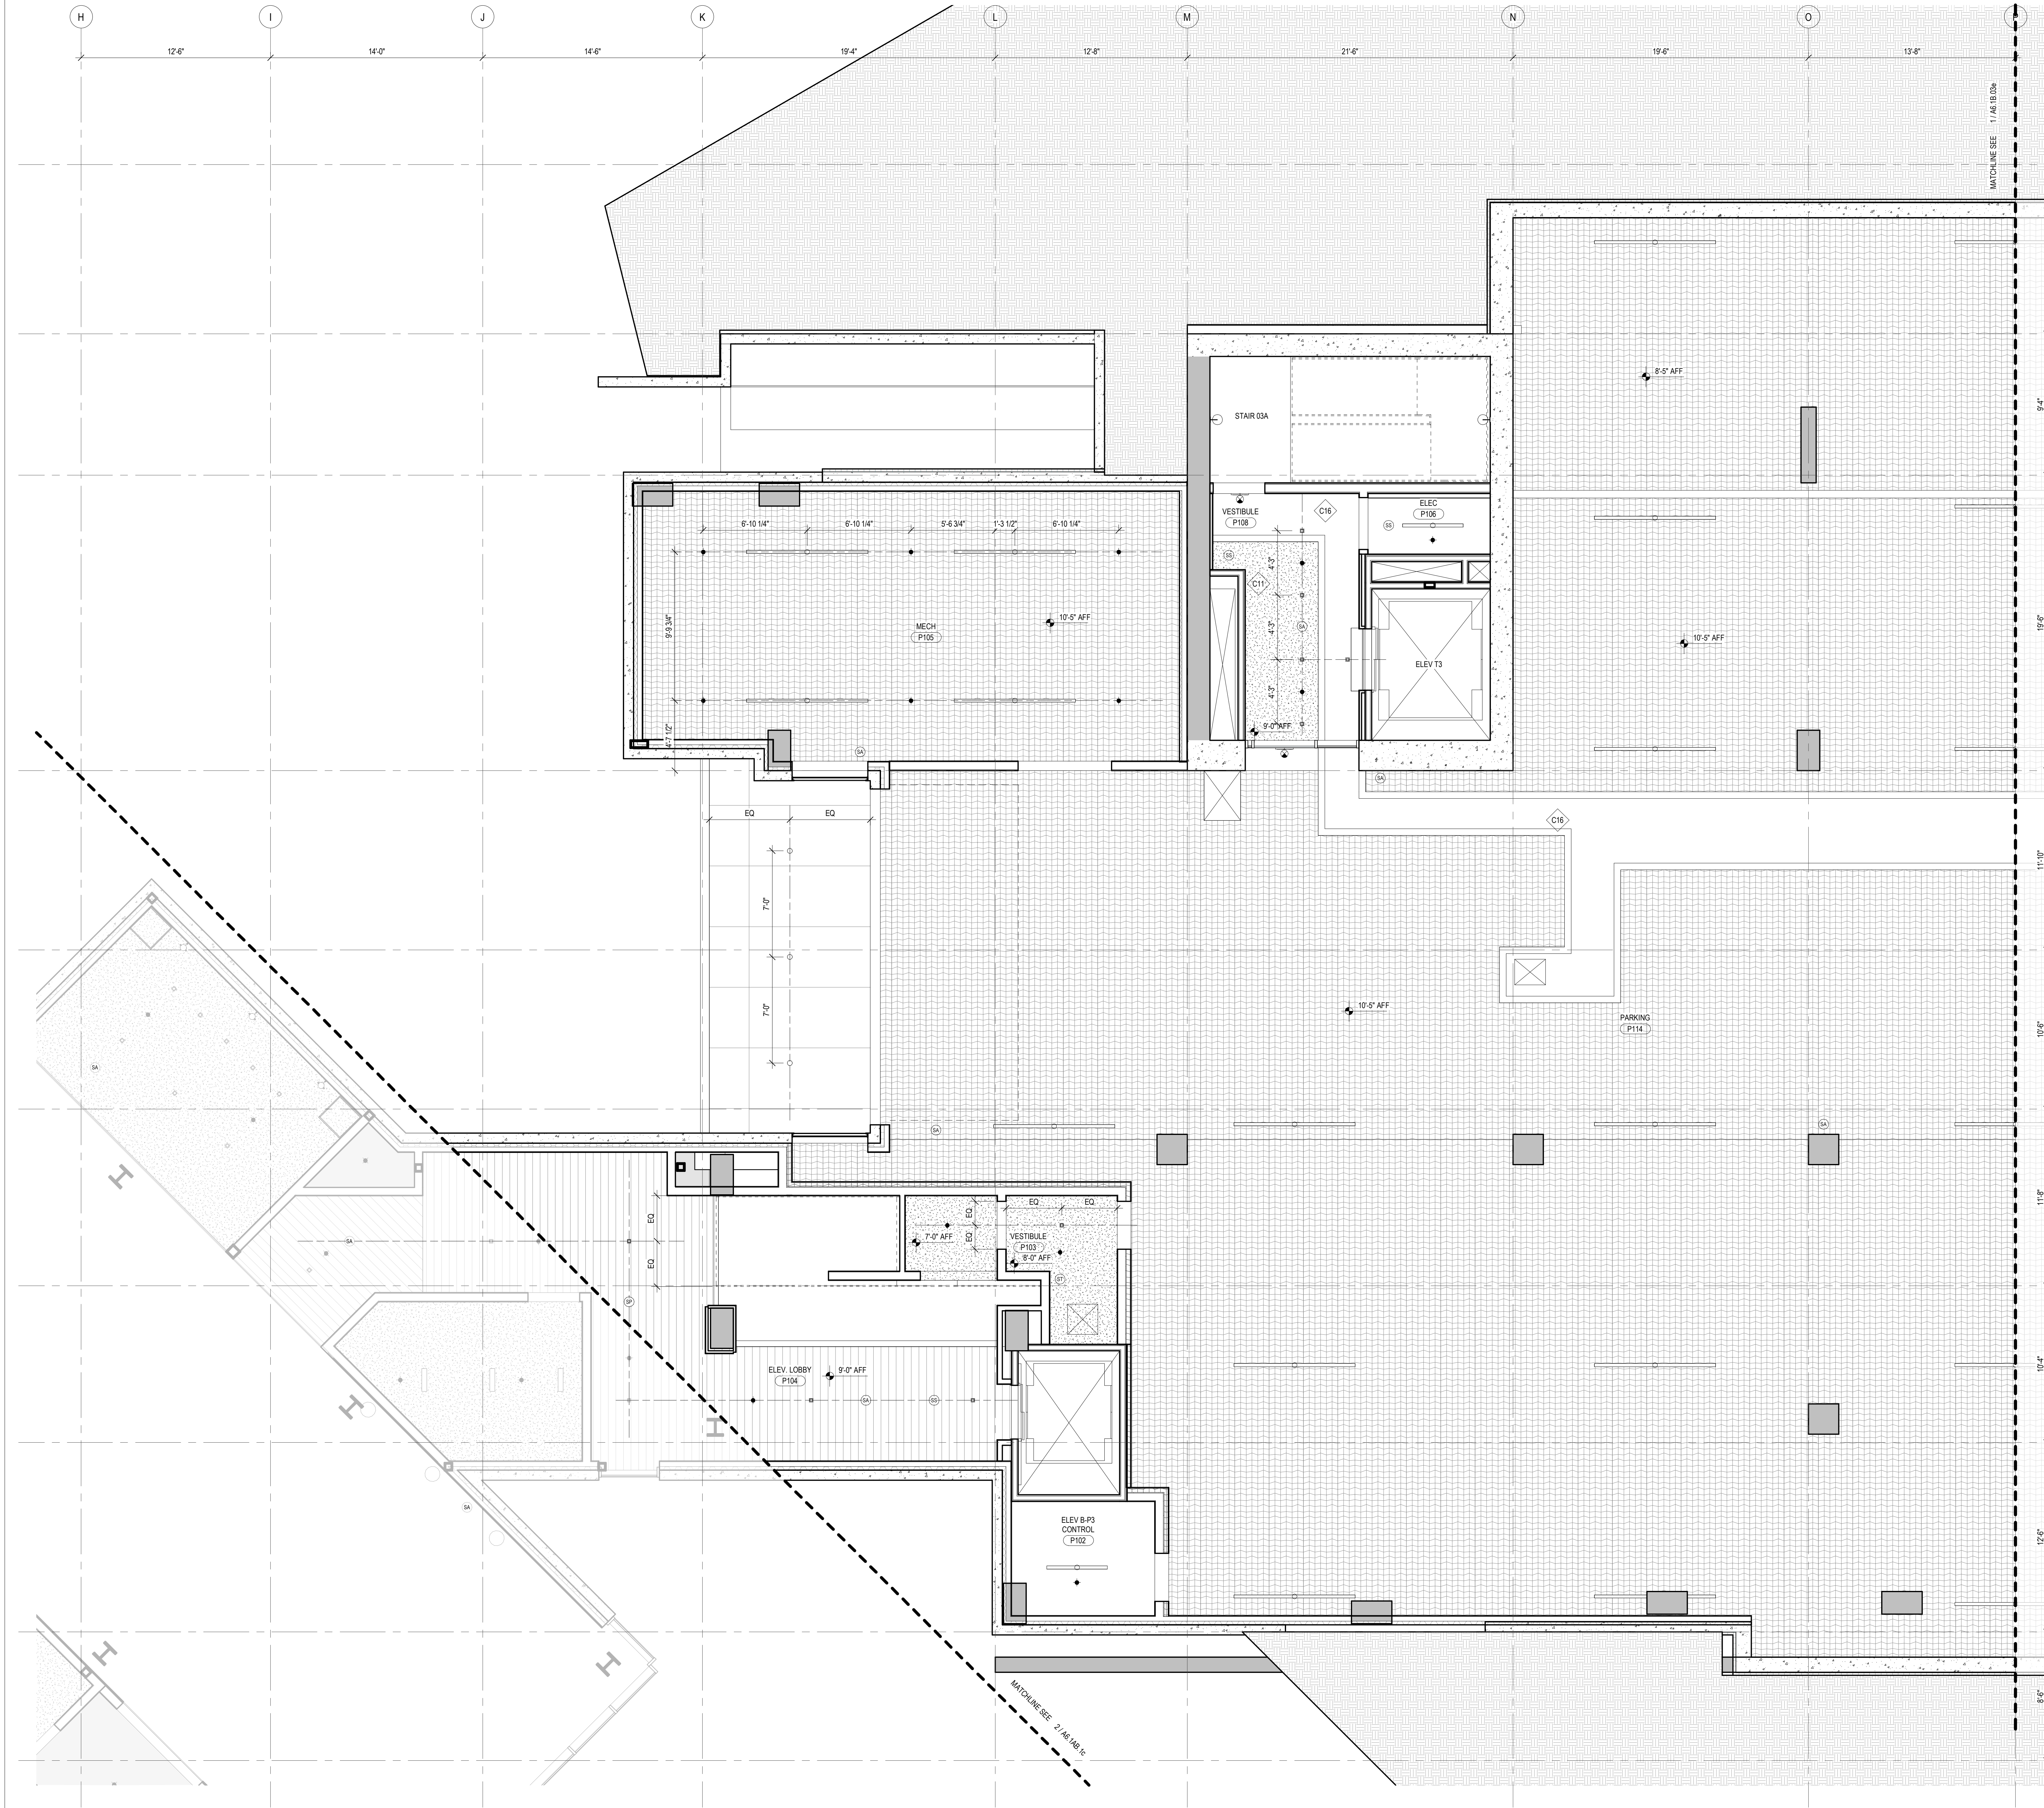

1 TOWER B LVL P1 - AREA D
SCALE: 1/4" = 1'-0"

RCP GENERAL NOTES



1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS, TYPICAL. LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.

RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- | | |
|--|------------------------------------------|
| | C10 - WOOD CEILING |
| | C11 - SUSPENDED GYPSUM WALL BOARD |
| | C12 - STONE TILE |
| | C14 - ACOUSTICAL CEILING TILE |
| | SQUARE RECESSED DOWNLIGHT |
| | DECORATIVE CUSTOM CHANDELIER |
| | ROUND PENDANT LIGHT |
| | J-BX |
| | LENSED LINEAR UTILITY STRIP |
| | CONCEALED LINEAR UNDERCABINET STRIP |
| | TRACK / RAIL / LINEAR LED |
| | SURFACE-MOUNTED LIGHT BAR |
| | SURFACE-MOUNTED PANEL |
| | SPRINKLER |
| | SS |
| | CS |
| | SP |
| | ST |
| | SA |
| | SH |
| | SH |
| | EXIT SIGN |
| | SECURITY CAMERA |
| | WAP |
| | AV SPEAKER |
| | MOTORIZED SINGLE ROLLER SHADE - EQ-02.00 |
| | MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01 |
| | CEILING FAN - MECH EXHAUST |
| | MECHANICAL LINEAR GRILLE |
| | CEILING ACCESS PANEL |
| | CCP |

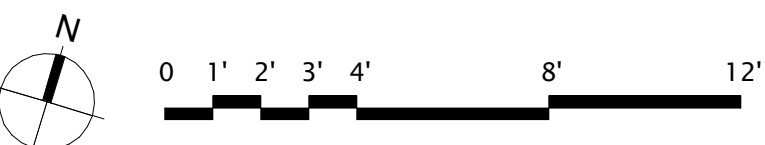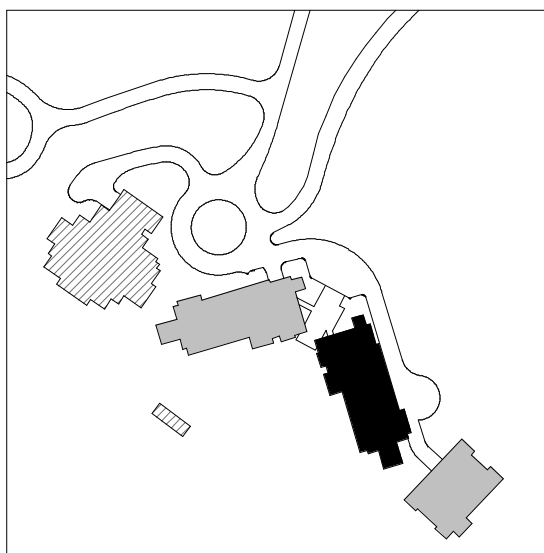

109 South Jackson St. Suite 600
Seattle, Washington 98104 USA
+1 206 454 1000 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSA C AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Howard H2O
2696 N University Ave., Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6840 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
1615 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave., Suite 3200
Seattle, WA 98101

Lighting Designer
OP
319 SE MLK Blvd., Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect: TK, KM
project manager: TM, JB, LB, MD
drawn by: SK, SS, JR, CP, AL
NR, EK, BD, ER

checked by: JB
job no.: 2052
date: 11/18/2022

revisions:

no. date by
































ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER B - LVL P1
- AREA D

A6.1B.03d


SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF UO N1
3. ALL CEILINGS ASSEMBLY C11 UO N1
4. ALL DIMENSIONS TO FACE OF FINISH UO N1
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT
OF NOT LESS THAN 7 FEET 6 INCHES FROM FINISH FLOOR TO TOP OF KITCHEN
STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN
7 FEET
7. SEE SHEET 10 AND 10.11 FOR FLOOR/CEILING ASSEMBLIES
8. PROVIDE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL
INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. PROVIDE UNMOUNTED FIRE EXTINGUISHER AREAS AND AMENITY LEVELS TO PROJECT 4"
MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE
DETECTORS. PROVIDE TYPICAL LOCATIONS TO BE DETERMINED WITH APPROVED SHOP
DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY
NOT ALIGN - ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY
13. PROVIDE CEILING DETAIL TO BE DETERMINED AT 4" DROPPED CEILINGS OR
SOFFITS WITH FASTENING AND JOINT TYPE AS REQUIRED FOR SPECIFIED RATING
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT
SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING
CHASE. PROVIDE DETAIL TO BE DETERMINED AT 4" DROPPED CEILINGS OR SOFFITS
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR
ADDITIONAL INSULATION REQUIREMENTS AT DUCTS
16. PROVIDE SLOPED DRAINAGE PARTS TO BE INSTALLED AT DAMPERS, VALVES, TELECOM ACCESS
POINTS AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO
INSTALLATION OF ANY OF THESE SYSTEMS

RCP LEGEND

	C10 - WOOD CEILING
	C11 - SUSPENDED GYPSUM WALL BOARD
	C12 - STONE TILE
	C14 - ACOUSTICAL CEILING TILE
	SQUARE RECESSED DOWNLIGHT
	DECORATIVE SCONCE
	DECORATIVE CUSTOM CHANDELIER
	ROUND PENDANT LIGHT
	J-BOX
	LENSED LINEAR UTILITY STRIP
	CONCEALED LINEAR UNDERCABINET STRIP
	TRACK / RAIL / LINEAR LED
	SURFACE-MOUNTED LIGHT BAR
	SURFACE MOUNT PANEL
	SPRINKLER
	SMOKE DETECTOR
	COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
	FIRE ALARM SPEAKER
	FIRE ALARM STROBE
	FIRE ALARM COMBINATION SPEAKER / STROBE
	COMBINATION SMOKE / HEAT DETECTOR
	EXIT SIGN
	SECURITY CAMERA
	WIRELESS ACCESS POINT
	AV SPEAKER
	MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
	MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
	CEILING FAN - MESH EXHAUST
	MECHANICAL LINEAR GRILLE
	CEILING ACCESS PANEL
	CEILING CONTROL POINT

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060

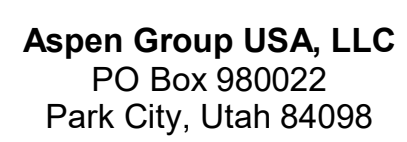

0000, 1994, 2004

25



Revisions:

no.	date	by
1	1970	
2	1971	
3	1972	
4	1973	
5	1974	
6	1975	
7	1976	
8	1977	
9	1978	
10	1979	
11	1980	
12	1981	
13	1982	
14	1983	
15	1984	
16	1985	
17	1986	
18	1987	
19	1988	
20	1989	
21	1990	
22	1991	
23	1992	
24	1993	
25	1994	
26	1995	
27	1996	
28	1997	
29	1998	
30	1999	
31	2000	
32	2001	
33	2002	
34	2003	
35	2004	
36	2005	
37	2006	
38	2007	
39	2008	
40	2009	
41	2010	
42	2011	
43	2012	
44	2013	
45	2014	
46	2015	
47	2016	
48	2017	
49	2018	
50	2019	
51	2020	
52	2021	
53	2022	
54	2023	
55	2024	
56	2025	
57	2026	
58	2027	
59	2028	
60	2029	
61	2030	
62	2031	
63	2032	
64	2033	
65	2034	
66	2035	
67	2036	
68	2037	
69	2038	
70	2039	
71	2040	
72	2041	
73	2042	
74	2043	
75	2044	
76	2045	
77	2046	
78	2047	
79	2048	
80	2049	
81	2050	
82	2051	
83	2052	
84	2053	
85	2054	
86	2055	
87	2056	
88	2057	
89	2058	
90	2059	
91	2060	
92	2061	
93	2062	
94	2063	
95	2064	
96	2065	
97	2066	
98	2067	
99	2068	
100	2069	
101	2070	
102	2071	
103	2072	
104	2073	
105	2074	
106	2075	
107	2076	
108	2077	
109	2078	
110	2079	
111	2080	
112	2081	
113	2082	
114	2083	
115	2084	
116	2085	
117	2086	
118	2087	
119	2088	
120	2089	
121	2090	
122	2091	
123	2092	
124	2093	
125	2094	
126	2095	
127	2096	
128	2097	
129	2098	
130	2099	
131	2100	
132	2101	
133	2102	
134	2103	
1		

ISSUED FOR
CONSTRUCTION
11/18/2022

CP - TOWER B - LVL P1
AREA F

A6.1B.03e

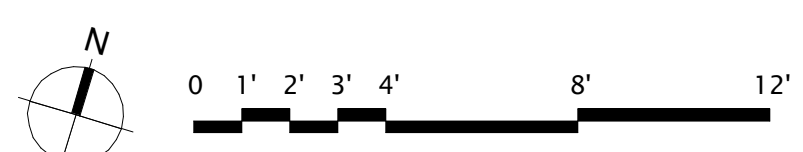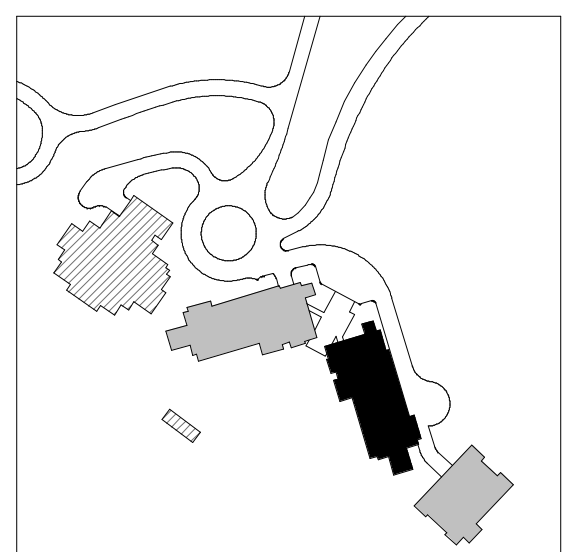

1. SPOT LEVELINGS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. USE CONCRETE PLANS TO DETERMINE LOCATION OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 8'-0" AFF U.N.O.
7. STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7'-0" AFF U.N.O.
8. USE SHEET 40.1 AND 41.1 FOR FLOOR/CEILING ASSEMBLIES
9. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RP DRAWINGS
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS
10. ALL WALLS MOUNTED FOR EXTINGUISHERS SHALL BE MOUNTED AT LEVELS TO PROTECT THE EXTINGUISHER FROM WALLS. FACE OR BE 8"-6" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF
11. SMOKE DETECTORS SHALL BE SPACED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS SHALL BE DETERMINED WITH APPROVED SHOP DRAWINGS.
13. DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR BEARS IN WALLS WITH FASTENERS TO BE SHOWN AND SPECIFIED RATED
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/PURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING
15. PROVIDE A DETAIL TO COVER ALL WALL CAVITIES TO BE DETERMINED WITH APPROVED SHOP DRAWINGS
16. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
17. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS WITH MECHANICAL INSTALLATION OF ANY OF THESE SYSTEMS

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

	C10 - WOOD CEILING
	C11 - SUSPENDED GYPSUM WALL BOARD
	C12 - STONE TILE
	C14 - ACOUSTICAL CEILING TILE
	SQUARE RECESSED DOWNLIGHT
	DECORATIVE SCONCE
	DECORATIVE CUSTOM CHANDELIER
	ROUND PENDANT LIGHT
	J-BOX
	LENSSED LINEAR UTILITY STRIP
	CONCEALED LINEAR UNDERCABINET STRIP
	TRACK / RAIL / LINEAR LED
	SURFACE-MOUNTED LIGHT BAR
	SURFACE MOUNT PANEL
	SPRINKLER
	SMOKE DETECTOR
	COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
	FIRE ALARM SPEAKER
	FIRE ALARM STROBE
	FIRE ALARM COMBINATION SPEAKER / STROBE
	COMBINATION SMOKE / HEAT DETECTOR
	EXIT SIGN
	SECURITY CAMERA
	WIRELESS ACCESS POINT
	AV SPEAKER
	MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
	MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
	CEILING FAN - MECH EXHAUST
	MECHANICAL LINEAR GRILLE
	CEILING ACCESS PANEL
	CEILING CONTROL POINT

159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 elconkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H20
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Write
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 3
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O.
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, A NH, EK, BD, ER

checked by	JB
job no.	20062
date	11/18/2022


revisions:

no.	date	by
-----	------	----


ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER B - LVL 1 -
AREA D

A6.1B.11d

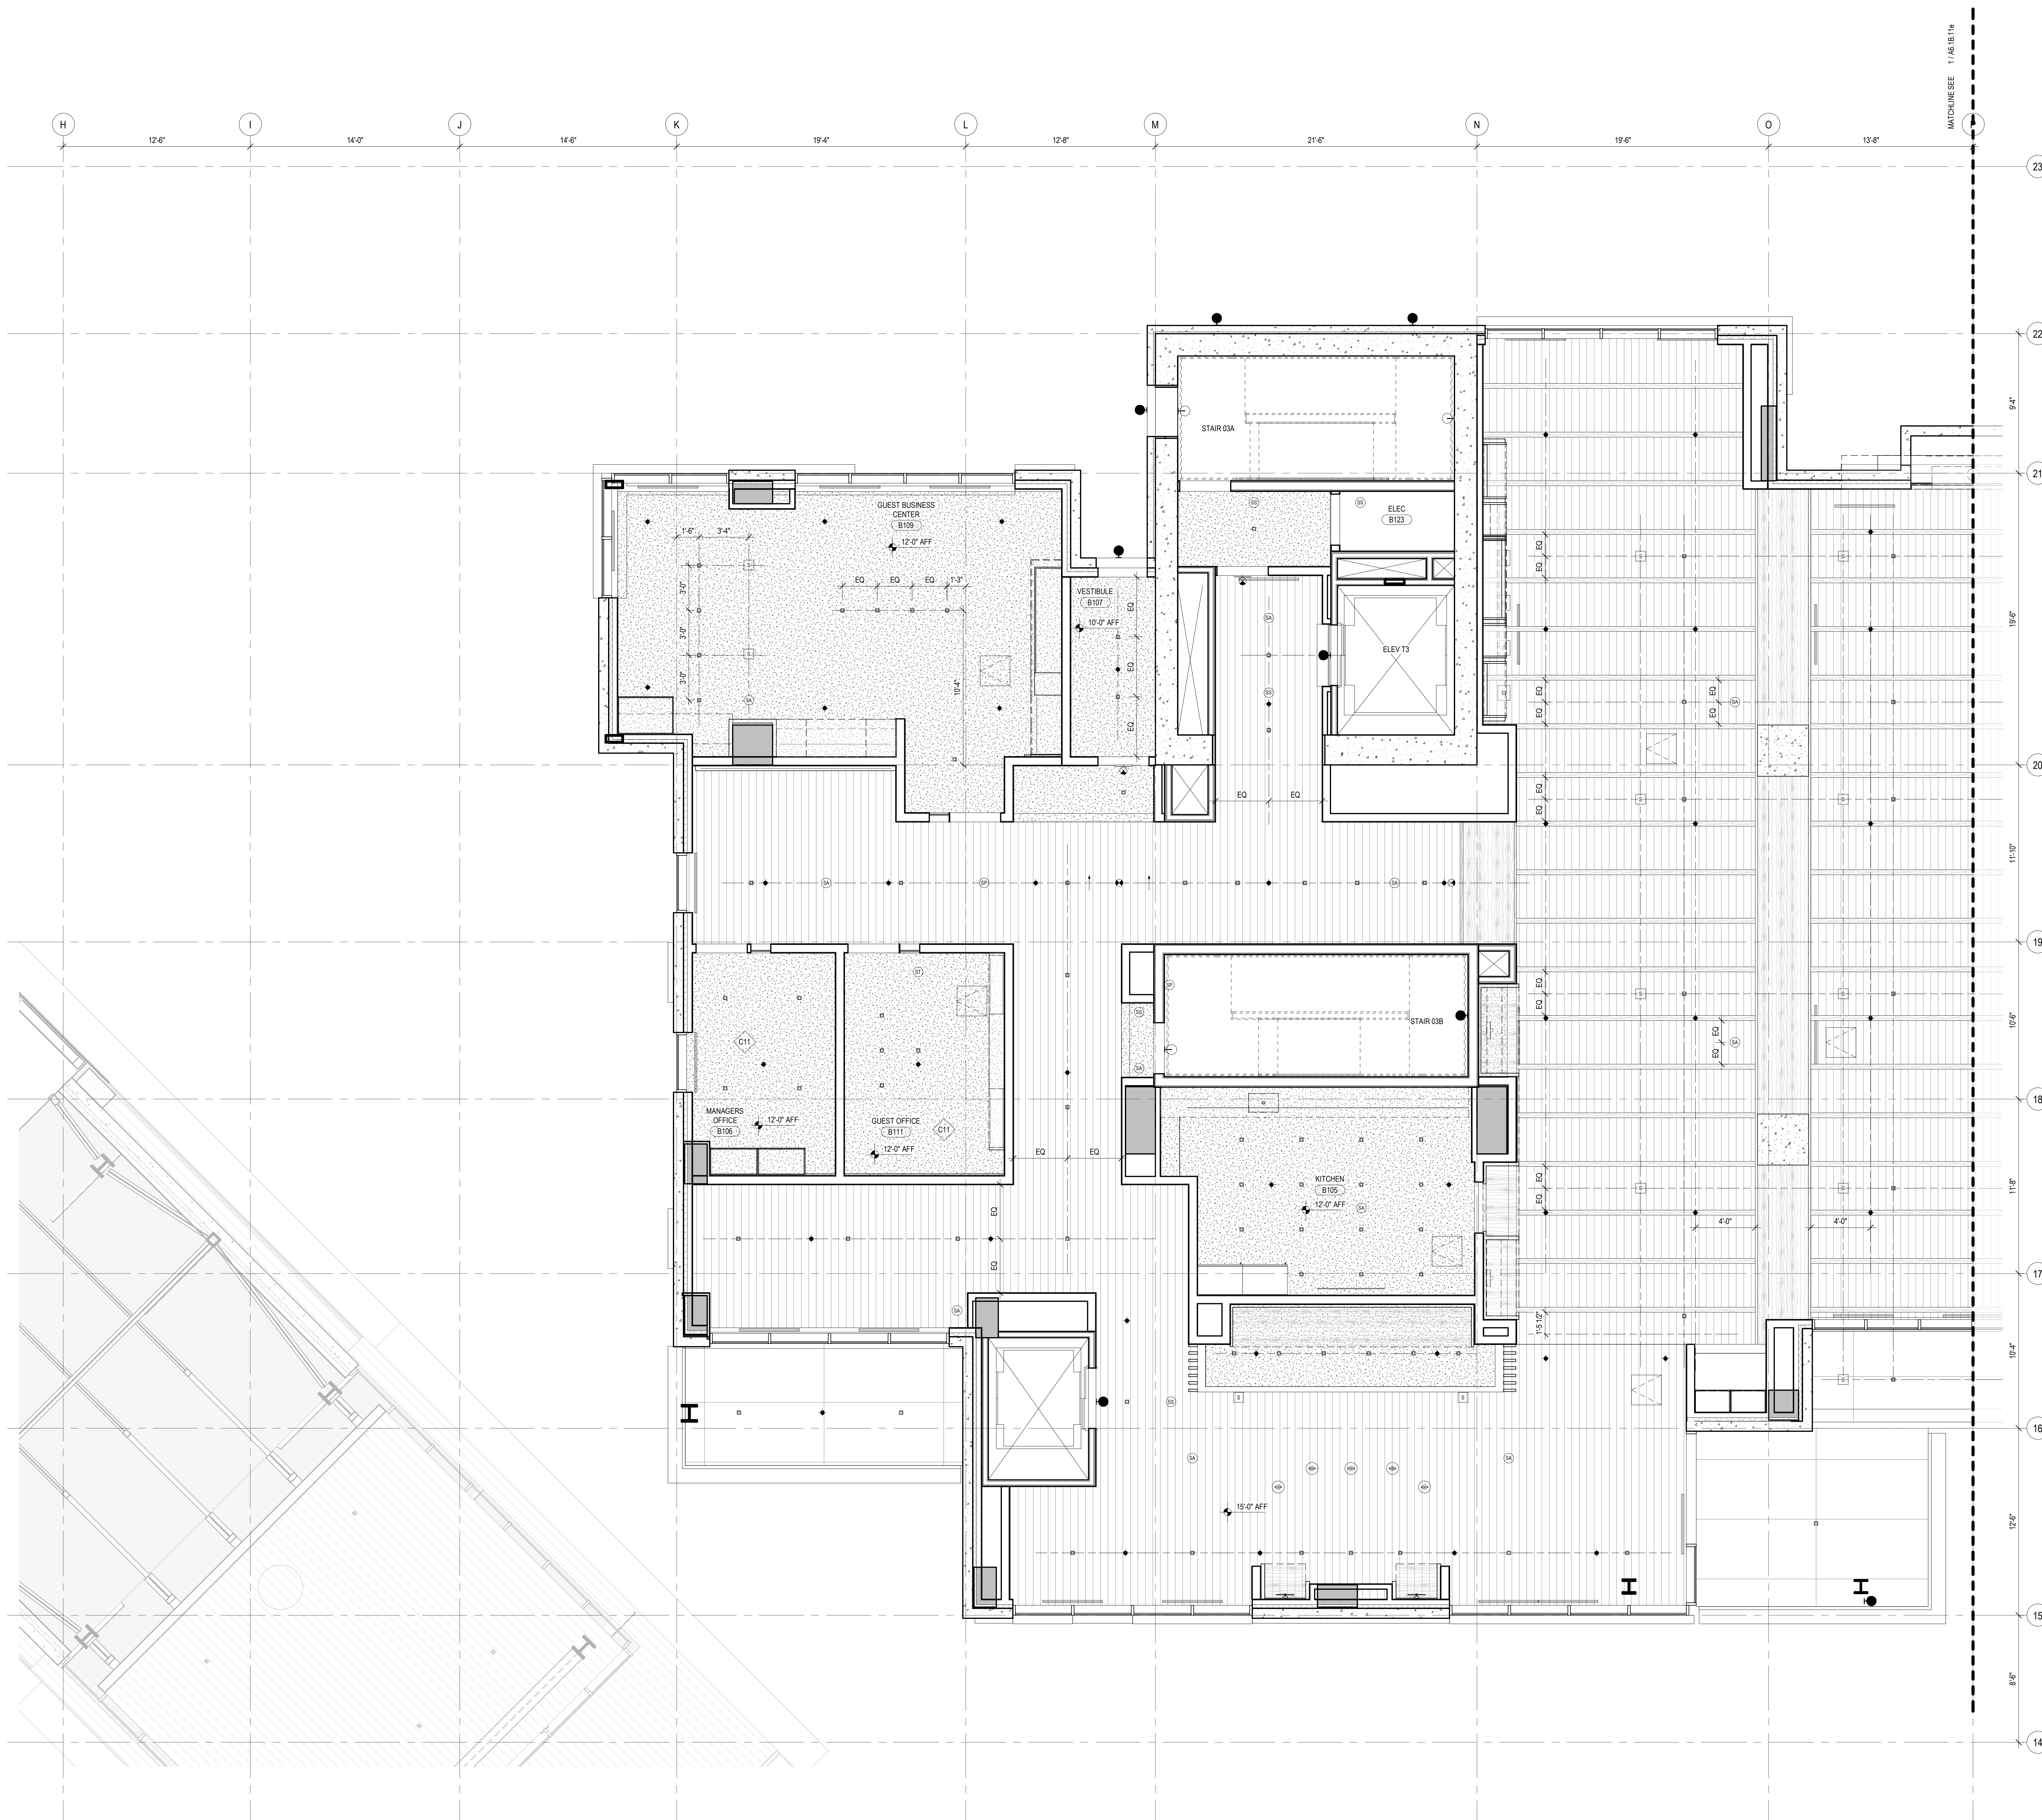

1 TOWER B LVL 1 - AREA D
SCALE: 1/4" = 1'-0"

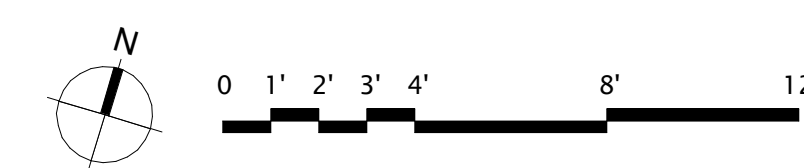

2. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
3. ALL CEILINGS 9'-0" AFF U/N O
4. ALL CEILINGS ASSEMBLY CH1 U/N O
5. ALL DIMENSIONS TO FACE OF FINISH U/N O
6. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
7. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF 8'0" TO 8'6" MINIMUM TO FACE OF FINISH U/N O
8. MECHANICAL ROOMS, ELECTRICAL ROOMS, TELECOM ROOMS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF A CEILING LESS THAN 7 FEET
9. SEE SHEET A0.10 AND A0.11 FOR FLOORCEILING ASSEMBLIES
10. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING FIXTURES, ROUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
11. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS
12. REFER TO MECHANICAL FOR SMOKE DETECTOR TYPE AND FOR LOCATIONS
13. MAXIMUM FLOOR/WALL FALL OR BE 8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF
14. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS
15. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS SHALL BE 10'-0" MAXIMUM TO FACE OF FINISH U/N O
16. SEE MECHANICAL DRAWINGS FOR PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
17. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR CHASES/CHASSED ROOFS WITH FACED EDGES TO MATCH THE DROPPED CEILING SPECIFIED RATING
18. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/SURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOORCEILING CAVITY
19. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS
20. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- C10 - WOOD CEILING

C11 - SUSPENDED GYPSUM WALL BOARD

C12 - STONE TILE

C14 - ACOUSTICAL CEILING TILE

SQUARE RECESSED DOWNLIGHT

DECORATIVE SCOSCE

DECORATIVE CUSTOM CHANDELIER

ROUND PENDANT LIGHT

J BOX

LENSED LINEAR UTILITY STRIP

CONCEALED LINEAR UNDERCABINET STRIP

TRACK / RAIL / LINEAR LED

SURFACE-MOUNTED LIGHT BAR

SURFACE MOUNT PANEL

SPRINKLER

SMOKE DETECTOR

COMBINATION SMOKE / CARBON MONOXIDE DETECTOR

FIRE ALARM SPEAKER

FIRE ALARM STROBE

FIRE ALARM COMBINATION SPEAKER / STROBE

COMBINATION SMOKE / HEAT DETECTOR

EXIT SIGN

SECURITY CAMERA

WIRELESS ACCESS POINT

AV SPEAKER

MOTORIZED SINGLE ROLLER SHADE - EQ-02-00

MOTORIZED DOUBLE ROLLER SHADE - EQ-02-01

CEILING FAN - MECH EXHAUST

MECHANICAL LINEAR GRILLE

CEILING ACCESS PANEL

CEILING CONTROL POINT

159 South Jackson St, Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkunding.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H20
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, A

checked by JB
job no. 20052

revisions:



no.	date	by
-----	------	----

ISSUED FOR
CONSTRUCTION

11/18/2022

RCP - TOWER B - LVL 1















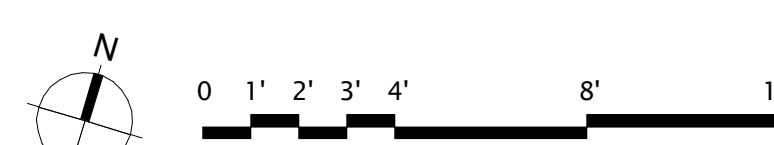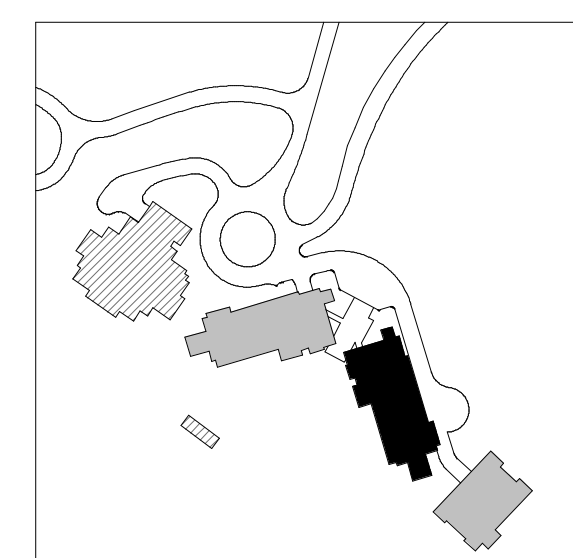
















A6.1B.11e








1. SPOT LIGHTINGS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTH POSITION OF FINISH FLOOR AND CEILING 9'-0" AFF. U.O.
2. ALL CEILINGS ASSUMED TO BE 9'-0" U.O.
3. ALL CEILINGS ASSUMED TO BE 9'-0" U.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT NOT LESS THAN 8'-0" ABOVE FINISH FLOOR LEVEL. KITCHENS, BATHS, BEDROOMS, HALLS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7'-0" FEET.
7. SEE SHEET 40.0 AND 40.1 FOR FLOOR/CEILING ASSEMBLIES.
8. PROVIDE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. PROVIDE DETAIL FOR ALL LIGHT FIXTURES. ALL LIGHTS SHALL BE DETERMINED TO PROJECT A MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. PROVIDE SMOKE DETECTOR LOCATIONS TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. PROVIDE DETAIL FOR ALL LIGHT FIXTURES. ALL LIGHTS SHALL BE DETERMINED TO PROJECT A MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF. OFFSETS WITH FASTENING AND JOINT TAP AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING.
15. PROVIDE DETAIL FOR ALL LIGHT FIXTURES. ALL LIGHTS SHALL BE DETERMINED TO PROJECT A MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
16. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
17. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS PANELS AND SUMP MECHANICAL ACCESS PANELS. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

-  C10 - WOOD CEILING
-  C11 - SUSPENDED GYPSUM WALL BOARD
-  C12 - STONE TILE
-  C14 - ACOUSTICAL CEILING TILE
-  SQUARE RECESSED DOWNLIGHT
-  DECORATIVE SCONCE
-  DECORATIVE CUSTOM CHANDELIER
-  ROUND PENDANT LIGHT
-  J-BOX
-  LENSED LINEAR UTILITY STRIP
-  CONCEALED LINEAR UNDERCABINET STRIP
-  TRACK / RAIL / LINEAR LED
-  SURFACE MOUNTED LIGHT BAR
-  SURFACE MOUNT PANEL
-  SPRINKLER
-  SMOKE DETECTOR
-  COMBINATION SMOKE / CARBON MONOXIDE DETECTOR
-  FIRE ALARM SPEAKER
-  FIRE ALARM STROBE
-  FIRE ALARM COMBINATION SPEAKER / STROBE
-  COMBINATION SMOKE / HEAT DETECTOR
-  EXIT SIGN
-  SECURITY CAMERA
-  WIRELESS ACCESS POINT
-  AV SPEAKER
-  MOTORIZED SINGLE ROLLER SHADE - EQ-02.00
-  MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01
-  CEILING FAN - MECH EXHAUST
-  MECHANICAL LINEAR GRILLE
-  CEILING ACCESS PANEL
-  CEILING CONTROL POINT

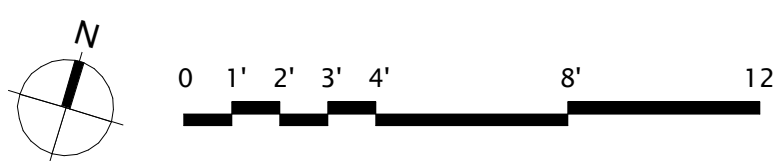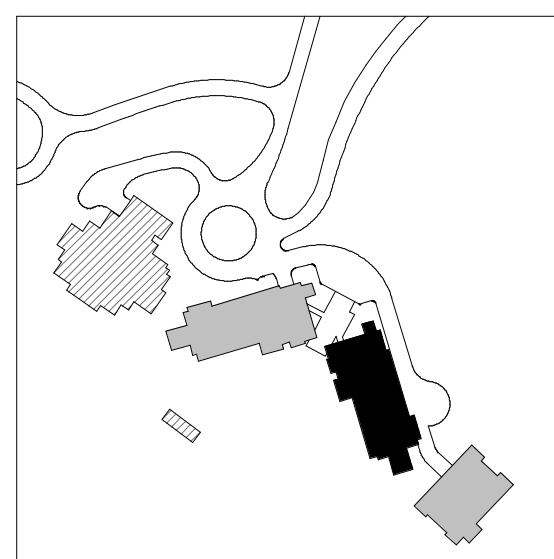

159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, A NH, EK, BD, EB

checked by JB
job no. 20062
date 11/18/2022

revisions:

no.	date	by
-----	------	----

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER B - CORE
3

A6.1B.23

RCP GENERAL NOTES





1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH
2. ALL CEILINGS 9'-0" AFF U.N.O.
3. ALL CEILINGS ASSEMBLY C11 U.N.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPIABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES.
8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. TYPICAL LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.

RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

- | | |
|--|----------------------------------------------|
| | C10 - WOOD CEILING |
| | C11 - SUSPENDED GYPSUM WALL BOARD |
| | C12 - STONE TILE |
| | C14 - ACOUSTICAL CEILING TILE |
| | SQUARE RECESSED DOWNLIGHT |
| | DECORATIVE CUSTOM CHANDELIER |
| | ROUND PENDANT LIGHT |
| | J-BOX |
| | LENSED LINEAR UTILITY STRIP |
| | CONCEALED LINEAR UNDERCABINET STRIP |
| | TRACK / RAIL / LINEAR LED |
| | SURFACE-MOUNTED LIGHT BAR |
| | SURFACE MOUNT PANEL |
| | SPRINKLER |
| | SMOKE DETECTOR |
| | COMBINATION SMOKE / CARBON MONOXIDE DETECTOR |
| | FIRE ALARM SPEAKER |
| | FIRE ALARM STROBE |
| | FIRE ALARM COMBINATION SPEAKER / STROBE |
| | COMBINATION SMOKE / HEAT DETECTOR |
| | EXIT SIGN |
| | SECURITY CAMERA |
| | WIRELESS ACCESS POINT |
| | AV SPEAKER |
| | MOTORIZED SINGLE ROLLER SHADE - EQ-02.00 |
| | MOTORIZED DOUBLE ROLLER SHADE - EQ-02.01 |
| | CEILING FAN - MECH EXHAUST |
| | MECHANICAL LINEAR GRILLE |
| | CEILING ACCESS PANEL |
| | CEILING CONTROL POINT |

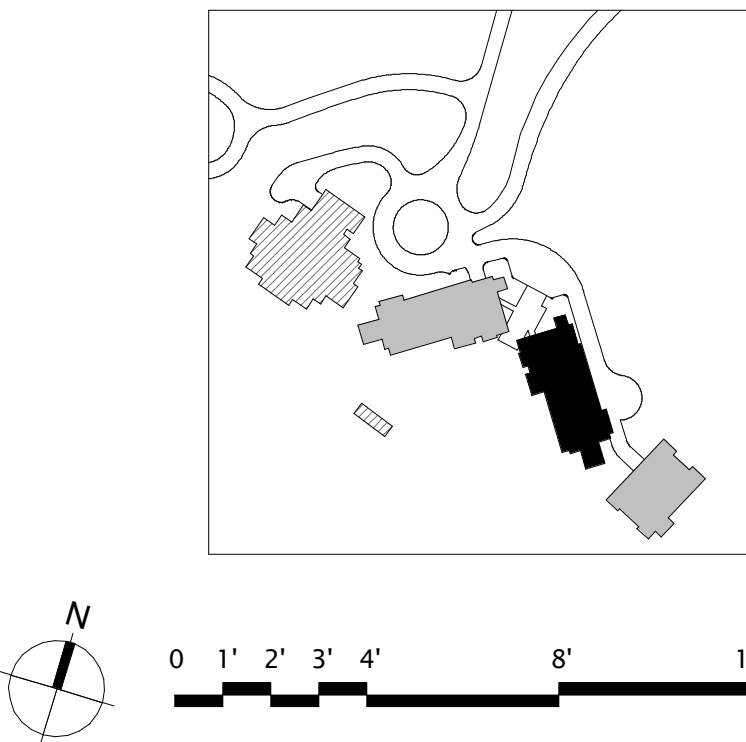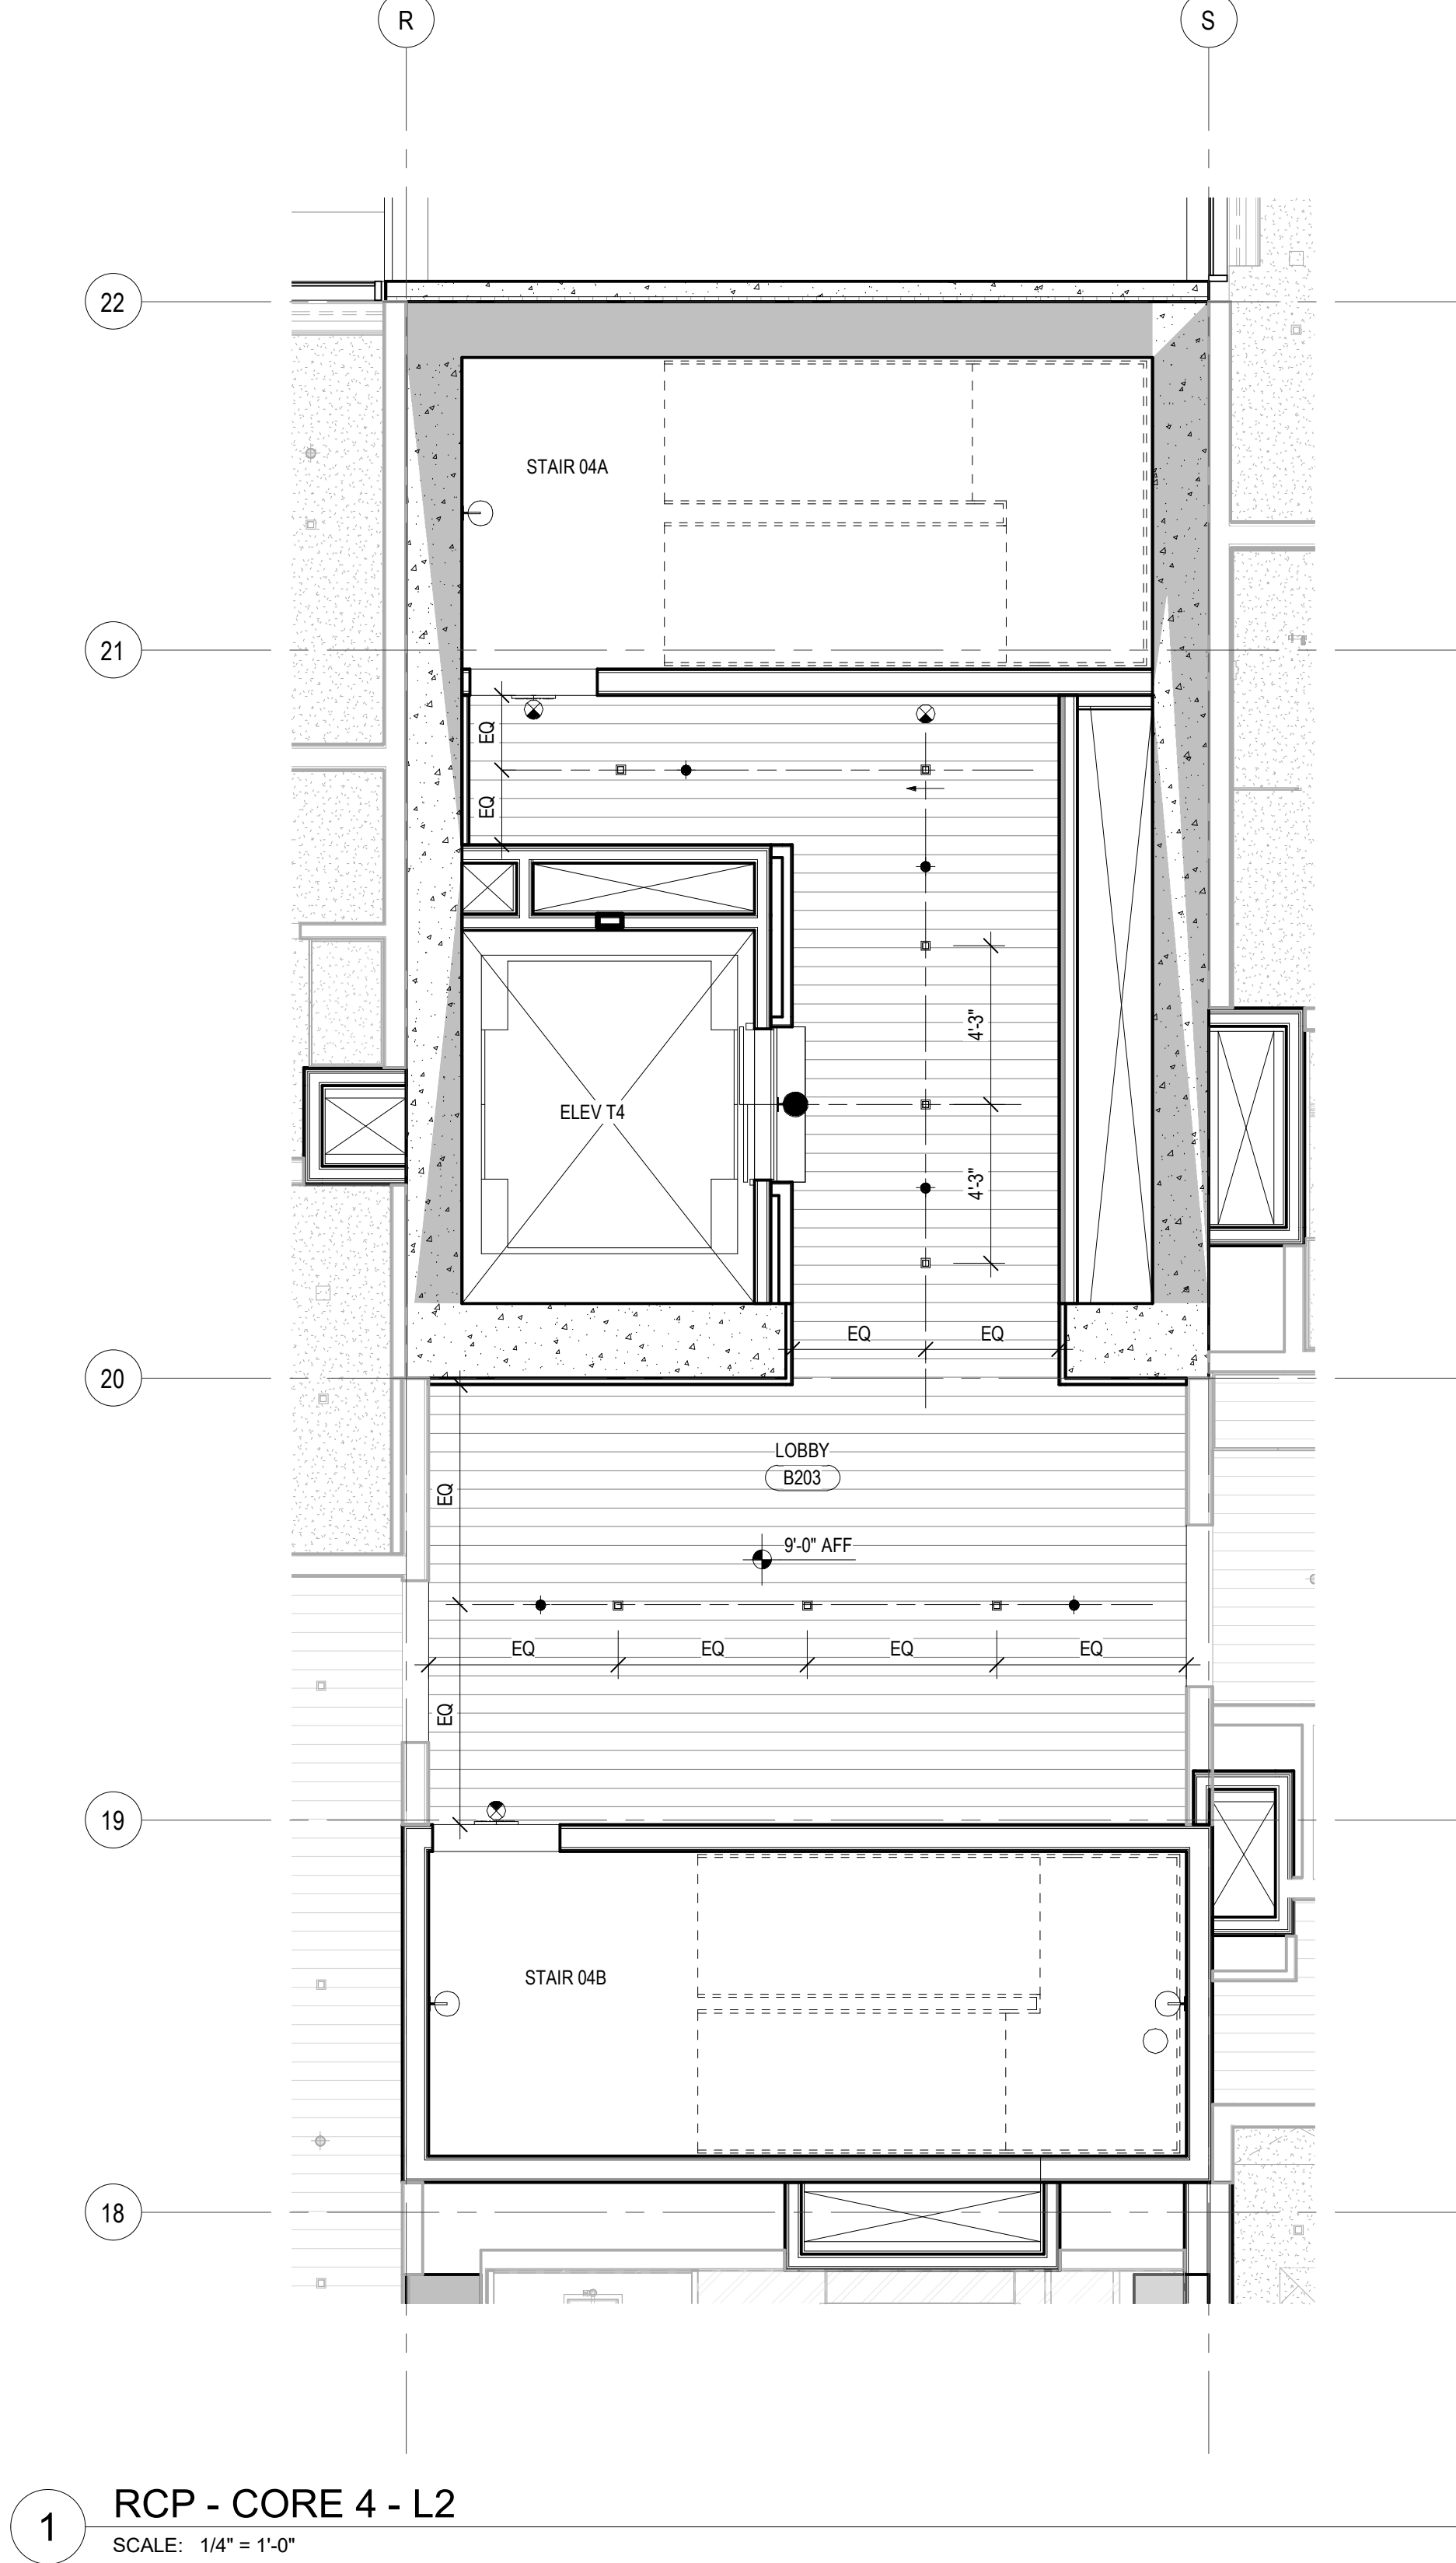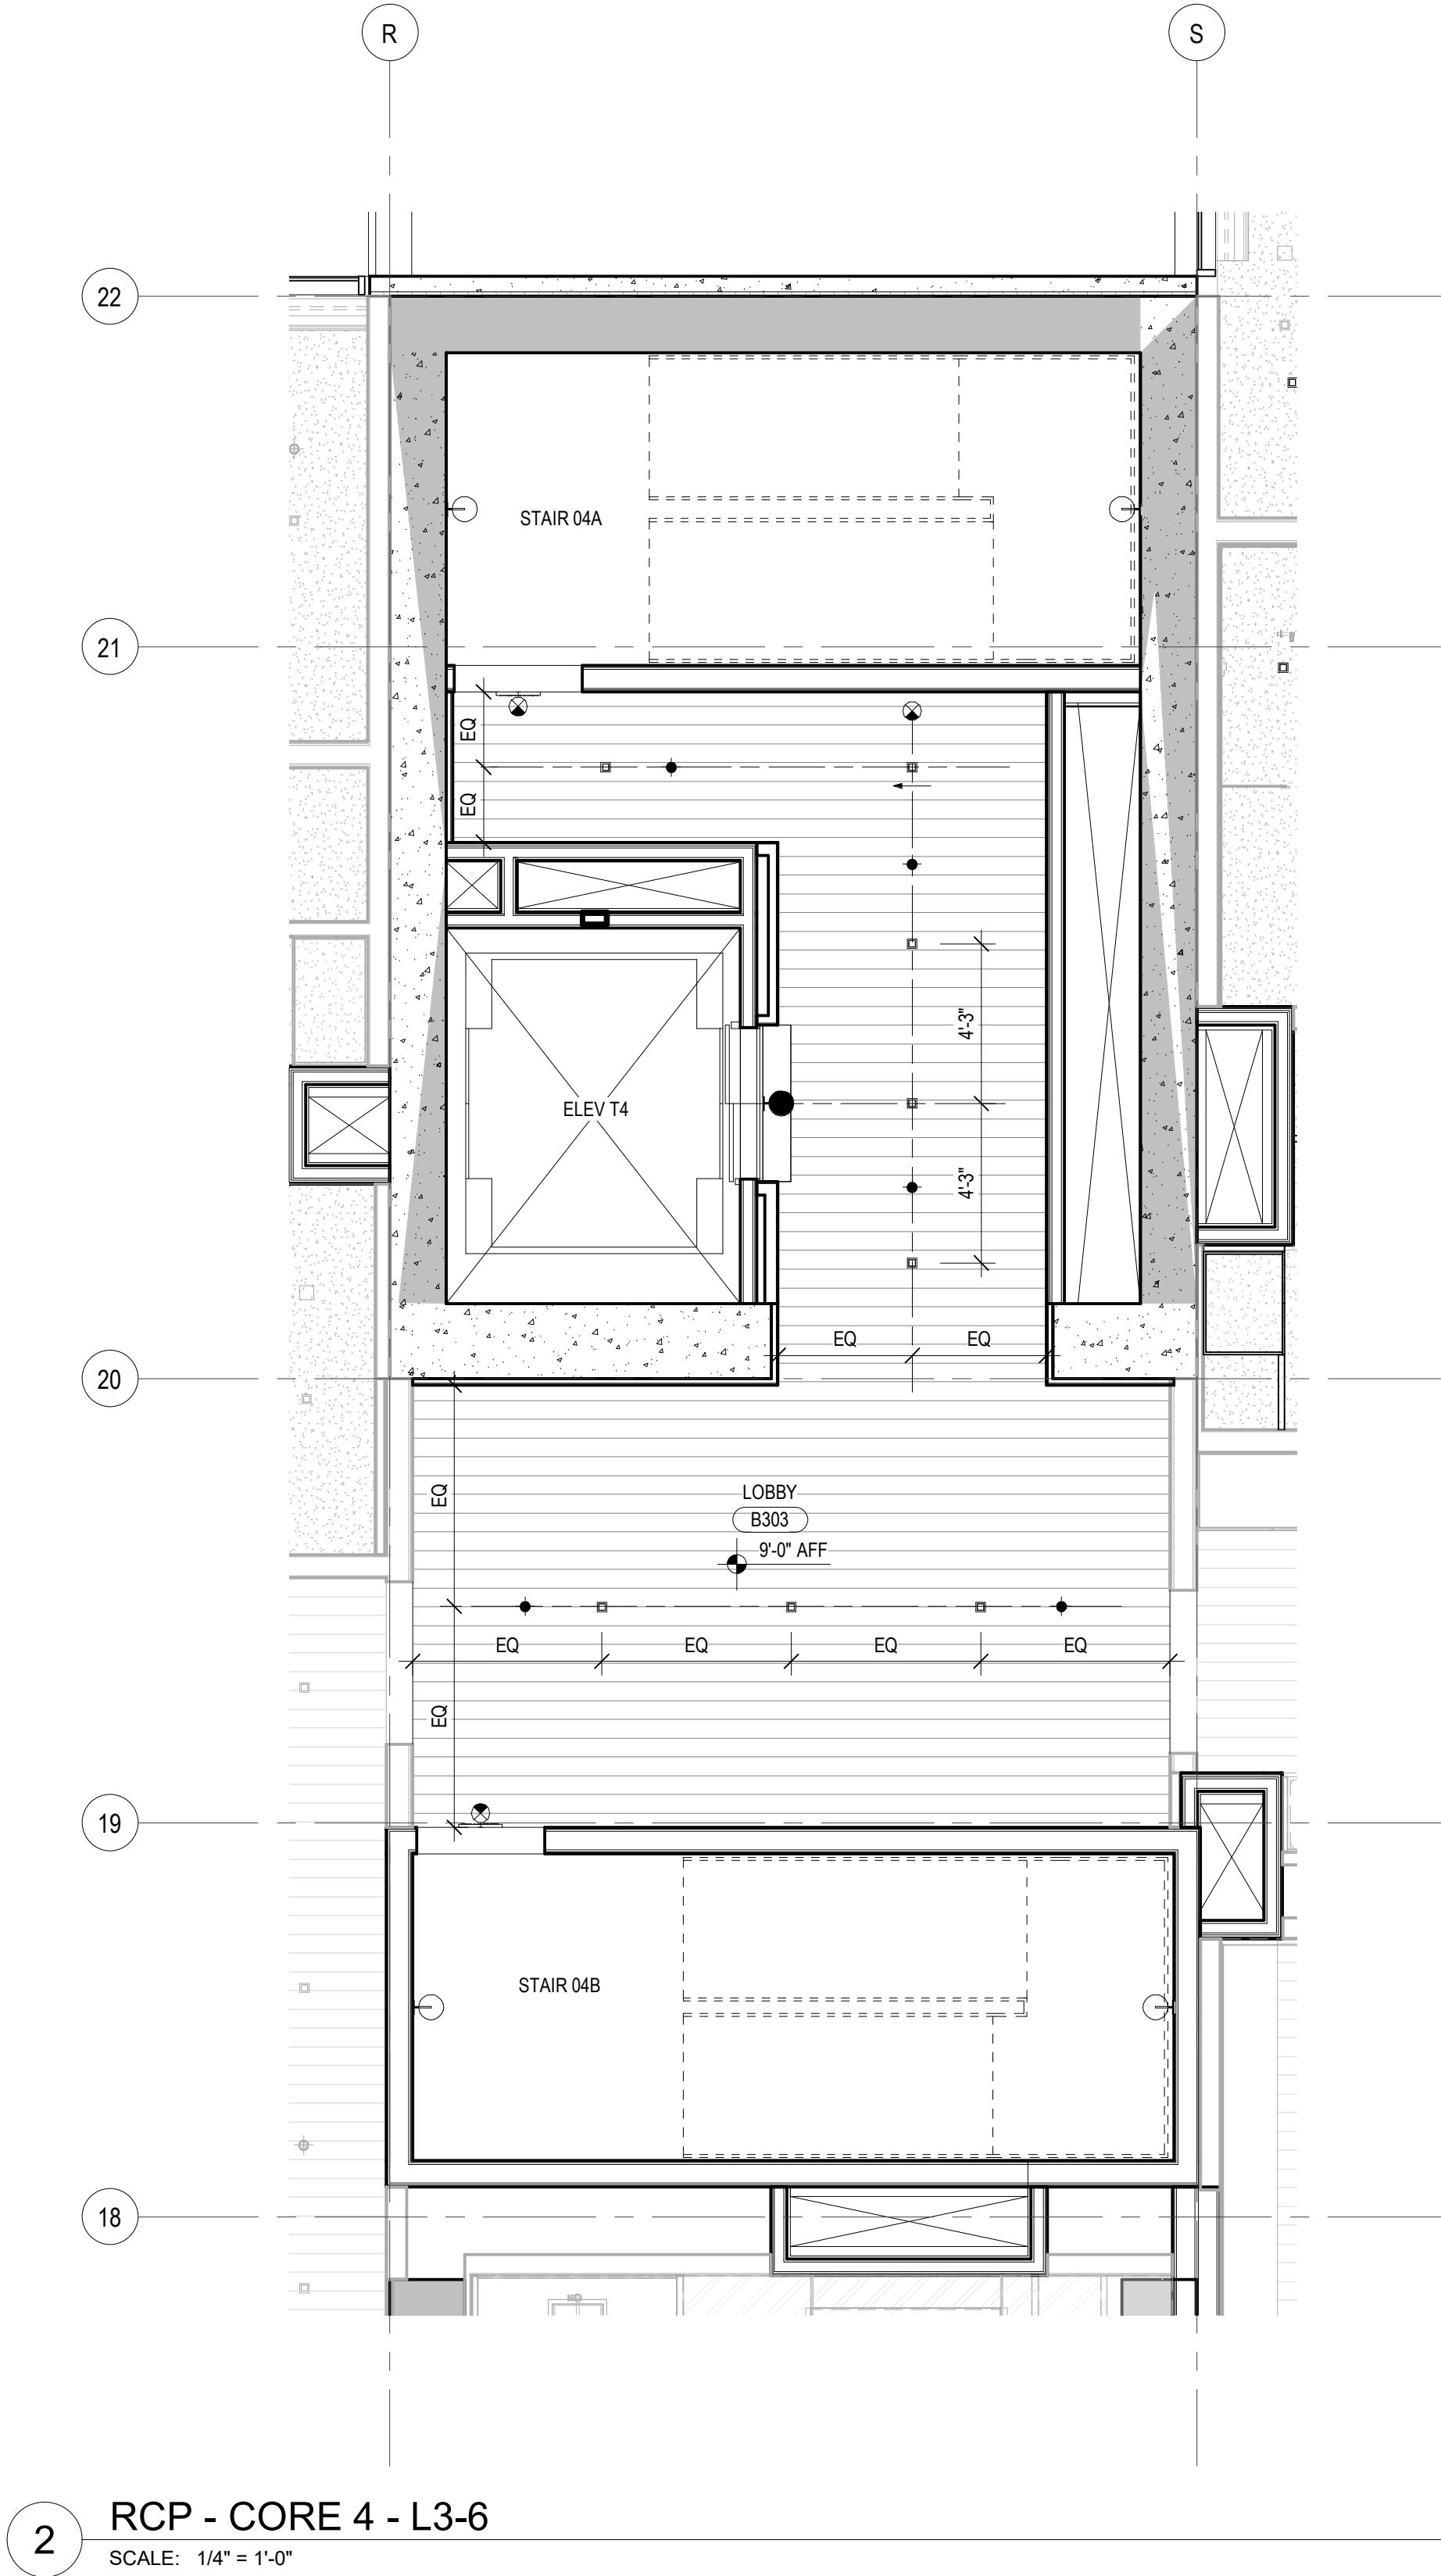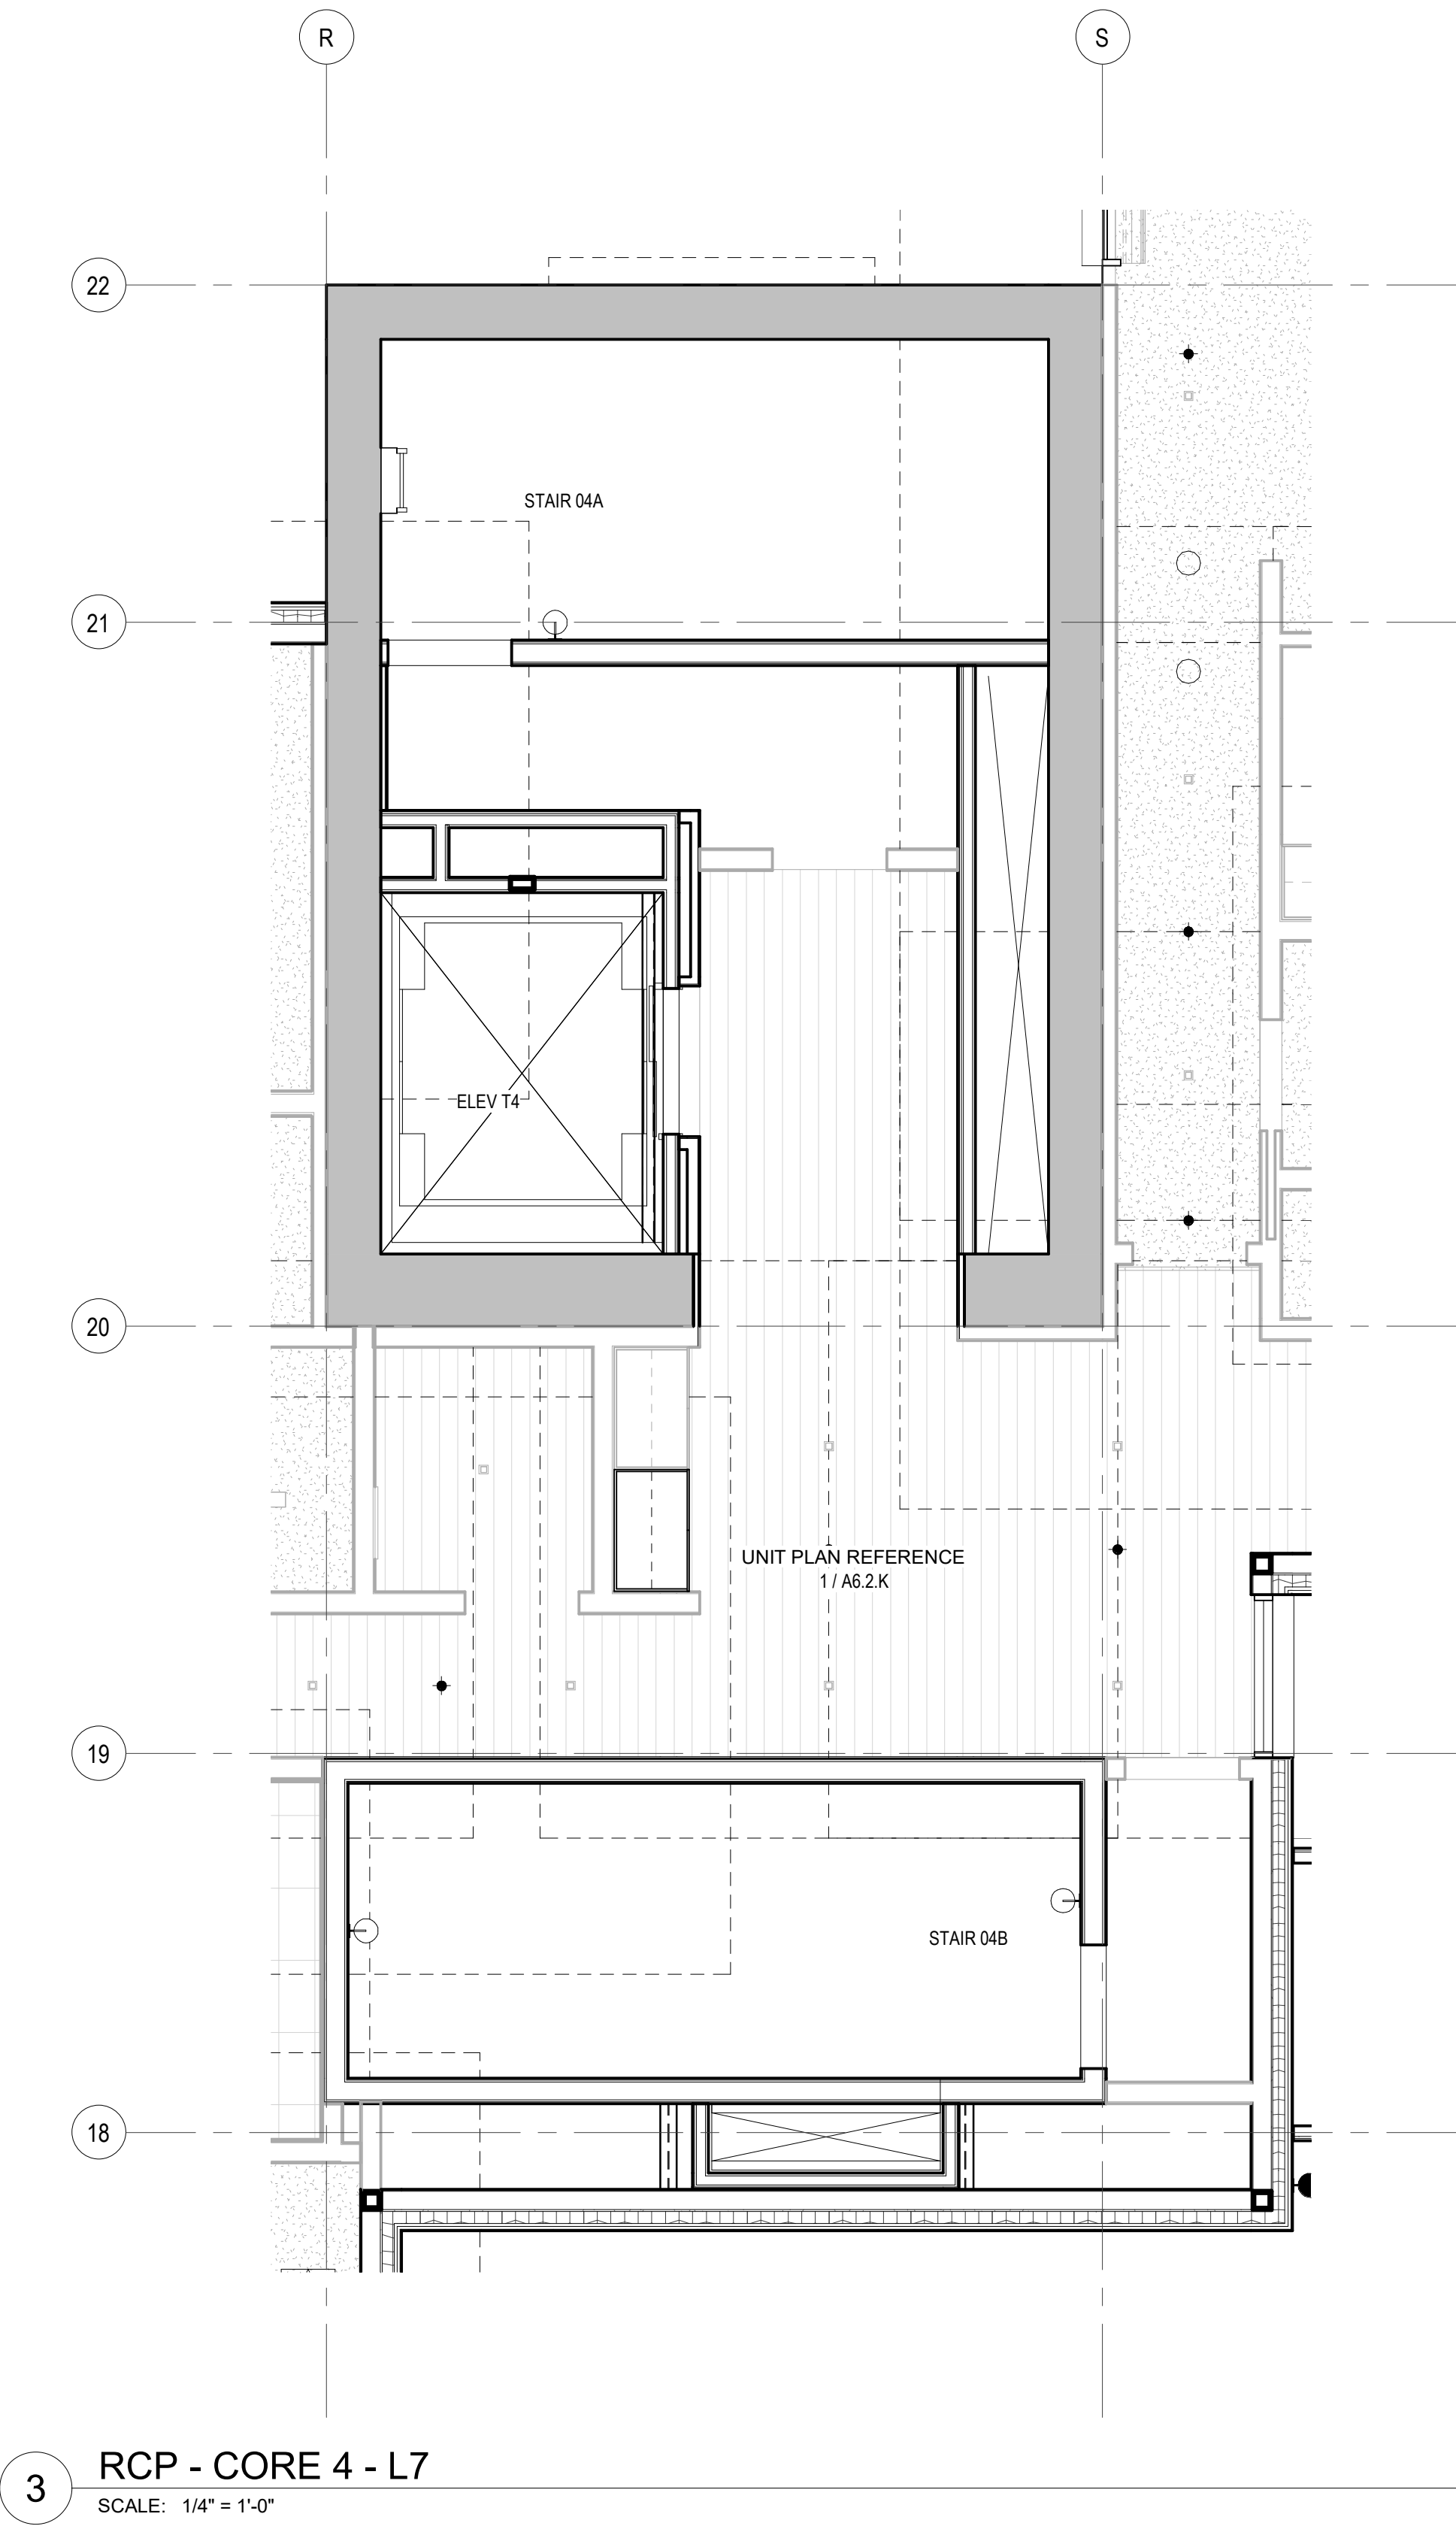

109 South Jackson St, Suite 600
Seattle, Washington 98104 USA
+1 206 454 1600 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6940 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainell Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
1615 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK, KM
project manager TM, JB, LB, MD
drawn by SK, SS, JR, CP, AL
NH, EK, BD, EB

checked by JB
job no. 2052
date 11/18/2022

revisions:

no. date by

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER B - CORE
4

A6.1B.24

1. SPOT LIGHTINGS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTH POSITION OF FINISH FLOOR AND CEILING 9'-0" AFF. U.O.
2. ALL CEILINGS ASSUMED TO BE 8' U.O.
3. ALL CEILINGS ASSUMED TO BE 8' U.O.
4. ALL DIMENSIONS TO FACE OF FINISH U.O.
5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS
6. OCCUPABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT NOT LESS THAN 7 FEET. BATHS, KITCHENS, HALLWAYS, CLOSET ROOMS, KITCHENS, KITCHEN STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET.
7. SEE SHEET AO-10 AND AO-11 FOR FLOOR/CEILING ASSEMBLIES.
8. PROVIDE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS.
9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.
10. PROVIDE DETAIL FOR SMOKE DETECTOR LOCATION AND MOUNTING LEVELS TO PROJECT AT LEAST MAXIMUM FROM WALL FACE OR BE 6"-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF.
11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS.
12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS. PROVIDE SMOKE DETECTOR LOCATIONS TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHOGONALLY.
13. PROVIDE DETAIL FOR JOINTS TO BE DETERMINED BY CONTRACTOR. DROPPED CEILINGS OR COFFITS WITH FASTENING AND JOINT TAPES AS REQUIRED FOR SPECIFIED RATING.
14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING LINE AND STOP ALL AIR FLOW THROUGH THE WALL CAVITY.
15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.
16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS AND SERVICE MEDIA PENETRATIONS. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS.

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES.
REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION
AND LOCATIONS.

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES
REFER TO CEILING ASSEMBLY FOR DETAIL INFORMATION

C10 - WOOD CEILING

C11 - SUSPENDED GYPSUM WALL BOARD

C12 - STONE TILE

C14 - ACOUSTICAL CEILING TILE

SQUARE RECESSED DOWNLIGHT

DECORATIVE SCORCE

DECORATIVE CUSTOM CHANDELIER

ROUND PENDANT LIGHT

J-BOX

LENNED LINEAR UTILITY STRIP

CONCEALED LINEAR UNDERCABINET STRIP

TRACK / RAIL / LINEAR LED

SURFACE-MOUNTED LIGHT BAR

SURFACE MOUNT PLANEL

SPRINKLER

SMOKE DETECTOR

COMBINATION SMOKE / CARBON MONOXIDE DETECTOR

FIRE ALARM SPEAKER

FIRE ALARM STROBE

FIRE ALARM COMBINATION SPEAKER / STROBE

COMBINATION SMOKE / HEAT DETECTOR

EXIT SIGN

SECURITY CAMERA

WIRELESS ACCESS POINT

AV SPEAKER

MOTORIZED SINGLE ROLLER SHDIE - EQ-02.00


MOTORIZED DOUBLE ROLLER SHDIE - EQ-02.01

CEILING FAN - MECH EXHAUST



MECHANICAL LINEAR GRILLE

CEILING ACCESS PLANEL

CEILING CONTROL POINT

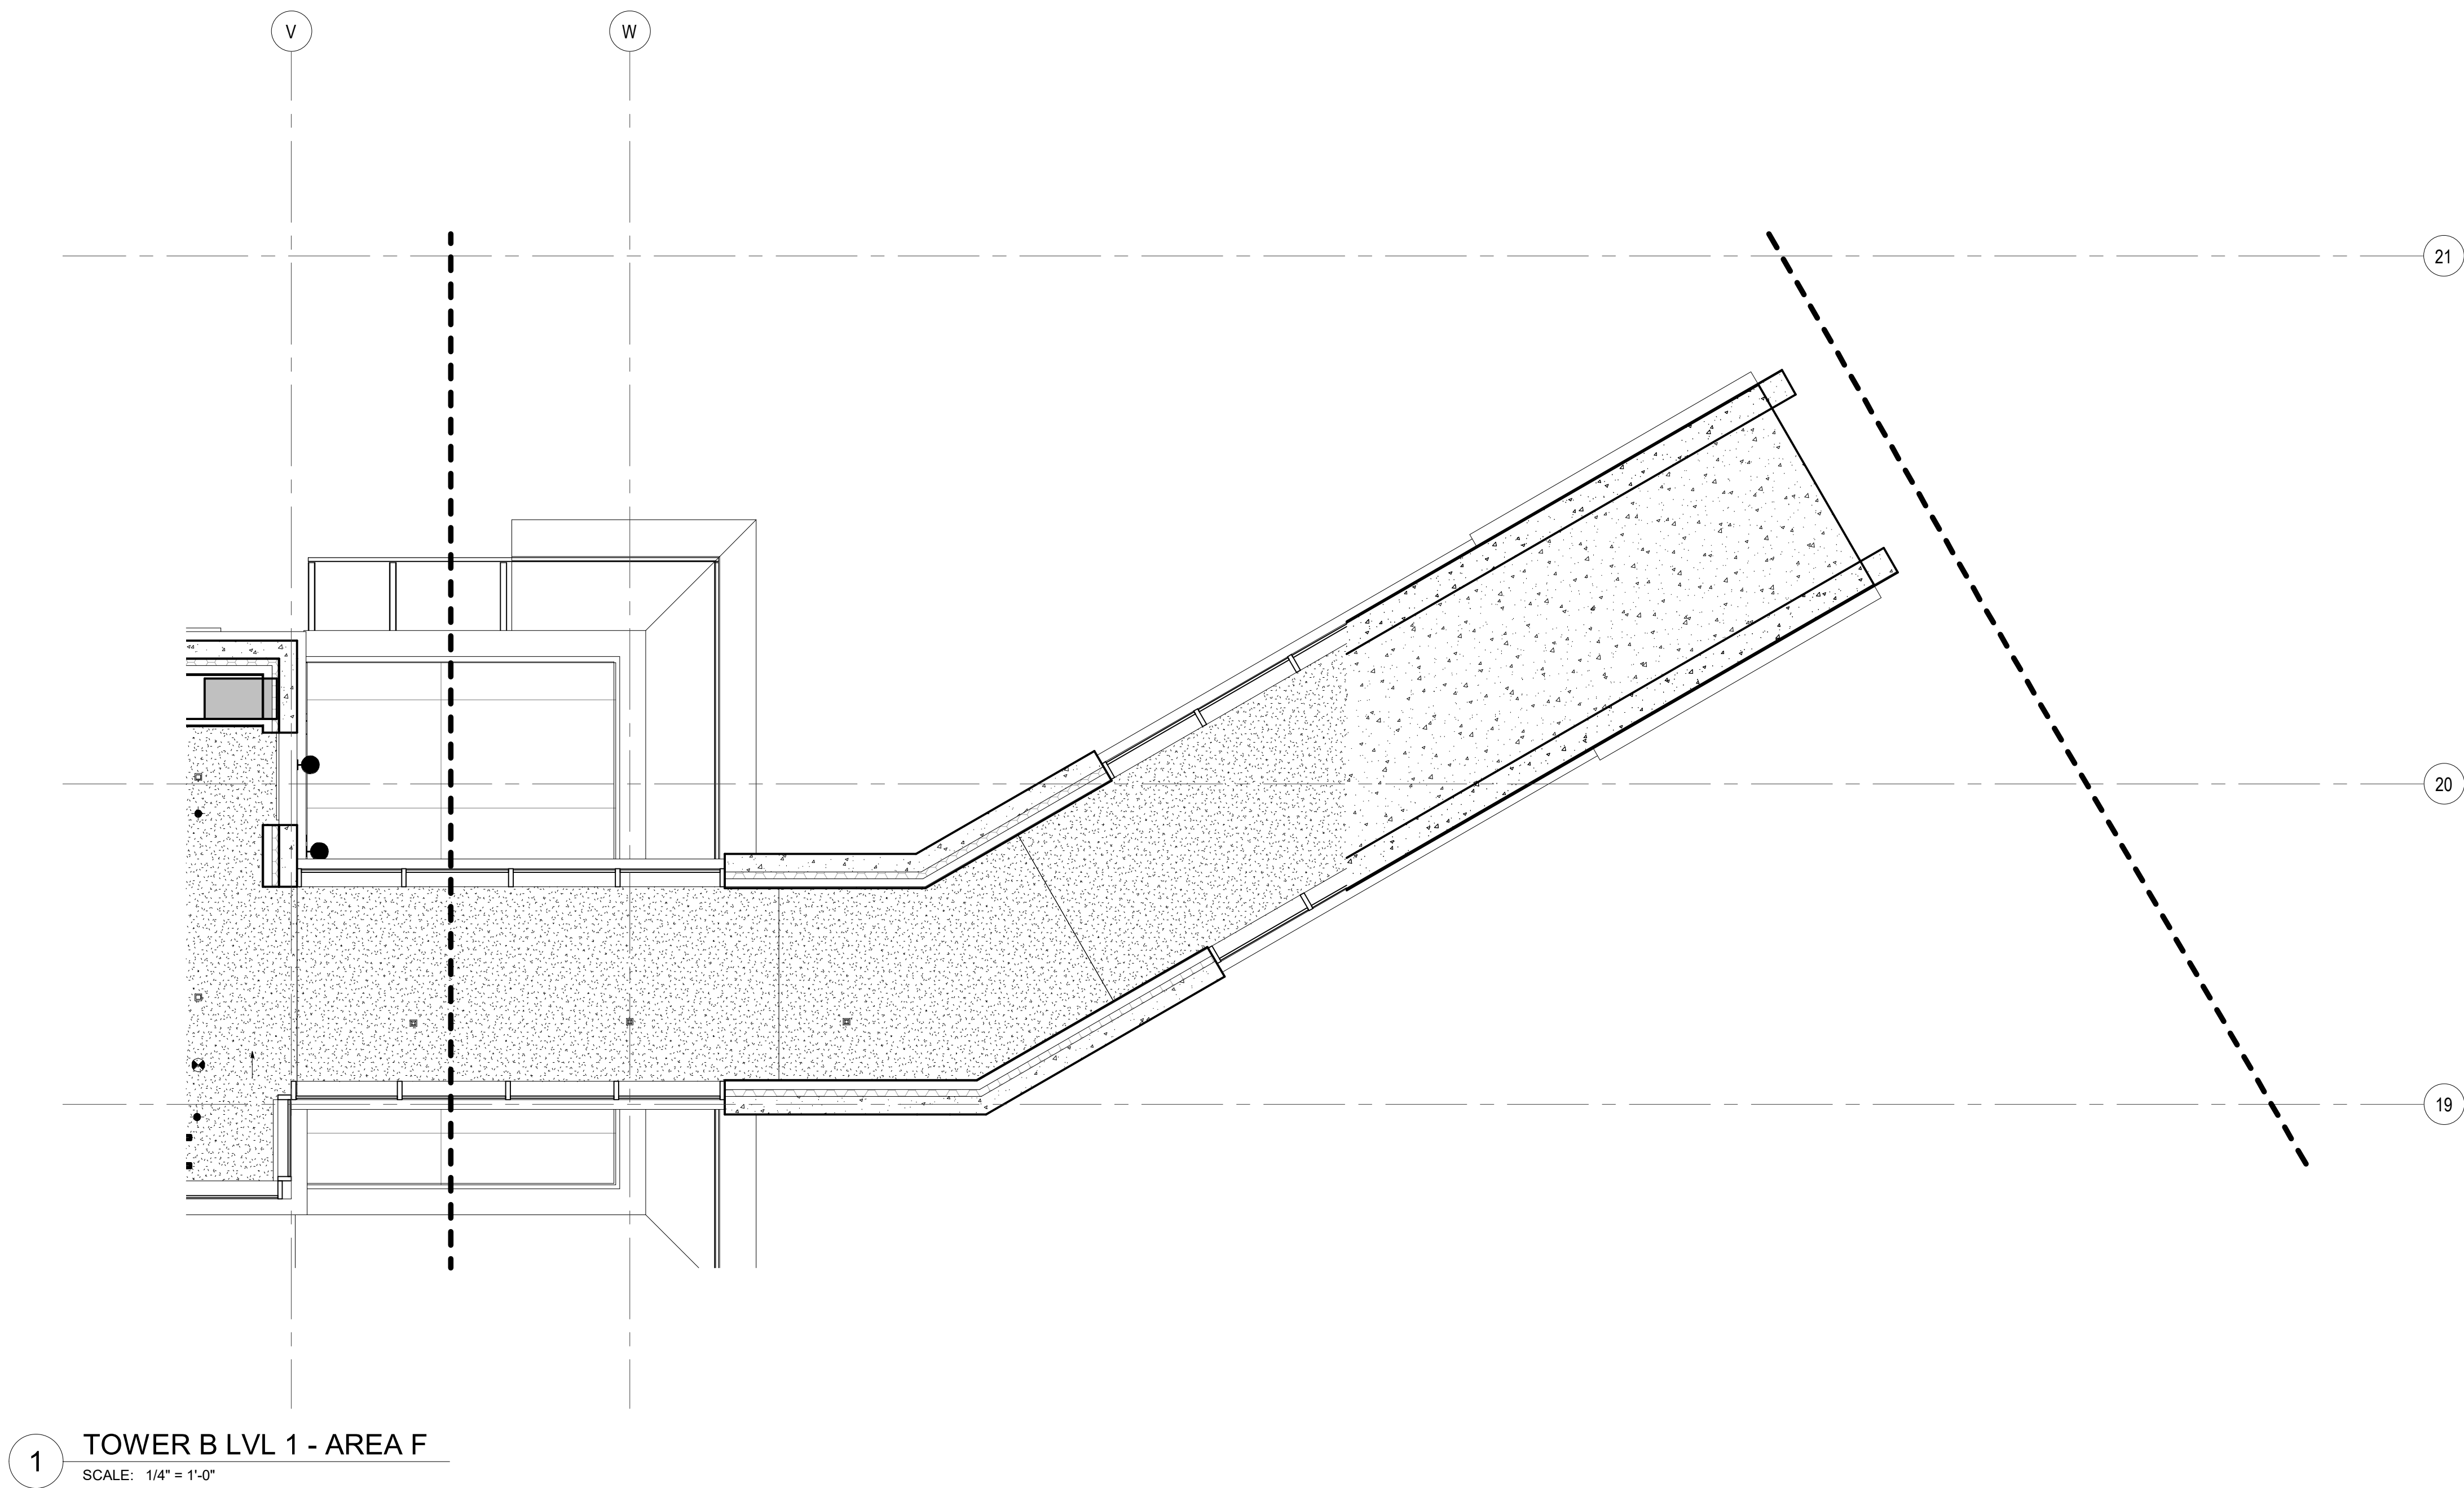

1 TOWER B LVL 1 - AREA F
SCALE: 1/4" = 1'-0"

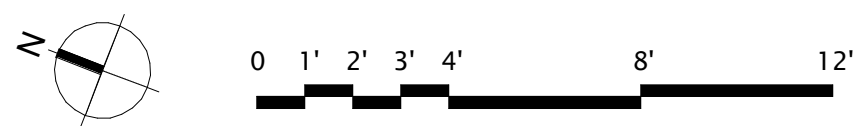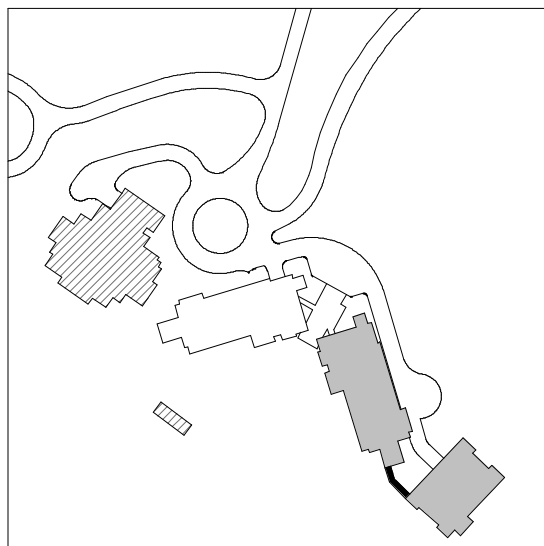

159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect	TK, KM
project manager	TM, JB, LB, MD
drawn by	SK, SS, JR, CP, A

checked by Checker
job no. 20062

Revisions:

[illegible]

no.	date	by
-----	------	----

ISSUED FOR
CONSTRUCTION
11/18/2022

RCP - TOWER BC
CONNECTOR - AREA F

A6.1BC.1f