

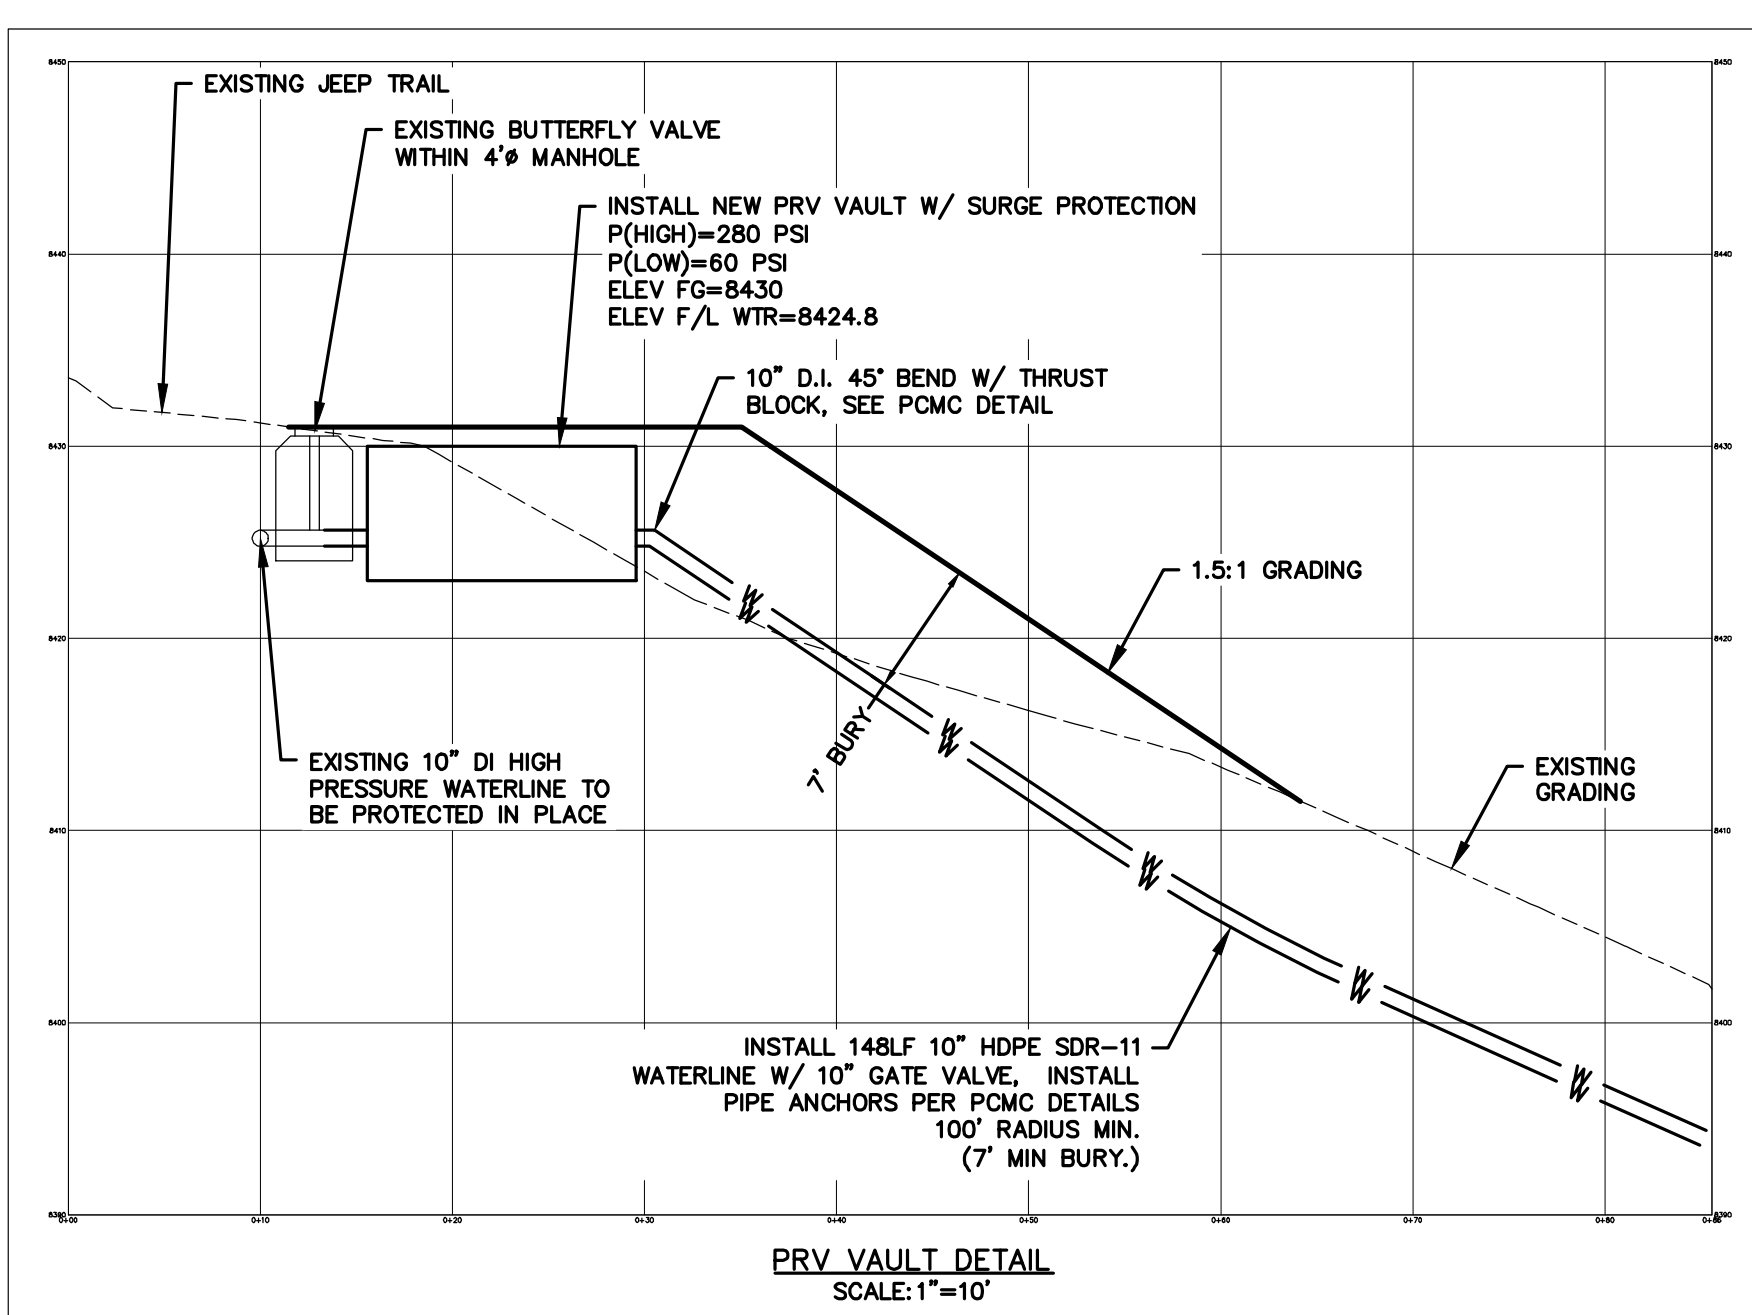
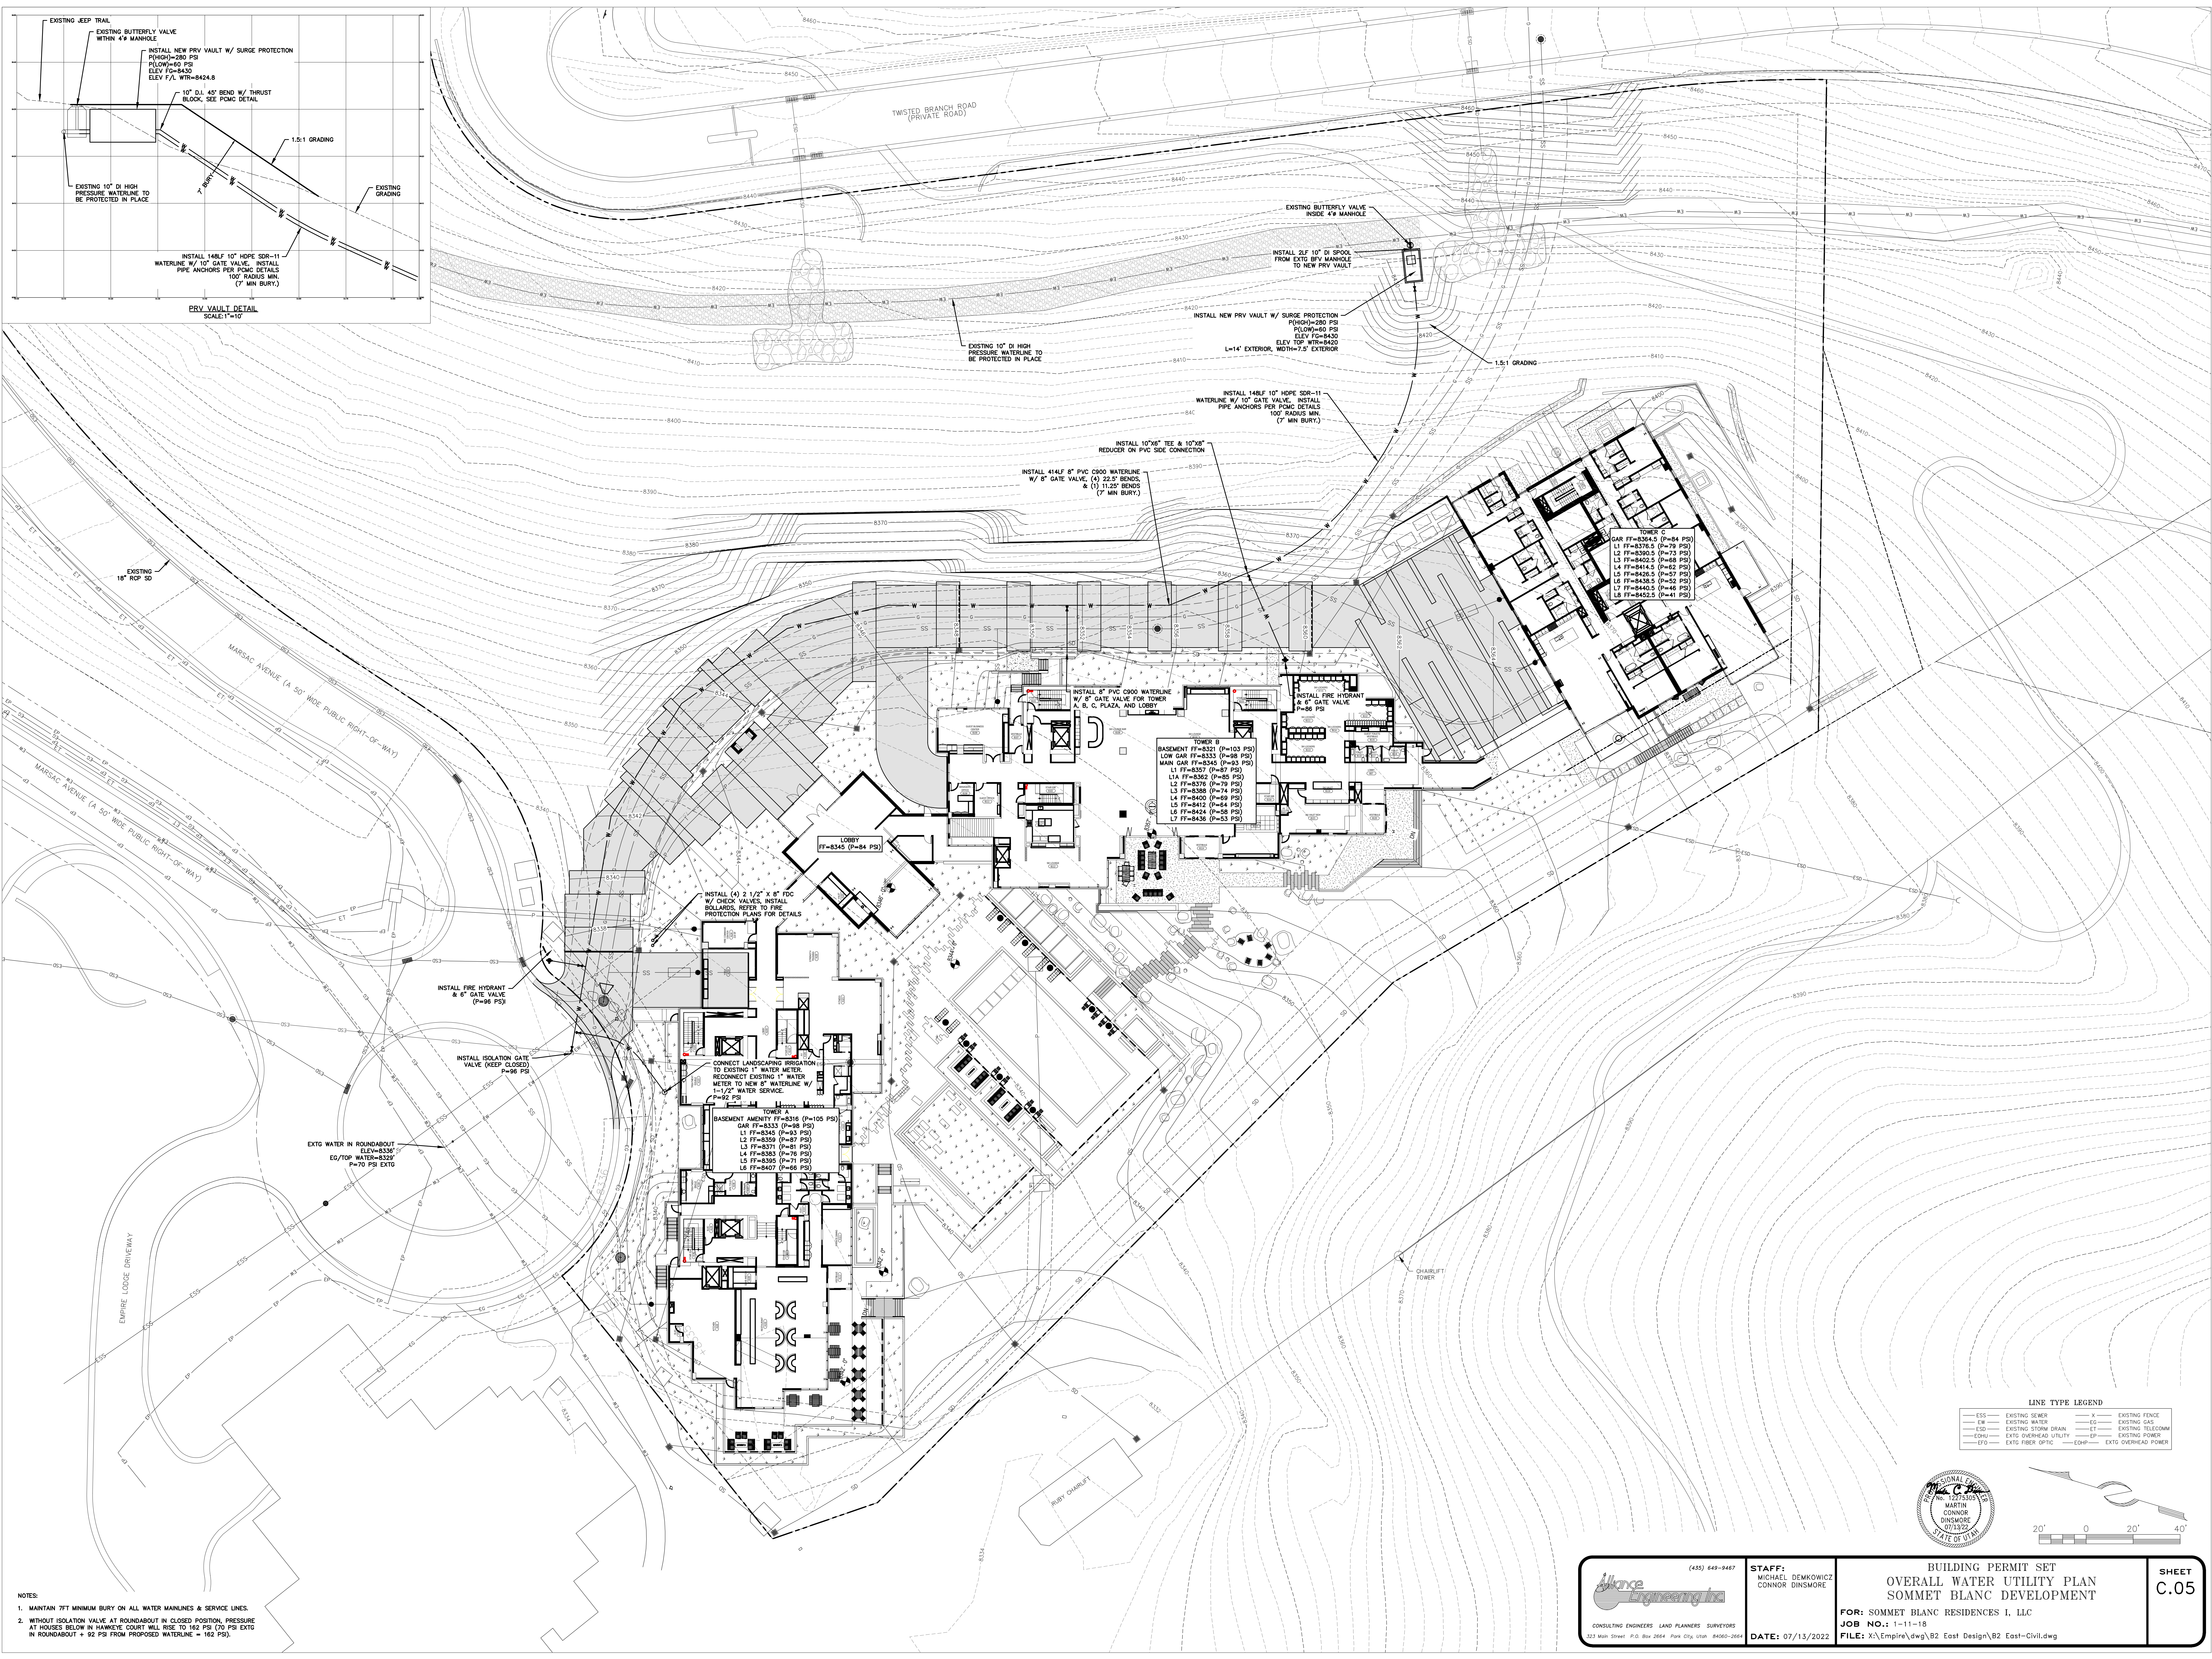


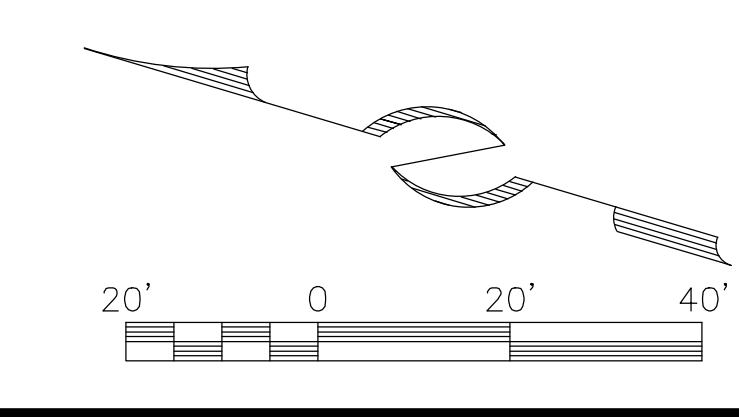

NOTES:

1. MAINTAIN 7' MINIMUM BURY ON ALL WATER MAINLINES & SERVICE LINES.
2. WITHOUT ISOLATION VALVE AT ROUNDABOUT IN CLOSED POSITION, PRESSURE AT HOUSES BELOW IN HAWKVIEW COURT WILL RISE TO 162 PSI (70 PSI EXTG IN ROUNDABOUT + 92 PSI FROM PROPOSED WATERLINE + 162 PSI).

LINE TYPE LEGEND			
ESS	EXISTING SEWER	X	EXISTING FENCE
EW	EXISTING WATER	CG	EXISTING GAS
ESD	EXISTING STORM DRAIN	ET	EXISTING TELECOM
EOH	EXTG OVERHEAD UTILITY	EP	EXISTING POWER
ETO	EXTG OVERHEAD POWER	EQHP	EXTG OVERHEAD POWER

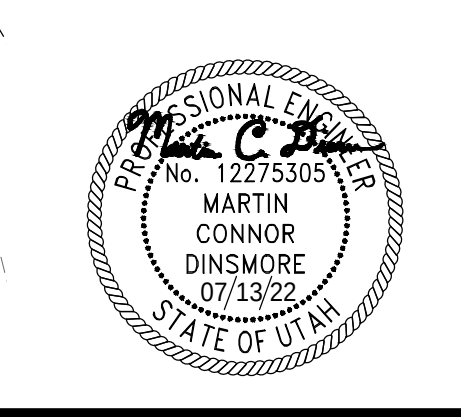

(435) 849-9467

CONSULTING ENGINEERS LAND PLANNERS SURVEYORS

123 Main Street P.O. Box 2004 Park City Utah 84060-2004

STAFF:

MICHAEL DEMKOWICZ

CONNOR DINSWORE

BUILDING PERMIT SET

OVERALL WATER UTILITY PLAN

SOMMET BLANC DEVELOPMENT

FOR: SOMMET BLANC RESIDENCES I, LLC

JOB NO.: 1-11-18

FILE: X:\Empire\dwg\B2 East Design\B2 East-Civil.dwg

DATE: 07/13/2022

SHEET

C.05