

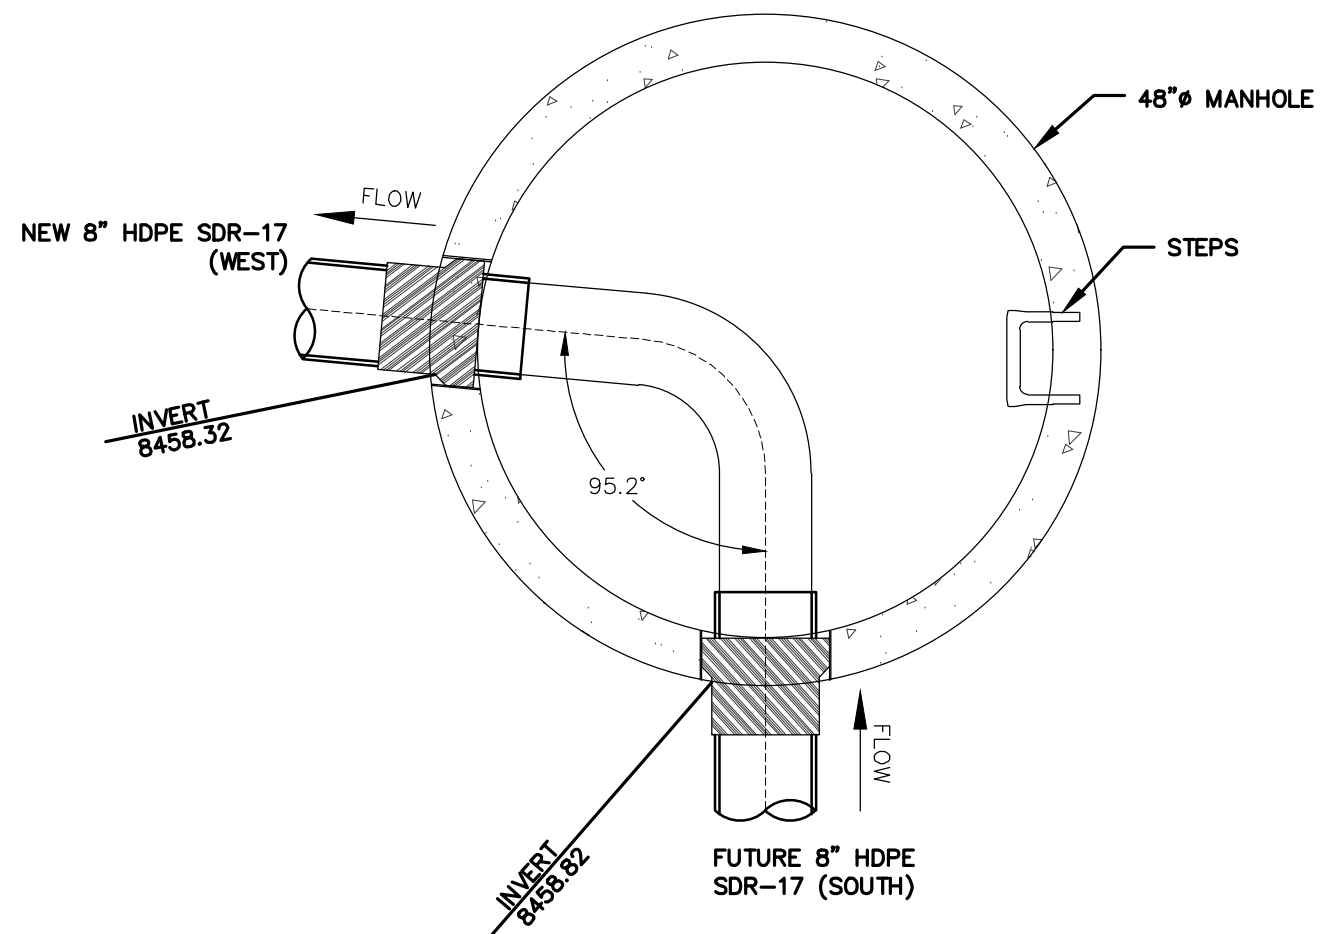


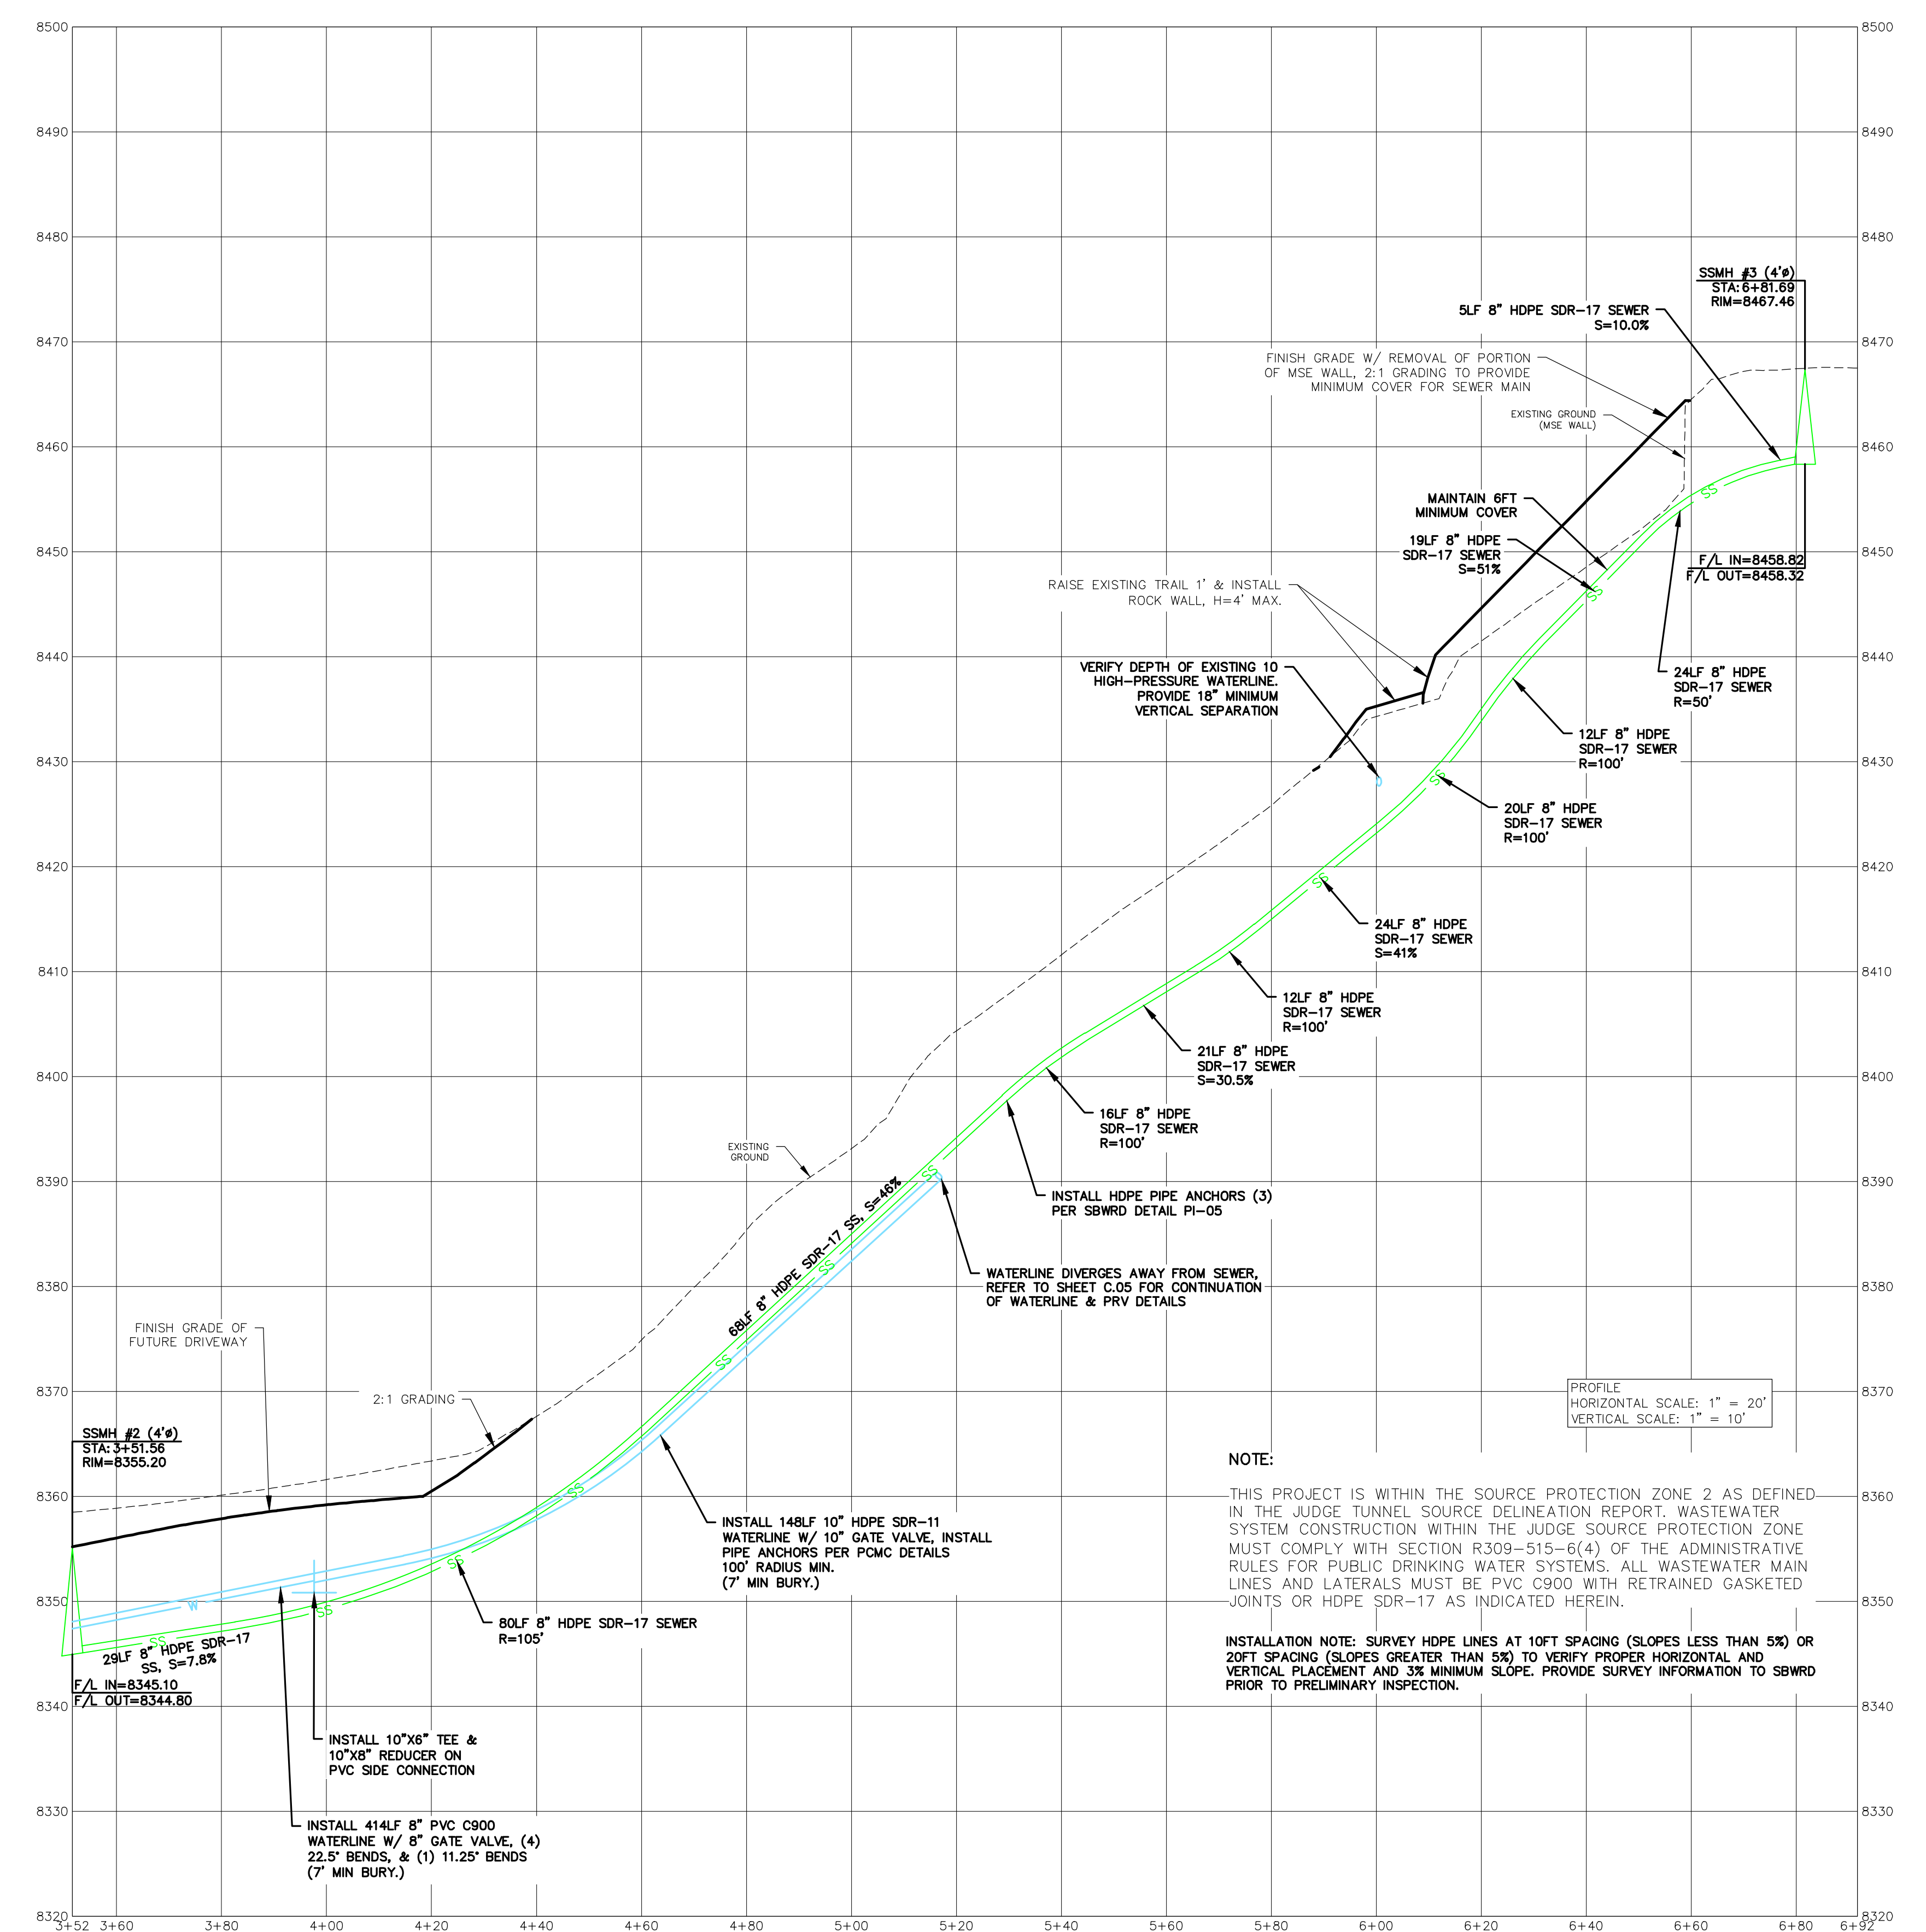



NOTES:

1. PROVIDE EXTERIOR CONCRETE COLLARS ON PIPE/BOX CONNECTIONS & INTERIOR SMOOTH GROUT FINISH.
2. MAINTAIN 5FT MINIMUM BURY ON ALL SEWER LATERALS & 8FT MINIMUM BURY ON ALL SEWER MAINLINES.
3. MAINTAIN 7FT MINIMUM BURY ON ALL WATER MAINLINES & SERVICE LINES.
4. MAINTAIN 36" MINIMUM BURY ON ALL STORM DRAIN.
5. MAINTAIN 18" MINIMUM VERTICAL SEPARATION BETWEEN NEW WATER & SEWER.

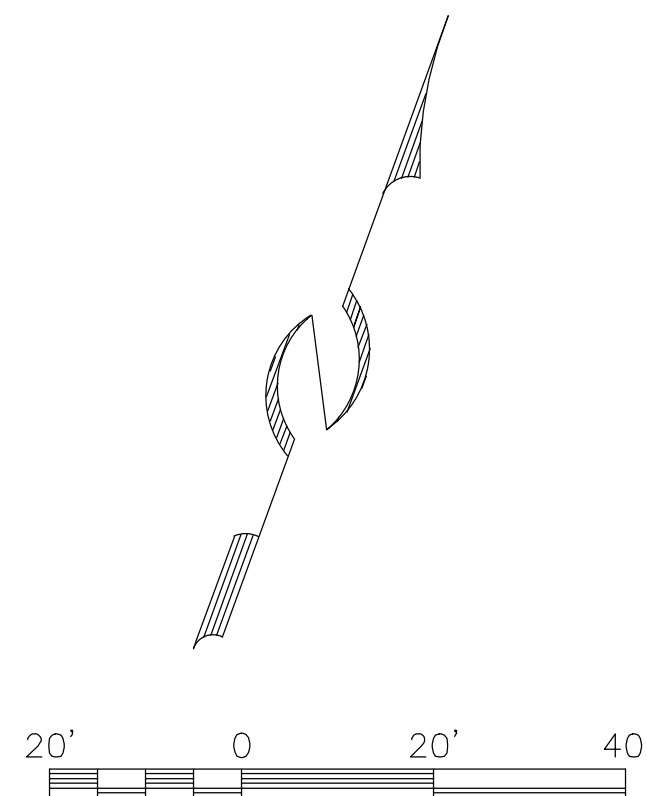

LINE TYPE LEGEND

—ESS—	EXISTING SEWER	—X—	EXISTING FENCE
—EW—	EXISTING WATER	—EG—	EXISTING GAS
—ESD—	EXISTING STORM DRAIN	—ET—	EXISTING TELECOMM
—EOH—	EXTG OVERHEAD UTILITY	—EP—	EXISTING POWER
—EFO—	EXTG FIBER OPTIC	—EOHP—	EXTG OVERHEAD POWER

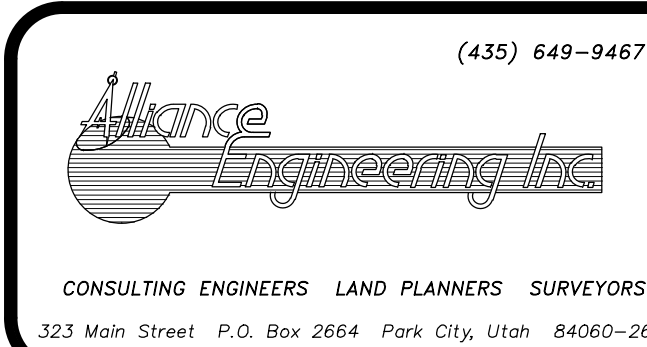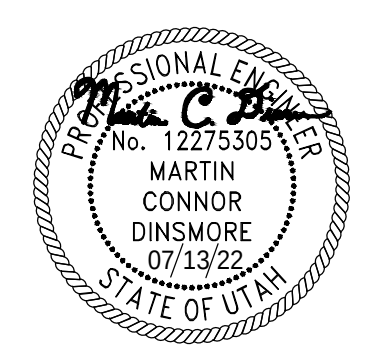

STAFF:
MICHAEL DEMKOWICZ
CONNOR DINSMORE

DATE: 07/13/2022

BUILDING PERMIT SET OFF ROAD SEWER PLAN & PROFILE SOMMET BLANC DEVELOPMENT		SHEET C.09
FOR: SOMMET BLANC RESIDENCES I, LLC JOB NO.: 1-11-18 FILE: X:\Empire\dwg\82 East Design\82 East-Civil.dwg		