



2. DIMENSIONS ARE TO FACE OF STUD OF EXTERIOR WALLS, CORRIDOR WALLS & INTERIOR WALLS. UNO
3. DIMENSIONS ARE TO CENTERLINE OF DEMISING WALLS. UNO
4. ALL EXPOSED STRUCTURAL STEEL TO RECEIVE 1 HR FIRE INSULATION PAINTING, UNO
5. ALL FRAMED EXTERIOR WALLS TO BE 16" THICK. SET BACK 50" FROM FACE OF CONCRETE TO ALLOW FOR FLUSH ALIGNMENT OF SHEATHING TO EDGE OF SLAB. UNO
6. CASEWORK DIMENSIONS ARE TO FACE OF FINISH. UNO
7. SEE SHEETS 01-10 AND 01-11 FOR ASSEMBLIES. UNO
8. ALL CORRIDOR WALLS ARE TYPE E6. UNO
9. ALL DEMISING WALLS ARE TYPE J6. UNO
10. ALL INTERIOR PARTITIONS ARE TYPE A6. UNO
11. ALL FLOORING ABOVE CONCRETE SLAB TO BE STRUCTURAL COLUMNS TYPE G1. UNO
12. ALL VENT SHAFT WALLS ARE TYPE K4. UNO
13. REFER TO LIFE SAFETY PLANS #4, UNO & 04-34 FOR FULL EXIST OF FIRE RATED WALLS.
14. UNIT PLAN LAYOUTS ON SHEET 04-35. UNO
15. ALL OWNER PARKING STALLS SHALL INCLUDE EV INFRASTRUCTURE.
16. REFER TO SHEET 04-08 FOR ANS1 TYPE 3 ACCESSIBILITY REQUIREMENTS.
17. REFER TO SHEET 04-07 FOR ANS1 TYPE 4 ACCESSIBILITY REQUIREMENTS.
18. REFER TO SHEET 04-06 FOR ANS1 TYPE 5 ACCESSIBILITY REQUIREMENTS.
19. ALL MECHANICAL EQUIPMENT LOCATED WITHIN ELEVATOR MECHANICAL EQUIPMENT ENCLOSURE.

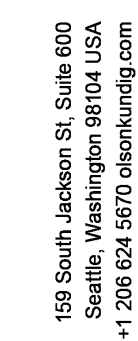

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060

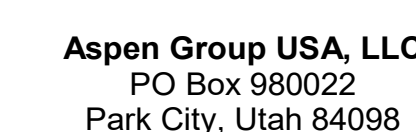

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

revisions:

no. date	BUILDING PERMIT RESUBMITTAL #1
---------------	-----------------------------------

A2.2A.01

