



2. DIMENSIONS ARE TO FACE OF STUD OF EXTERIOR WALLS, CORRIDOR WALLS & INTERIOR WALLS. UNO
3. DIMENSIONS ARE TO CENTERLINE OF DEMISING WALLS. UNO
4. ALL EXPLODED STRUCTURAL STEEL TO RECEIVE 1 HR INTUMESCENT PAINTING UNO
5. ALL FRAMED EXTERIOR WALLS SHALL BE CONCRETE WITH MIN 60% FROM FACE OF CONCRETE TO ALLOW FOR FLUSH ALIGNMENT OF SHEATHING TO EDGE OF SLAB. UNO
6. CASEWORK DIMENSIONS ARE TO FACE OF FINISH. UNO
7. SEE SHEETS A10 AND A0111 FOR ASSEMBLIES.
8. ALL CORRIDOR WALLS ARE TYPE EE. UNO
9. ALL DEMISING WALLS ARE TYPE JH. UNO
10. ALL INTERIOR PARTITIONS ARE TYPE A6. UNO
11. ALL FURRING AROUND CONCRETE STAIR COLUMNS TYPE G1. UNO
12. ALL VENT SHAFT WALLS ARE TYPE K4. UNO
13. REFER TO LIFE SAFETY PLANS A00 - A34 FOR FULL EXTENT OF FIRE RATED WALLS.
14. UNIT PLAN LAYOUTS ON SHEET S2-A24 - A24R
15. ALL OWNER PARKING STALLS SHALL BE CONCRETE WITH CURB-LEVEL INFRASTRUCTURE.
16. REFER TO SHEET A08 FOR ANY TYPE B ACCESSIBILITY REQUIREMENTS.
17. REFER TO SHEET A07 FOR ANY TYPE C ACCESSIBILITY REQUIREMENTS.
18. REFER TO SHEET A08 FOR ADA PUBLIC SPACE ACCESSIBILITY REQUIREMENTS.
19. REFER TO SHEET A08 FOR EQUIPMENT ELEVATION, MINIMUM ELEVATION CHANGES, EQUIPMENT ENCLOSURE

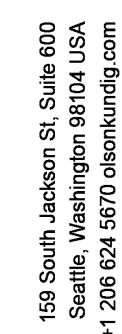

SOMMET BLANC
9300 MARSAC AVE
PARK CITY, UT 84060

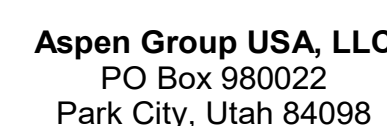

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

revisions:

A2.3AB.1c

