

RCP GENERAL NOTES

1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH 2. ALL CEILINGS 9'-0" AFF U.N.O.

3. ALL CEILINGS ASSEMBLY C11 U.N.O. 4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.

5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS 6. OCCUPIABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN

7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES. 8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS. 9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS. 10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4" MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF. 11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS. 12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS, TYPICAL. LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHAGONALLY. 13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING. 14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES. 15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS. 16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS


ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.

POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO


RCP LEGEND

HATCH PATTERN INDICATE EXTENT OF CEILING TYPES

INSTALLATION OF ANY OF THESE SYSTEMS

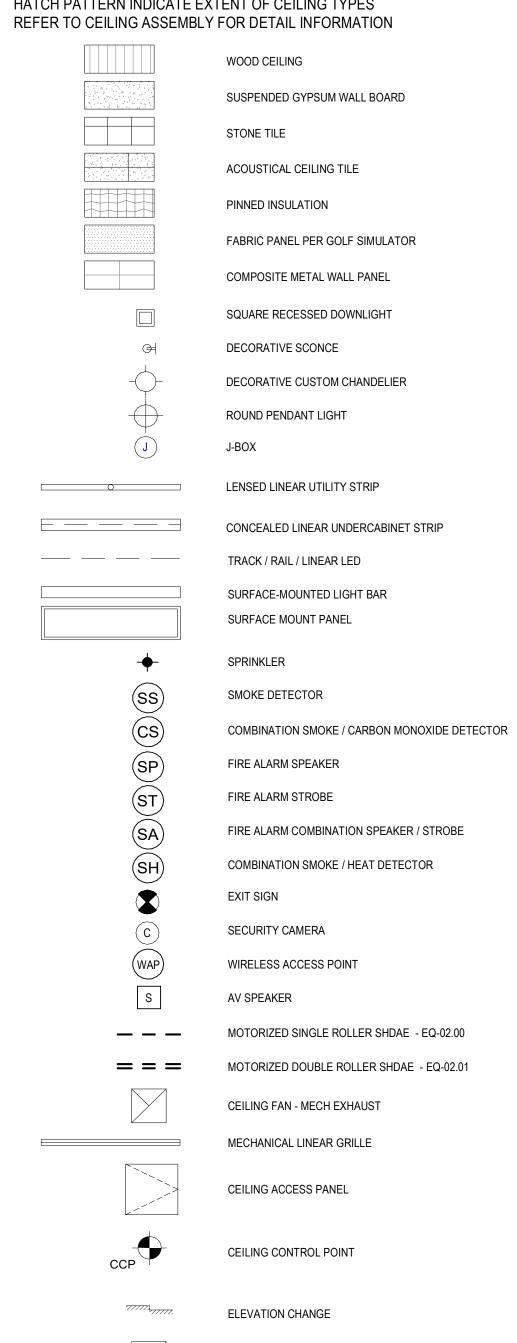

RETURN AIR GRILLE



• —

ASPEN GROUP Aspen Group USA, LLC PO Box 980022 Park City, Utah 84098 Pool Consultant
Cloward H20 2696 N University Ave, Suite 290 Provo, UT 84604 <u>Landscape Architect</u> **EPG Design**6949 South High Tech Drive, Suite 100
Midvale, Utah 84047 Specifications Writer
Friday Group
88 Mainelli Road Middlebury, VT Code Consultant
Holmes 600 1st Avenue, Suite 200A Seattle, WA 98104 Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C Westborough, MA 01581 Vertical Transportation Consulatant Lerch Bates 19515 North Creek Parkway, Suite 304 Bothell, WA 98011 Structural Engineer
Magnusson Klemencic Associates

1301 5th Ave, Suite 3200

1319 SE MLK Blvd, Suite 210

Building Envelope Consultant RDH

Portland, Oregon 97219

Seattle, WA 98101

<u>Lighting Designer</u>

2101 N 34th St

Seattle, WA 98103

Seattle, WA 98109

Seattle, WA 98154

Accessibility Consultant
Studio Pacifica 2144 Westlake Ave N, Suite F

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100

principal architect ___TK, KM project manager TM, JB, SL, MD drawn by SK, SS, JR, CP, EA, JF, BD checked by JB job no. 20052 date 05/31/2024

no. date

IFC SET 3 OF 3 05/31/2024

RCP - TOWER AB - UNIT A6.2.D