

1 RCP - TOWER A/B - UNIT Q
SCALE: 1/4" = 1'-0"

RCP GENERAL NOTES

1. SPOT ELEVATIONS ARE RELATIVE TO FINISH FLOOR LEVEL AND INDICATE BOTTOM OF FINISH 2. ALL CEILINGS 9'-0" AFF U.N.O.

3. ALL CEILINGS ASSEMBLY C11 U.N.O. 4. ALL DIMENSIONS TO FACE OF FINISH U.N.O.

5. SEE CONCRETE PLANS FOR EXTENT OF CONCRETE SLABS AND BEAMS 6. OCCUPIABLE SPACES, HABITABLE SPACES AND CORRIDORS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7 FEET AND 6 INCHES. BATHROOMS, TOILET ROOMS, KITCHENS, STORAGE ROOMS AND LAUNDRY ROOMS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN

7. SEE SHEET A0.10 AND A0.11 FOR FLOOR/CEILING ASSEMBLIES. 8. SEE ELECTRICAL AND LIGHTING DRAWINGS FOR LIGHTING LAYOUTS AND ADDITIONAL INFORMATION NOT SHOWN ON ARCHITECTURAL RCP DRAWINGS. 9. REFER TO MECHANICAL FOR SPRINKLER AND EXTINGUISHER TYPE AND FOR LOCATIONS.

MAXIMUM FROM WALL FACE OR BE 6'-8" MINIMUM TO THE UNDERSIDE OF THE FIXTURE AFF. 11. SMOKE DETECTORS SHALL BE LOCATED A MINIMUM OF 3'-0" FROM SUPPLY AIR DIFFUSERS. 12. CENTER SPRINKLER HEAD LOCATIONS BETWEEN LIGHTING FIXTURES AND/OR SMOKE DETECTORS, TYPICAL. LOCATION AND SPACING TO BE DETERMINED WITH APPROVED SHOP DRAWINGS. PROVIDE SIDE ARMS WHERE HEADS AND OTHER CEILING FIXTURES MAY BE IN CONFLICT. ALIGN ALL HEADS AND FIXTURES ORTHAGONALLY. 13. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS ABOVE DROPPED CEILINGS OR SOFFITS WITH FASTENING AND JOINT TAPE AS REQUIRED FOR SPECIFIED RATING. 14. FIRE-RATED CEILINGS SHALL ALWAYS BE CONTINUOUS OVER CHASES/FURRED-OUT SPACES TO PREVENT THE WALL CAVITY FROM COMMUNICATING WITH THE FLOOR/CEILING CAVITY. FIRESTOP ALL PENETRATIONS OF FIRE-RATED FLOOR/CEILING ASSEMBLIES. 15. SEE MECHANICAL DRAWINGS FOR DUCT ROUTING. SEE MECHANICAL DRAWINGS FOR ADDITIONAL INSULATION REQUIREMENTS AT DUCTS.


10. ALL WALL-MOUNTED FIXTURES IN COMMON AREAS AND AMENITY LEVELS TO PROJECT 4"

16. CEILING ACCESS PANELS ARE REQUIRED AT ALL DAMPERS, VALVES, TELECOM ACCESS POINTS, AND SOME MECHANICAL EQUIPMENT. COORDINATE LOCATIONS PRIOR TO INSTALLATION OF ANY OF THESE SYSTEMS

ELECTRICAL AND MECHANICAL INFORMATION ARE SHOWN FOR COORDINATION PURPOSES. REFER TO MECHANICAL DRAWINGS AND ELECTRICAL DRAWINGS FOR GENERAL INFORMATION AND LOCATIONS.

RCP LEGEND


HATCH PATTERN INDICATE EXTENT OF CEILING TYPES

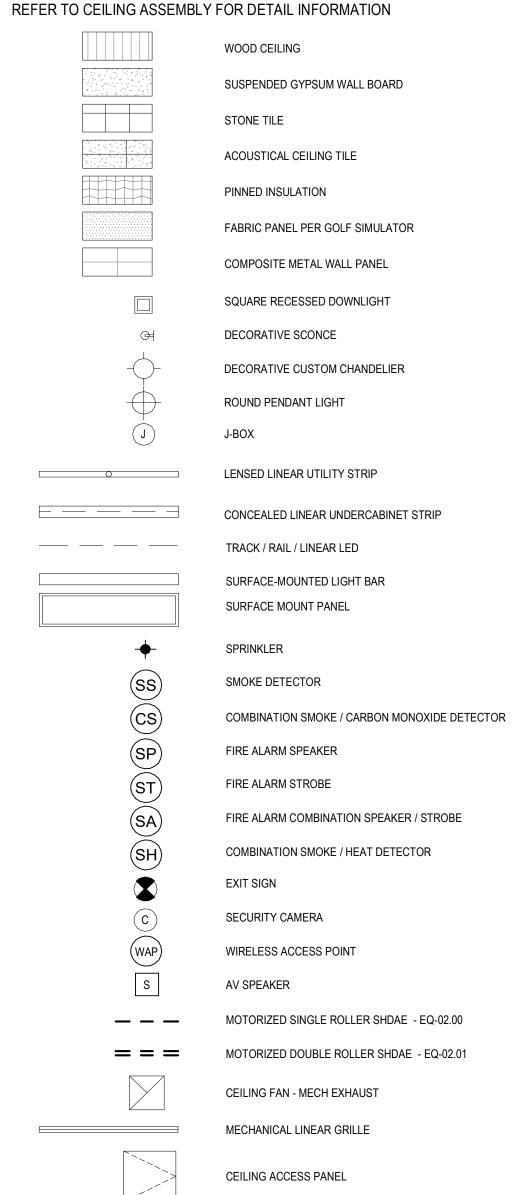


CEILING CONTROL POINT

ELEVATION CHANGE

RETURN AIR GRILLE



• —

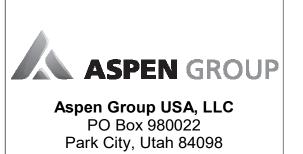

Pool Consultant Cloward H20 2696 N University Ave, Suite 290 Provo, UT 84604
<u>Landscape Architect</u> EPG Design 6949 South High Tech Drive, Suite Midvale, Utah 84047
Specifications Writer Friday Group 88 Mainelli Road Middlebury, VT
Code Consultant Holmes 600 1st Avenue, Suite 200A Seattle, WA 98104
Fire Protection Engineer Jensen Hughes One Research Drive, Suite 305C

Vertical Transportation Consulatant Lerch Bates 19515 North Creek Parkway, Suite 304 Bothell, WA 98011 Structural Engineer
Magnusson Klemencic Associates

Westborough, MA 01581


1301 5th Ave, Suite 3200 Seattle, WA 98101 <u>Lighting Designer</u> 1319 SE MLK Blvd, Suite 210 Portland, Oregon 97219

Building Envelope Consultant RDH 2101 N 34th St Seattle, WA 98103 Accessibility Consultant
Studio Pacifica

Seattle, WA 98109

1001 Fourth Ave., Suite 3100 Seattle, WA 98154

2144 Westlake Ave N, Suite F

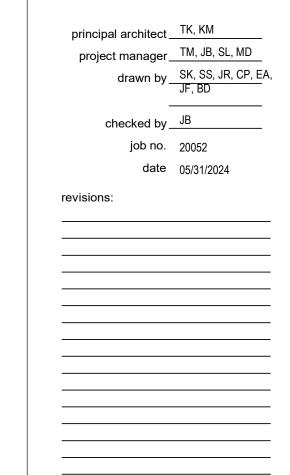



IFC SET 3 OF 3 05/31/2024

RCP - TOWER AB - UNIT Q