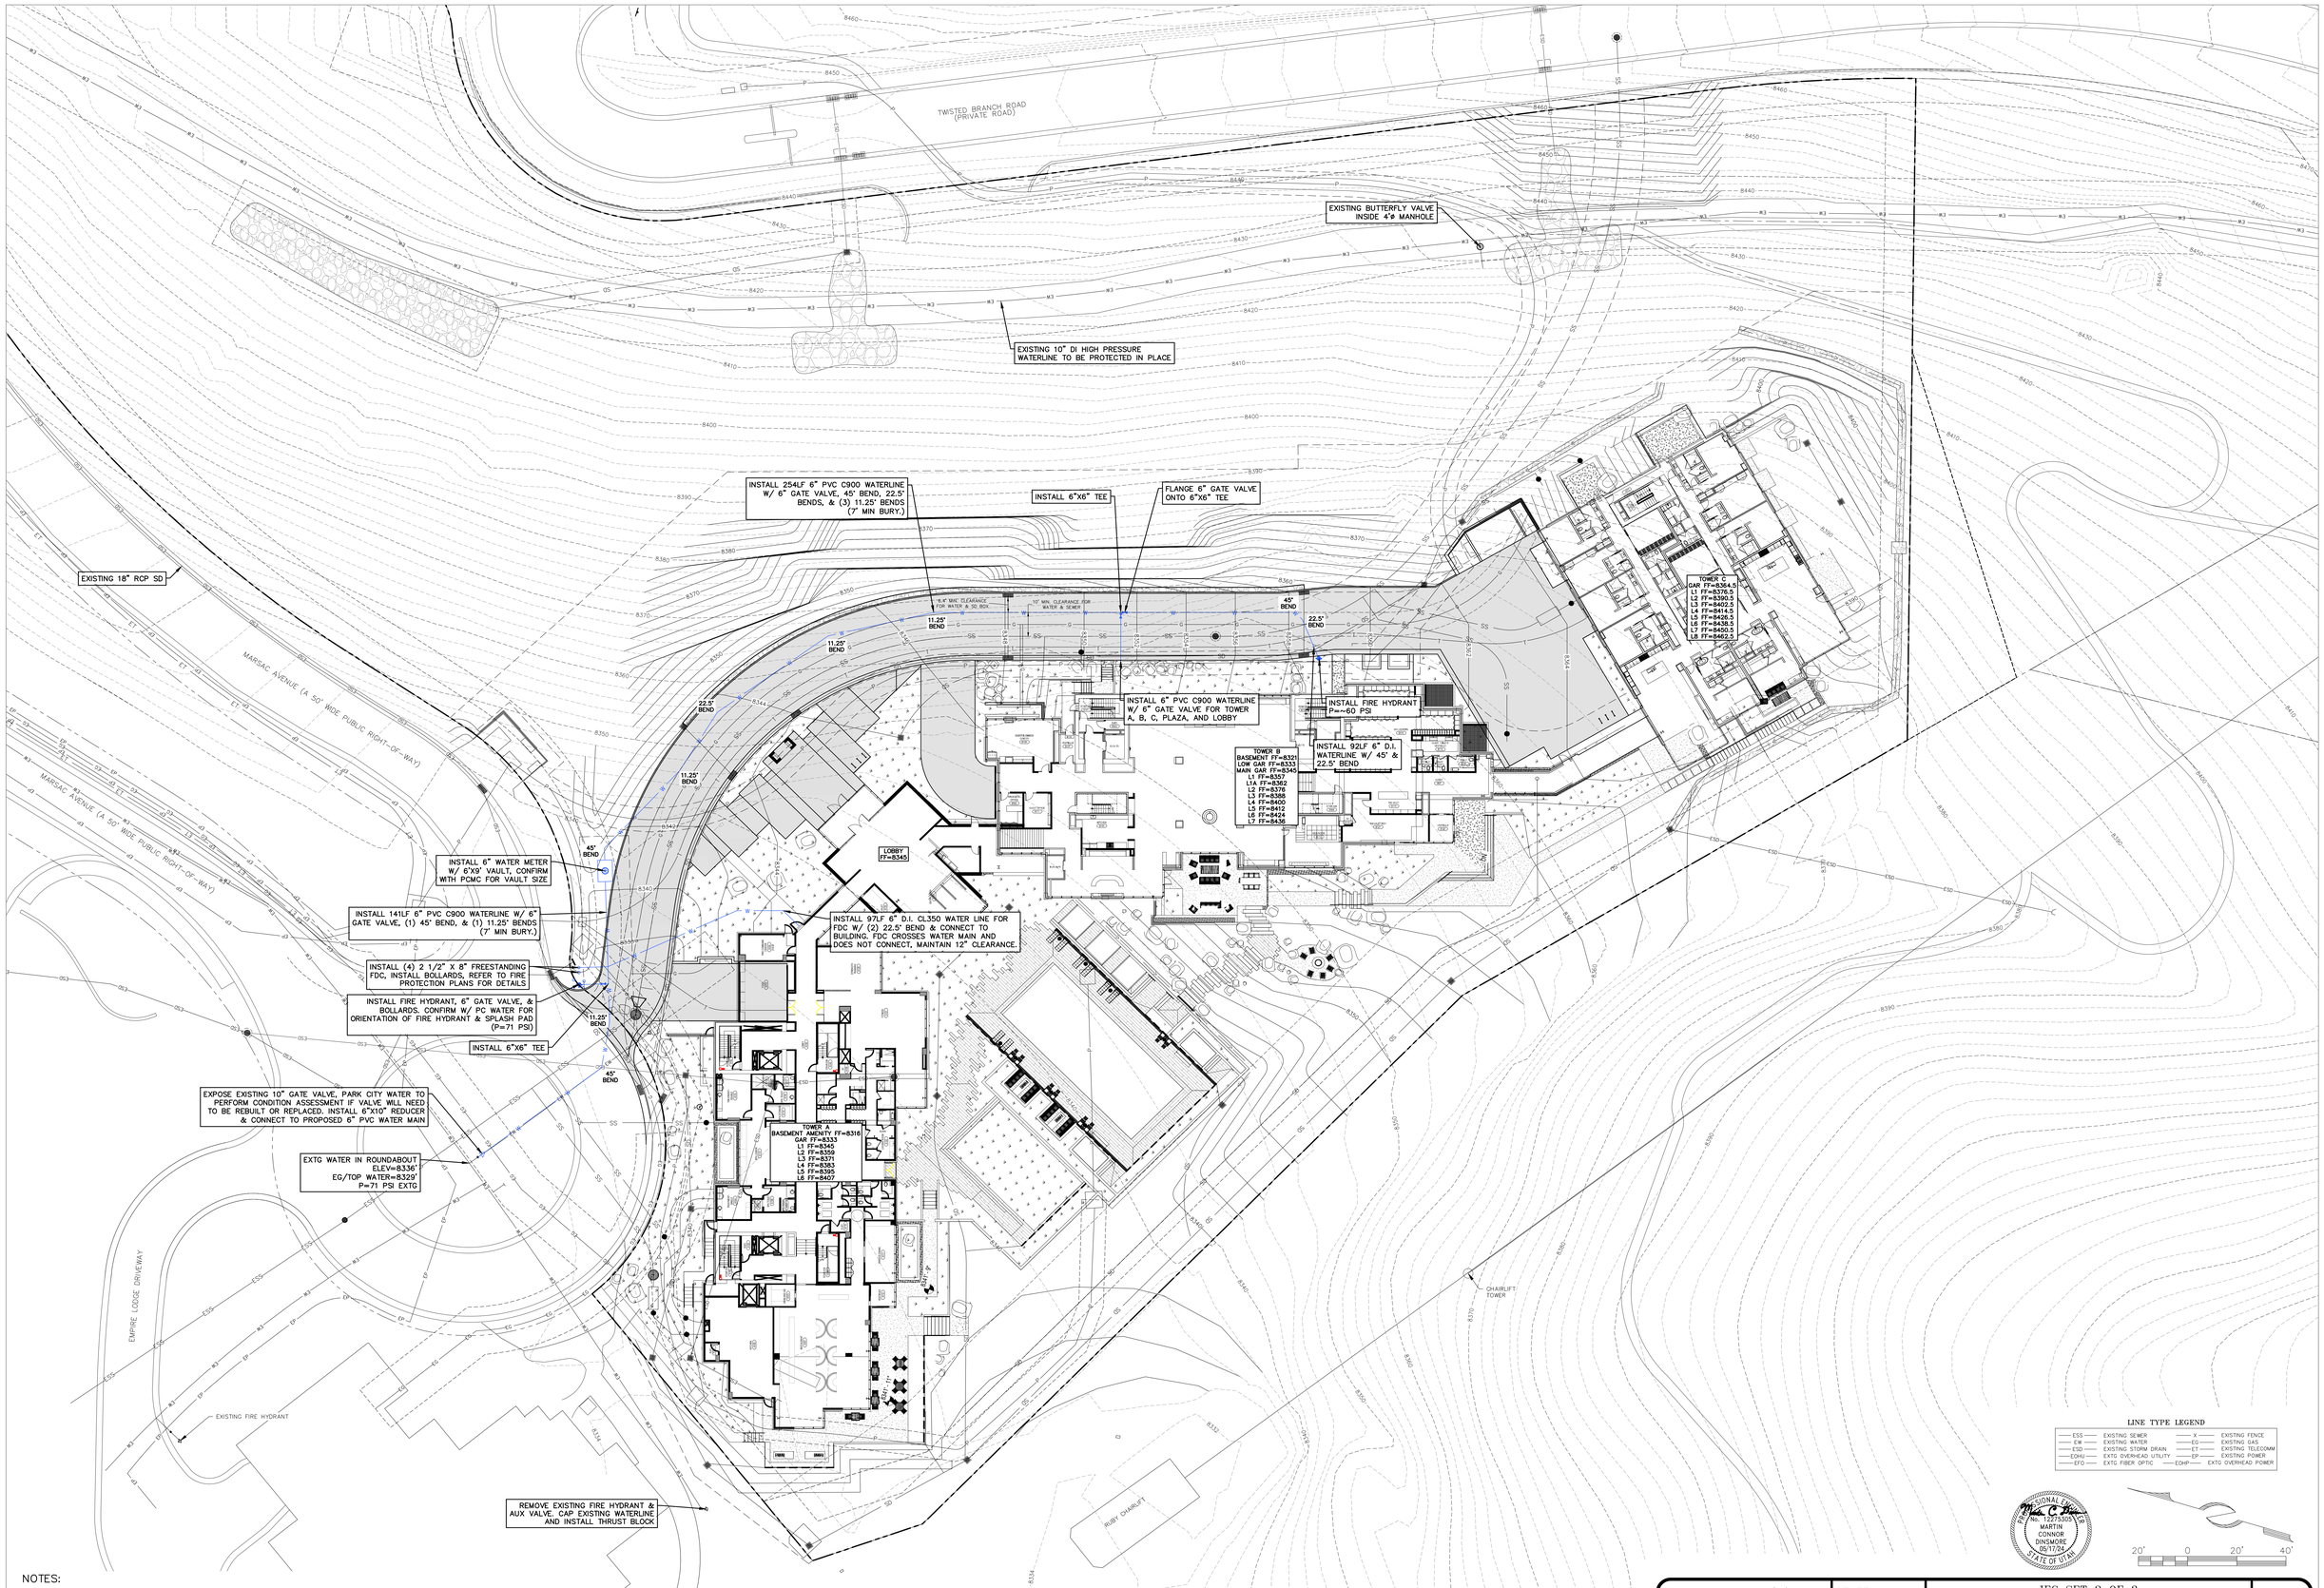

NOTES:

1. MAINTAIN 7FT MINIMUM BURY ON ALL WATER MAINLINES & SERVICE LINES.
2. CONFIRM WITH MECHANICAL PLAN FOR DETAILS OF BOOSTER PUMP SYSTEM INSIDE OF BUILDING B BASEMENT.
3. REFER TO SHEET C.18 FOR WATER DETAILS

(435) 649-9467
Alliance Engineering Inc
CONSULTING ENGINEERS LAND PLANNERS SURVEYORS
423 Main Street P.O. Box 2664 Park City, Utah 84060-2664

STAFF: MICHAEL DEMKOWICZ, CONNOR DINSMORE

DATE: 05/17/2024

IFC SET 2 OF 3
OVERALL WATER UTILITY PLAN
SOMMET BLANC DEVELOPMENT

FOR: SOMMET BLANC RESIDENCES I, LLC
JOB NO.: 1-11-18
FILE: X:\Empire\dwg\B2 East Design\B2 East-Civil.dwg

SHEET C.06