DARK SKY COMPLIANT 26" HIGH RECESSED LED STEPLIGHT - FAR THROW OPTIC

EMERGENCY LIGHTING 1FC AVERAGE Illuminance (Fc) Average = 0.77 Maximum = 1.6 Minimum = 0.2Avg/Min Ratio = 3.85 Max/Min Ratio = 8.00 20'-0"


A B C

101/8 23/4 5

EGRESS LIGHTING 1FC MINIMUM Illuminance (Fc) Average = 1.47 Maximum = 2.0Minimum = 1.0Avg/Min Ratio = 1.47 Max/Min Ratio = 2.00


LUMINAIRE TYPE X03


BEGA 24064

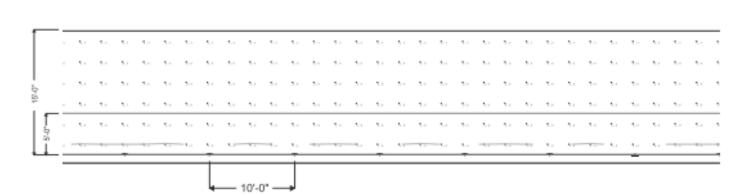


LUMINAIRE TYPE X09 TECH LIGHTING ENTRA CYLINDER

DARK SKY COMPLIANT CYLINDER DOWNLIGHT - 40 DEGREE OPTIC 15 WATTS

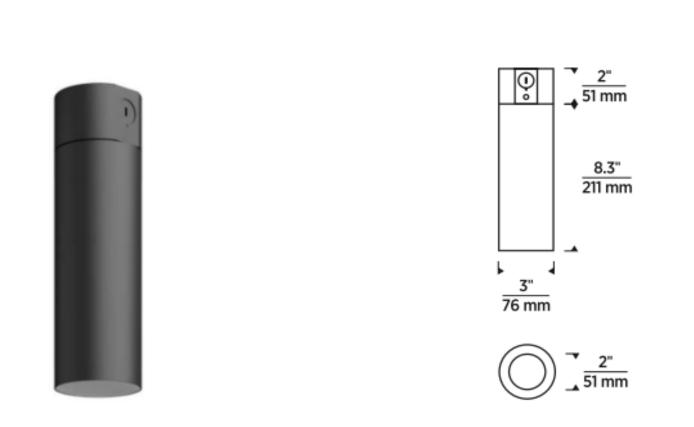

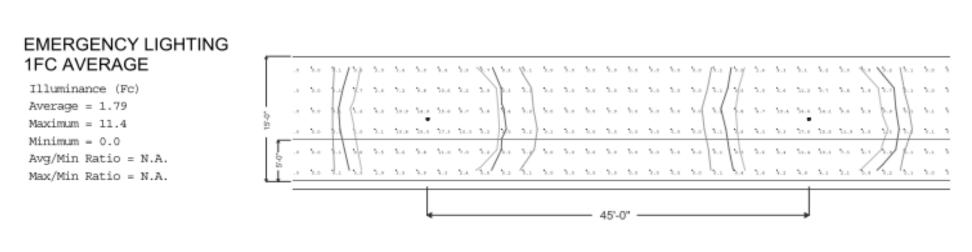

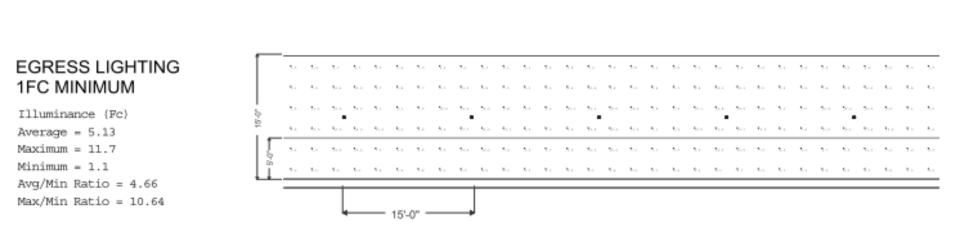



LUMINAIRE TYPE X01 SISTEMALUX GHOST

DARK SKY COMPLIANT 8' HIGH SURFACE MOUNT WALL SCONCE - DOWNWARD ASYMMETRIC

12 WATTS




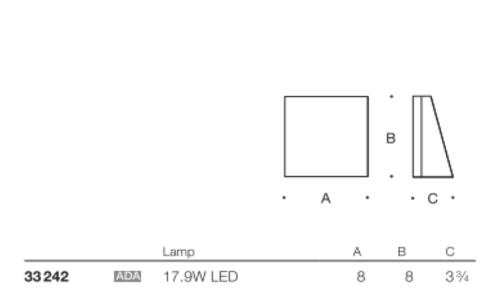


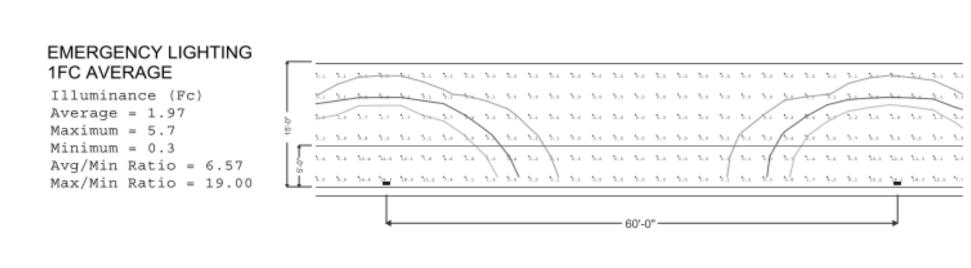

EGRESS LIGHTING 1FC MINIMUM Illuminance (Fc) Average = 13.08 Maximum = 20.8Minimum = 7.0Avg/Min Ratio = 1.87

Max/Min Ratio = 2.97

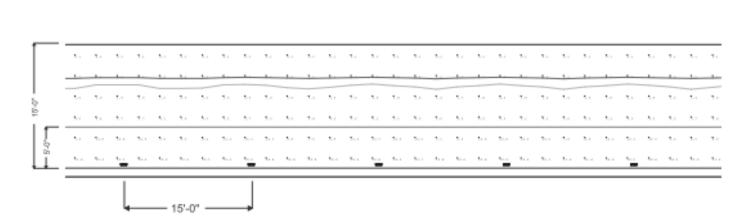

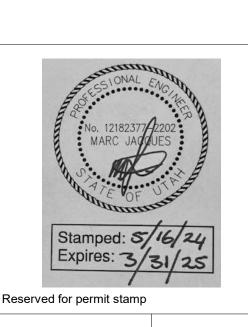

Olson Kundig

**ASPEN** GROUP Aspen Group USA, LLC PO Box 980022 Park City, Utah 84098

Pool Consultant
Cloward H20
2696 N University Ave, Suite 290 Provo, UT 84604 <u>Landscape Architect</u> **EPG Design**6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A Seattle, WA 98104 Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consulatant Lerch Bates 19515 North Creek Parkway, Suite 304 Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

<u>Lighting Designer</u> **O-**1319 SE MLK Blvd, Suite 210 Portland, Oregon 97219

Building Envelope Consultant RDH 2101 N 34th St Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100 Seattle, WA 98154 principal architect\_\_\_\_\_

> project manager\_\_\_\_\_ drawn by\_\_\_\_\_ checked by <u>Checker</u> job no. date 5/17/2024

> > IFC Set 2 of 3

5/17/2024

no. date

ELECTRICAL SITE LIGHTING DETAILS E1.03