

Kundig

ASPEN GROUP **Aspen Group USA, LLC**PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H20
2696 N University Ave, Suite 290
Provo, UT 84604 <u>Landscape Architect</u> **EPG Design**6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer Friday Group 88 Mainelli Road Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A Seattle, WA 98104 Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consulatant Lerch Bates 19515 North Creek Parkway, Suite 304 Bothell, WA 98011

Structural Engineer

Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101 <u>Lighting Designer</u> **O-**1319 SE MLK Blvd, Suite 210 Portland, Oregon 97219

Building Envelope Consultant RDH 2101 N 34th St Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109 MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

> principal architect_____ project manager_____ checked by <u>Checker</u>

IFC Set 2 of 3 5/17/2024

no. date

TOWER A - LVL 4 ELECTRICAL POWER PLAN E2.2A.14

SHEET NOTES:

A. DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATIONS EXCEPT WHERE DIMENSIONS ARE SHOWN. ELECTRICAL WORK IS SHOWN ON PLANS USING STANDARD INDUSTRY SYMBOLS. BEFORE ORDERING MATERIALS OR DOING WORK, VERIFY MEASUREMENTS PERTAINING THERETO AND ASSUME RESPONSIBILITY THEREFOR. ANY SUBSTANTIAL DIFFERENCES BETWEEN DRAWINGS AND CONDITIONS IN THE FIELD SHALL BE SUBMITTED TO THE CONSTRUCTION MANAGER FOR CONSIDERATION

BEFORE PROCEEDING WITH WORK. WORK PERFORMED INCLUDES LABOR, MATERIALS, AND EQUIPMENT REQUIRED TO INSTALL A COMPLETE ELECTRICAL SYSTEM AS INDICATED ON THESE DRAWINGS AND AS SPECIFIED. REFER TO ELECTRICAL CONNECTION SCHEDULE FOR CONDUIT, WIRING, COPD, DISCONNECT REQUIREMENTS.


D. VERIFY EQUIPMENT SIZES AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY ELECTRICAL CONDUITS IN FINISHED SPACES SHALL BE CONCEALED. COORDINATE WITH OTHER TRADES AND USE CHASES AND CEILING SPACES.LOCATIONS OF ELECTRICAL JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO

F. REFER TO MECHANICAL AND PLUMBING PLANS FOR EXACT LOCATION OF HVAC/PLUMBING

J-BOXES TO BE DETERMINED BY CONTRACTOR.

ROUGH-IN. G. PROVIDE CONDUIT, WIRE AND J-BOXES FOR CIRCUITING SHOWN. QUANTITY AND SIZES OF H. CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OF ANY ELECTRICAL CIRCUITS AFFECTED BY CONSTRUCTION. SUCH CIRCUITS WILL BE REPAIRED IMMEDIATELY. THERE WILL BE NO DISRUPTION OF SERVICE OUTSIDE OF CONSTRUCTION ZONE/ AREA.
PROVIDE TAMPER PROOF RECEPTACLES IN RESIDENTIAL UNITS AND ALL COMMON AREAS
AS PER NEC 406.12. # NUMBERED NOTES:

1 BRANCH CIRCUITS IN EACH DWELLING UNIT SHALL SUPPLY ONLY LOADS WITHIN THAT DWELLING UNIT OR LOADS ASSOCATED ONLY WITH THAT DWELLING UNIT. 2 FEEDERS TO A DWELLING UNIT SHALL NOT ENTER AND BE ROUTED THOUGH ANOTHER DWELLING UNIT. ELECTRICAL CONTRACTOR TO UTILIZE THE ELECTRICAL SHAFTS LOCATED ON THE EAST CORE AND WEST CORE TO ROUTE FEEDERS TO THE DWELLING UNITS.

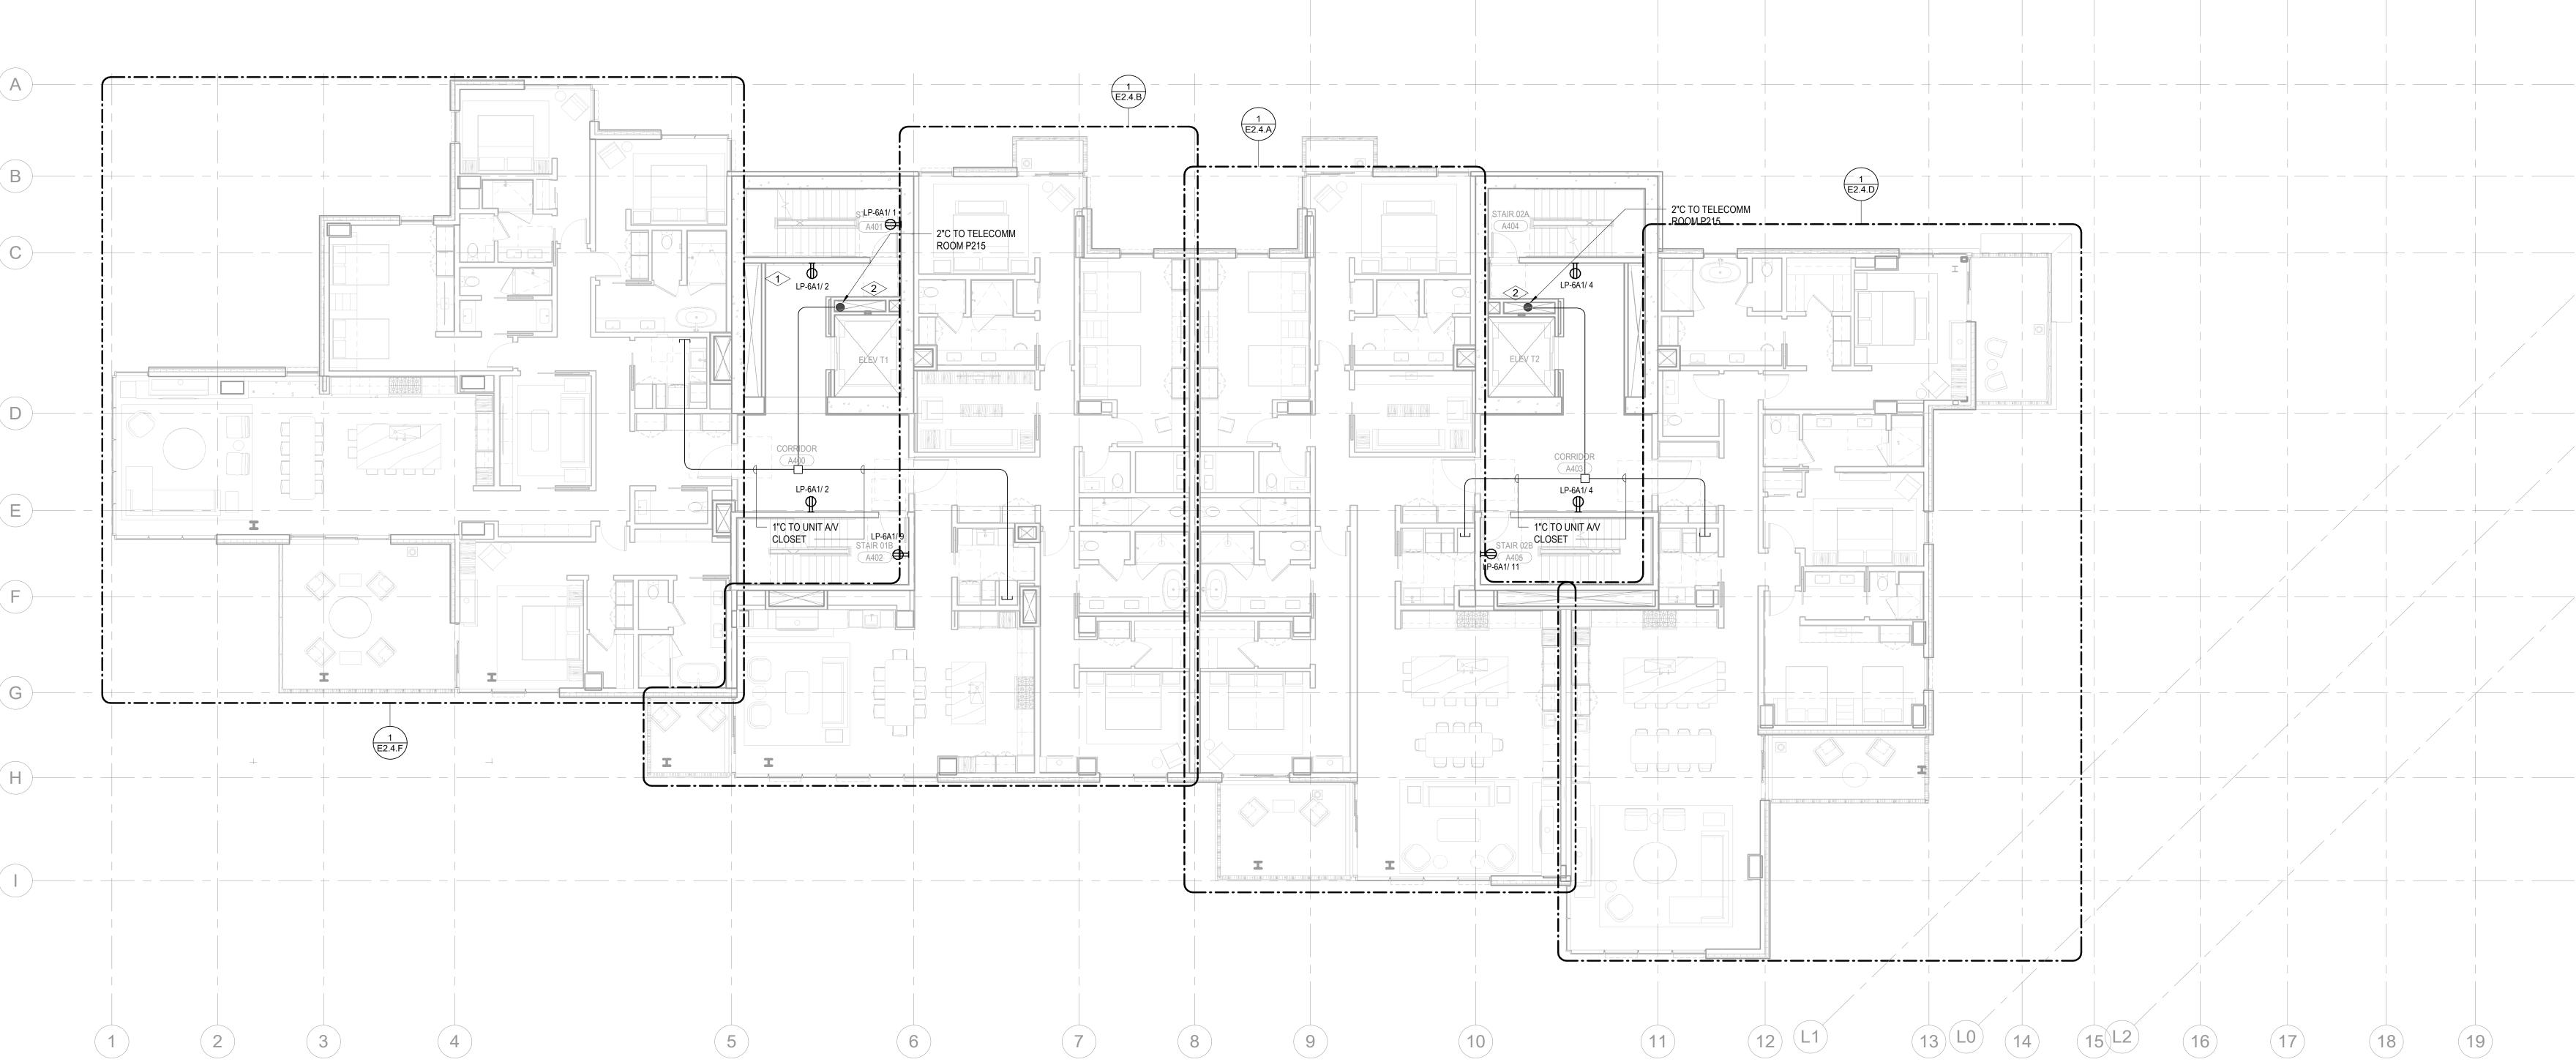

1 TOWER A - LEVEL 4 ELECTRICAL POWER

SCALE: 1/8" = 1'-0"