


159 South Jackson St, Suite 600
Seattle, Washington 98104 USA
1 206 624 5670 oleonkundig.com

Olson Kundig

project: **SOMMET BLANC**
3300 Marsac Ave (B2 East Parcel)
Bark City, Utah 84060

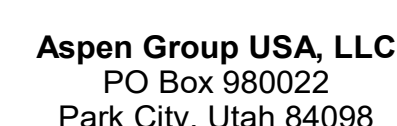

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Lakewood, Colorado 80026

Code Consultant
Holmes
600 1st Avenue, Suite 2000
New York, NY 10017-4803
Tel: 212 512-2000
Fax: 212 512-2001

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 300
Seattle, WA 98148-3100
Tel: 206/465-1100
Fax: 206/465-1101
E-mail: info@lerchbates.com
Web: www.lerchbates.com

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98164

principal architect _____
project manager _____
drawn by _____
checked by Checker
job no. _____
date 05/17/2024

revisions:

no.	date	br
-----	------	----

IFC Set 2 of 3
05/17/2024

TOWER C - LVL 6
ELECTRICAL POWER
PLAN

E2.2C.16

SHEET NOTES:

- A. DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATIONS WHERE THERE DIMENSIONS ARE SHOWN. ELECTRICAL WORK IS SHOWN ON THE BASIS OF THE ASSUMED LOCATION OF THE EQUIPMENT. THE CONTRACTOR SHALL VERIFY MEASUREMENTS PERTAINING THEREON AND ASSUME RESPONSIBILITY THEREFOR. ANY SUBSTANTIAL DIFFERENCES BETWEEN DRAWINGS AND CONDITIONS IN THE FIELD SHALL BE SUBMITTED TO THE ARCHITECT FOR REVIEW AND APPROVAL BEFORE PROCEEDING WITH WORK.
- B. THE CONTRACTOR SHALL INCLUDE MATERIALS AND EQUIPMENT REQUIRED TO INSTALL WORK AS SPECIFIED AND AS INDICATED ON THESE DRAWINGS AND AS SPECIFIED REFER TO ELECTRICAL CONNECTION SCHEDULE FOR CONDUIT, WIRING, COPD, AND ACCESSORIES.
- C. THE CONTRACTOR SHALL VERIFY EQUIPMENT SIZES AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY OTHERS.
- D. THE CONTRACTOR SHALL FINISH SPACES SHALL BE CONCEALED, COORDINATE WITH OTHER TRADES AND USE CHASES AND CEILING SPACES. LOCATIONS OF ELECTRICAL JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO REPAIRS.
- E. REFER TO MECHANICAL AND PLUMBING PLANS FOR EXACT LOCATION OF HVAC/PLUMBING EQUIPMENT.
- F. THE CONTRACTOR SHALL PROVIDE WIRE AND J-BOXES FOR CIRCUITING SHOWN. QUANTITY AND SIZES OF J-BOXES TO BE DETERMINED BY CONTRACTOR.
- G. CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OF ANY ELECTRICAL CIRCUITS DAMAGED BY THE CONTRACTOR. THE CONTRACTOR SHALL BE REPAIRED IMMEDIATELY. THERE WILL BE NO DISRUPTION OF SERVICE OUTSIDE OF CONSTRUCTION ZONE AREA. PROVIDE TAMPER PROOF RECEPTACLES IN RESIDENTIAL UNITS AND ALL COMMON AREAS.

▶ **NUMBERED NOTES:**

- 1 BRANCH CIRCUITS IN EACH DWELLING UNIT SHALL SUPPLY ONLY LOADS WITHIN
THAT DWELLING UNIT OR LOADS ASSOCIATED ONLY WITH THAT DWELLING UNIT.
- 2 FEEDERS TO A DWELLING UNIT SHALL NOT ENTER AND BE ROUTED THOUGH
ANOTHER DWELLING UNIT.



1 TOWER C - LEVEL 6 ELECTRICAL POWER PLAN
SCALE: 1/8" = 1'-0"

