


Seattle, Washington 98104 USA
+1 206 624 5670 olav@kurdig.com

project: **SOMMET BLANC**
3300 Marsac Ave (B2 East Parcel)

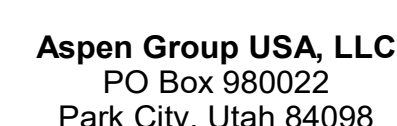

principal architect _____
project manager _____
drawn by _____
checked by _____ Checker _____
job no. _____
date 05/17/2024

no.	date	t
-----	------	---

E2.2C.17

A. DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATION EXCEPT WHERE DIMENSIONS ARE SHOWN. ELECTRICAL WORK IS SHOWN ON THE BASIS OF THE STANDARD PRACTICES OF THE ELECTRICAL INDUSTRY. THE CONTRACTOR SHALL VERIFY MEASUREMENTS PERTAINING THEREIN AND ASSUME RESPONSIBILITY THEREFOR. ANY SUBSTANTIAL DIFFERENCES BETWEEN DRAWINGS AND CONDITIONS IN THE FIELD SHALL BE SUBMITTED TO THE ARCHITECT FOR REVIEW AND APPROVAL BEFORE PROCEEDING WITH WORK.

B. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS, AND EQUIPMENT REQUIRED TO INSTALL WORK PERFORMED INCLUDING LUGS, SPLICERS, AND CONDUIT. MATERIALS AND EQUIPMENT TO BE USED SHALL BE AS INDICATED ON THESE DRAWINGS, AND AS SPECIFICALLY REFERRED TO ELECTRICAL CONNECTION SCHEDULE FOR CONDUIT, WIRING, COPD, AND EQUIPMENT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS. VERIFY EQUIPMENT, CONDUIT AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY OTHERS.

C. ALL ELECTRICAL SIZES IN FINISHED SPACES SHALL BE CONCEALED COORDINATE WITH OTHER TRADES AND USE CHASES AND CEILING SPACES. LOCATIONS OF ELECTRICAL JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO INSTALLATION.

D. REFER TO MECHANICAL AND PLUMBING PLANS FOR EXACT LOCATION OF FLOOR/CEILING EQUIPMENT.

E. ALL CONDUIT, WIRE AND J-BOXES FOR CUTTING SHOWN, QUANTITY AND SIZES OF J-BOXES TO BE DETERMINED BY CONTRACTOR.

F. CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OF ANY ELECTRICAL CIRCUITS, OR CONSTRUCTION DAMAGE TO EXISTING ELECTRICAL SYSTEMS. IF REPAIR IS REQUIRED IMMEDIATELY, THERE WILL BE NO DISRUPTION OF SERVICE OUTSIDE OF CONSTRUCTION ZONE/AREA. PROVIDE TAMPER PROOF RECEPTACLES IN RESIDENTIAL UNITS AND ALL COMMON AREAS.

1 BRANCH CIRCUITS IN EACH DWELLING UNIT SHALL SUPPLY ONLY LOADS WITHIN
THAT DWELLING UNIT OR LOADS ASSOCIATED ONLY WITH THAT DWELLING UNIT.

2 FEEDERS TO A DWELLING UNIT SHALL NOT ENTER AND BE ROUTED THOUGH
ANOTHER DWELLING UNIT.



1 TOWER C - LEVEL 7 ELECTRICAL POWER PLAN
SCALE: 1/8" = 1'-0"

