


Olson Kundig

project: **SOMMET BLANC**
3300 Marsac Ave (B2 East Parcel)

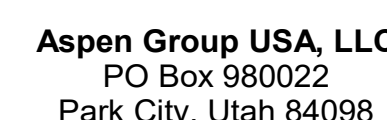

principal architect _____
project manager _____
drawn by _____
checked by Checker
job no. _____
date 5/31/2024

no.	date
-----	------

IFC Set 3 of
5/31/2024

TOWER A/B ELECTRICAL
LIGHTING PLAN - UNIT E

E3.4.E

DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATIONS EXCEPT WHERE DIMENSIONS ARE SHOWN. ELECTRICAL WORK IS SHOWN ON PLANS USING STANDARD INDUSTRY SYMBOLS. BEFORE ORDERING MATERIALS OR COMMENCEMENT WITH WORK, VERIFY MEASUREMENTS PERTAINING THERETO AND CORRECT ANY DISCREPANCY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING DIMENSIONS AND CONDITIONS IN THE FIELD. SHALL BE SUBMITTED TO THE CONSTRUCTION MANAGER FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

ALL WORK REQUIRED INCLUDED IN THE SCHEDULE SHALL BE COMPLETED TO INSTAL A COMPLETE ELECTRICAL POWER SYSTEM AS INDICATED ON DRAWINGS AND SPECIFICATIONS. PROVIDE EXHAUSTING AND EXHAUST SIGNS. LUMINAIRE NOTES AS EMERGENCY; PROVIDE EMERGENCY POWER SOURCE AS NOTED ON DRAWINGS.

REFER TO LUMINAIRE SCHEDULE FOR INFORMATION.

FIXTURES SHALL BE IDENTIFIED BY A CHANGE IN DIFFERENCES BETWEEN FIELD MEASURED CATALOG NUMBERS FOR ACCURACY.


VERIFY EQUIPMENT SIZES AND POWER REQUIREMENTS F OR EQUIPMENT PROVIDED BY OTHERS.

G. ELECTRICAL COUNTS IN FINISHED SPACES SHALL BE CONCEALED, COORDINATE WITH OTHER TRADES AND USE CHASES AND GELING LOCATIONS FOR ELECTRICAL CONDUIT. BOXES IN FINISHED SPACES SHALL BE CONCEALED. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND ALL OTHER APPLICABLE CODES.

H. COORDINATE REMOTE REMOTE MOUNTING LOCATIONS WITH ARCHITECT/PRO TO BOLT IN.

I. COORDINATE LUMINAIRE VOLTAGE WITH ARCHITECT AND OWNER PRIOR TO PURCHASE AND INSTALLATION.

- 1 LUTRON WIRELESS POCKET SWITCH IS TO BE SUPPLIED AND INSTALLED FOR SHADE CONTROL.
- 1 SUPPLY AND INSTALL LUTRON RADIO RA2 SYSTEM WITH PARTIAL LIGHTING CONTROL IN THE RESIDENTIAL UNITS. MASTER BEDROOM (IDENTIFIED AS BED 1) AND ALL ROOMS WITH MORE THAN THREE (3) LIGHTING CONTROL ZONES ARE TO BE CONTROLLED BY THE LUTRON RADIO RA2 SYSTEM. ALL ROOMS WITH THREE (3) LIGHTING CONTROL ZONES OR LESS ARE TO BE CONTROLLED BY LOCAL DIMMERS.
- 1 SUPPLY AND INSTALL CEILING MOUNTED JUNCTION BOX COMPLETE WITH CAPPED LIGHTING CIRCUIT WIRING FOR INSTALLATION OF FUTURE CLOSET LIGHT FIXTURE.
- 4 LIGHT FIXTURE LOCATIONS IN CLOSETS ARE TO BE CONTROLLED BY CLOSET DORM JAM SWITCH.
- 5 REFER TO ARCHITECTURE, DRAWINGS AND ELEVATIONS FOR EXACT DIMENSION AND MOUNTING LOCATION OF LIGHT FIXTURES TO COORDINATE WITH MILLWORK.

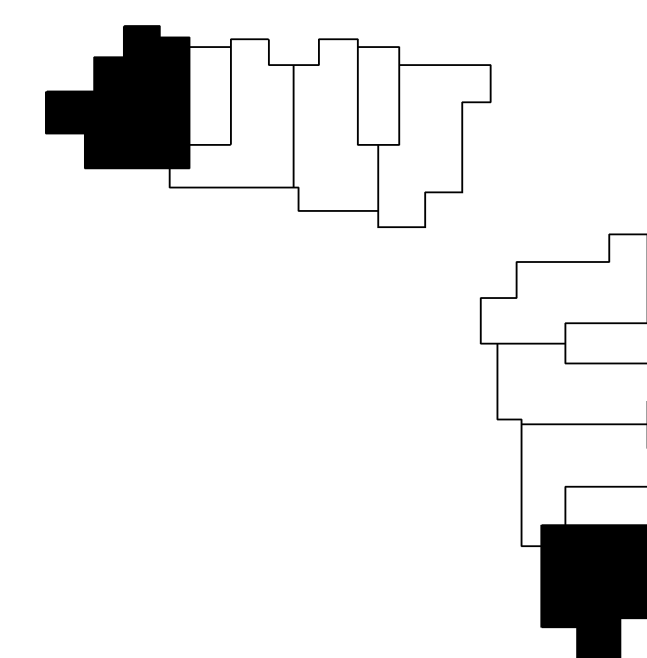

0 1' 2' 3' 4' 8' 1