


159 South Jackson St, Suite 600
Seattle, Washington 98104 USA
Tel: 206.824.8470 info@nordicusa.com

project:
SOMMET BLANC
3300 Marsac Ave (B2 East Parcel)

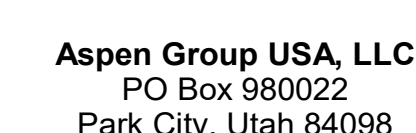

no.	date	t
-----	------	---

E3.4.F

DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATION OF THE DEVICES OR EQUIPMENT. THE ELECTRICAL WORK OR SHOWING PLANS USING STANDARD INDUSTRY SYMBOLS, BEFORE ORDERING MATERIALS OR COMMENCEMENT WITH WORK. VERY MEASUREMENTS PERTAINING THERE TO AND ANY CHANGES TO THE DRAWINGS WILL BE THE RESPONSIBILITY OF THE ARCHITECT. THE DRAWINGS AND CONDITIONS IN THE FIELD SHALL BE SUBMITTED TO THE CONSTRUCTION MANAGER FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

THE ARCHITECT HAS INCLUDED THE FOLLOWING INFORMATION REQUIRED TO INSTALL A COMPLETE ELECTRICAL SYSTEM AS INDICATED ON DRAWINGS AND SPECIFICATIONS. THE ARCHITECT HAS NOT INCLUDED THE FOLLOWING INFORMATION NEEDED TO EMERGENCY POWER SOURCE AS INDICATED ON PLANS.

REFER TO LUMINAIRE SCHEDULE FOR INFORMATION.

FURNISH THE FOLLOWING INFORMATION TO THE MANUFACTURER, VERIFY THE FIXTURE CATALOG NUMBERS FOR ACCURACY.


VERIFY EQUIPMENT SIZES AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY OTHERS.

USE THE FOLLOWING INFORMATION TO VERIFY THE ELECTRICAL CONDITIONS IN FINISHED SPACES SHALL BE CONCEALED. COORDINATE WITH THE ARCHITECT AND THE ELECTRICAL CONTRACTOR TO VERIFY THE LOCATION OF THE JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO ROUGH IN.

THE ARCHITECT REMOTE POWER MOUNTING LOCATIONS WITH ARCHITECT PRIOR TO ROUGH IN.

COORDINATE LUMINAIRE VOLTAGE WITH ARCHITECT AND OWNER PRIOR TO PURCHASE AND INSTALLATION TYPE FOR EACH LIGHT FIXTURE.

- 1 LUTRON WIRELESS PICO CONTROL SWITCH IS TO BE SUPPLIED AND INSTALLED FOR SHADE CONTROL.
- 1 LIGHT FIXTURE LOCATION IN CLOSETS ARE TO BE CONTROLLED BY CONTROL DOOR JAMB SWITCH.
- 1 SUPPLY AND INSTALL LUTRON RADIO RAC SYSTEM TO PROVIDE PRETIAL LIGHTING CONTROL IN THE RESIDENTIAL UNITS MASTER BEDROOM (DENOTED AS BED 1) AND ALL ROOMS WITH MORE THAN THREE (3) LIGHTING CONTROL ZONES ARE TO BE CONTROLLED BY THE LUTRON RADIO RAC SYSTEM. ALL ROOMS WITH THREE (3) LIGHTING CONTROL ZONES OR LESS ARE TO BE CONTROLLED BY LOCAL SWITCH.
- 4 SUPPLY AND INSTALL CEILING MOUNTED JUNCTION BOX COMPLETE WITH CAPPED LIGHTING CIRCUIT WIRING FOR INSTALLATION OF FUTURE CLOSET LIGHT FIXTURE.
- 5 REFER TO ARCHITECTURAL DRAWINGS AND ELEVATIONS FOR EXACT DIMENSION AND MOUNTING LOCATION OF LIGHT FIXTURE. USE LUTRON COORDINATOR WITH LOW VOLTAGE CONTRACTOR ERROR FOR INSTALLATION.

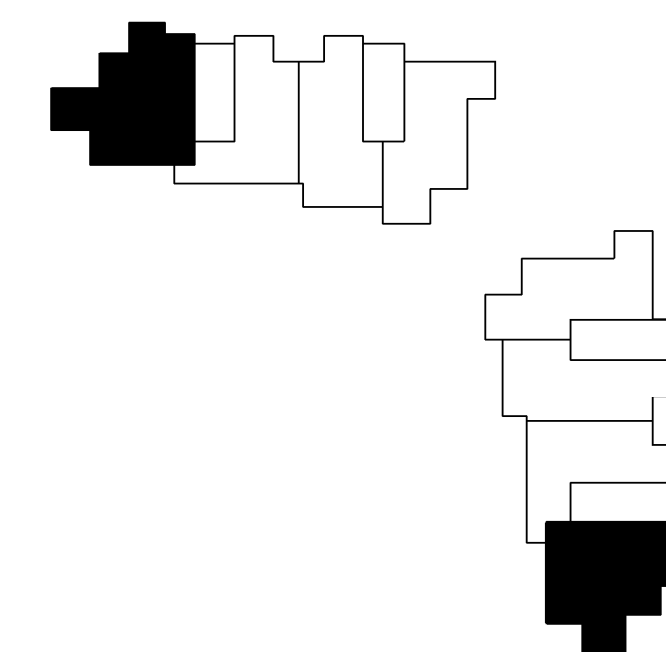

0 1' 2' 3' 4' 8' 1

1 TOWER A/B - ELECTRICAL LIGHTING PLAN - UNIT F
SCALE: 1/4" = 1'-0"

TOWER A/B ELECTRICAL
LIGHTING PLAN - UNIT F