


Olson Kundig

project: **SOMMET BLANC**  
3300 Marsac Ave (B2 East Parcel)  
Bark City, Utah 84060

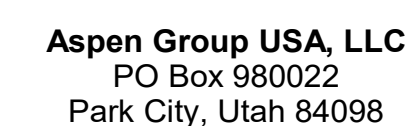

no.	date	t
-----	------	---

### E3.4.M

DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORKS AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATIONS OF WORKS. WHEN CHANGING THE LOCATION OF WORKS, SHOW THE CHANGES BY STANDARD INDUSTRY SYMBOLS. BEFORE ORDERING MATERIALS OR COMMENCEMENT WITH WORK, VERIFY MEASUREMENTS PERTAINING THERE TO AND ASSUME RESPONSIBILITY THEREFOR. THE SUBMITTER SHALL BE RESPONSIBLE FOR THE LOCATION OF WORKS IN THE FIELD. SHALL BE SUBMITTED TO THE CONSTRUCTION MANAGER FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

UNLESS OTHERWISE INDICATES LABOR, MATERIALS, AND EQUIPMENT REQUIRED TO INSTALL A COMPLETE ELECTRICAL SYSTEM AS INDICATED ON DRAWINGS AND SPECIFICATIONS. PROVIDE EXISTING AND CONCEPT EXIST SIGNS AND LUMINAIRES NOTED AS EMERGENCY TO EMERGENCY POWER SOURCE. PROVIDE EXISTING AND CONCEPT EXIST SIGNS AND LUMINAIRE REFERENCE TO LUMINAIRE SCHEDULE FOR INFORMATION.

D. FUTURE CALL OUT NUMBERS ARE SUBJECT TO CHANGE BY MANUFACTURER. VERIFY FUTURE CALL OUT NUMBERS TO BE USED BY MANUFACTURER.


F. VERIFY EQUIPMENT SIZES AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY OTHERS.

G. ELECTRICAL CONDITIONS IN FINISHED SPACES SHALL BE CONCEALED. COORDINATE WITH OTHER TRADES AND USE CHASES AND CEILING SPACES. LOCATIONS OF ELECTRICAL JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO ROUGH-IN.

COORDINATE REMOTE DRIVER MOUNTING LOCATIONS WITH ARCHITECT PRIOR TO ROUGH-IN.

LUMINAIRE: LUMINAIRE SHALL BE PROVIDED BY CONTRACT AND OWNER PRIOR TO PURCHASE AND INSTALLATION. TYPE AND ALL UNIT LIGHTING.

- 1 LUTRON WIRELESS PICO CONTROL SWITCH IS TO BE SUPPLIED AND INSTALLED FOR SHADE CONTROL.
- 2 LIGHT FIXTURE LOCATED IN CLOSET ARE TO BE CONTROLLED BY CLOSET DOOR JAM SWITCH.
- 3 SUPPLY AND INSTALL LUTRON WIRELESS PICO CONTROL SWITCH TO PROVIDE PARTIAL LIGHTING CONTROL IN THE RESIDENTIAL UNITS. MASTER BEDROOM (DENOTED AS BED 1) AND ALL ROOMS WITH MORE THAN THREE (3) LIGHTING CONTROL ZONES ARE TO BE CONTROLLED BY THE LUTRON RADIO RAS SYSTEM. ALL ROOMS WITH LESS THAN (3) LIGHTING CONTROL ZONES ARE TO BE CONTROLLED BY THE LUTRON RADIO RAS SYSTEM.
- 4 SUPPLY AND INSTALL CEILING MOUNTED JUNCTION BOX COMPLETE WITH CAPPED LIGHTING CIRCUIT WIRING FOR INSTALLATION OF FUTURE CLOSET LIGHT FIXTURE.
- 5 REFER TO ARCHITECTURAL DRAWINGS AND ELEVATIONS FOR EXACT DIMENSION AND MOUNTING LOCATION OF LIGHT FIXTURE TYPE, LUMEN CORP.
- 6 CONTRACTOR TO INSTALL.

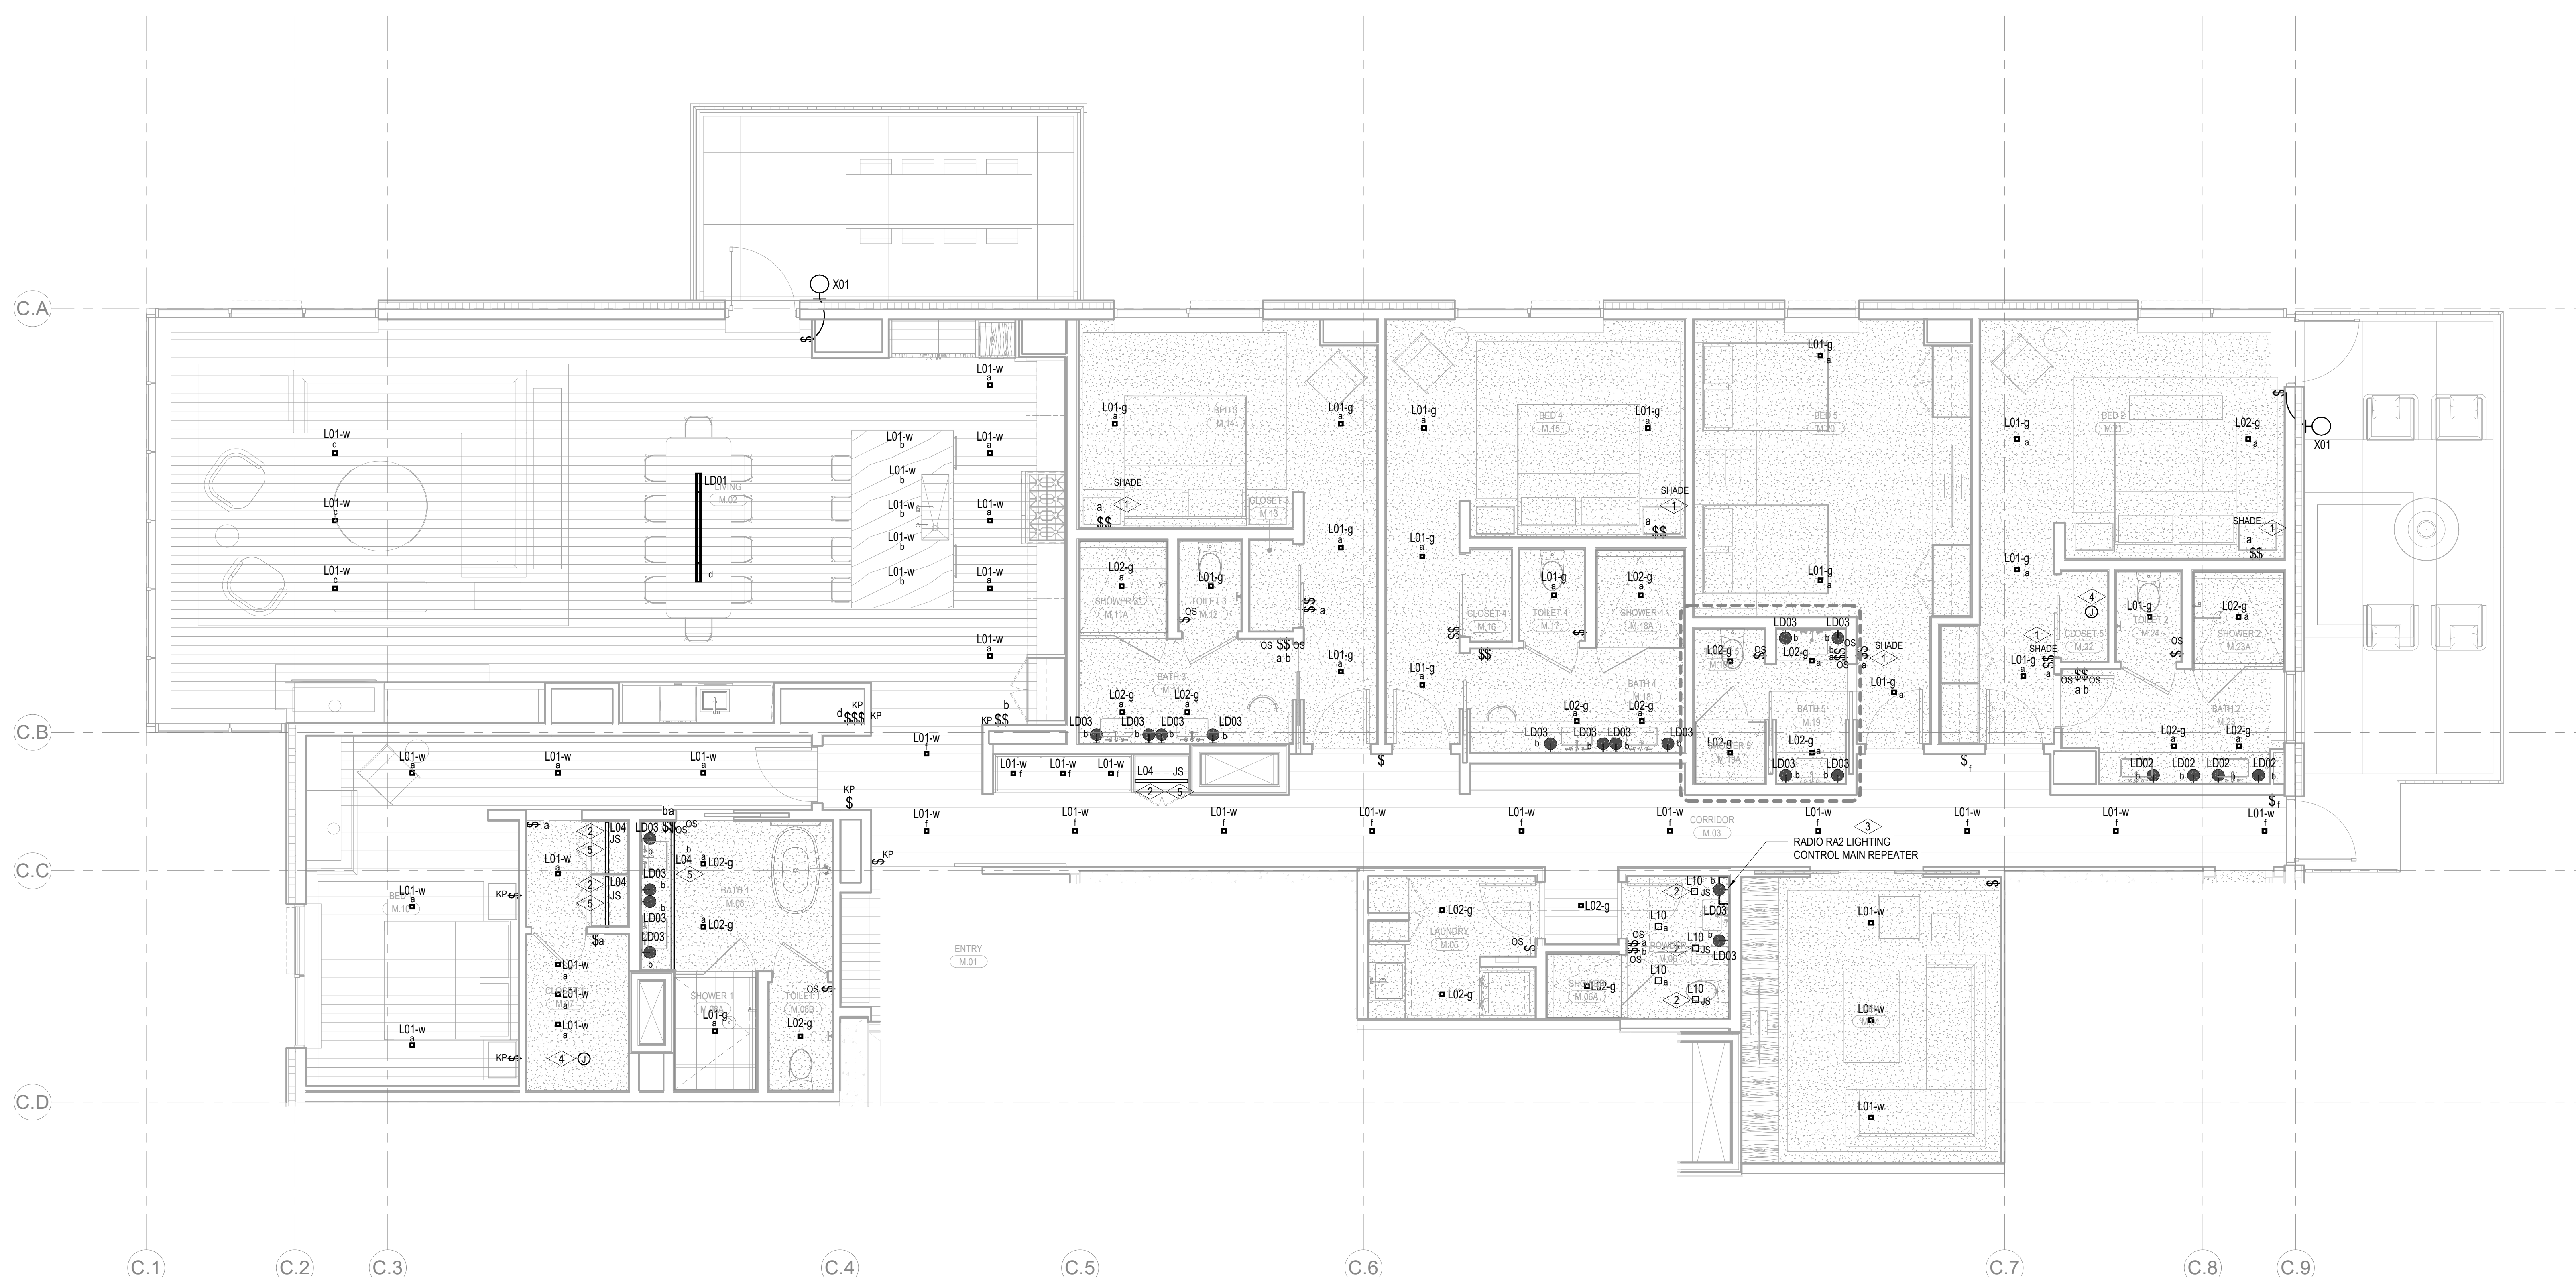

1 TOWER C - ELECTRICAL LIGHTING UNIT PLAN - M  
SCALE: 1/4" = 1'-0"

