


Olson Kundig

project: **SOMMET BLANC**
3300 Marsac Ave (B2 East Parcel)
Bark City, Utah 84060

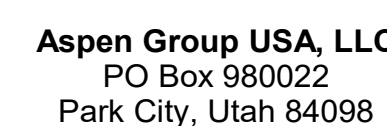

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

no.	date	by
-----	------	----

IFC Set 3 of 3
5/31/2024

TOWER A/B ELECTRICAL
LIGHTING PLAN - UNIT P

E3.4.P

TOWER A/B ELECTRICAL
LIGHTING PLAN - UNIT P

E3.4.P

DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATION OF WORK. THEREFORE, THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE PLANS USING STANDARD INDUSTRY SYMBOLS, BEFORE ORDERING MATERIALS OR COMMENCEMENT WITH WORK. VERY MEASUREMENTS PERTAINING THERETO AND ANY DISCREPANCY OR INCONSISTENCY SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. DRAWINGS AND CONDITIONS IN THE FIELD SHALL BE SUBMITTED TO THE CONSTRUCTION MANAGER FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

EXISTING UTILITIES INCLUDED INCLUDE ELECTRICAL, TELEPHONE, CABLE, AND GAS. TO INSTALL A COMPLETE ELECTRICAL SYSTEM AS INDICATED ON DRAWINGS AND SPECIFICATIONS. CONDITIONS AND MATERIALS NOT SHOWN OR SPECIFIED ARE NOTED AS EMERGENCY TO EMERGENCY POWER SOURCE AS INDICATED ON DRAWING.

REFER TO LUMINAIRE SCHEDULE FOR INFORMATION

FIXTURE SCHEDULE NUMBERS AND DESCRIPTIONS CHANGE BY MANUFACTURER, VERIFY FIXTURE CATALOG NUMBERS FOR ACCURACY.


VERIFY EQUIPMENT SIZES AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY OTHERS.

ELECTRICAL CONDITIONS IN FINISHED SPACES SHALL BE CONCEALED, COORDINATE WITH MECHANICAL AND USE OF SPACE. ALL ELECTRICAL WORK SHALL BE IN ACCORDANCE WITH THE JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO POUR.

CONCEAL BEMER DRIVE MOUNTING LOCATIONS WITH ARCHITECT PRIOR TO POUR.

COORDINATE LUMINAIRE VOLTAGE WITH ARCHITECT AND OWNER PRIOR TO PURCHASE AND INSTALLATION TYPE FOR ALL UNIT LIGHTING.

- 1 LIGHT FIXTURE LOCATED IN CLOSETS ARE TO BE CONTROLLED BY CLOSET DOOR JAM SWITCH.
- 2 SUPPLY AND INSTALL LUTRON RADIO RAS2 SYSTEM TO PROVIDE PARTIAL LIGHTINGS CONTROL IN THE RESIDENTIAL UNITS. MASTER BEDROOM (DENOTED AS BED 1) AND ALL ROOMS WITH MORE THAN THREE (3) LIGHTING CONTROL ZONES ARE TO BE CONTROLLED BY THE LUTRON RADIO RAS2 SYSTEM. ALL ROOMS WITH THREE (3) LIGHTING CONTROL ZONES OR LESS ARE TO BE CONTROLLED BY LOCAL DIMMERS.
- 3 REFER TO ARCHITECTURAL DRAWINGS AND ELEVATIONS FOR EXACT DIMENSION AND MOUNTING LOCATION OF LIGHT FIXTURE TYPE / (A4, COORDINATE WITH MILL WORK CONTRACTOR PRIOR TO INSTALLATION.

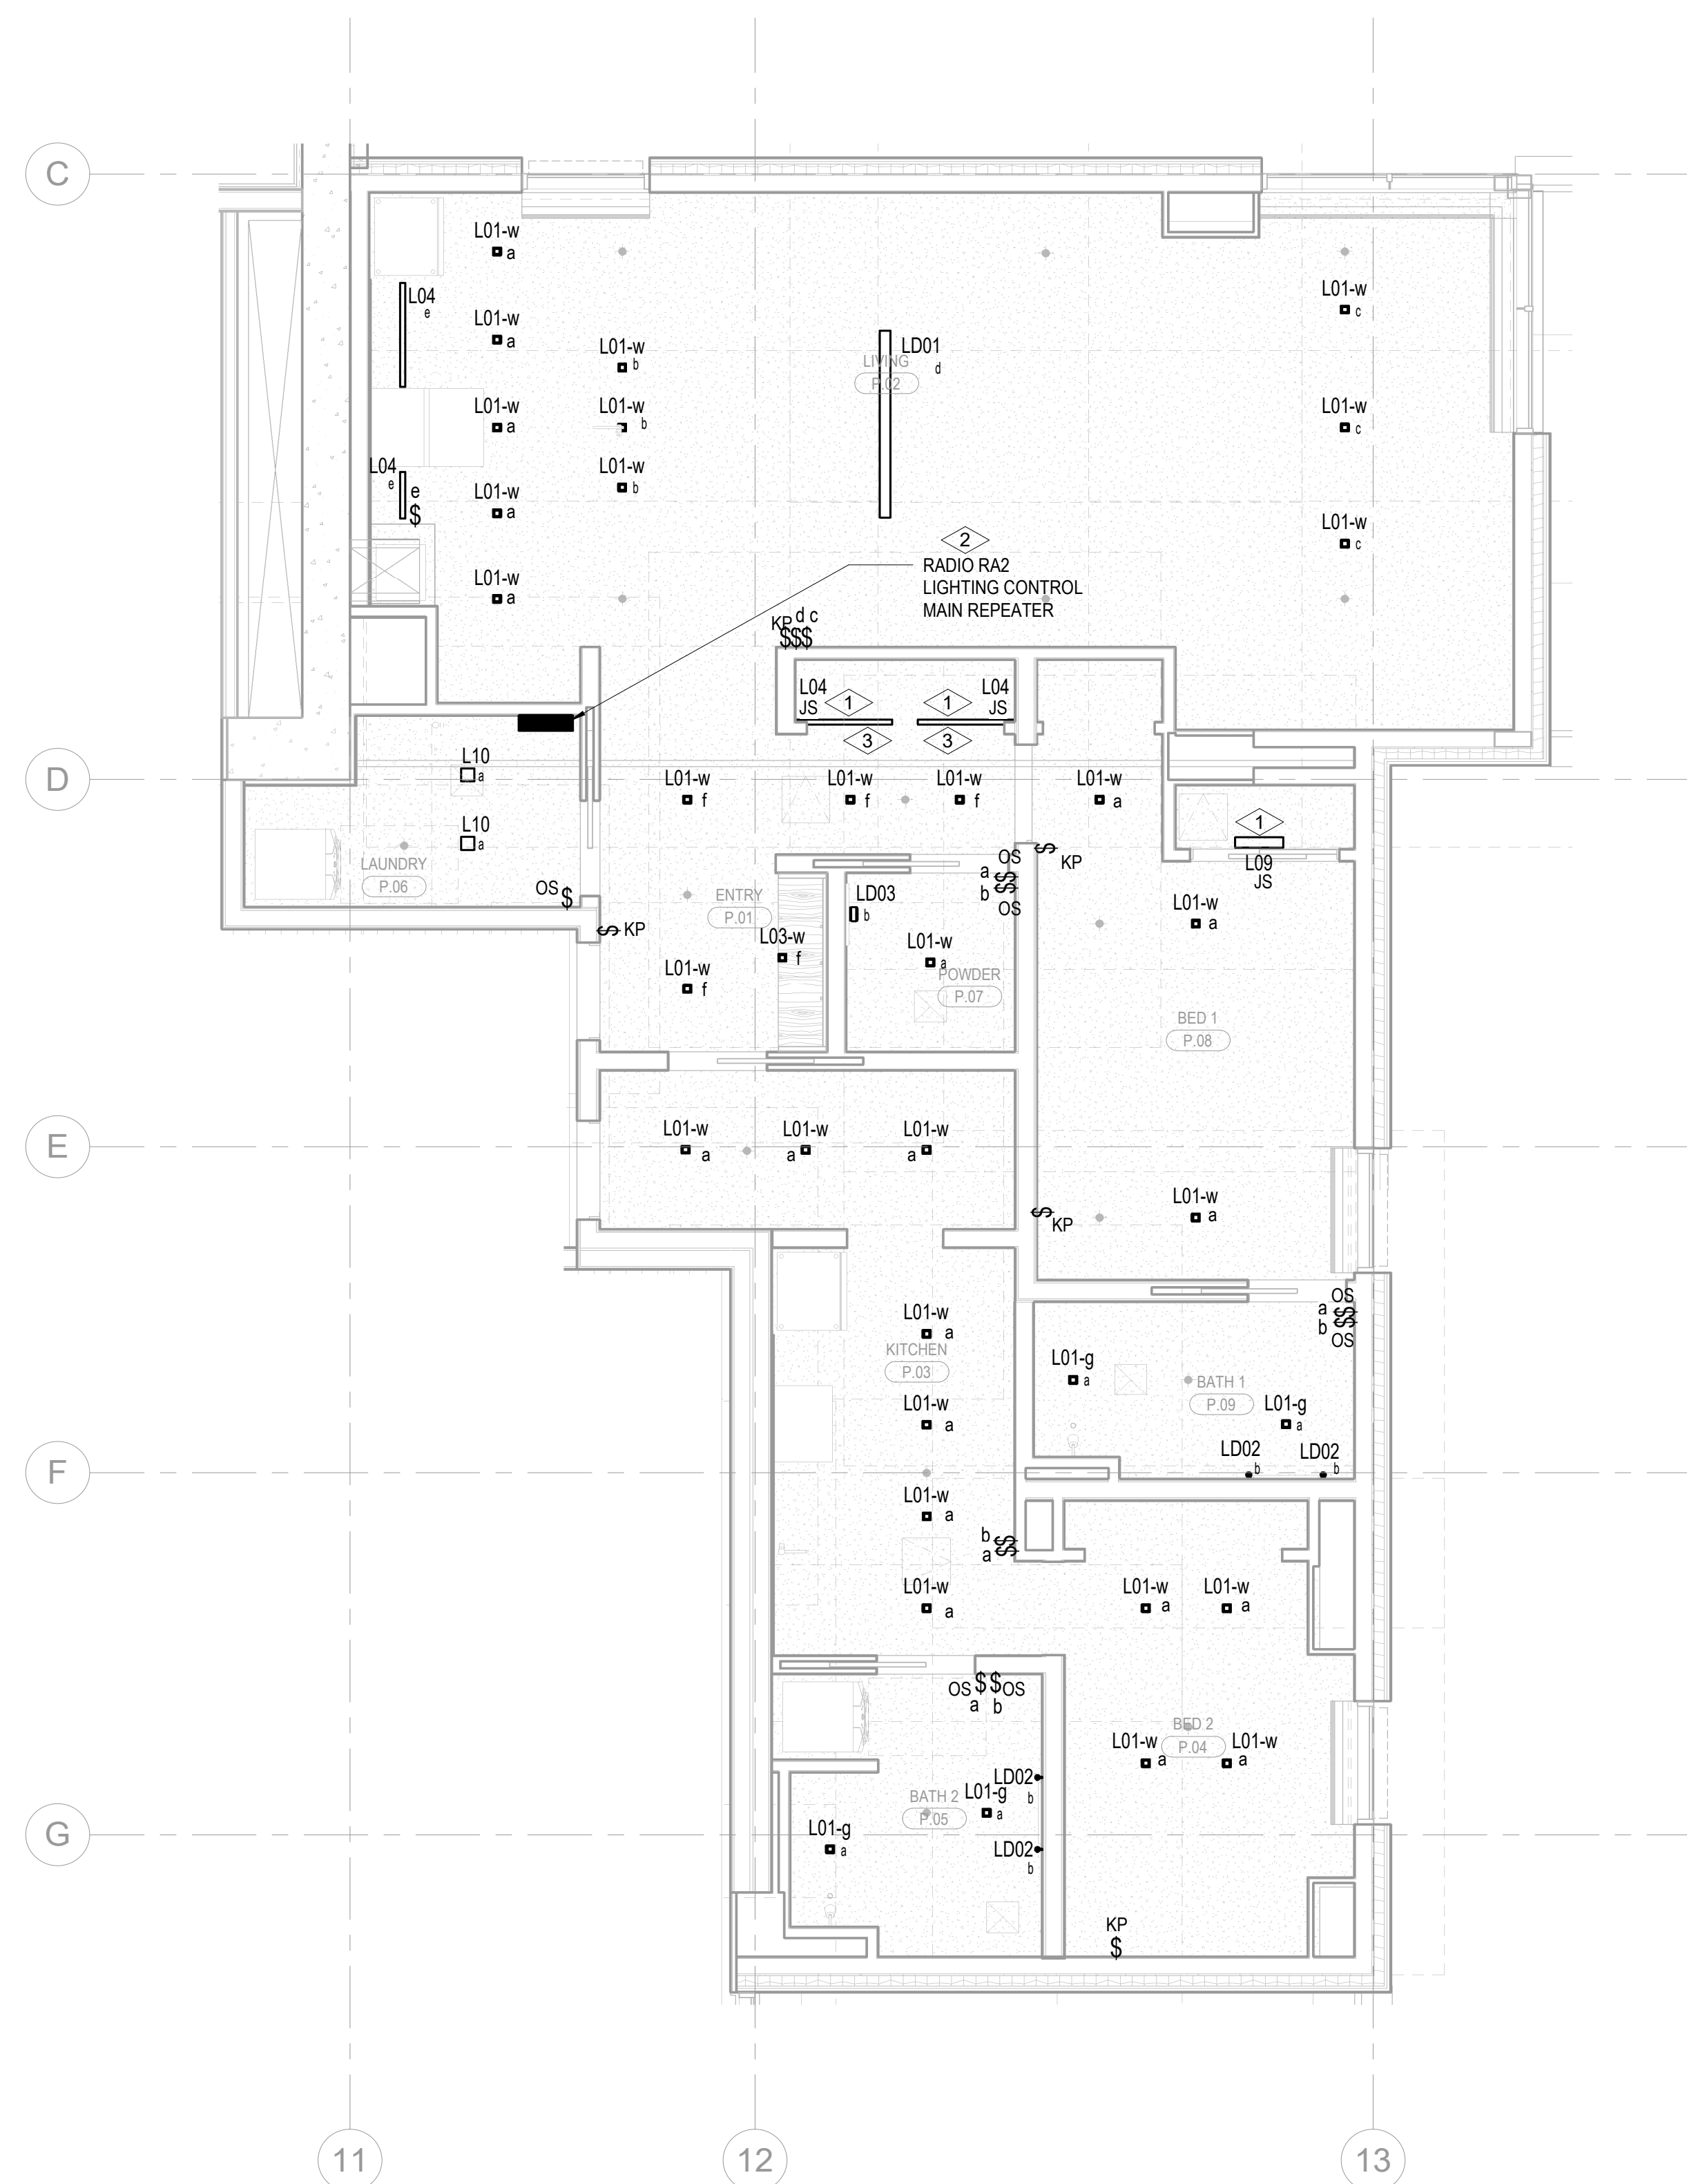

1 TOWER A/B - ELECTRICAL LIGHTING PLAN - UNIT P
SCALE: 1/4" = 1'-0"

