

1. SCOPE OF WORK INCLUDES SPRINKLER PROTECTION THROUGHOUT ALL AREAS IN ACCORDANCE WITH NFPA 13. SPRINKLERS ARE INDICATED IN HYDRAULIC CALCULATION REMOTE AREAS AND AREAS WITH FINISHED CEILINGS FOR COORDINATION PURPOSES. INSTALLING CONTRACTOR SHALL BE RESPONSIBLE FOR DETAILED DESIGN OF BRANCH PIPING AND UPRIGHT SPRINKLERS IN AREAS WITHOUT FINISHED CEILINGS.

105 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 olson@olsonbundy.com



SOMMET BLANC - C
DEER VALLEY, UTAH

principal architect: TK
project manager: JCC
drawn by: CBB_SMK
checked by: Checker
job no. 20052
date 05/17/2024

[illegible]

____ date _____ by _____

FP2.2C.13

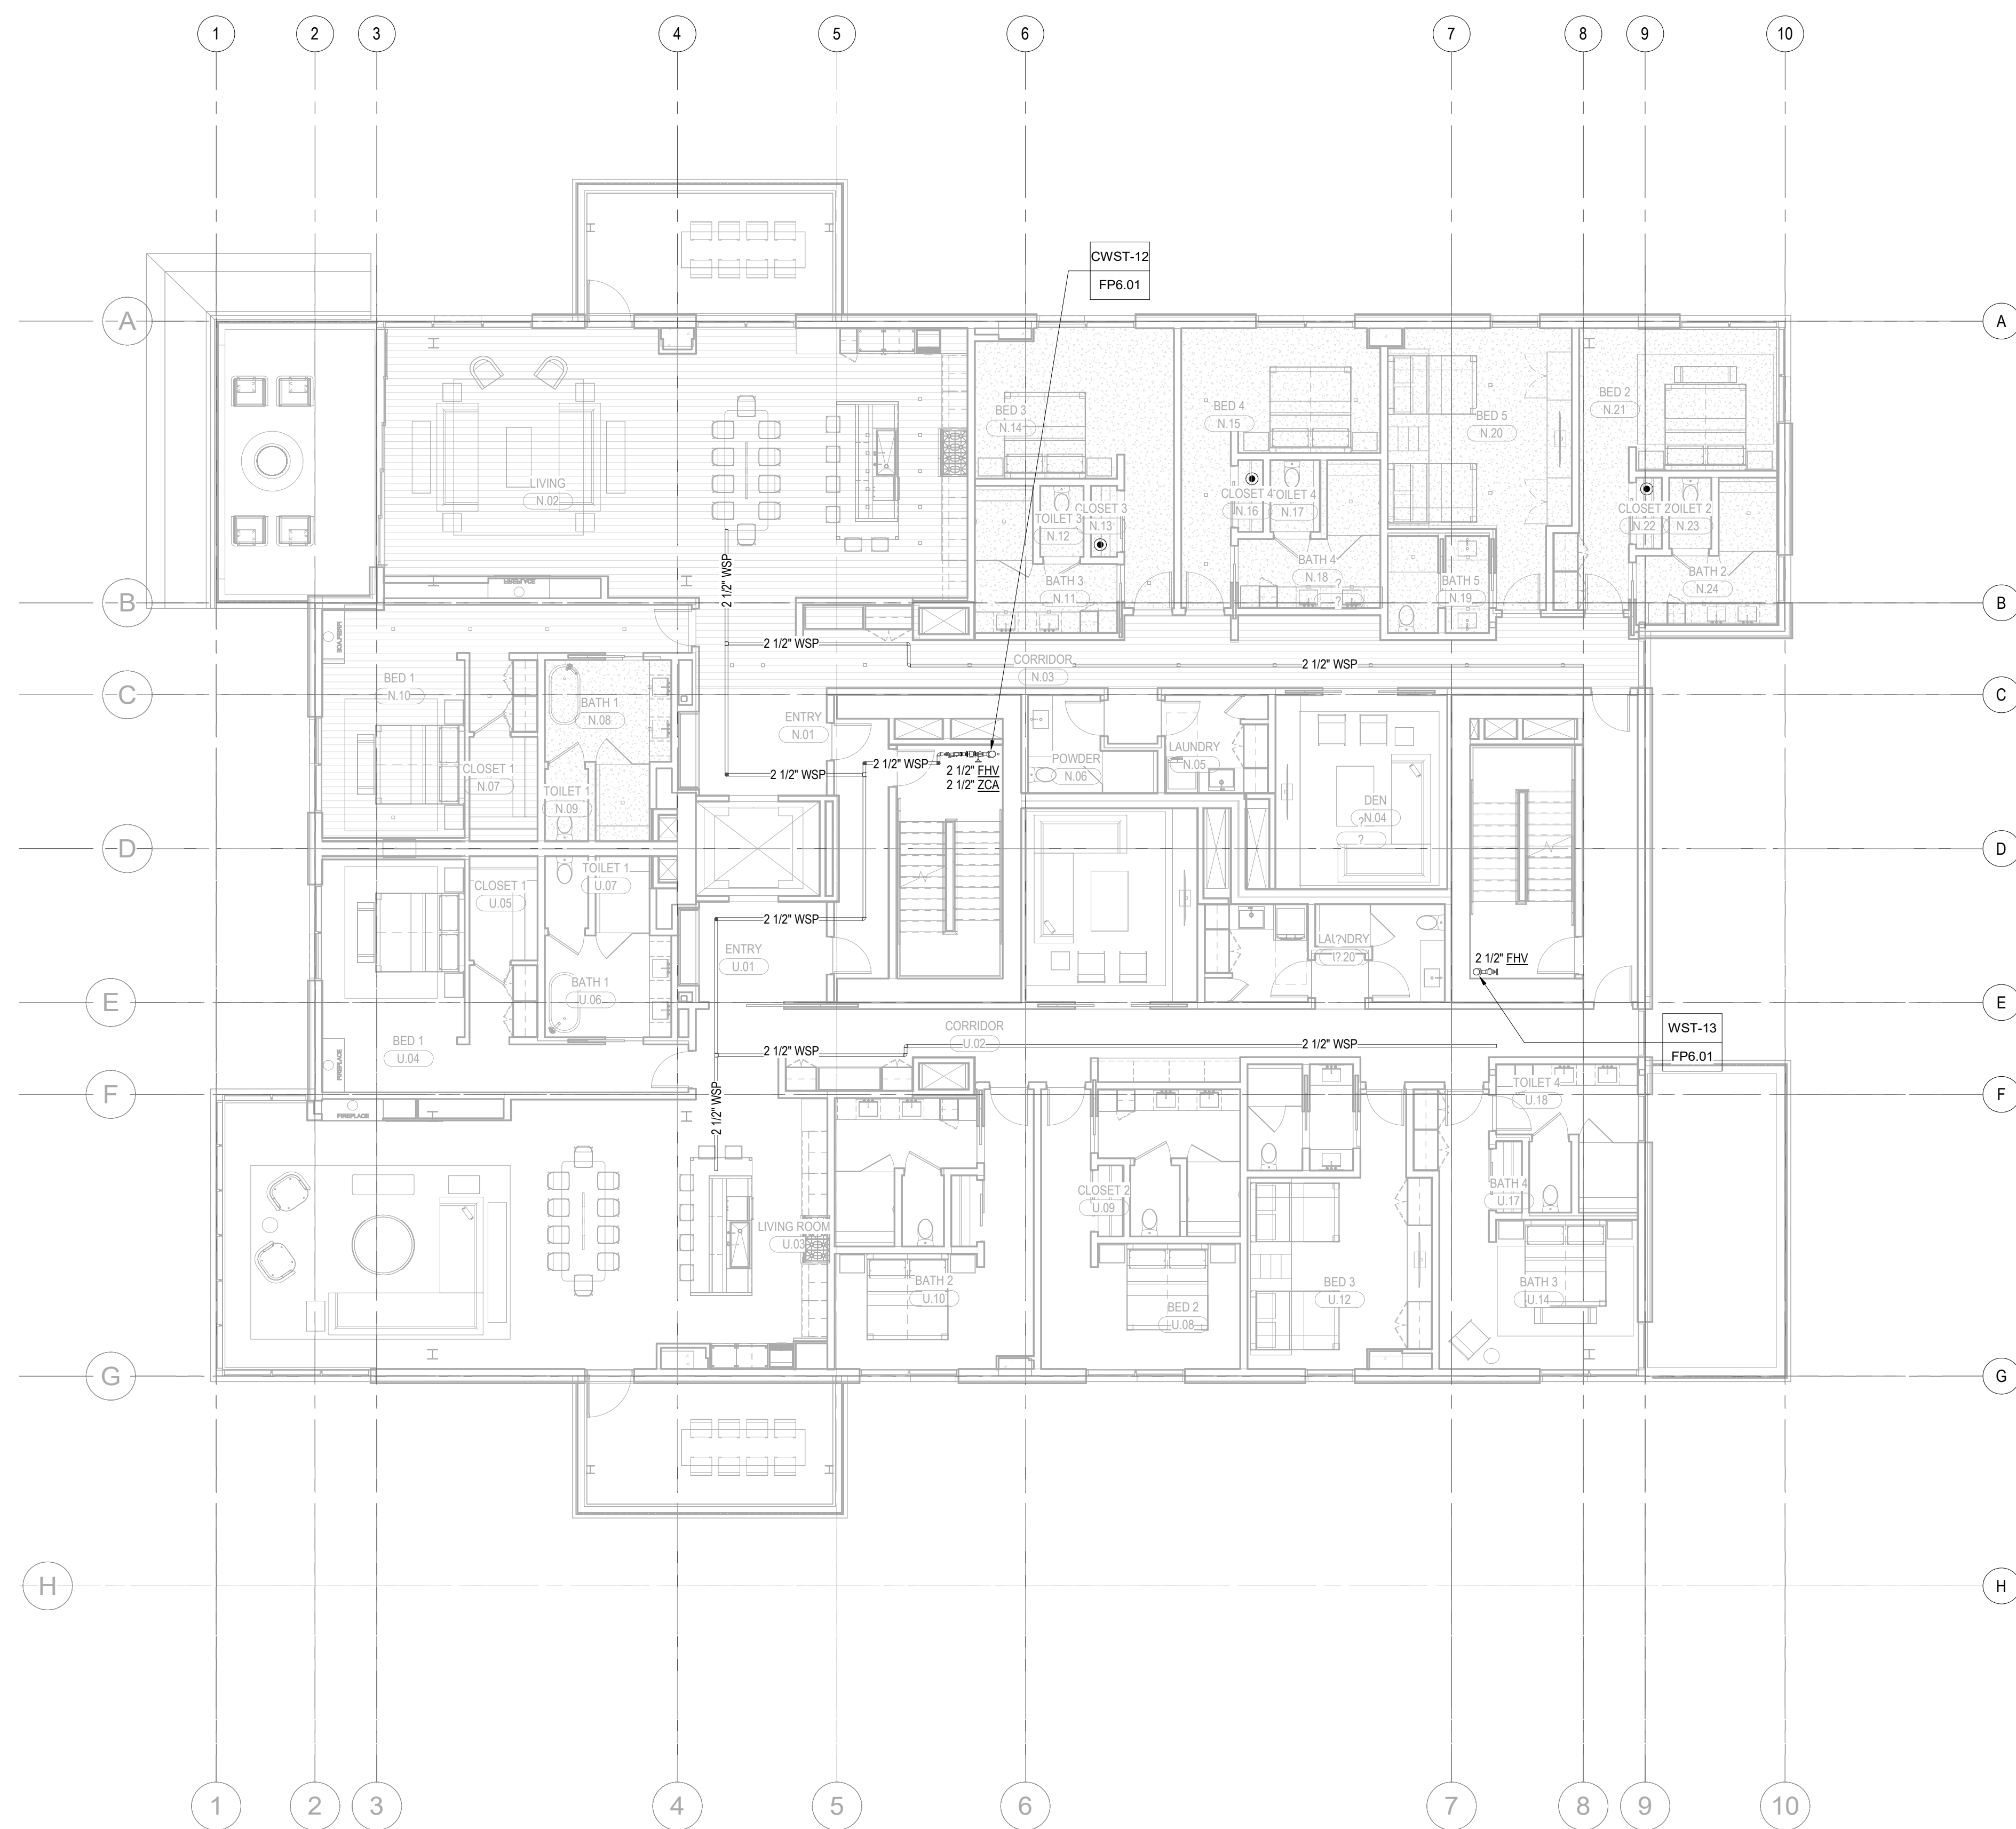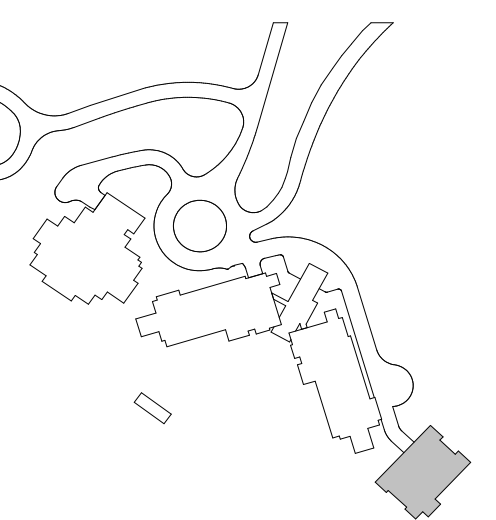

1 TOWER C - LEVEL 3 - FP
1/8" = 1'-0"