




4 EXTERIOR FIRE PROTECTION PIPING BUILDING ENTRANCE DETAIL (NTS)

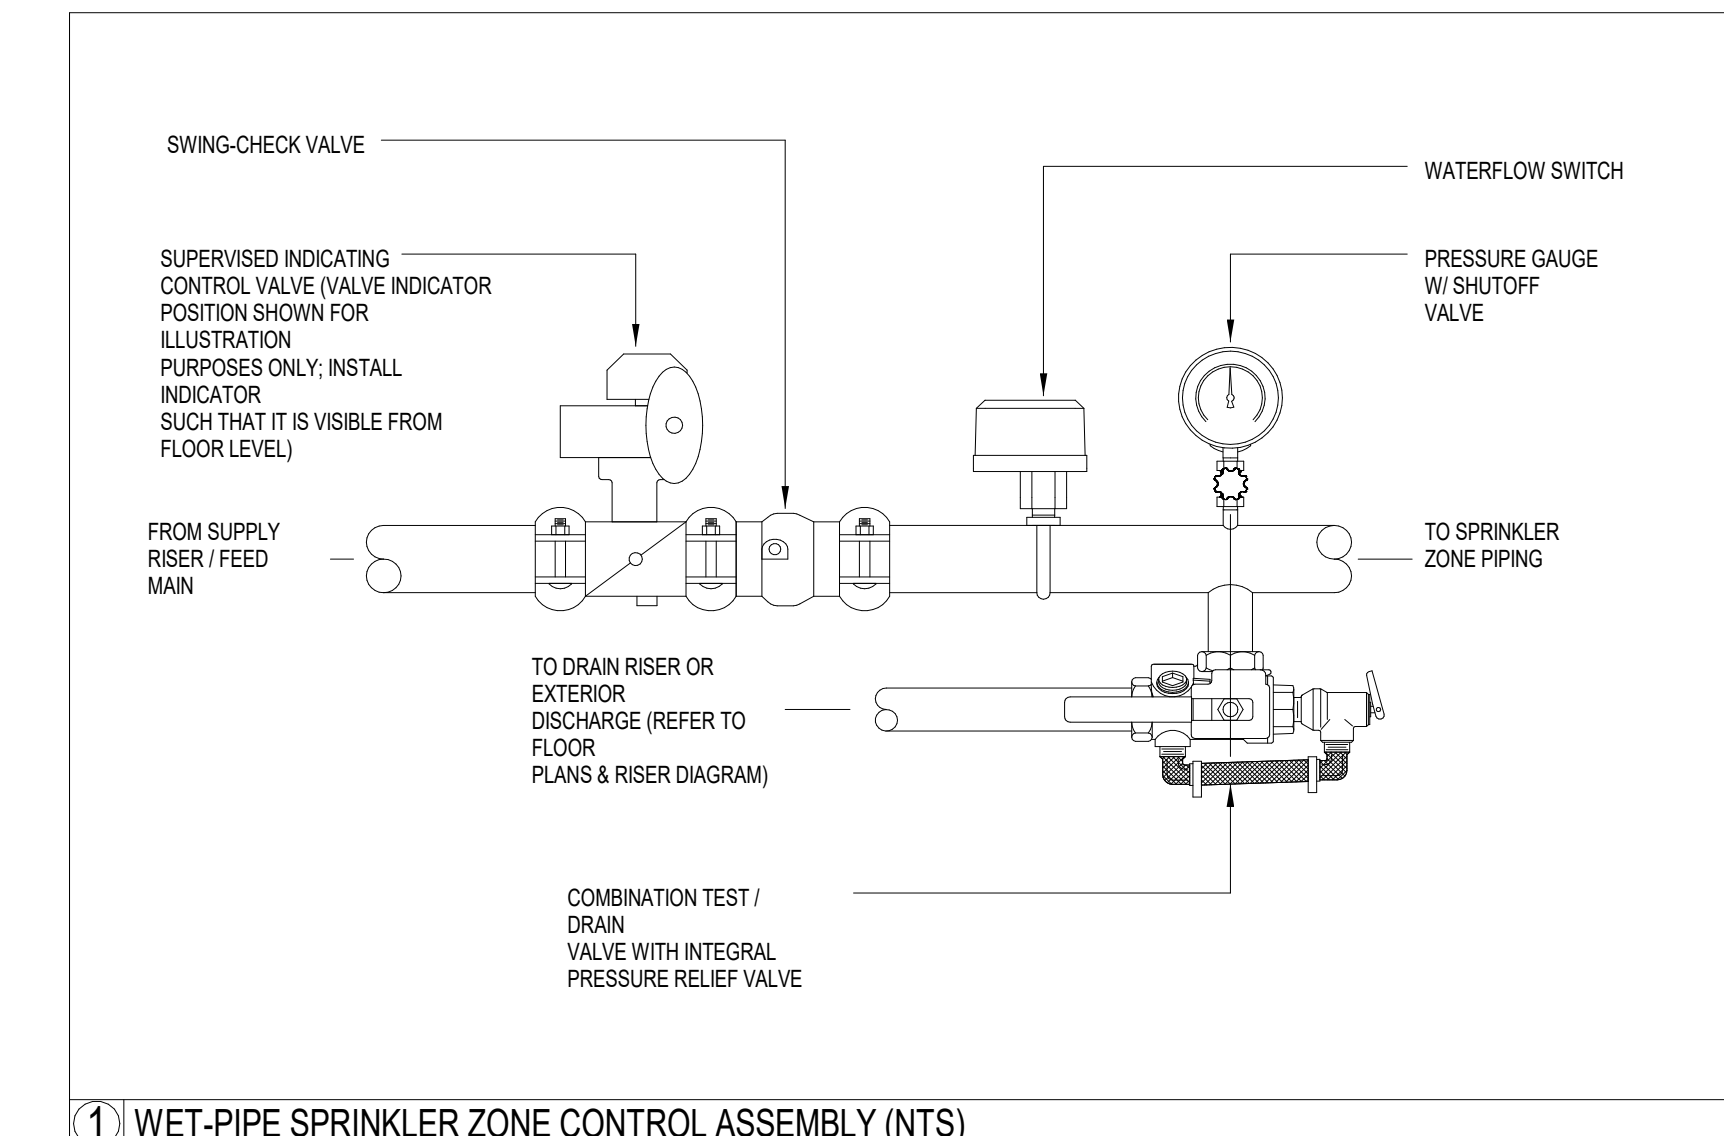


1 WET-PIPE SPRINKLER ZONE CONTROL ASSEMBLY (NTS)

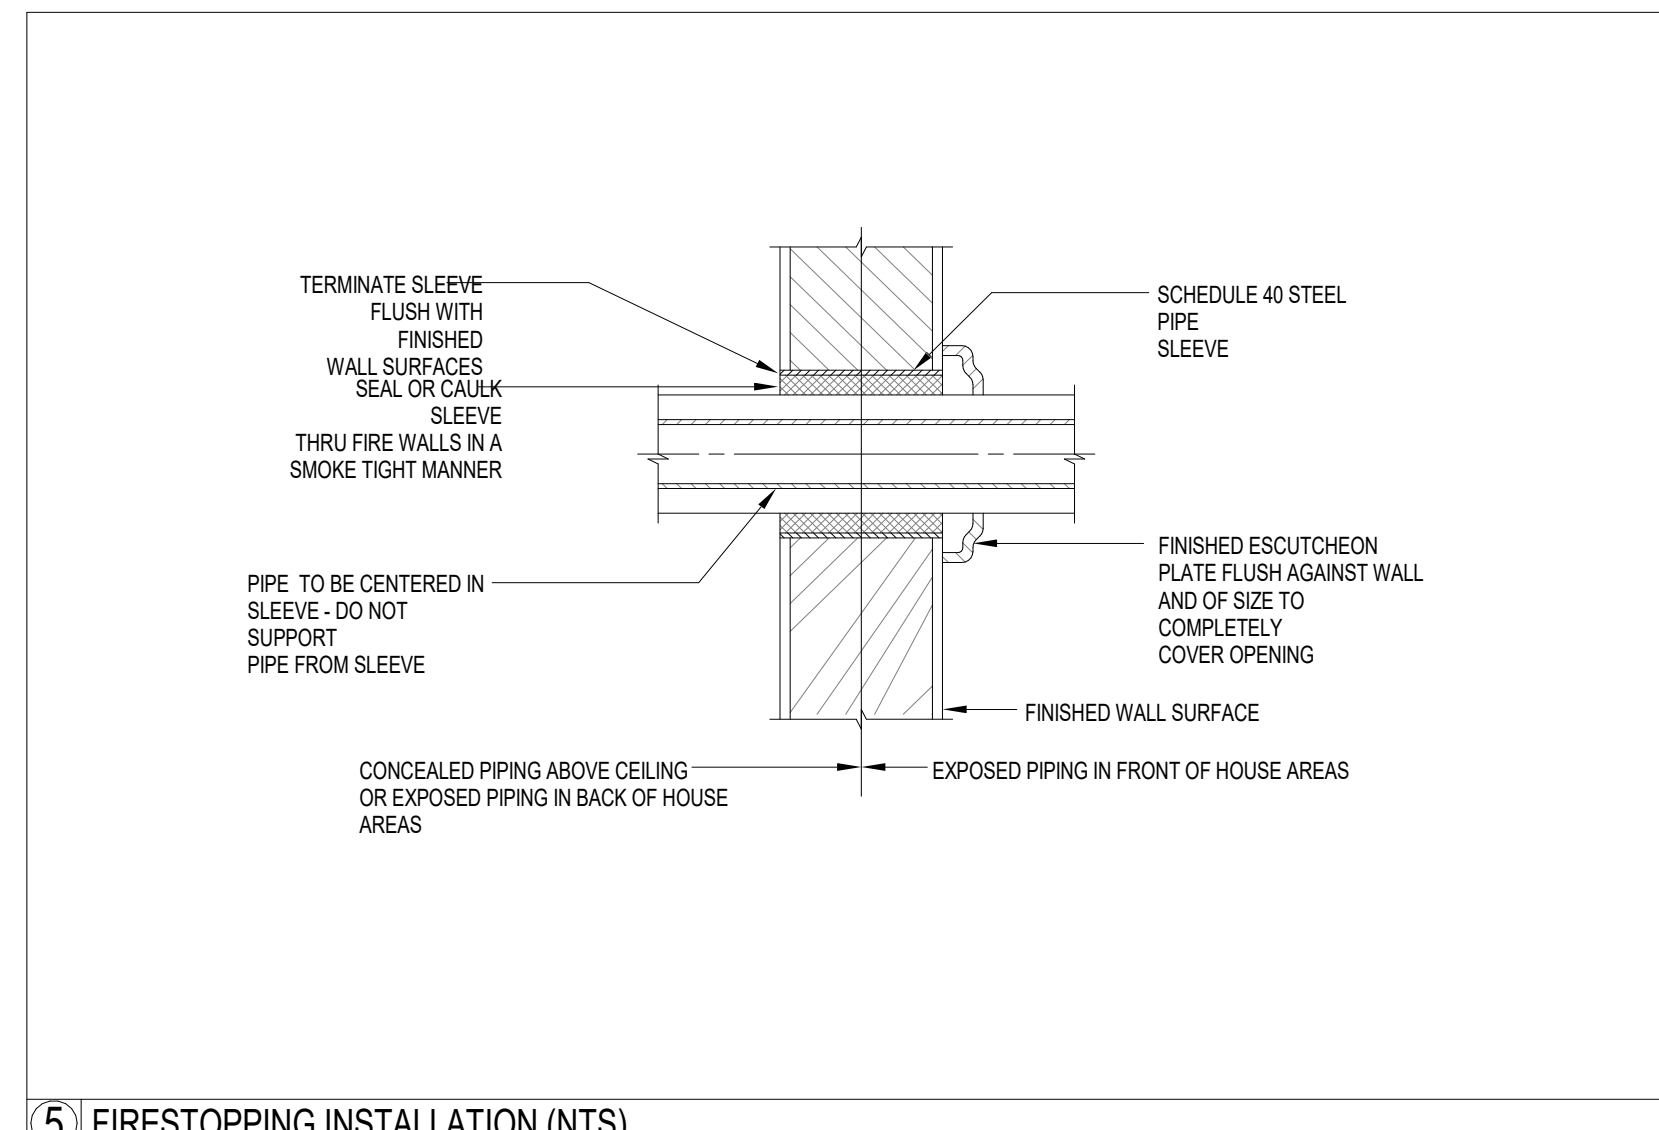


5 FIRESTOPPING INSTALLATION (NTS)

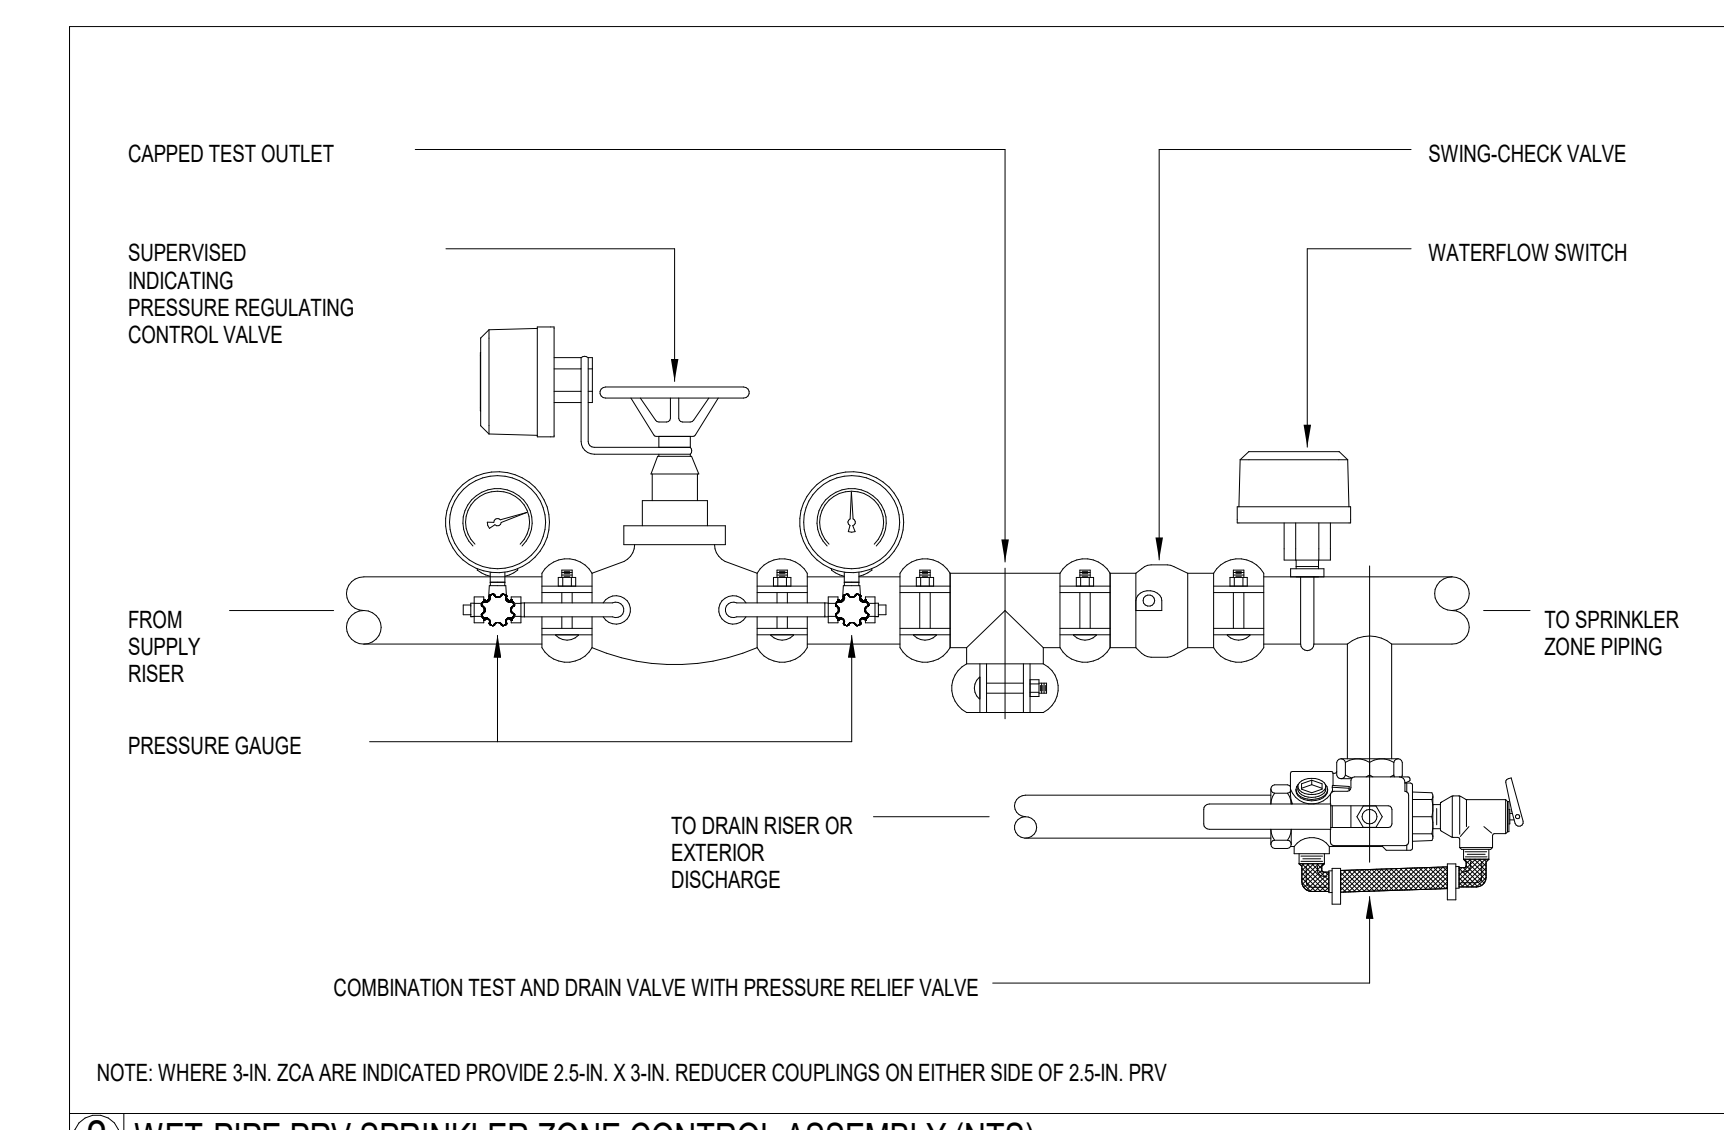


2 WET-PIPE PRV SPRINKLER ZONE CONTROL ASSEMBLY (NTS)

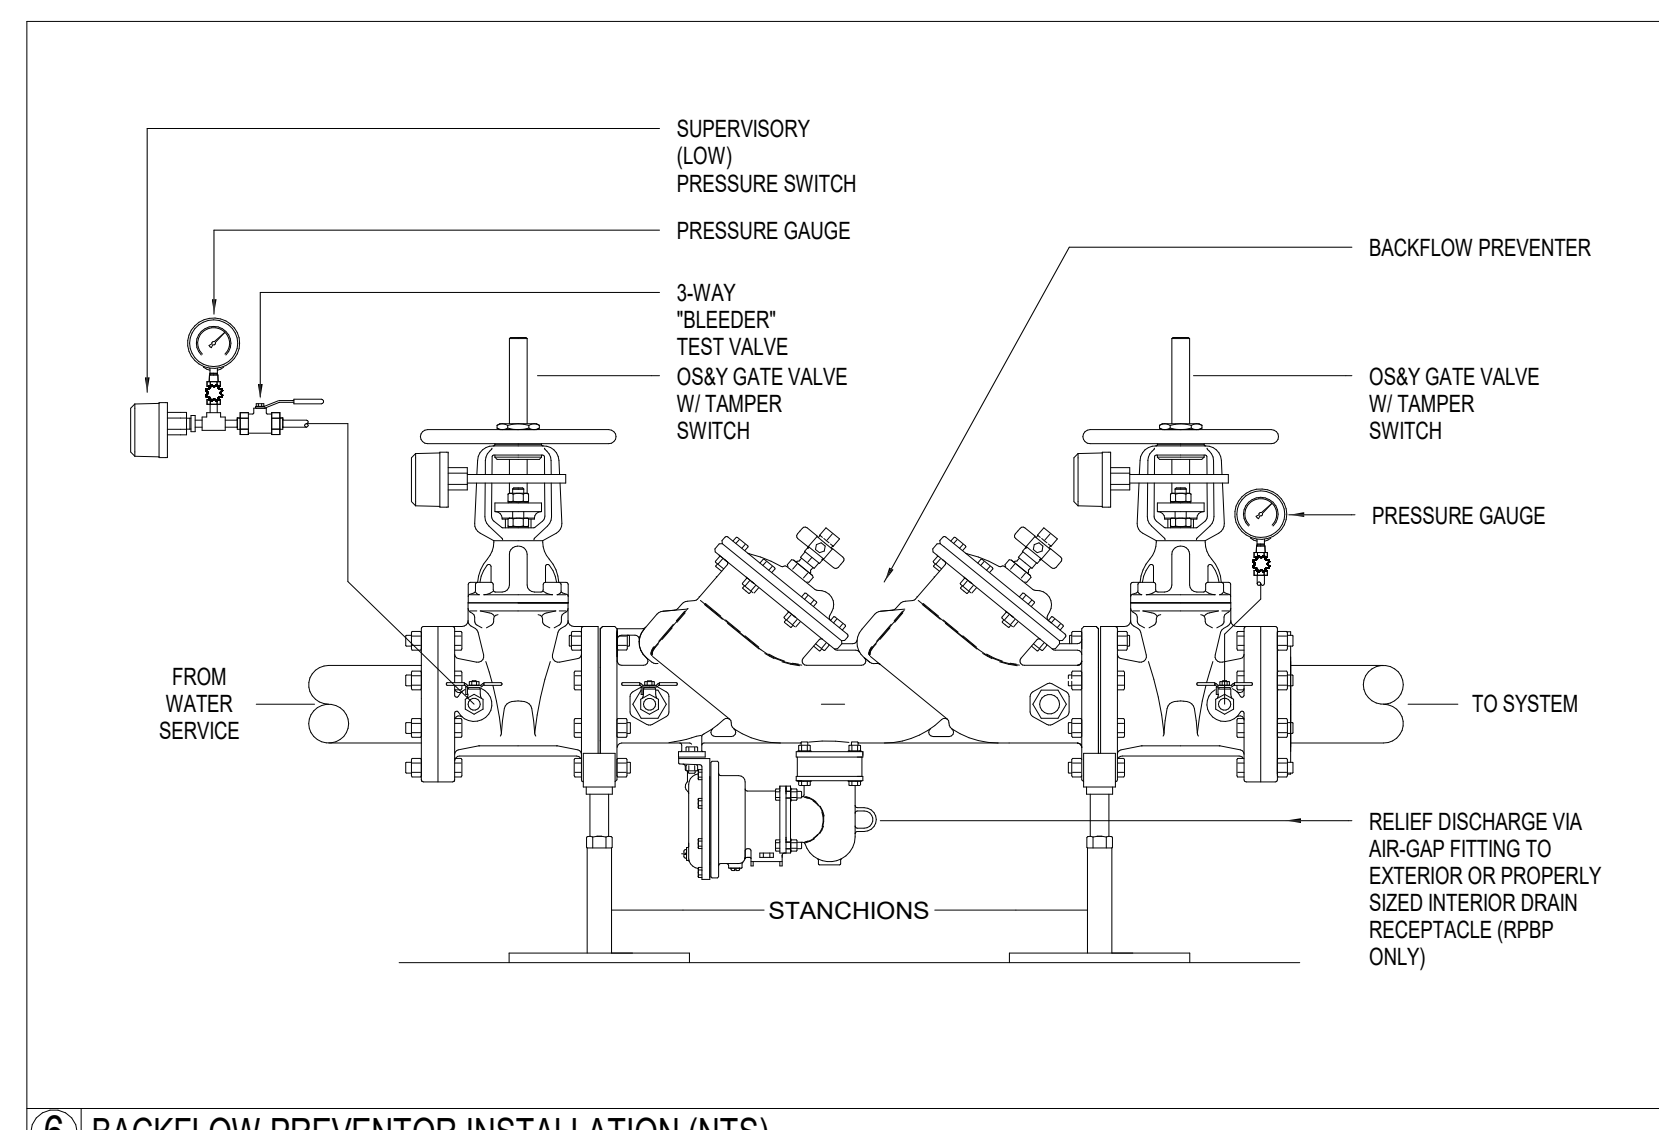

6 BACKFLOW PREVENTOR INSTALLATION (NTS)

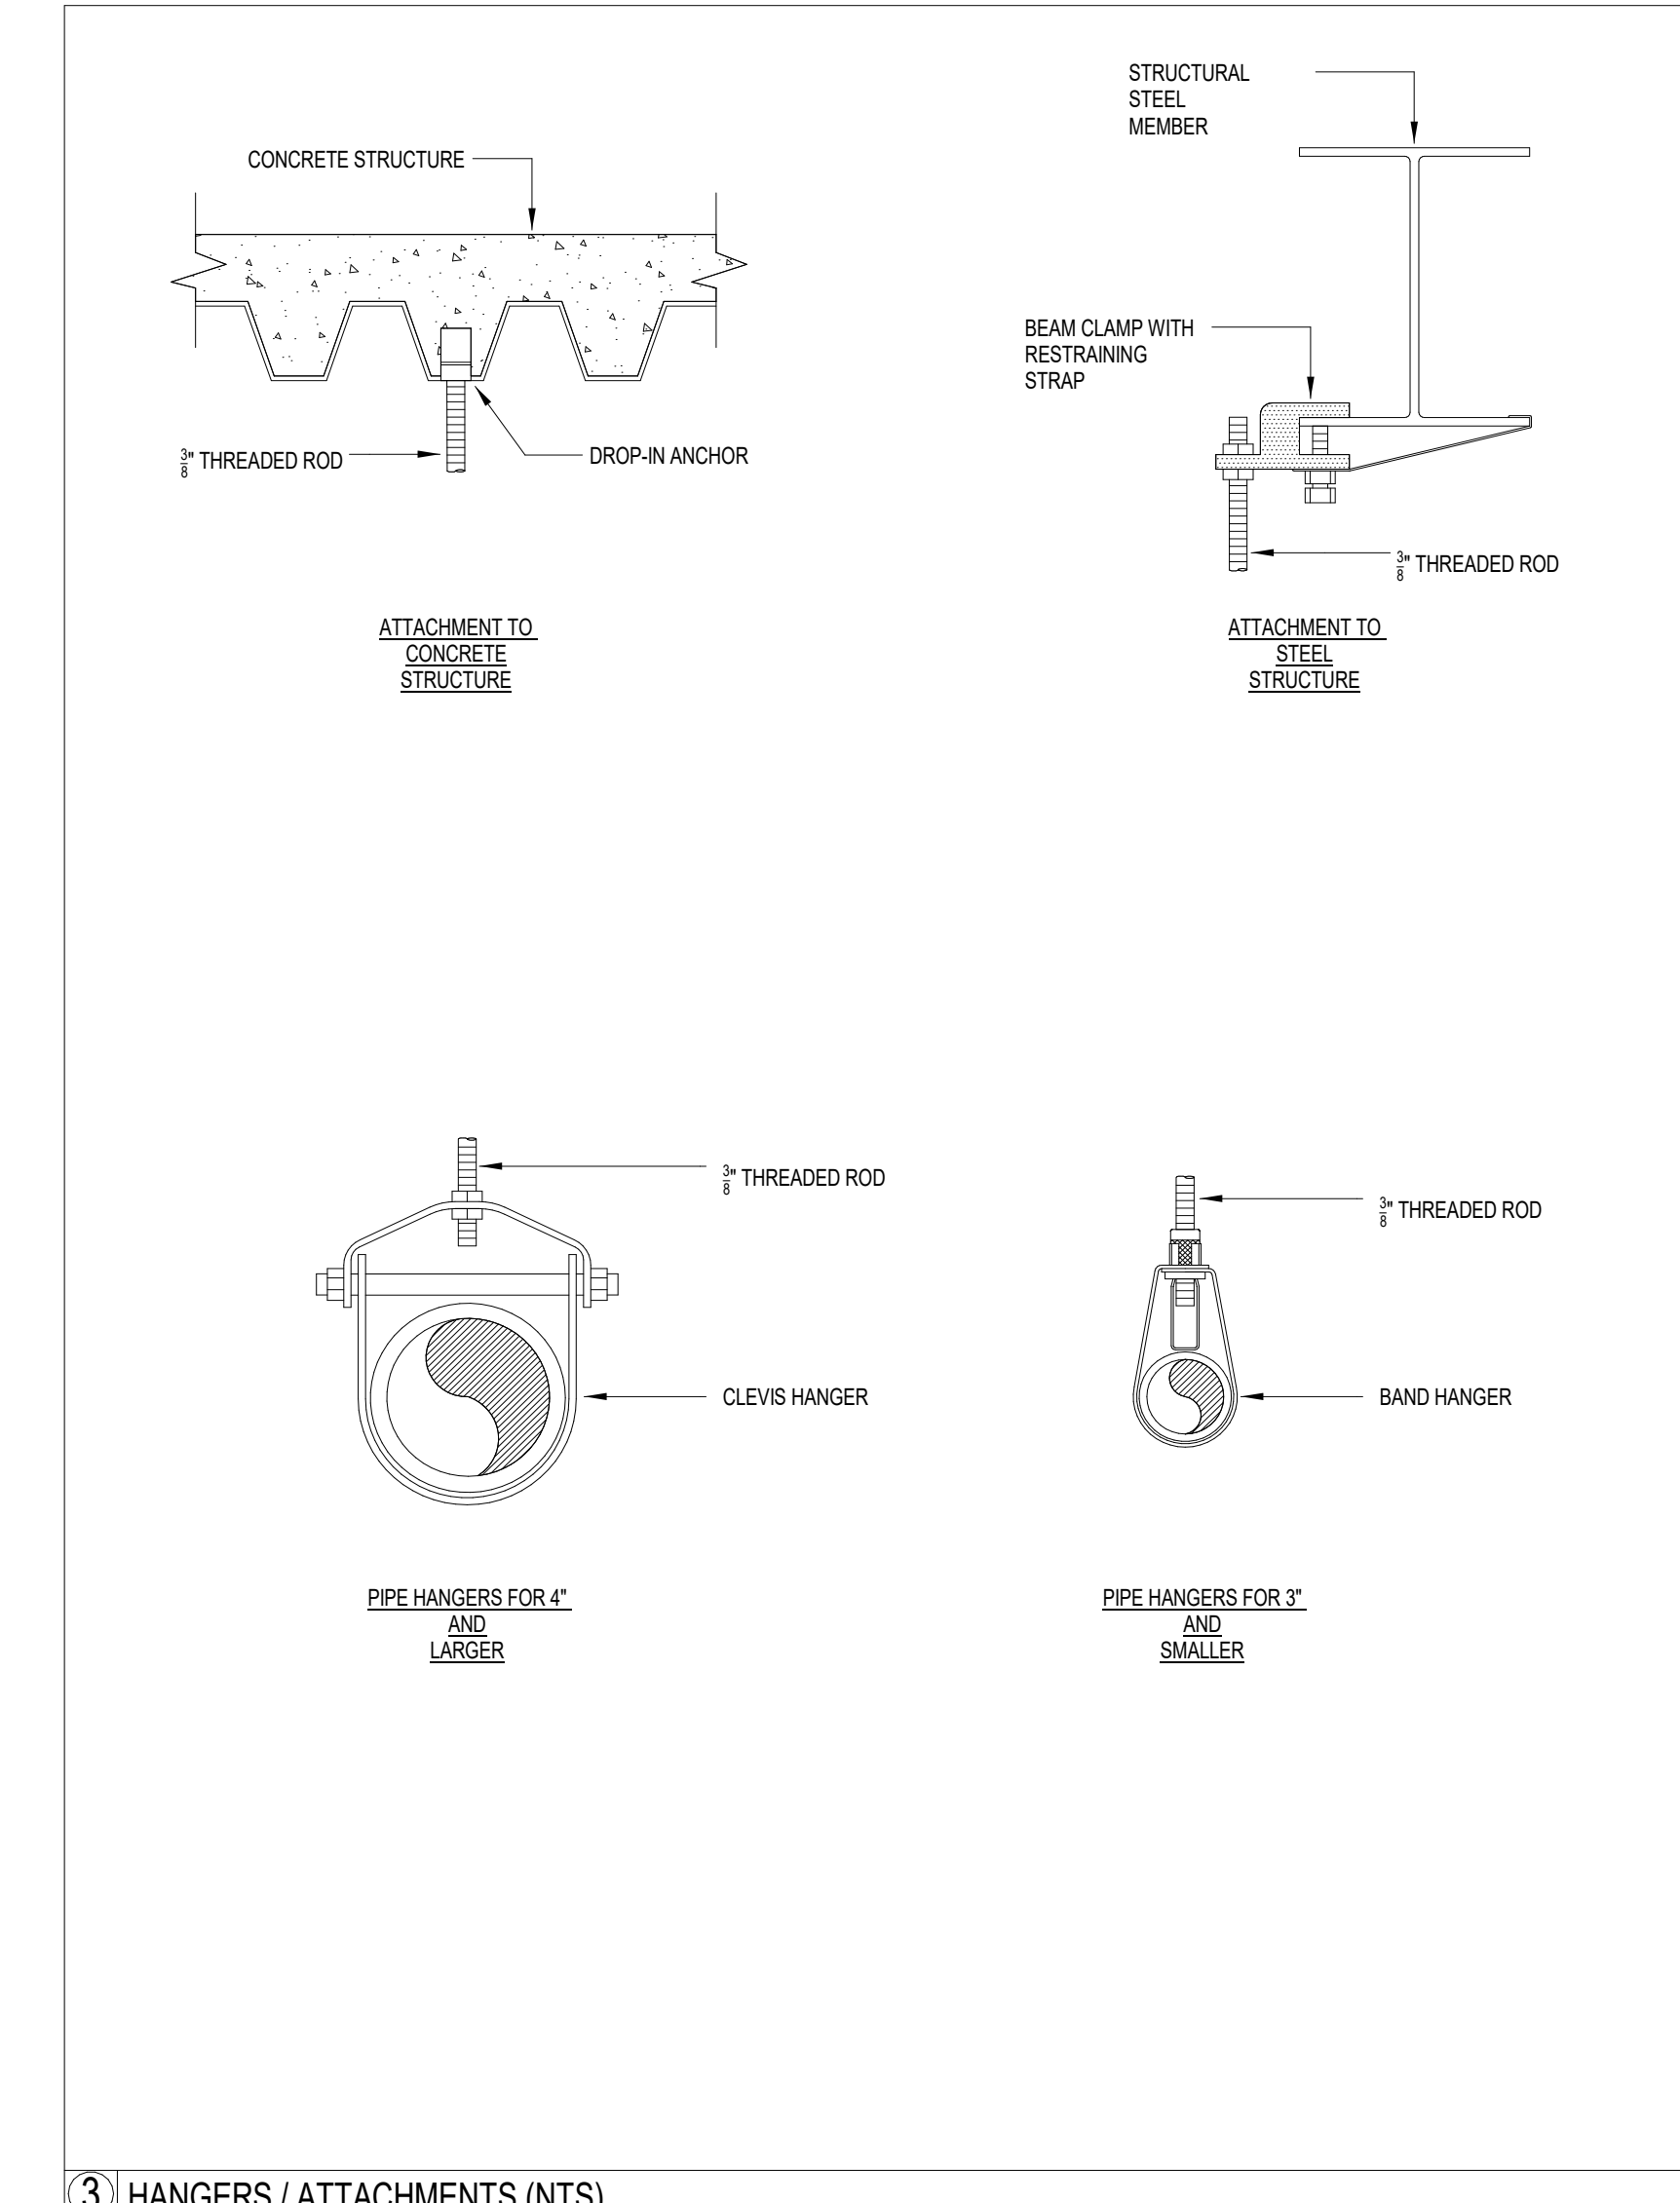

3 HANGERS / ATTACHMENTS (NTS)

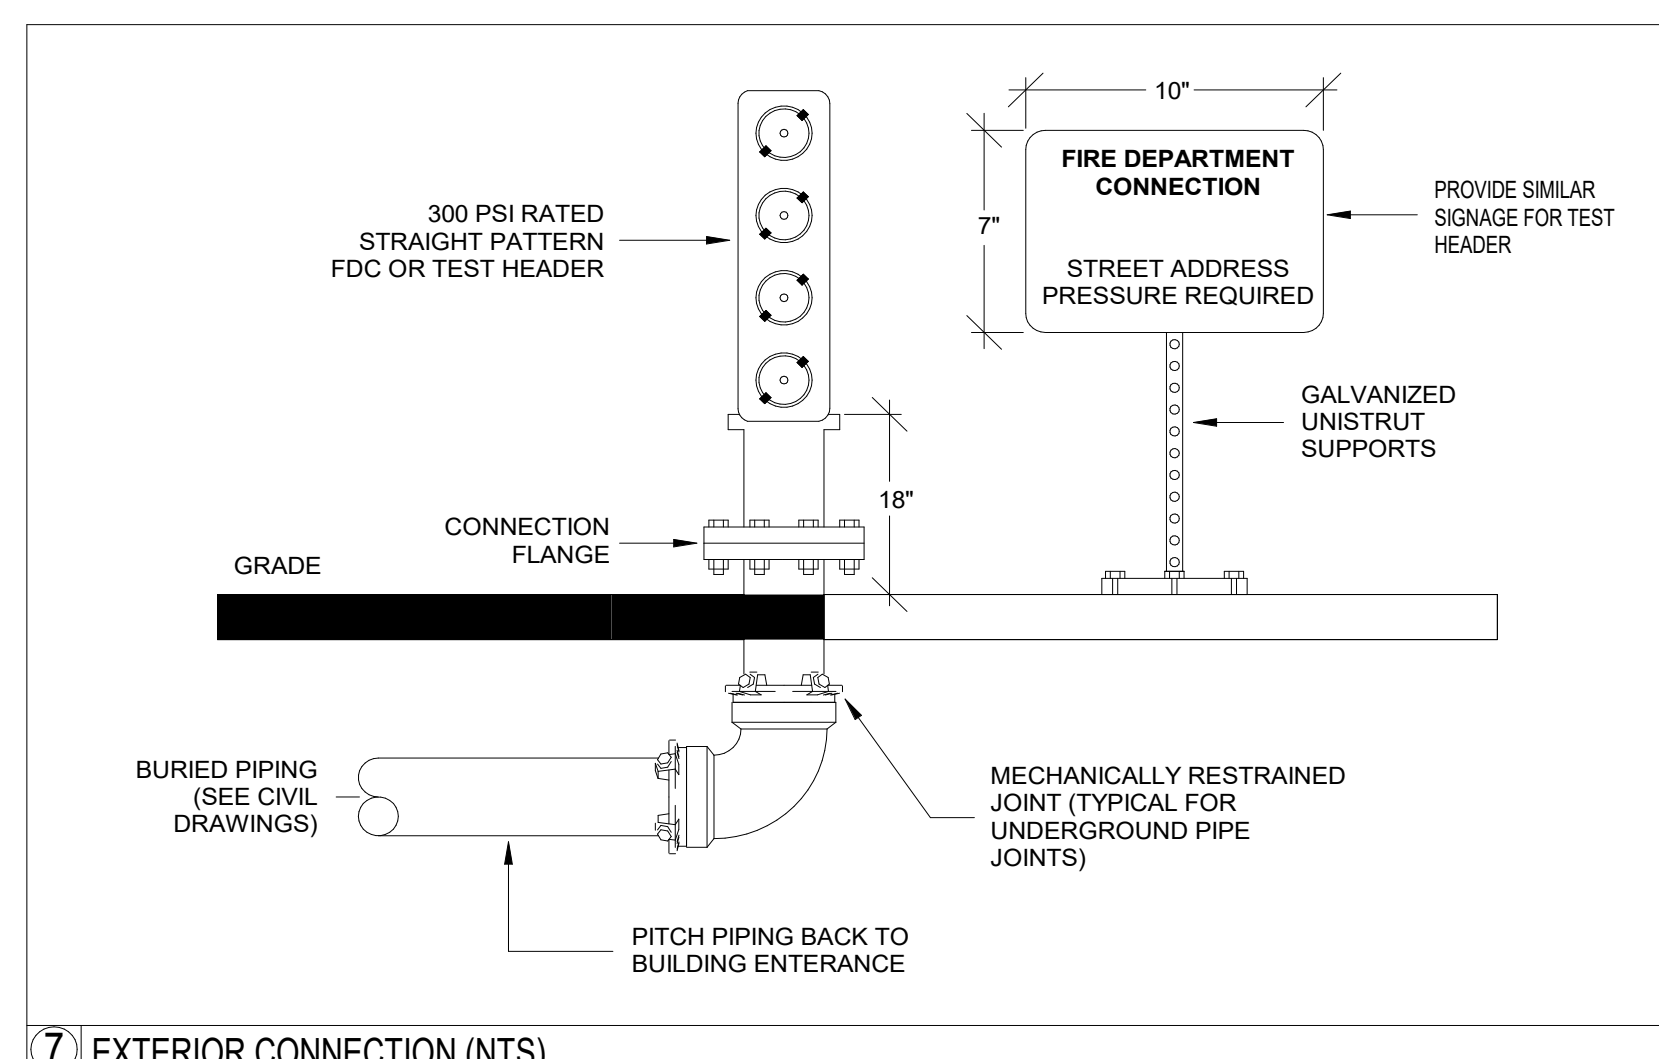


7 EXTERIOR CONNECTION (NTS)

Reserved for permit stamp

100 South Jackson, P.O. Box 600
Salt Lake City, Utah 84143
www.olsonkundig.com

Olson Kundig

PROJECT
SOMMET BLANC - AB
DEER VALLEY, UTAH



White Summit Development, LLC
PO Box 980022
Park City, Utah 84098

Acoustic Consultant
BRC Acoustics
1552 1st Ave., Suite 420
Seattle, WA 98101

Pool Consultant
Cloward H2O
2098 N University Ave., Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6945 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Main St
Middlebury, VT

Code Consultant
Homes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Armen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lorch Bates
195 15 North Creek Parkway, Suite 304
Bumet, WA 98011

Structural Engineer
Magnuson Klemencic Associates
137 5th Ave., Suite 3200
Seattle, WA 98101

Lighting Designer
OR
1319 SE MLK Blvd., Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDM
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MED Equipment
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98104

principal architect: _____
project manager: JCC
drawn by: DRL, SMC
checked by: Jhacker
job no. 2052
date 05/17/2024

revisions:

no. _____ date _____ by _____

IFC Set 2 of 3
05/17/2024

FIRE PROTECTION
DETAILS

FP7.01