
- 1. MEANS OF EGRESS SIZING (IBC 1005.3) A. STAIRWAYS (1005.3.1) EXCEPTION: B. DOORS & OTHER COMPONENTS (1005.3.2) EXCEPTION:
- 2. COMMON PATH OF EGRESS TRAVEL (1006.2.1): OCCUPANCY B, S = 100' WITH SPRINKLERS OCCUPANCY R-2 = 125' WITH SPRINKLERS
- OTHER OCCUPANCIES (INCLUDES A, M) = 75' WITH SPRINKLERS
- MAXIMUM OCCUPANT LOAD FOR SPACES WITH ONE EXIT OR EXIT ACCESS DOORWAY: A, B, M = 49 S = 29 R-2 = 20
- DOOR SEPARATION SHOULD BE MINIMUM 1/3 DIAGONAL OF SPACE SERVED WITH SPRINKLERS 5. MAXIMUM EXIT ACCESS TRAVEL DISTANCE (1017.2) WITH SPRINKLER SYSTEM: OCCUPANCIES A, M, R, S-1 = 250' WITH SPRINKLERS





Life Safety Occupant Load - Tower A Level B						
Nama	Occupancy	Function	Occupant	Net/Cross	Area	Occupant
Name	Class	Function	Load Factor	Net/Gross	Area	Load
BOWLING B.O.H.	В	BUISNESS AREAS	150 SF	GROSS	589 SF	
BOWLING CENTER	A-3	ASSEMBLY WITHOUT FIXED SEATS - UNCONCENTRATED (TABLE AND CHAIRS)	15 SF	NET	535 SF	20
BOWLING LANES	В	BOWLING CENTERS	7 SF	NET	2,320 SF	16
DRY STORAGE	S-2	ACCESSORY STORAGE AREAS, MECHANICAL EQUIPMENT ROOMS	300 SF	GROSS	1,321 SF	5
ELECTRICAL ROOM	S-2	ACCESSORY STORAGE AREAS, MECHANICAL EQUIPMENT ROOMS	300 SF	GROSS	47 SF	1
EMPLOYEE BREAK	В	BUISNESS AREAS	150 SF	GROSS	393 SF	3
LOCKER ROOM	A-3	LOCKER ROOMS	50 SF	GROSS	93 SF	
LOUNGE	A-3	ASSEMBLY WITHOUT FIXED SEATS - UNCONCENTRATED (TABLE AND CHAIRS)	15 SF	NET	3,752 SF	251
MECHANICAL ROOM	S-2	ACCESSORY STORAGE AREAS, MECHANICAL EQUIPMENT ROOMS	300 SF	GROSS	1,665 SF	6
OXYGEN ROOM	S-2	ACCESSORY STORAGE AREAS, MECHANICAL EQUIPMENT ROOMS	300 SF	GROSS	144 SF	1
10	•	r.			10,860 SF	303

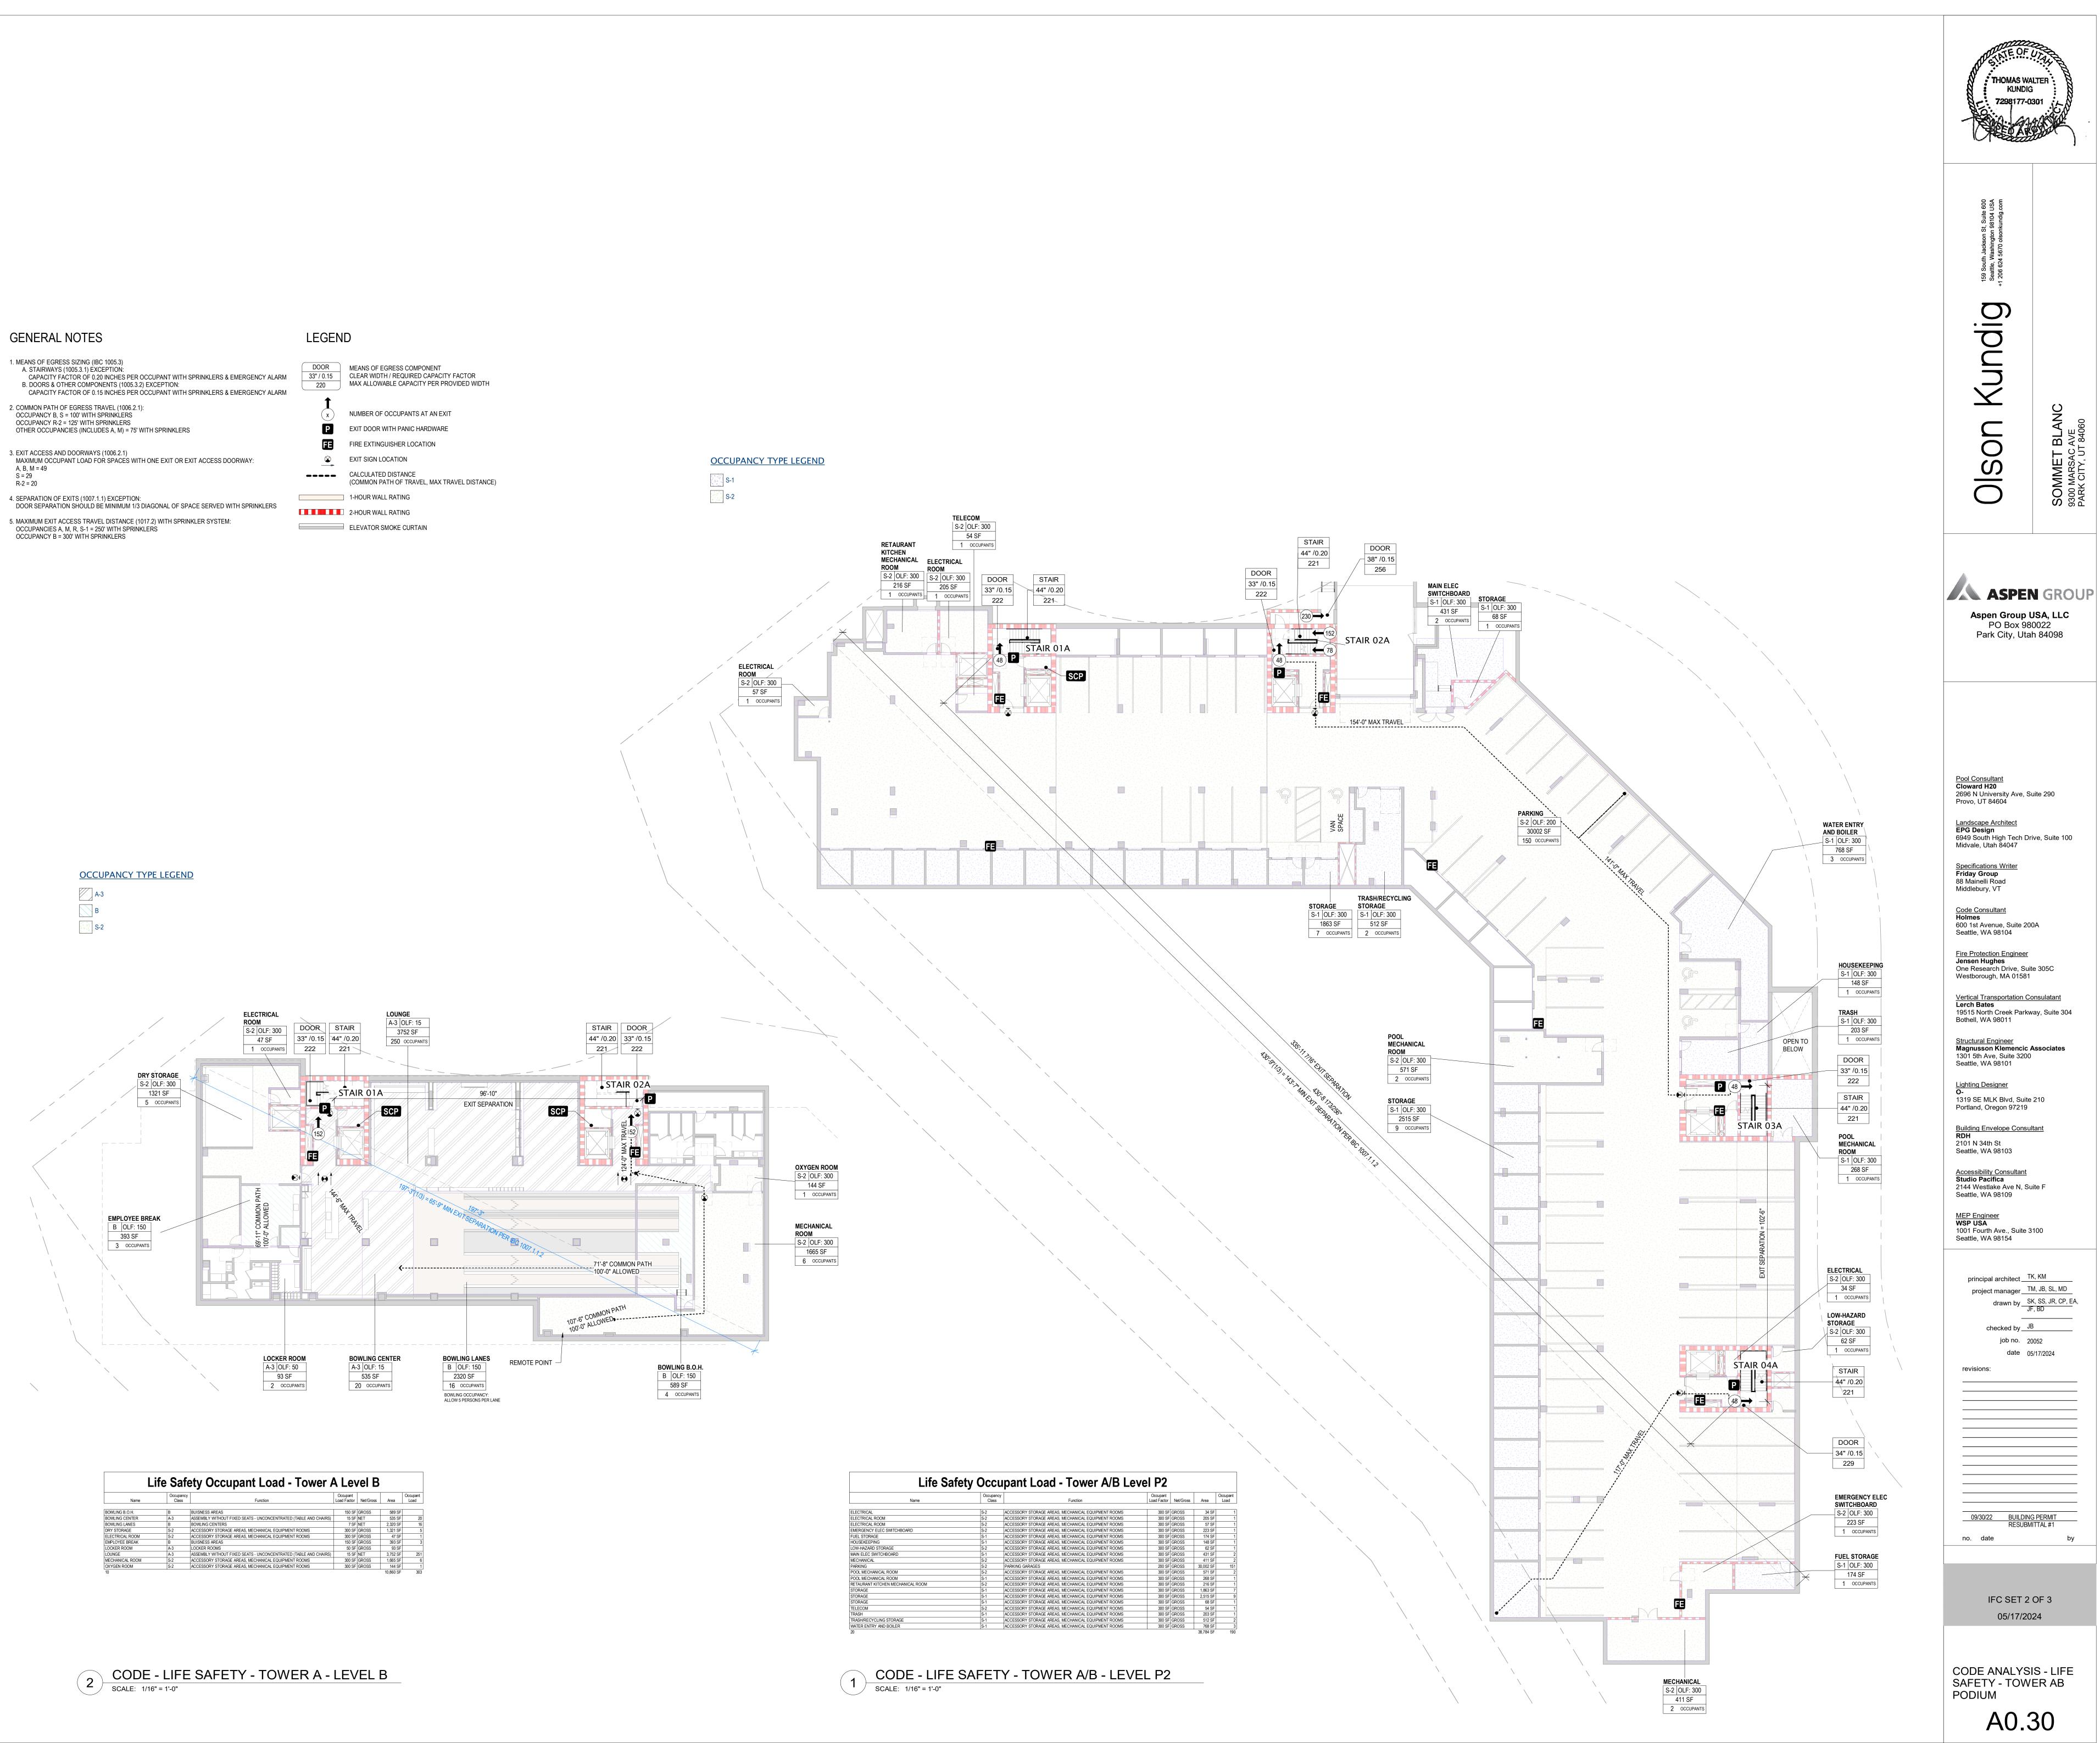