


Olson Kundig

project:
SOMMET BLANC
3300 Marsac Ave (B2 East Parcel)
Park City, Utah 84060

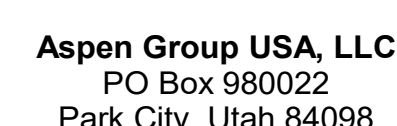

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

revisions:

no.	date	t
-----	------	---


IFC Set 3 of 3
5/31/2024

TOWER B - LVL B
MECHANICAL DUCT
PLAN

M2.2B.01

- A. REFER TO M2.4 SERIES FOR ENLARGED PLANS.
- B. FIREPLACE FLUE ROUTING SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING AND SIZING DETAIL.
- C. MECHANICAL EQUIPMENT SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR DETAIL.
- D. ARCHITECT SHALL PROVIDE 1-SOFT N/A OPENINGS IN ALL FULL HEIGHT, NON-RATED WALLS FOR RETURN AIR PATHS IF NO DUCT TRANSFER IS SHOWN.
- E. ALL EQUIPMENT, INSULATION, WIRING, AND INFRASTRUCTURE IN THE PLENUM SHALL BE PLENUM RATED.
- F. FLEX DUCT SHALL NOT BE INSTALLED ABOVE FINISHED HARD-UD CEILINGS.
- G. PROVIDE BUTTON TYPE TEMPERATURE SENSOR IN PUBLIC AREAS. SEE DETAIL-13, SHEET M5.04
- H. PROVIDE REMOTE CABLE DAMPER OPERATOR OR IN DIFFUSERS ABOVE HARD-UD CEILINGS. SEE DETAIL-9, SHEET M5.04

- 1 PROVIDE 44X10 TRANSFER DUCT INTO MECH ROOM
- 2 GRILL AND DUCTWORK BACK TO BRANCH LINE SHALL BE
- 3 STAINLESS STEEL CONSTRUCTION
- 4 3" FREE AIR GAP ALONG THIS WALL FOR RETURN AIR. SEE
- 5 ARCH DRAWINGS
- 6 WALL GRILL SHALL BE ABOVE FINISHED CEILING. FSD
- 7 ACCESS IN ELECTRICAL ROOM
- 8 REMAINING 3" GAP NOT OCCUPIED BY LINEAR DIFFUSER IN
- 9 THIS LINE SHALL BE BLANKED OFF TO RETURN AIR AT THIS
- 10 LOCATION
- 11 DISCHARGE AND/OR INTAKE ABOVE CEILING PLENUM.
- 12 PROTECT OPENING WITH WMS.

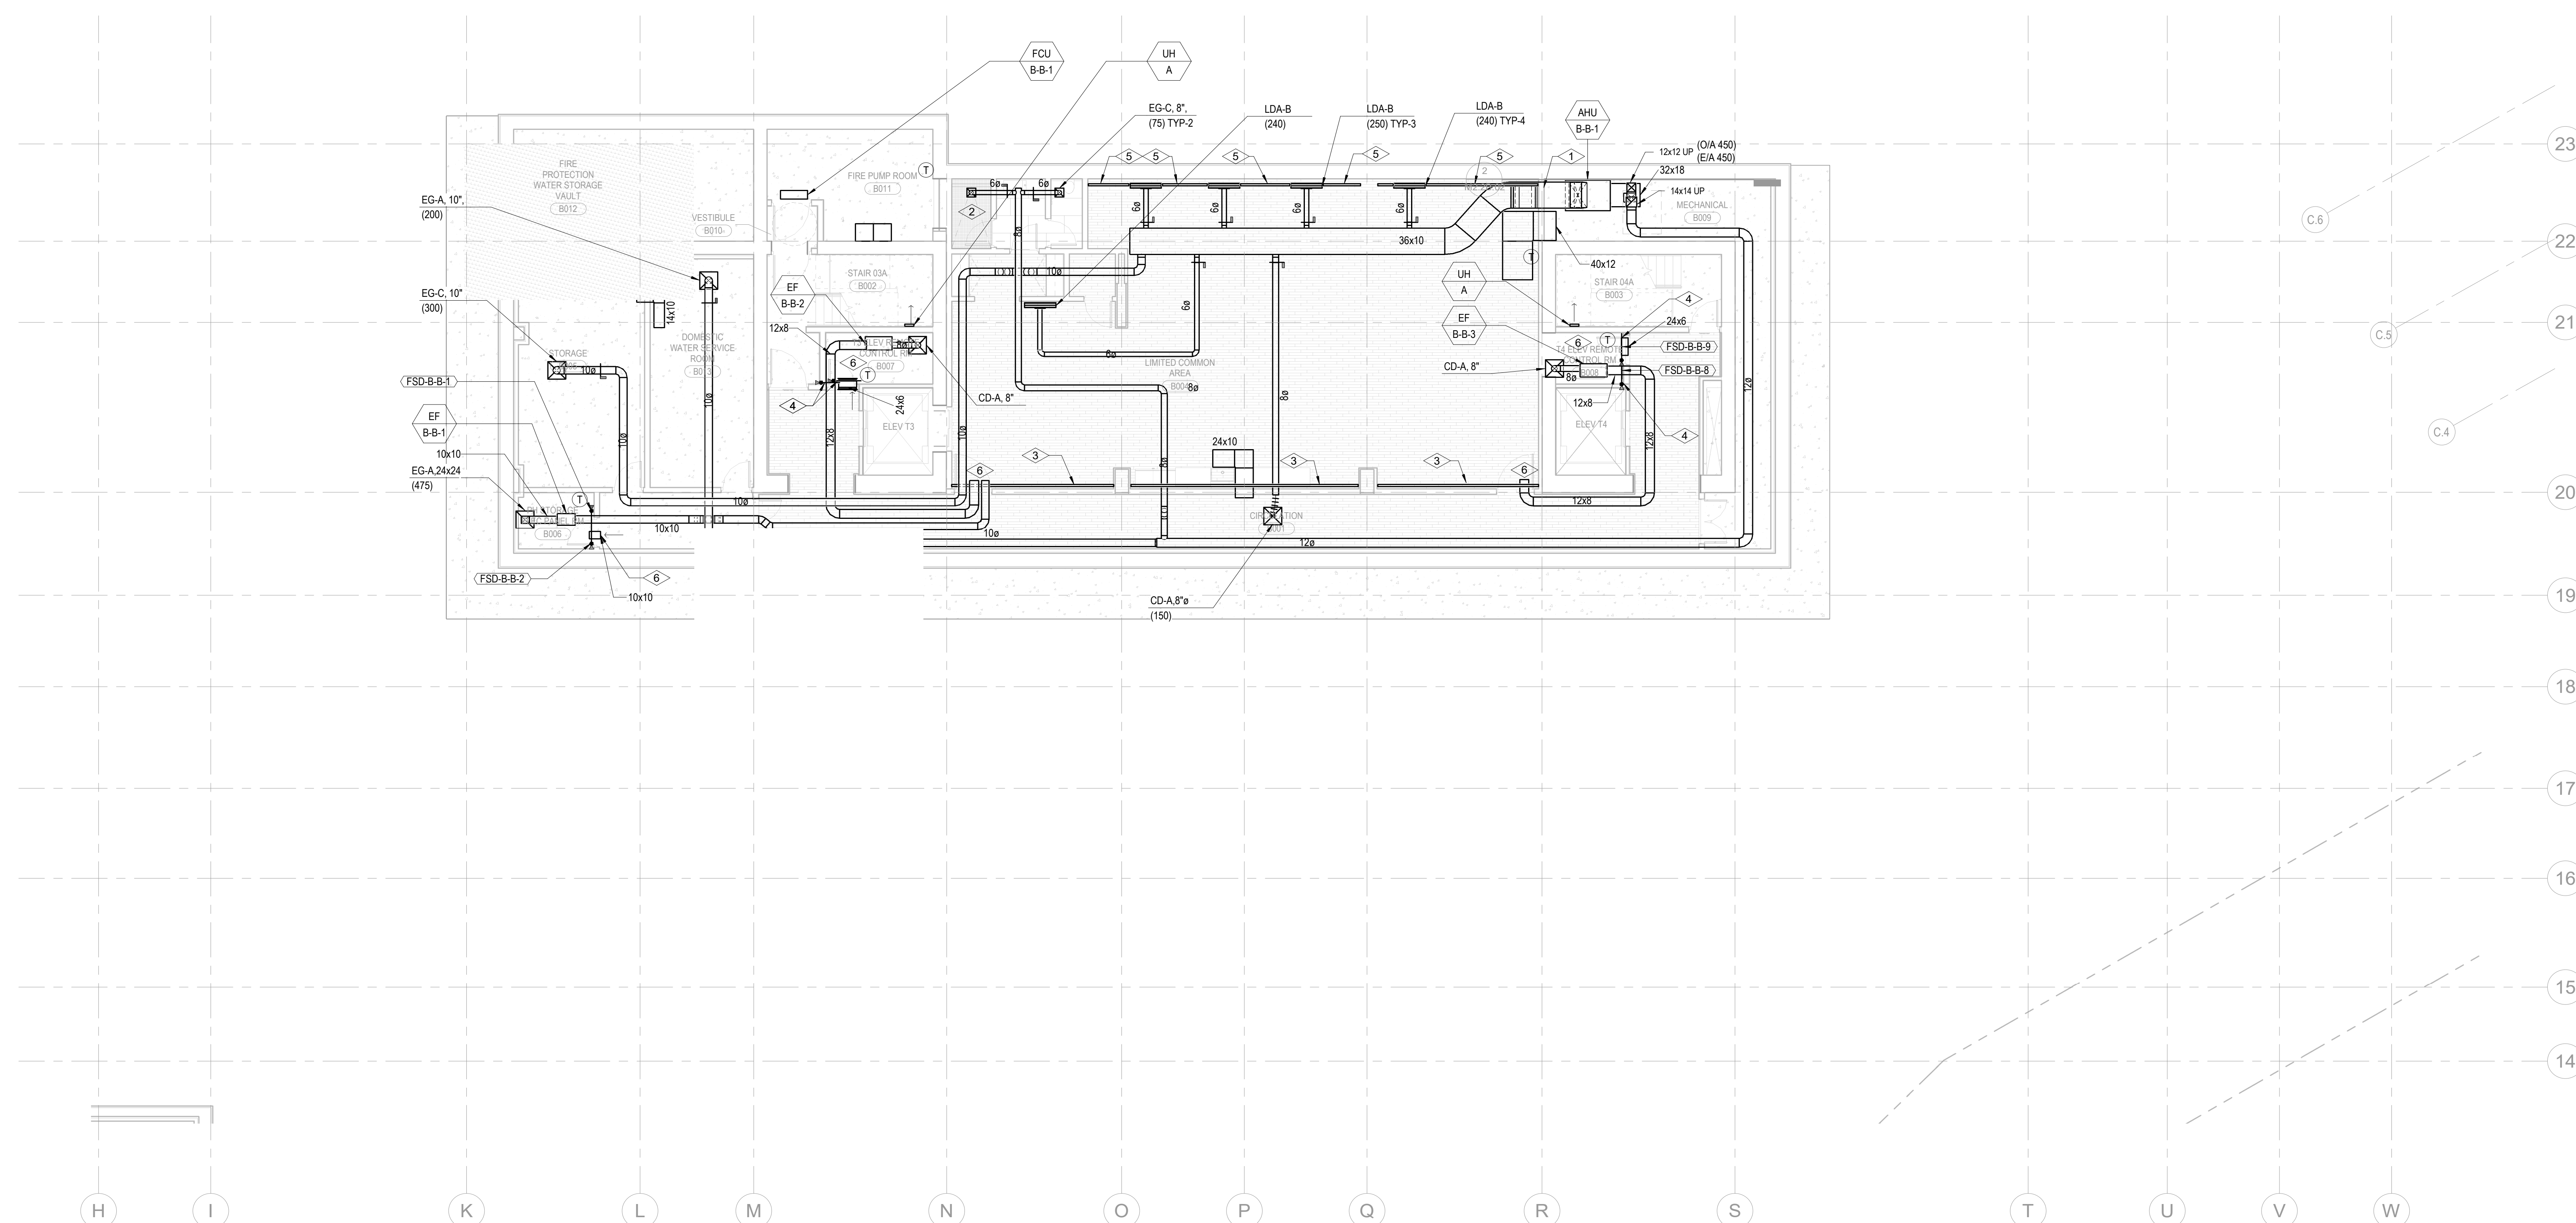

1 TOWER B - LEVEL B1 MECHANICAL DUCT PLAN
SCALE: 1/8" = 1'-0"

