- A. REFER TO M2.4 SERIES FOR ENLARGED PLANS.B. FIREPLACE FLUE ROUTING SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING
- AND SIZING DETAIL.


 C. MECHANICAL EQUIPMENT SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR DETAIL.

 D. ALL DUCTS AND EQUIPMENT LOCATED IN THE GARAGE SHALL BE INSTALLED TIGHT TO UNDERSIDE OF THE SLAB TO MAINTAIN 8'-6" CLEARANCES FOR VEHICLES.

***** NUMBERED NOTES:


- 1 SEE ARCHITECTURAL DRAWINGS FOR INTAKE WELL
 - INFORMATION.
 SEE ARCHITECTURAL DRAWINGS FOR EXHAUST WELL INFORMATION.
- ARCHITECT TO PROVIDE 58-SQFT NFA GARAGE AND SPF AIR INTAKE.
- ROUTE CONDENSATE TO NEAREST FLOOR DRAIN.
 GENERATOR REMOTE RADIATOR. PROVIDE BACKDRAFT DAMPERS ON THE EXHAUST AIR DUCT.
- EQUIPMENT SHALL BE MOUNTED ON MECHANICAL PLATFORM ABOVE GARAGE DRIVE ISLE STAIR PRESSURIZATION FANS AND ASSOCIATED
- DUCTWORK TO BE LOCATED IN A 2-HR RATED ENCLOSURE ADJACENT TO FAN. SEE ARCHITECTURAL DRAWINGS FOR ENCLOSURE DETAIL.
- ENCLOSURE DETAIL.
 REFER TO M6.04 FOR BLDG B HYDRONIC RISER DIAGRAM
 AND MECHANICAL ROOM PIPE CONFIGURATION.
- 1-CFM / SQFT PROVIDED FOR ELEVATOR LOBBY PRESSURIZATION.
 PROVIDE ENERVEX SMDS-8 MODULATING DAMPER OFF
- BOILER EXHAUST STACK WITH 120V/1PH ELECTRICAL POWER.
 DISCHARGE AND/OR INTAKE PROTECT OPENING WITH
- WMS.


 12 PROVIDE MODULATING PRESSURE CONTROLLER WITH
 120V/1PH ELECTRICAL POWER.

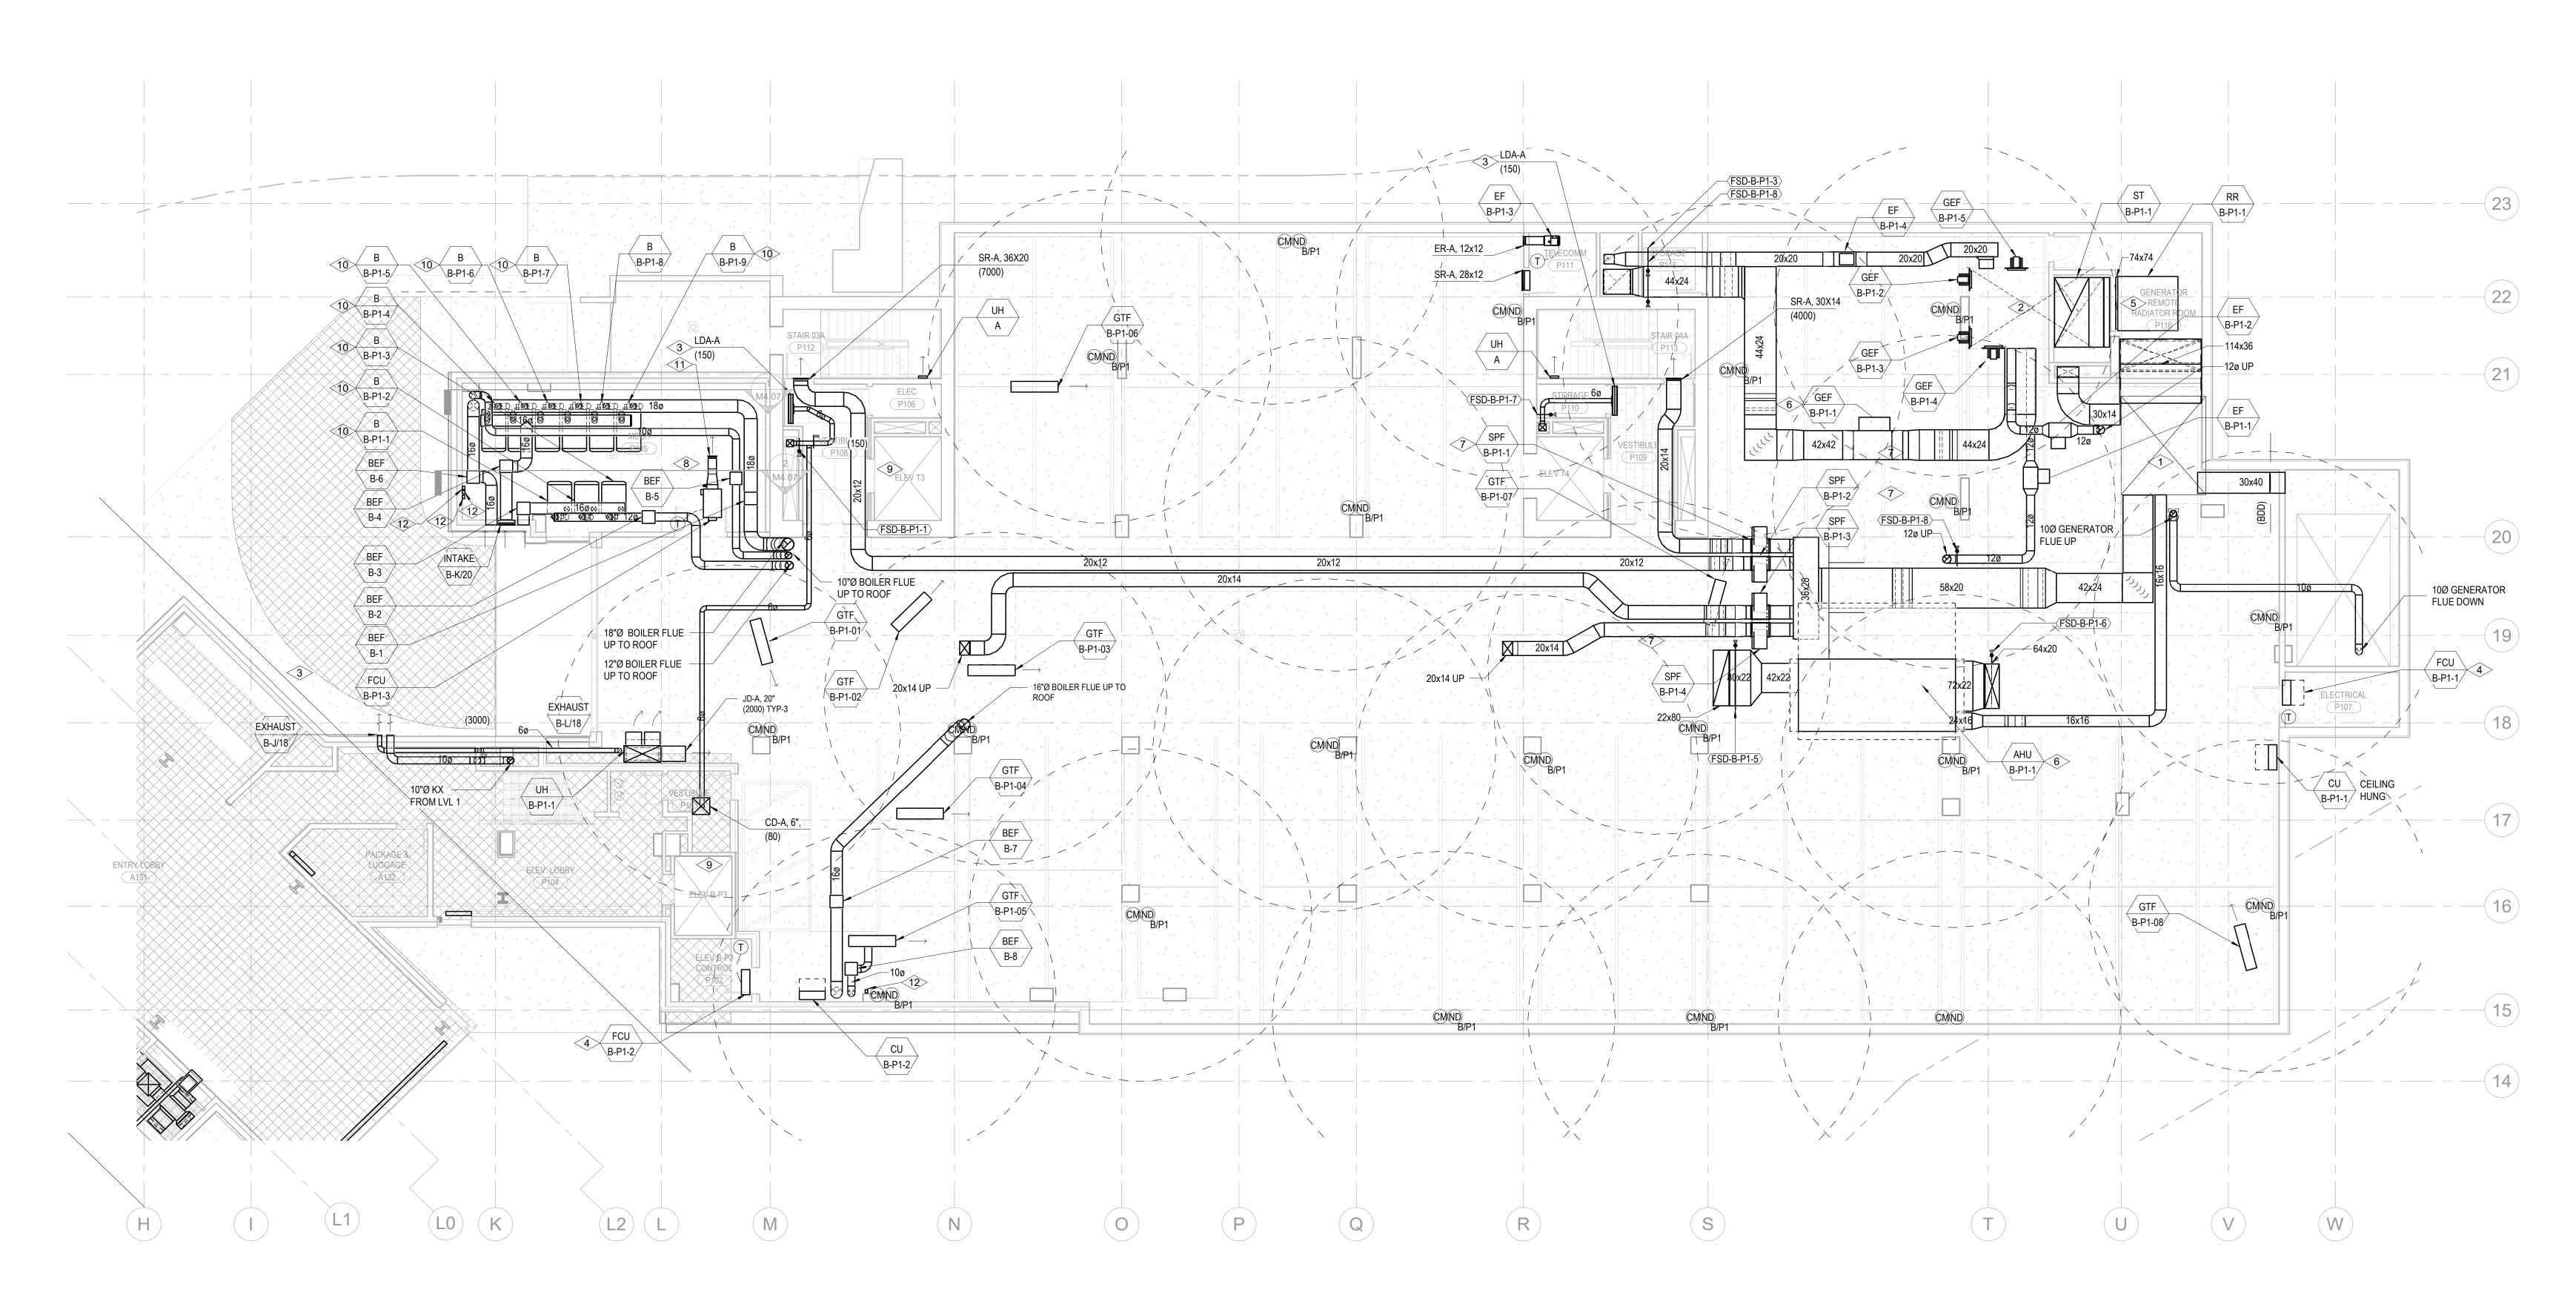

1 TOWER B - PARKING LEVEL 1 MECHANICAL DUCT PLAN

SCALE: 1/8" = 1'-0"

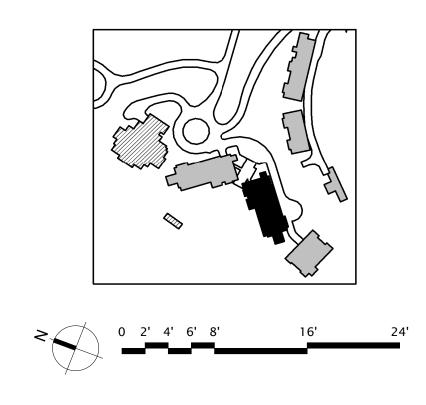




Reserved for permit stamp

159 South Jackson St, Suite 600 Seattle, Washington 98104 USA +1 206 624 5670 olsonkundig.com

roject:

SOMMET B 9300 Marsac Ave Park City, Utah 84



Pool Consultant
Cloward H20
2696 N University Ave, Suite 290
Provo, UT 84604

<u>Landscape Architect</u> **EPG Design**6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C

Westborough, MA 01581

Vertical Transportation Consulatant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer

Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH

2101 N 34th St Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect ______

project manager _____

drawn by _____

checked by Checker

checked by <u>Checker</u>
job no.
date 5/31/2024
revisions:

no. date

IFC Set 3 of 3 5/31/2024

TOWER B - LVL P1
MECHANICAL DUCT
PLAN

M2.2B.03