

Reserved for permit stamp

109 State Avenue, Suite 100
Salt Lake City, Utah 84101
+1 800 624 2970 [saltcityengineering.com](http://www.saltcityengineering.com)

#

Olson Kundig
SOMMET BLANC
9300 Alasse Ave (B) East Parcel
Park City, Utah 84060

project:

ASPEN GROUP
Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Clelland H2O
2698 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPD Group
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Fridley Group
28 Mainell Road
Middlebury, VT

Code Consultant
Heller
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lever Solutions
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnuson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
D
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
1141 University Ave, Suite F
Seattle, WA 98109

MEP Engineer
WSP US
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect _____
project manager _____
drawn by _____

checked by _____
job no. _____
date 05/31/2024

revisions: _____

2 5/24/2024 IFC 3

no. date by _____


IFC Set 3 of 3
05/23/2024

TOWER C - LVL P1
MECHANICAL DUCT
PLAN

M2.2C.01


SHEET NOTES:

- A. REFER TO M2.2C.01 FOR ENLARGED PLANS.
- B. FIRE PROTECTION ROUTING PLAN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING AND SIZING DETAIL.
- C. MECHANICAL EQUIPMENT AS SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR SIZING.
- D. UNLESS OTHERWISE NOTED, MEDIUM PRESSURE DUCT RUNOUTS TO TERMINAL BOXES SHALL BE THE SAME SIZE AS TERMINAL BOX INLET. DUCT RUNOUTS TO TERMINAL BOXES SHALL BE 2" LARGER THAN INLET IF RUNOUT IS GREATER THAN 12".
- E. ALL DUCT BRANCHES LEADING TO DIFFUSERS ARE TO MATCH NECK SIZE OF DIFFUSER UNLESS NOTED OTHERWISE.

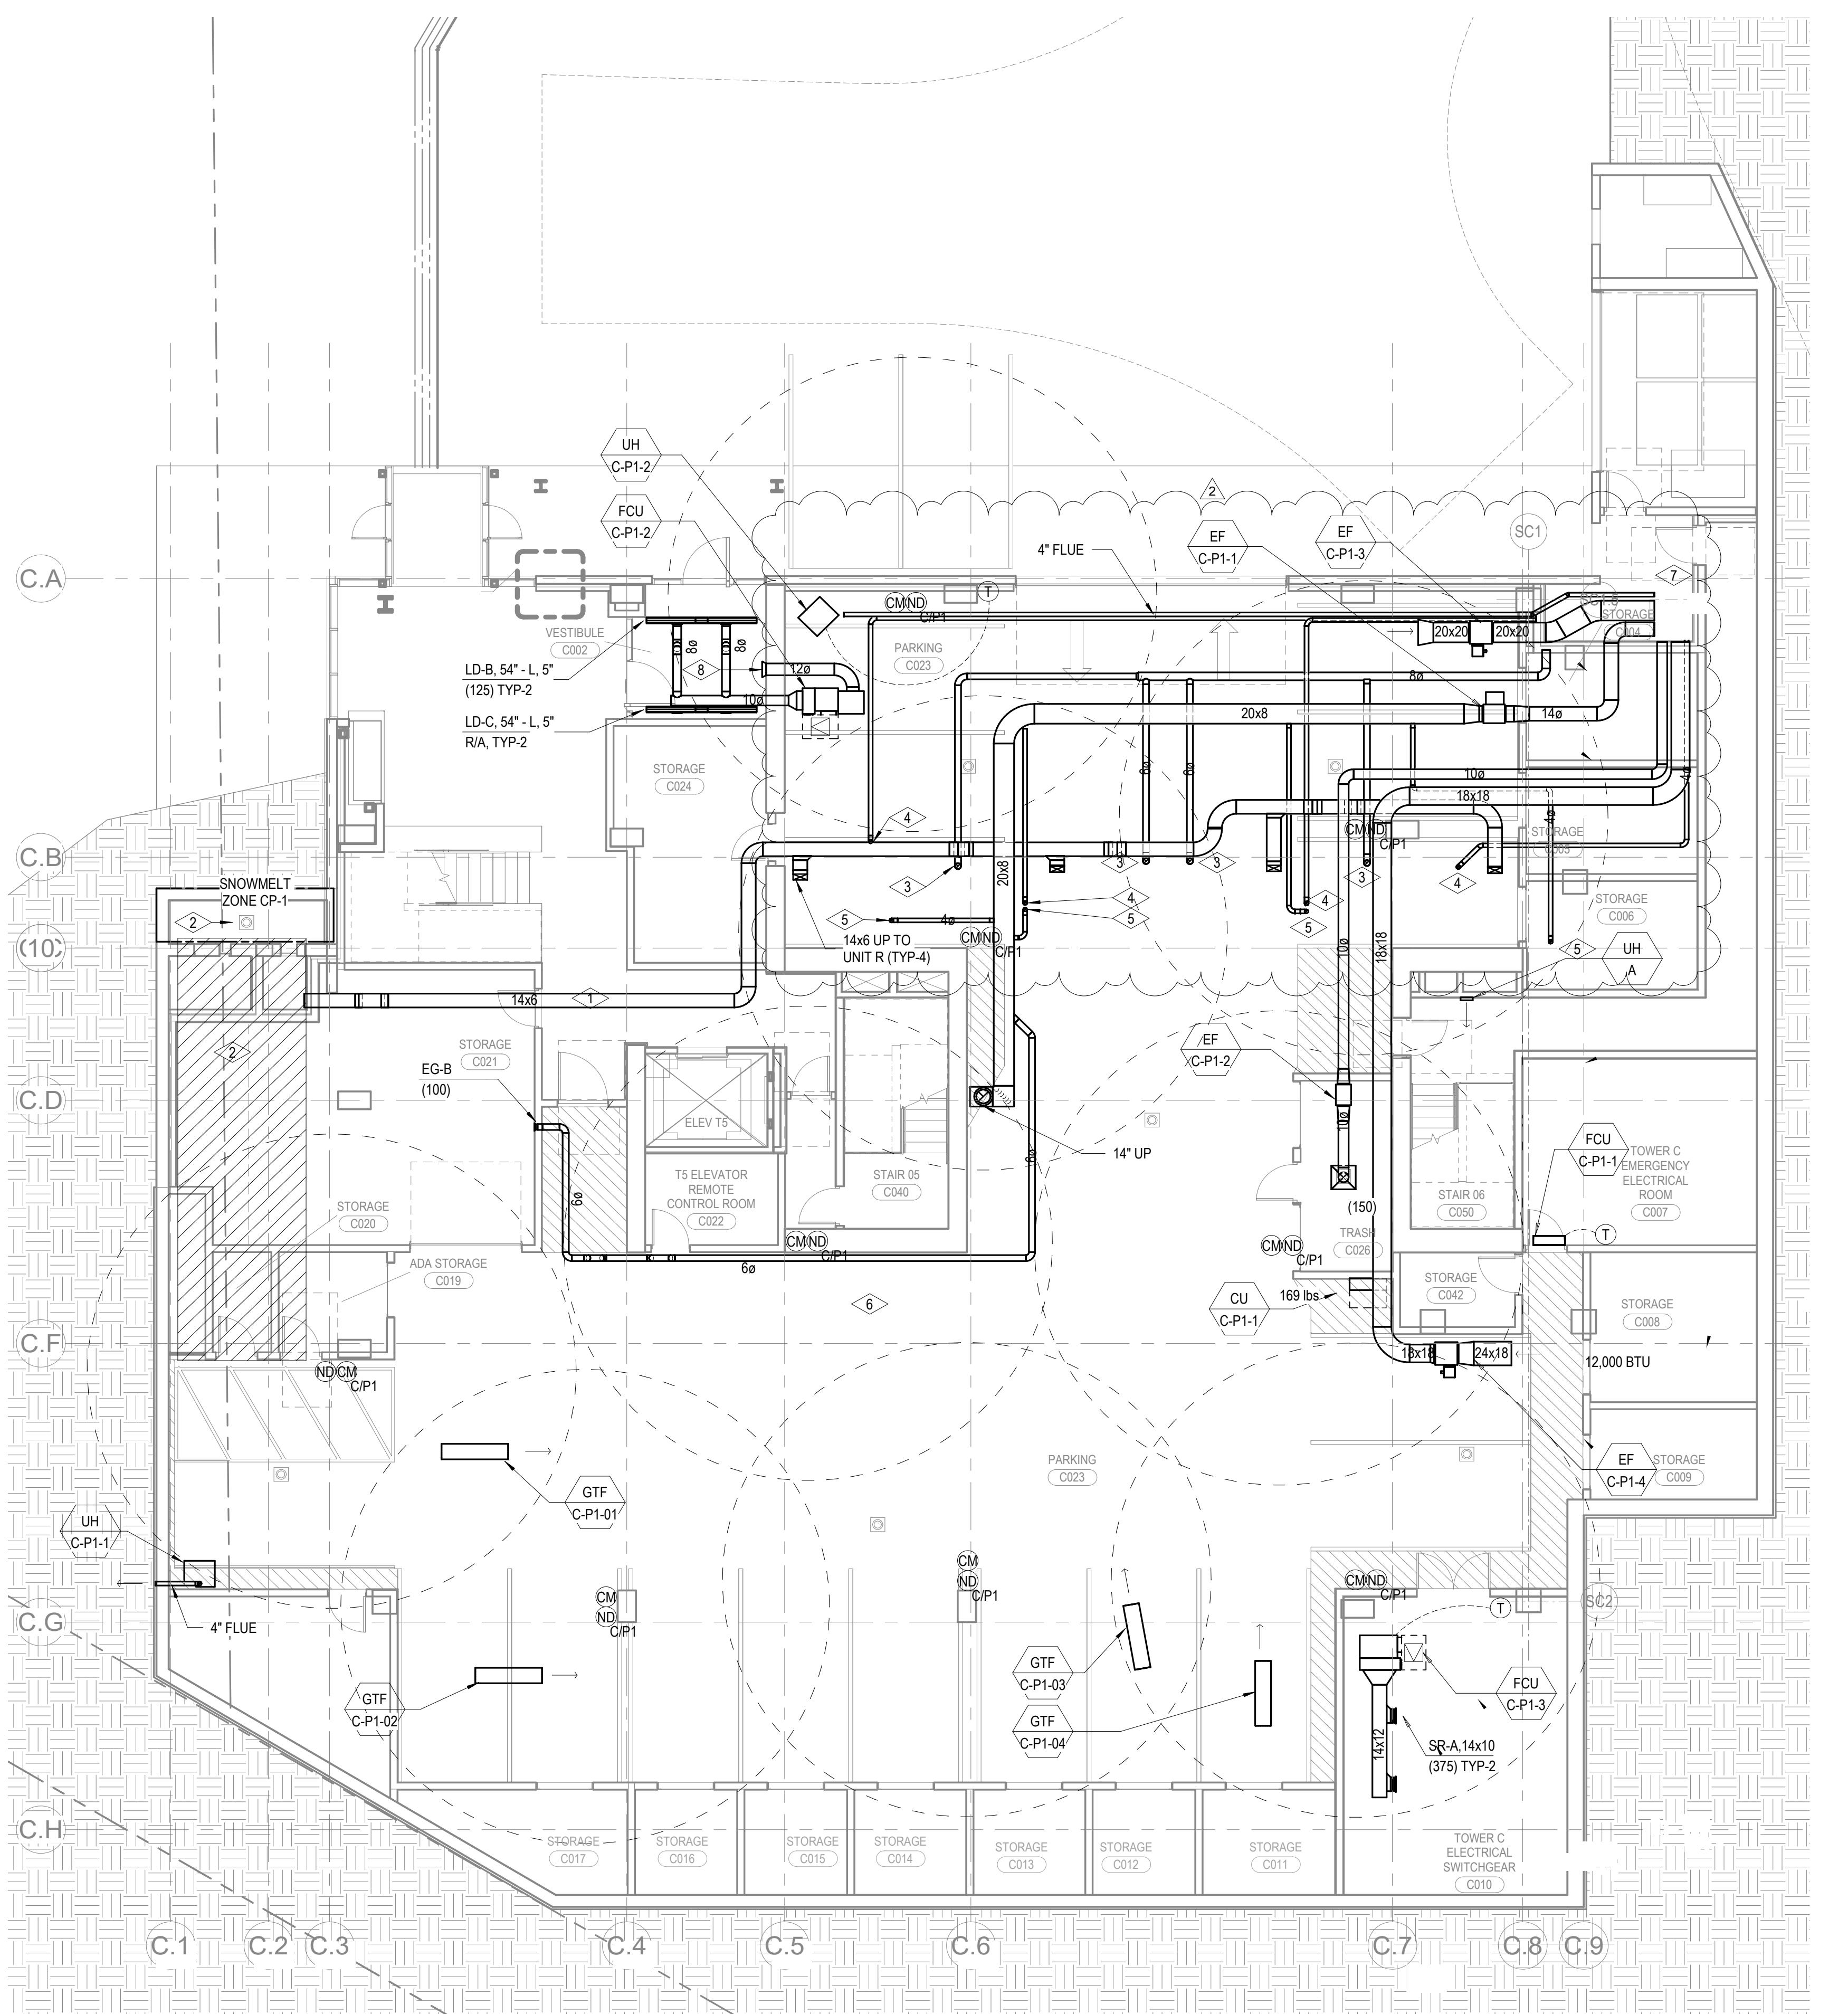

1 TOWER C - PARKING LEVEL MECHANICAL DUCT PLAN

SCALE: 1/8" = 1'-0"

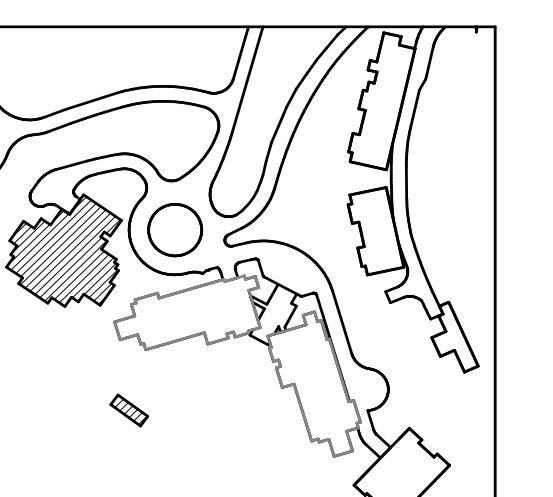

0 2' 4' 6' 8' 16' 24'

05/23/2024