

C 20x12 TX DN **D** 

 $(\mathsf{E})$ 

(G)

## SHEET NOTES:


- CONFIRM EXACT LOCATION OF ALL WALL DEVICES WITH ARCHITECTURAL ELEVATIONS. Α. CONFIRM ALL CEILING AND WALL ACCESS DOORS WITH ARCHITECTURAL RCP'S AND WALL ELEVATIONS. REFER TO M3-2A-01 THROUGH M3-2C-R FOR RADIANT FLOOR HWS/R PIPING ROUTING AND SIZING.
- PROVIDE 1-INCH ACOUSTIC LINING FOR ENTIRITIY OF MAIN DUCT RUN OFF FAN COIL. ALL RESIDENTIAL TOILET EXHAUST, DRYER EXHAUST, AND KITCHEN RANGE HOOD EXHAUST TO BE PART OF A SUB-DUCT EXHAUST SYSTEM.
- F. ROUTE 3/4" CONDENSATE DRAINS FROM FCUS TO NEAREST SINK TAILPIECE.

## # <u>NUMBERED NOTES:</u>

- RANGE HOOD EXHUAST FAN TO BE INEGRAL WITH RANGE SPECIFIED BY THE ARCHITECT. INTERLOCK CONTROL WITH MUA-A. 2 3 
   63
   125
   250
   500
   1000
   2000
   4000
   8000

   0
   4
   6
   8
   7
   9
   8
   0
   CONFIRM WITH OWNER AND ARCHITECT PRIOR TO PROVIDING HUMIDIFIER. 2" RETURN AIR SLOT 4 OWNER OPTION: PROVIDE 120(16A)/1 CONNECTION FOR APRILAIRE 800 HUMIDIFIER DOWNSTREAM OF FAN COIL UNIT. REFER TO 5 ELECTRICAL DRAWINGS FOR DETAIL. REFER TO PLUMBING DRAWINGS FOR 1/2" CW CONNECTION. ROUTE 3/4" CD TO NEAREST SINK TAILPIECE. REFER TO DETAILS M5.04/8 & M5.04/12 FOR INSTALLATION CONNECTION. REMOVE SOUND LINING FROM FCU AND PROVIDE PRICE RSP 3'-0" SOUND ATTENUATOR WITH A MINIMUM INSERTION LOSS OF: 
   63
   125
   250
   500
   1000
   2000
   4000
   8000

   0
   4
   6
   8
   7
   9
   8
   0
- CONFIRM WITH OWNER AND ARCHITECT PRIOR TO PROVIDING HUMIDIFIER. CONNECT 4"Ø TO DRYER. 6 LOCATION OF STEAM GENERATOR FOR DUCT HUMIDIFIER. CONFIRM EXACT LOCATION WITH ARCHITECT PRIOR TO INSTALLING. 7

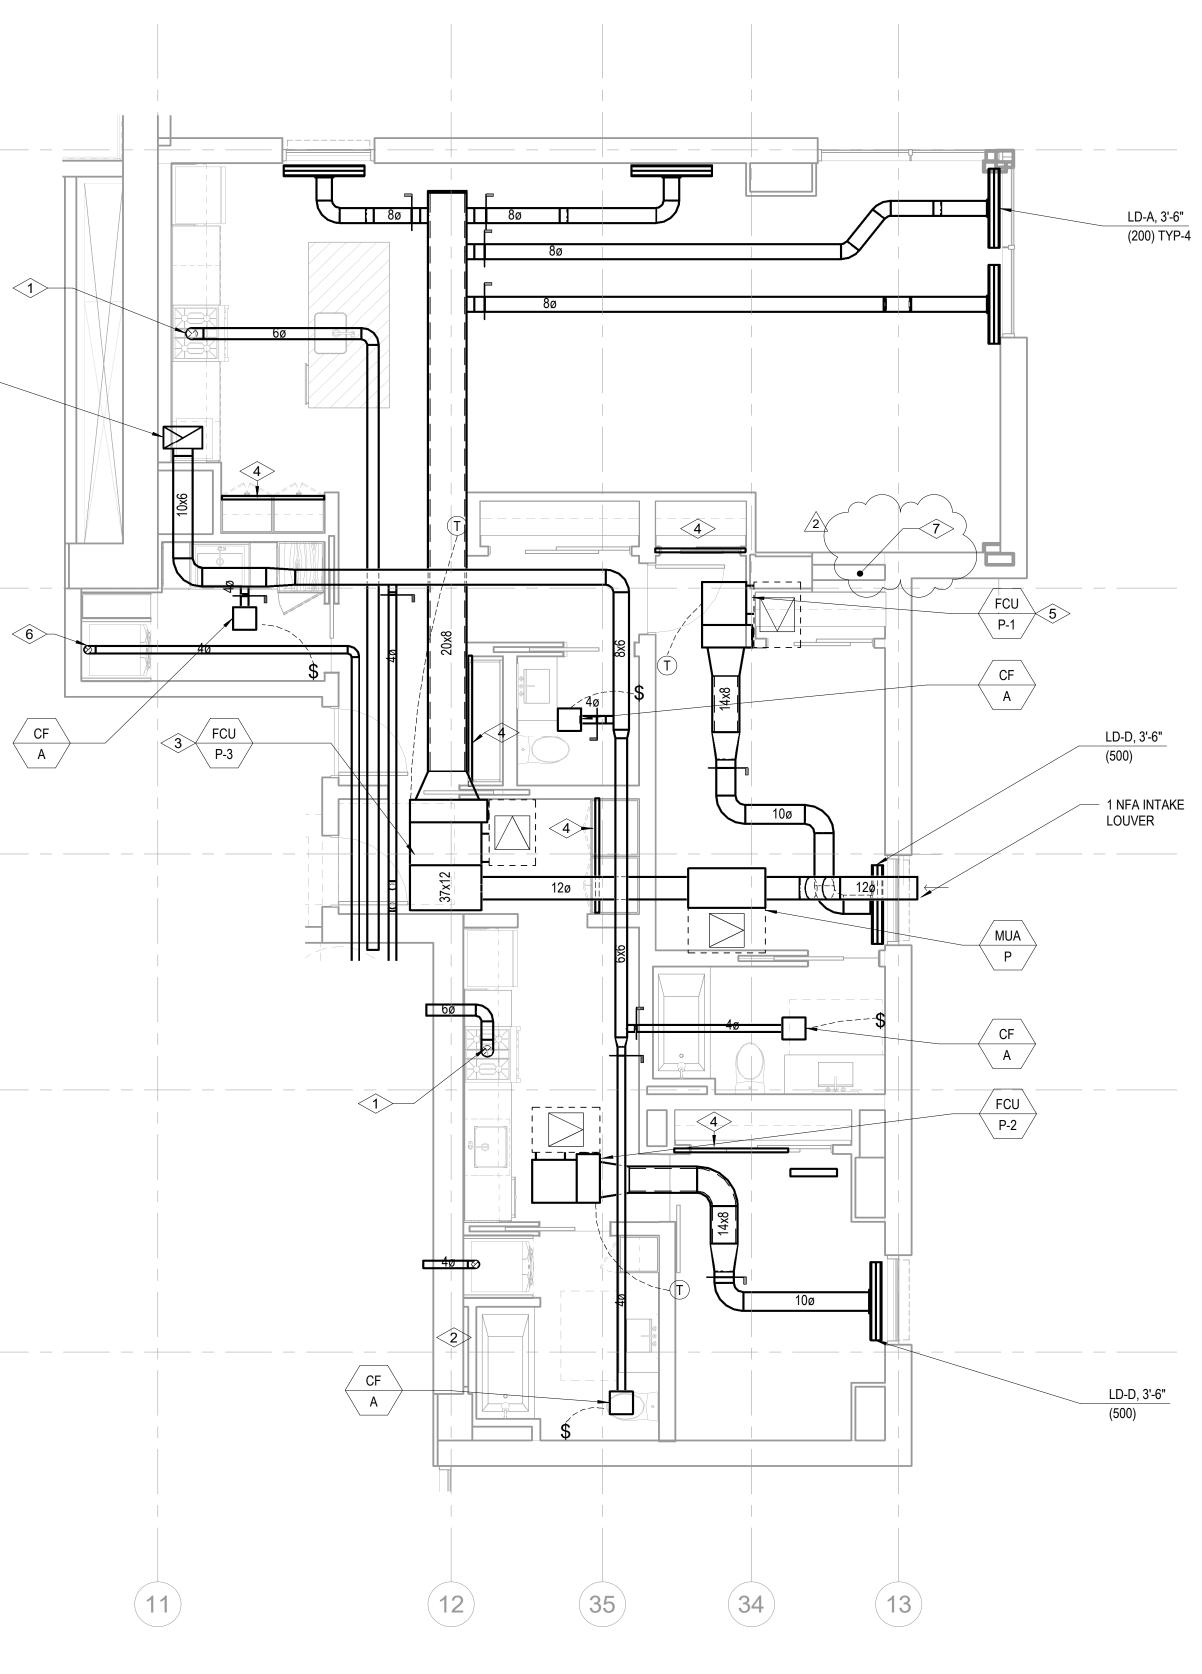

<sup>1</sup> TOWER A/B - MECHANICAL PLAN - UNIT P SCALE: 1/4" = 1'-0"

0 1' 2' 3' 4'	8'	12'

no.	date	by
	IFC Set 3 of 3	
	5/31/2024	
	5/51/2024	
	ARGED	
LAP	N - UNIT P	
	M2.4.P	

2 5/31/2024 IFC 3

<u>Building Envelope Consultant</u> <b>RDH</b> 2101 N 34th St Seattle, WA 98103
<u>Accessibility Consultant</u> <b>Studio Pacifica</b> 2144 Westlake Ave N, Suite F Seattle, WA 98109
<u>MEP Engineer</u> <b>WSP USA</b> 1001 Fourth Ave., Suite 3100 Seattle, WA 98154
principal architect
project manager
drawn by
checked by <u>Checker</u>
job no.
date 5/31/2024
revisions:

<u>Lighting Designer</u> **O-**1319 SE MLK Blvd, Suite 210 Portland, Oregon 97219

<u>Structural Engineer</u> **Magnusson Klemencic Associates** 1301 5th Ave, Suite 3200 Seattle, WA 98101

<u>Vertical Transportation Consulatant</u> **Lerch Bates** 19515 North Creek Parkway, Suite 304 Bothell, WA 98011

<u>Fire Protection Engineer</u> Jensen Hughes One Research Drive, Suite 305C Westborough, MA 01581

<u>Code Consultant</u> **Holmes** 600 1st Avenue, Suite 200A Seattle, WA 98104

<u>Specifications Writer</u> **Friday Group** 88 Mainelli Road Middlebury, VT

<u>Pool Consultant</u> **Cloward H20** 2696 N University Ave, Suite 290 Provo, UT 84604 <u>Landscape Architect</u> **EPG Design** 6949 South High Tech Drive, Suite 100 Midvale, Utah 84047

ASPEN GROUP

**Aspen Group USA, LLC** PO Box 980022 Park City, Utah 84098

Reserved for permit stamp

300 ISA

159 Sol Seattle 1 206 6:

Kundig

Olson

E E E ⊢ < asc **∏** 

0.0 0.0 Proj

REMOVE SOUND LINING FROM FCU AND PROVIDE PRICE RSP 3'-0" SOUND ATTENUATOR WITH A MINIMUM INSERTION LOSS OF:

OWNER OPTION: PROVIDE 208(16A)/1 CONNECTION FOR APRILAIRE 800 HUMIDIFIER DOWNSTREAM OF FAN COIL UNIT. REFER TO ELECTRICAL DRAWINGS FOR DETAIL. REFER TO PLUMBING DRAWINGS FOR 1/2" CW CONNECTION. ROUTE 3/4" CD TO NEAREST SINK TAILPIECE. REFER TO DETAILS M5.04/8 & M5.04/12 FOR INSTALLATION CONNECTION.

ELECTRICAL RADIANT FLOOR TO BE PROVIDED IN MASTER BATHROOM. SEE ELECTRICAL DRAWINGS.