CONFIRM EXACT LOCATION OF ALL WALL DEVICES WITH ARCHITECTURAL ELEVATIONS.

CONFIRM ALL CEILING AND WALL ACCESS DOORS WITH ARCHITECTURAL RCP'S AND WALL ELEVATIONS.


REFER TO M3-2A-01 THROUGH M3-2C-R FOR RADIANT FLOOR HWS/R PIPING ROUTING AND SIZING.

PROVIDE 1-INCH ACOUSTIC LINING FOR ENTIRITIY OF MAIN DUCT RUN OFF FAN COIL.

ROUTE 3/4" CONDENSATE DRAINS FROM FCUS TO NEAREST TAILPIECE.

NUMBERED NOTES:


1 RANGE HOOD EXHUAST FAN TO BE INEGRAL WITH RANGE SPECIFIED BY THE ARCHITECT. INTERLOCK CONTROL WITH MUA-A.
2 4" DUCT UP TO DRYER EXHAUST
3 2" RETURN AIR SLOT



Reserved for permit stamp

159 South Jackson St, Sr Seattle, Washington 981 +1 206 624 5670 olsonkun

project:
SOMMET BLANC
9300 Marsac Ave (82 Fast Parcel)

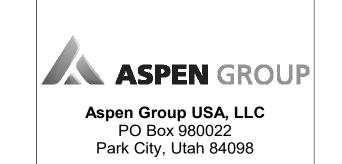

Pool Consultant
Cloward H20
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consulatant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer

Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect ______
project manager _____
drawn by _____

checked by __Checker
 job no.
 date __05/31/2024

revisions:

job no.

date 05/31/2024


revisions:

IFC Set 3 of 3 05/31/2024

no. date

ENLARGED
MECHANICAL PLAN UNIT R

M2.4.R

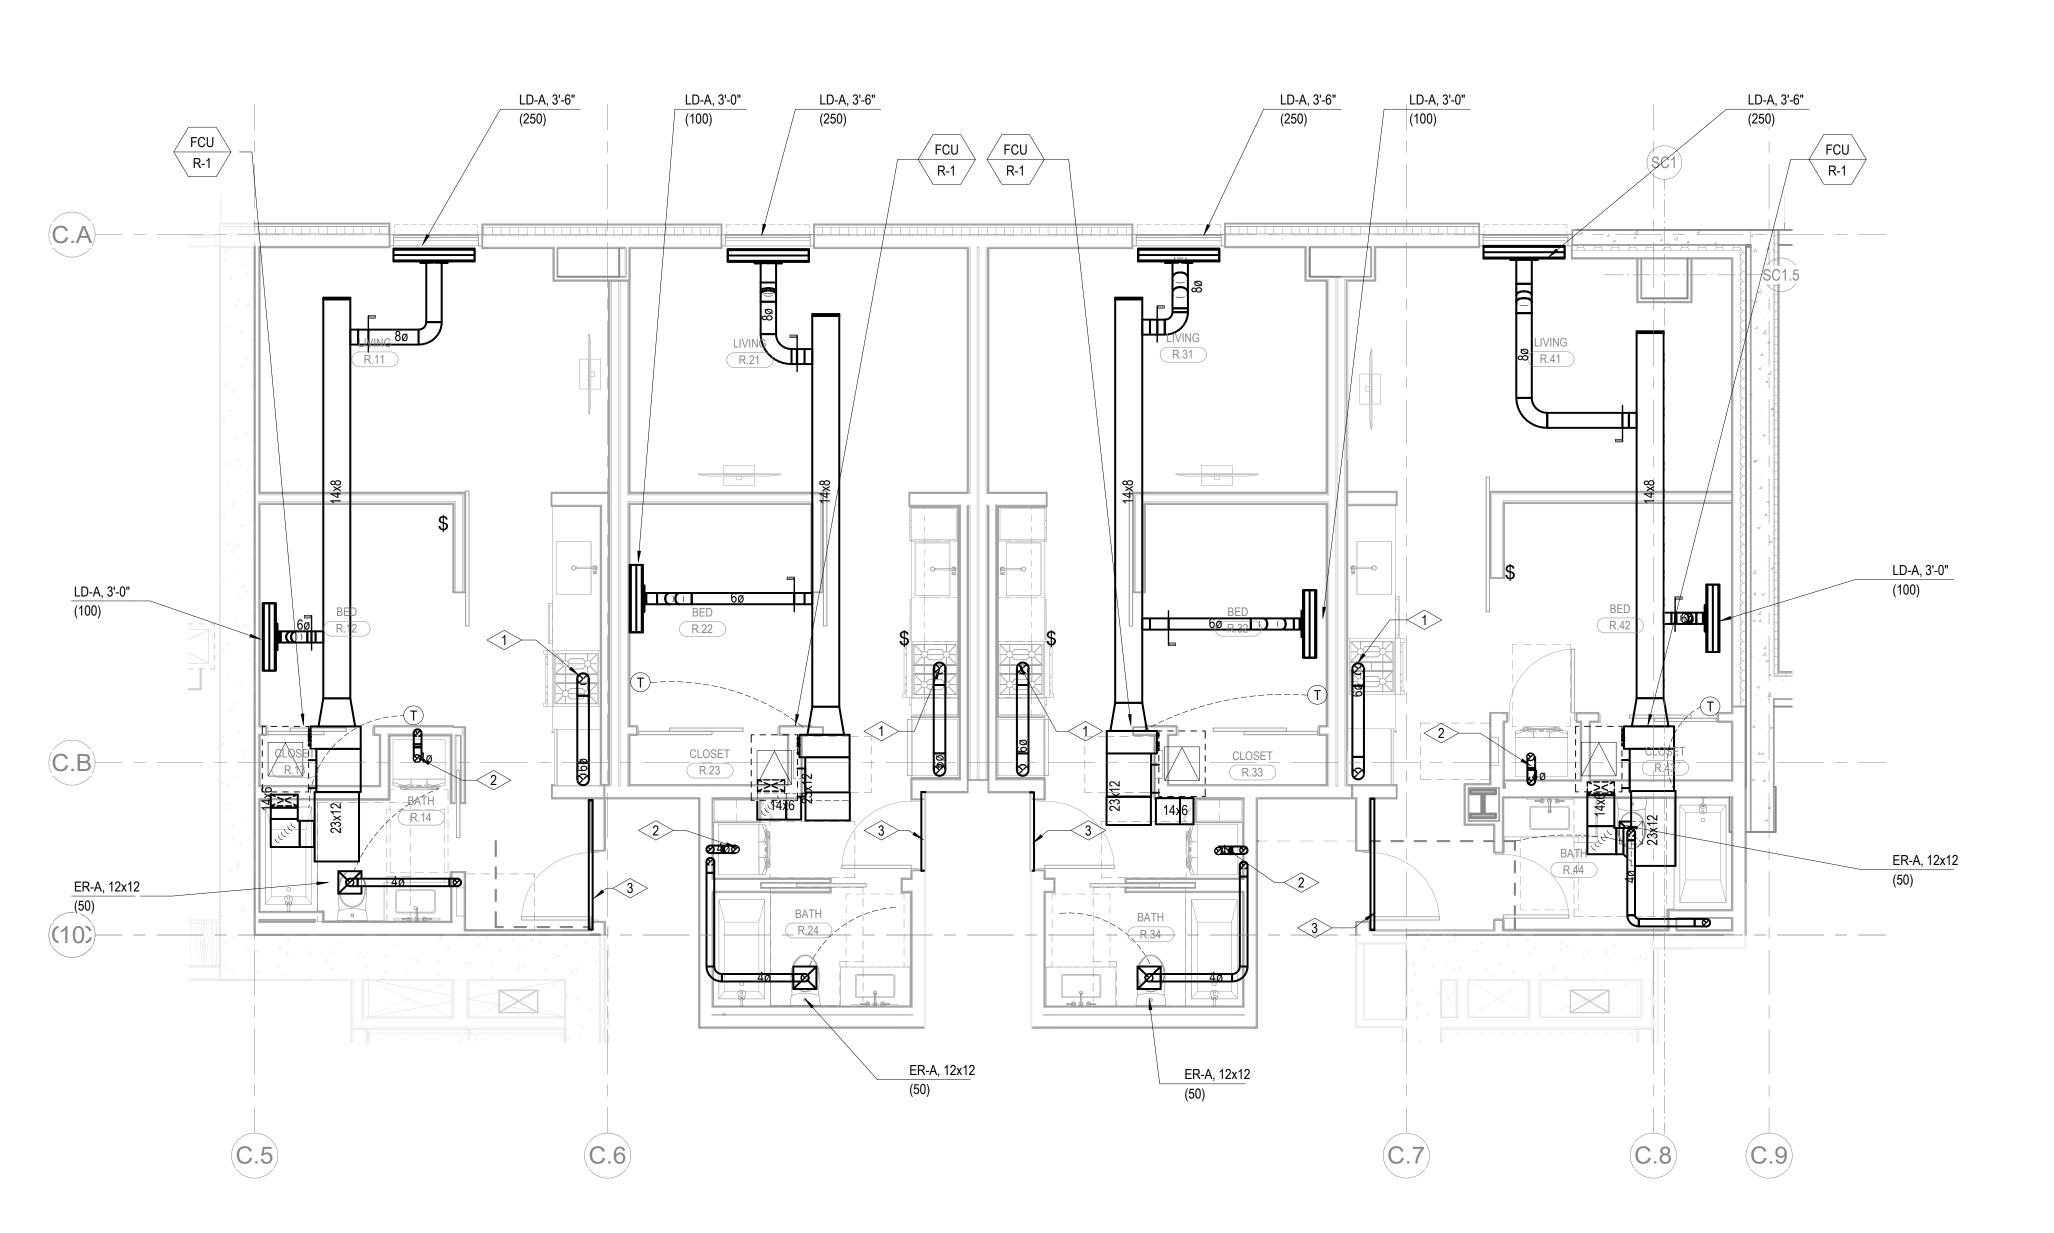

BLDG C - MECHANICAL UNIT PLAN - R

SCALE: 1/4" = 1'-0"

