

1 TOWER B - PARKING LEVEL 2 MECHANICAL PIPING PLAN SCALE: 1/8" = 1'-0"


	a a a a a a a a a a a a a a a a a a a		
FIRE PROTECTION WATER STORAGE VAULT B012	POOL MECH B-P2-4		d d d d d d d d d d d d d d
HOUSEKÉEPING A A P275 A A A A A A A A A A A A A A A A A A A	STAIR 03A P272 ELEC P261		A A A A A A A A A A A A A A A A A A A
P258 a a a a a a a a a a a a a a a a a a a	A A A A A A A A A A A A A A A A A A A		
	1" HWS &R 1" CHWS &R		1" HWS &R -1" CHWS &R
	$\begin{bmatrix} a & a \\ a $	$\begin{bmatrix} a & a & a \\ \hline $	
FCU B-P2-2	$\begin{array}{c ccccccccccccccccccccccccccccccccccc$		
B-P2-2	a d d d d d d d d d d d d d d d d d d d	STORAGE P219 STORAGE P219 A A A A A A A A A A A A A	A A A A A A A A A A A A A A A A A A A
POOL MECH			P215 P214 P214

## SHEET NOTES:

- A. ALL CHILLED WATER AND HOT WATER BRANCH PIPING SHALL BE SIZED AT 1" FOR ALL FAN COIL UNITS UNLESS
- B. REFER TO MANUFACTURER SPECIFICATIONS FOR REFRIGERANT PIPING SIZING FOR SPLIT SYSTEM FAN COILS. C. ROUTE 3/4" CONDENSATE FROM FCU TO NEAREST SINK TAILPIECE PER DETAIL M5.06/8.

MUMBERED NOTES:

1 2" FO DN TO FUEL SUBBASE TANK.

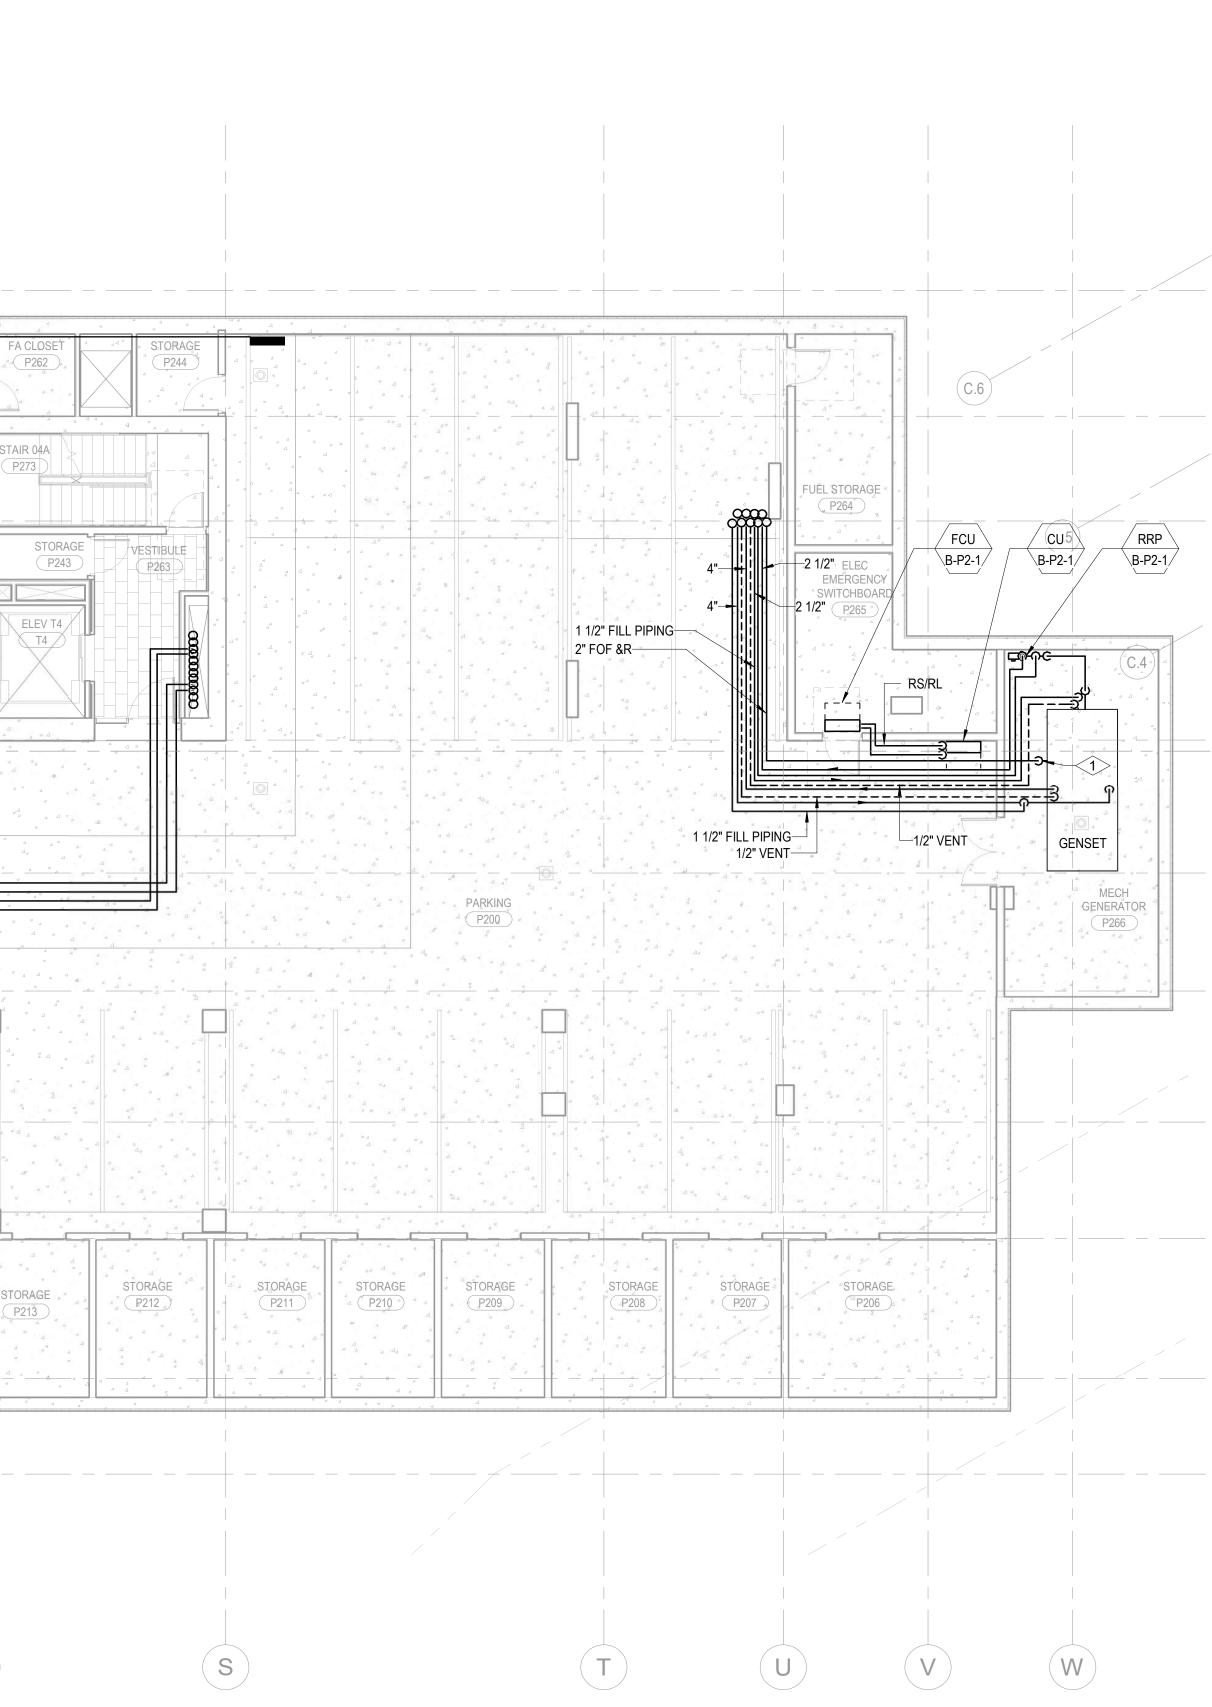

	Reserved for permit stamp	
	OBSOR X Suite 60 159 South Jackson St, Suite 60 Seattle, Washington 98104 USA +1 206 624 5670 olsonkundig.com	project: SOMMET BLANC 9300 Marsac Ave (B2 East Parcel) Park City, Utah 84060
23	Aspen Group PO Box 98 Park City, Uta	<b>N GROUI</b> USA, LLC 30022 ah 84098
	Pool Consultant Cloward H20 2696 N University Ave, S Provo, UT 84604Landscape Architect EPG Design 6949 South High Tech D Midvale, Utah 84047Specifications Writer Friday Group 88 Mainelli Road Middlebury, VTCode Consultant Holmes 600 1st Avenue, Suite 20 Seattle, WA 98104Fire Protection Engineer Jensen Hughes One Research Drive, Su Westborough, MA 01581Vertical Transportation C Lerch Bates 19515 North Creek Park	rive, Suite 100 00A ite 305C
18	Bothell, WA 98011   Structural Engineer   Magnusson Klemencic   1301 5th Ave, Suite 3200   Seattle, WA 98101   Lighting Designer   O-   1319 SE MLK Blvd, Suite   Portland, Oregon 97219   Building Envelope Consu   RDH   2101 N 34th St   Seattle, WA 98103   Accessibility Consultant   Studio Pacifica   2144 Westlake Ave N, S	Associates
- 16	Seattle, WA 98109     MEP Engineer     WSP USA     1001 Fourth Ave., Suite 3     Seattle, WA 98154     principal architect     project manager     drawn by	3100
	revisions:	
	IFC Set 2 5/17/20	2 of 3
	TOWER B - LVI MECHANICAL I PLAN M3.2E	PIPING