
	I		I		I		I
_							
	 					·	
	 						H1-1,3
	 	·					
	 			<u>\</u>			
	 			{			








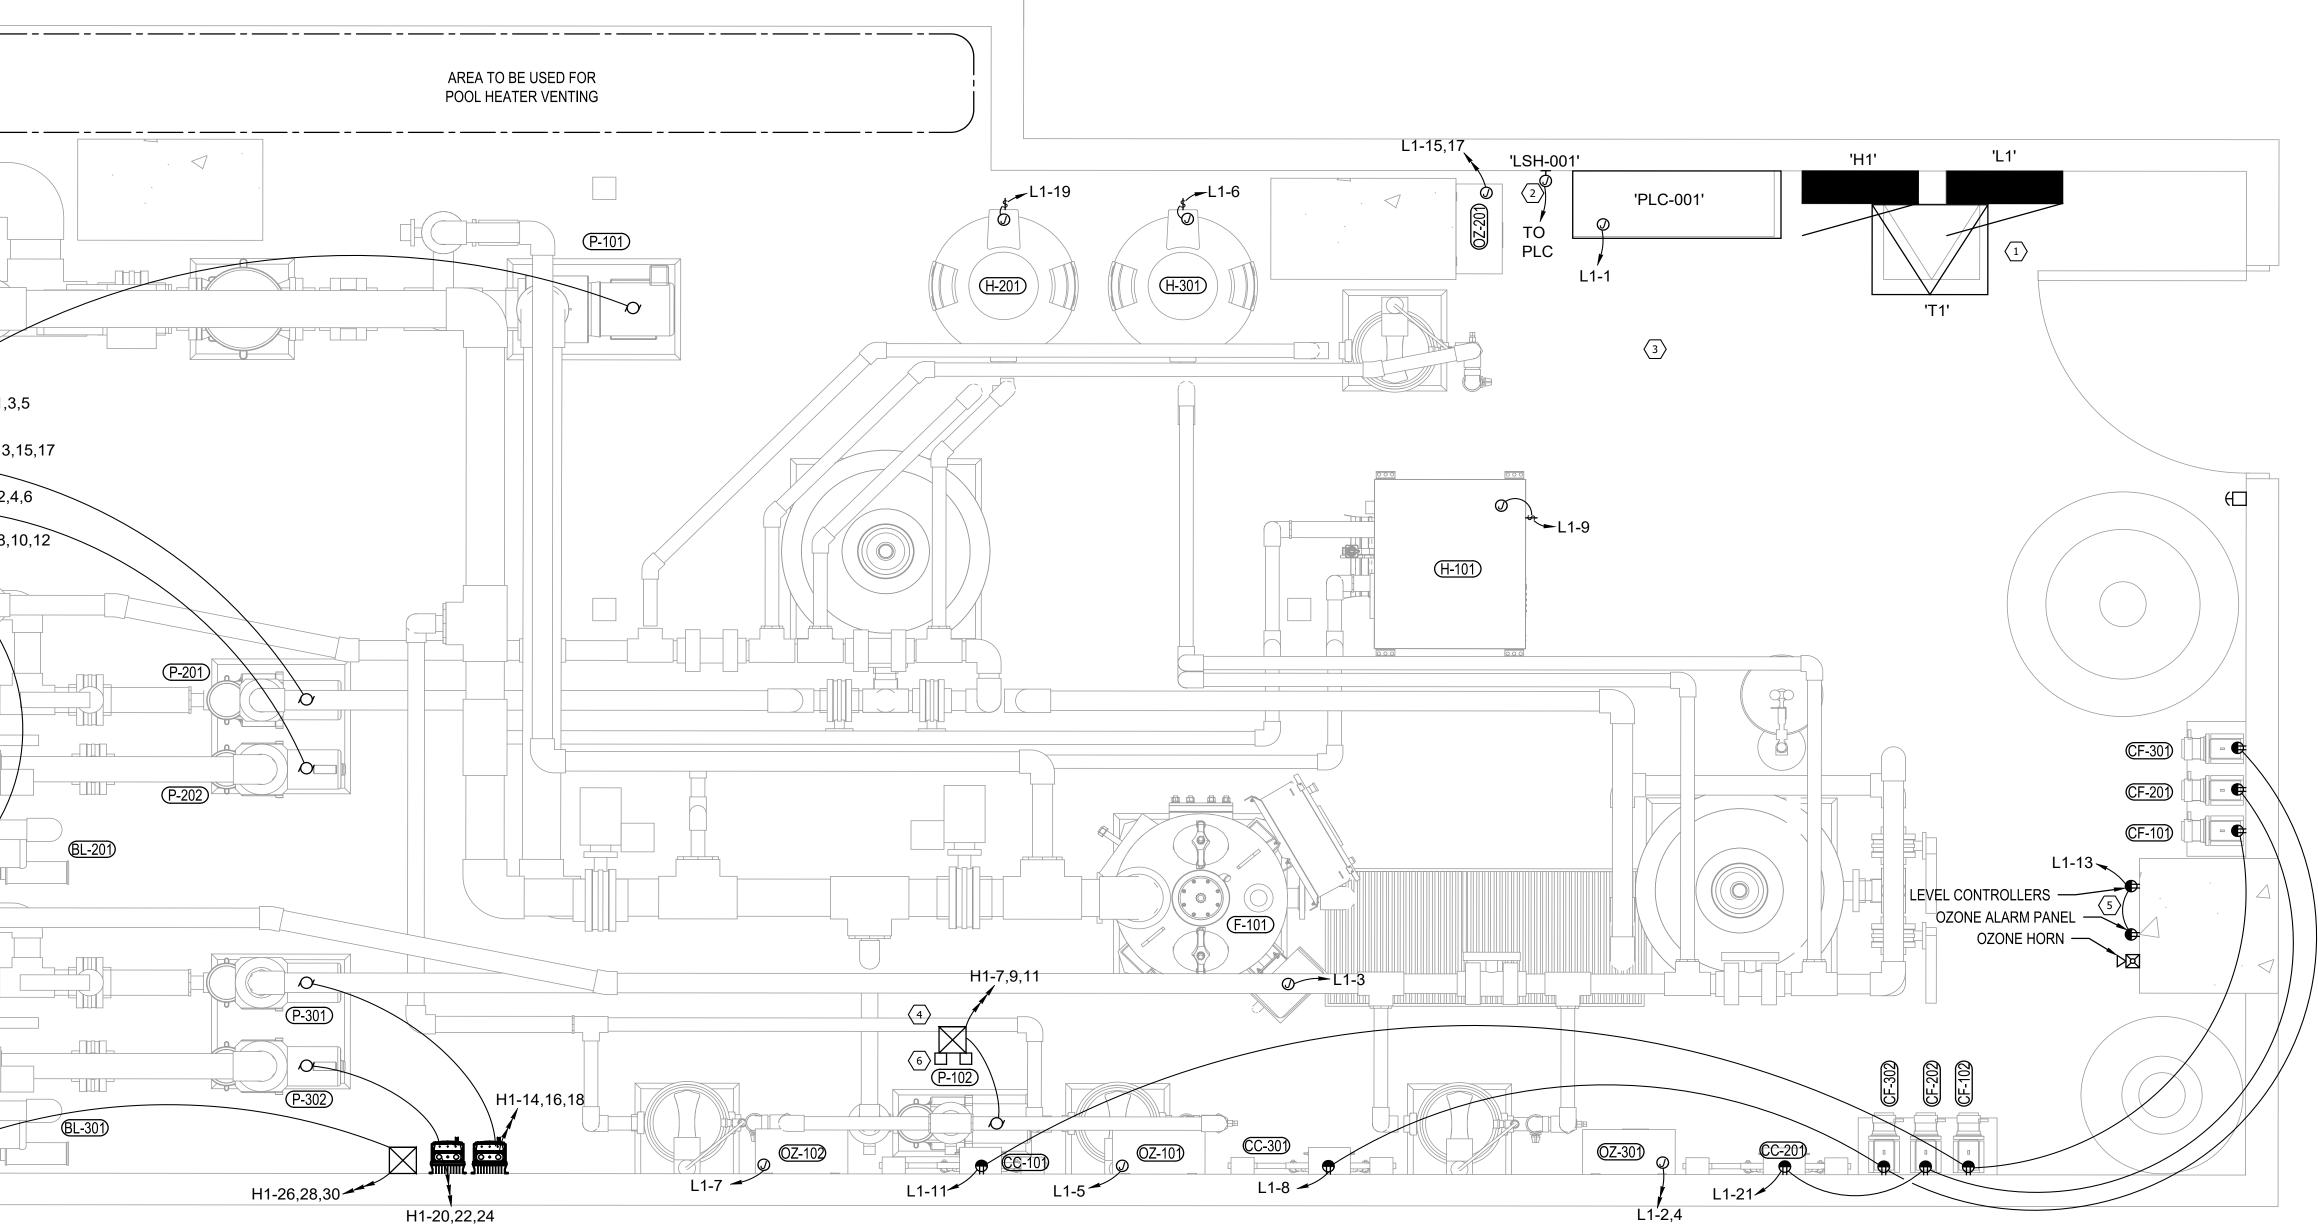

L1-2,4

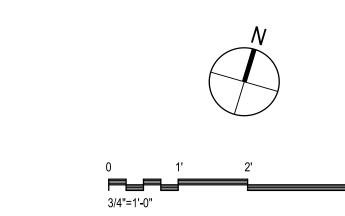

	 KEYED NOTES SEE DETAIL 7/WE5.03 FOR MORE INFORMATION. PROVIDE (1) 21mm C AND A 2-1.3mm CONDUCTOR FROM MOTORIZED ACTUATOR BACK TO THE PLC. ALL EQUIPMENT NEEDS TO BE RATED NEMA 3R OR BETTER. PROVIDE A GALVANIZED DRIP SHIELD OVER THE DISCONNECT. CONFIRM EXACT LOCATION OF EQUIPMENT PRIOR TO ROUGH-IN. PROVIDE A P1000 UNISTRUT SUPPORT RACK FOR MOUNTING OF PUMP STARTER. RACK IS TO HAVE VERTICAL SUPPORTS HELD IN PLACE UTILIZING THE FLOOR CONCRETE. SEE DETAIL 9-WE5.11 FOR MORE INFORMATION. 	DAVID W. STEWARD ANTE OF UTADOM		
	A. COORDINATE MOUNTING HEIGHTS OF ALL EQUIPMENT WITH ARCHITECTURAL DRAWINGS AND MILL WORK CONTRACTOR PRIOR TO ROUGH IN. B. VERIFY AND COORDINATE EXACT ELECTRICAL REQUIPMENT OF ALL EQUIPMENT WITH MANUFACTURER'S RECOMMENDATIONS PRIOR TO INSTALLATION OF EQUIPMENT.	Reserved for permission strain for the form of the for	project: PROJECT NAME : SOMMET BLANC PROJECT ADDRESS	
		White Summit Deve PO Box 980 PO Box 980 Park City, Utal Acoustic Consultant BRC Acoustics 1932 1st Ave, Suite 620 Seattle, WA 98101 CECEVERED VATER PERFEC 2096 N. University Ave, Ste. 290, Proversity Ave, Ste. 290, Proverse 1: 401.375.1223 • www.com Landscape Architect EPG Design 6949 South High Tech Drive Midvale, Utah 84047 Specifications Writer Friday Group 88 Mainelli Road Middlebury, VT Code Consultant Holmes 600 1st Avenue, Suite 200 Seattle, WA 98104 Fire Protection Engineer Jensen Hughes One Research Drive, Suite One Research Drive, Suite Westborough, MA 01581 Vertical Transportation Constant Westborough, MA 01581	0022 n 84098	
4'		Structural Engineer Magnusson Klemencic A 1301 5th Ave, Suite 3200 Seattle, WA 98101 Lighting Designer O- 1319 SE MLK Blvd, Suite 3 Portland, Oregon 97219 Building Envelope Consult RDH 2101 N 34th St Seattle, WA 98103 Accessibility Consultant Studio Pacifica 2144 Westlake Ave N, Suite 32 Seattle, WA 98109 MEP Engineer WSP USA 1001 Fourth Ave., Suite 32 Seattle, WA 98154 Or Fourth Ave., Suite 32 Seattle, WA 98154 Oprincipal architect Checked by RN job no. job no. job no. wate Or	210 ant te F 100 120 5 1/AD 1/CE	
		DRAWING ST IFC SET 2 C 05/17/20 MECHANICA LAYOUT	df 3 24 L ROOM PLAN	