



CONDUIT/CONDUCTOR SCHEDULE							
MARK	AMPS	CONDUIT	CU/L	CONDUCTORS (TOTAL)			NOTES
				PHASE	NEUTRAL	GROUND	
212	20	3/4"	CU	12	12	12	1
403	200	2"	CU	(3) 3/0	3/0	6	1
036	-	-	CU	-	-	3/0	2
38	40	1"	CU	(3) 8	-	10	1
44	70	1-1/4"	CU	(3) 4	4	8	1
85	-	-	CU	-	-	8	2

A	ESTIMATED AT 22,439A	B	15,535A
		C	14,521A

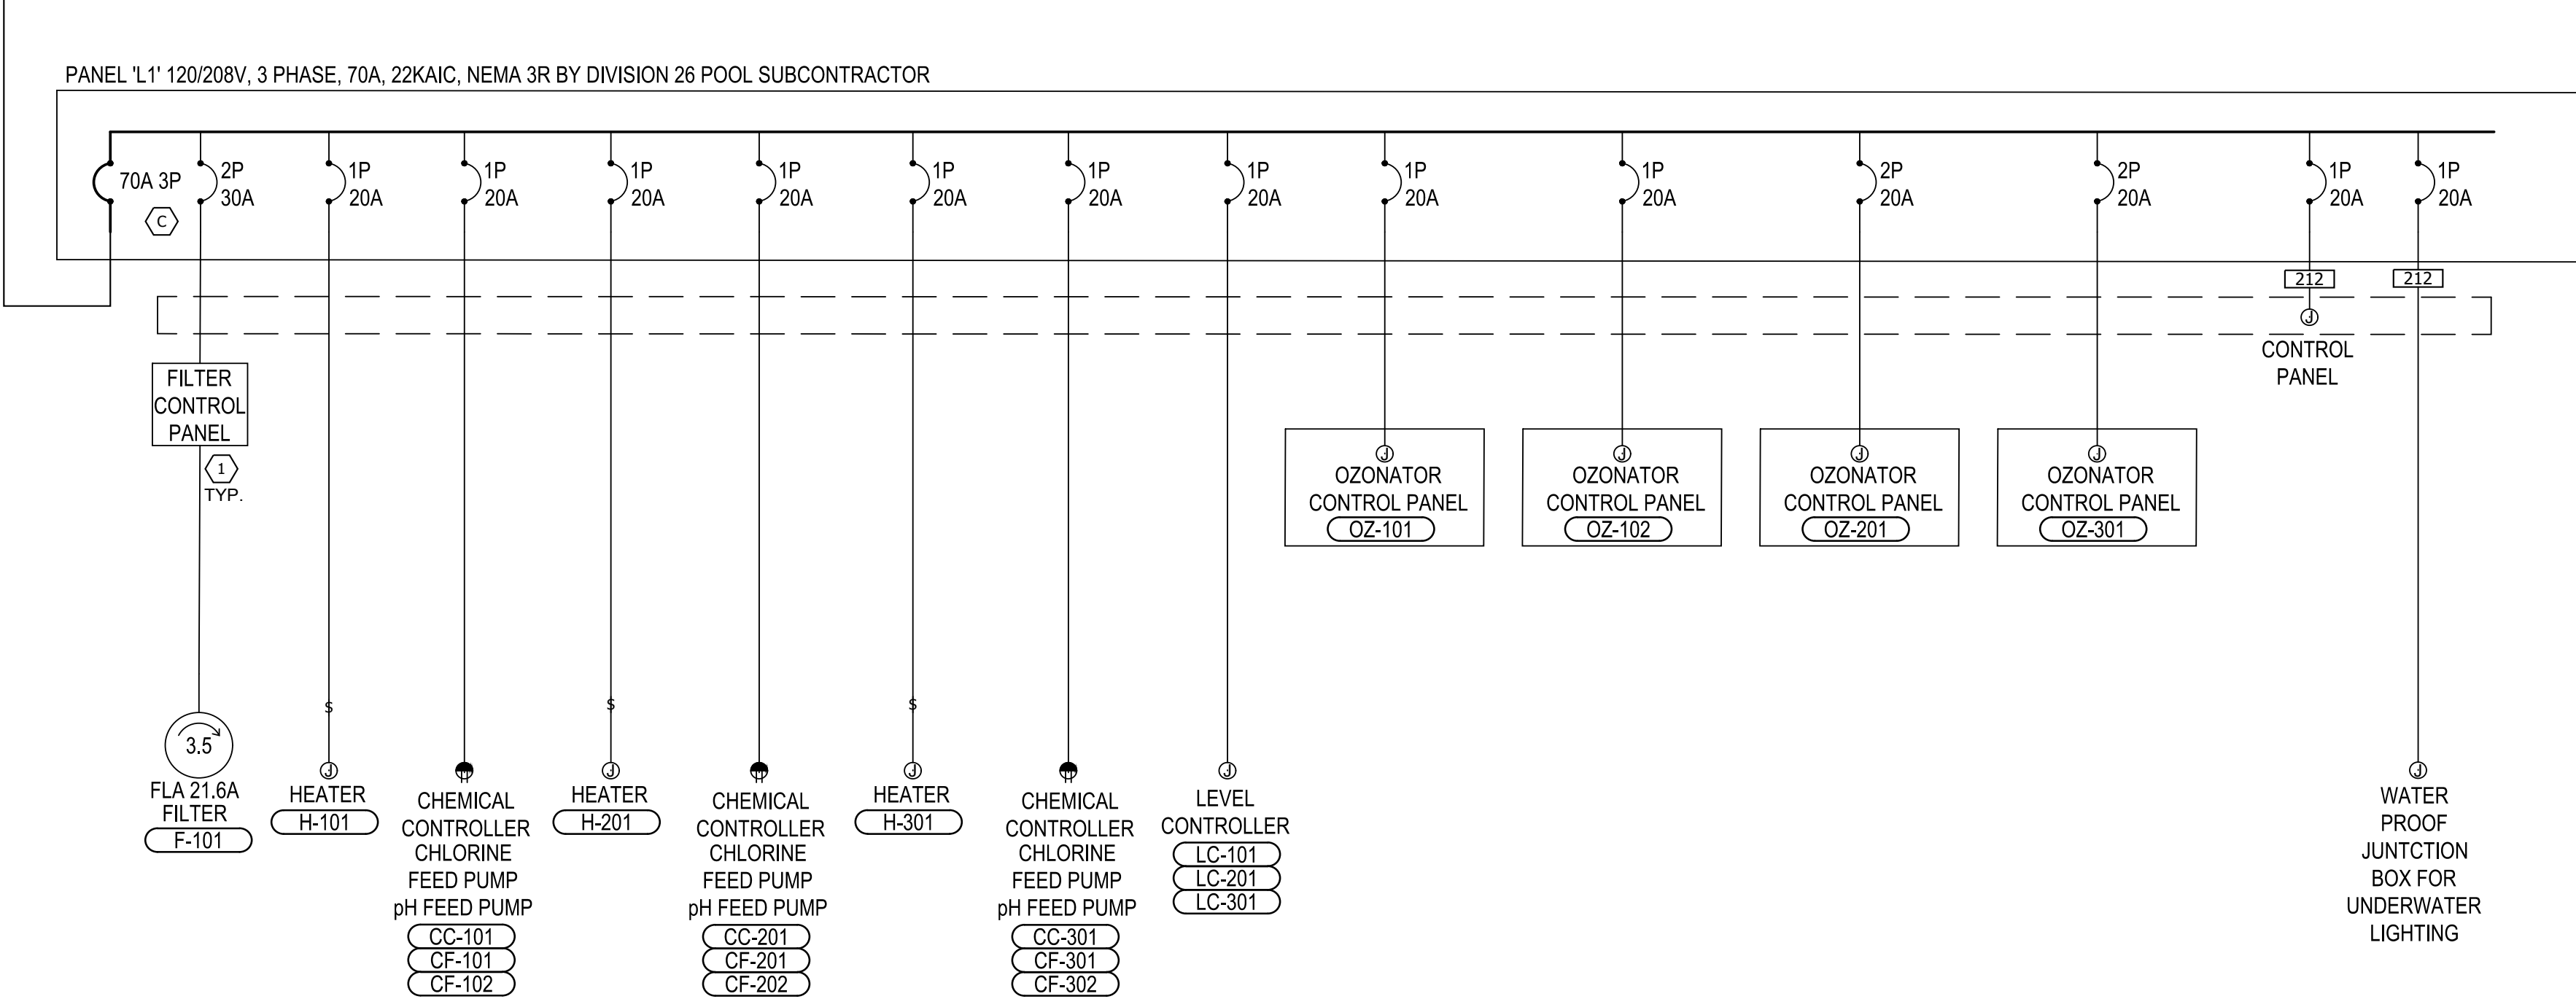

1. SEE WIRE SIZE IN THE EQUIPMENT SCHEDULE.
2. PROVIDE A NAME PLATE ON EACH ELECTRICAL PANEL AND SERVICE DISCONNECT WITH AVAILABLE FAULT CURRENT AND THE DATE WHICH THE CALCULATIONS WERE PERFORMED (05/05/22) PER NEC 110.24.
3. PROVIDE NEMA 3R OR BETTER ENCLOSURE.

- A. COORDINATE EXACT ELECTRICAL REQUIREMENTS OF ALL EQUIPMENT WITH MANUFACTURERS RECOMMENDATIONS PRIOR TO INSTALLATION.
- B. ALL ELECTRICAL EQUIPMENT SHALL BE RATED NEMA 3R.



159 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

0

PROJECT NAME
PROJECT ADDRESS

PO Box 980022
Park City, Utah 84098

Acoustics
1st Ave, Suite 620
e, WA 98101



Design
South High Tech Drive, Suite 1
le, Utah 84047

Group
inelli Road
bury, VT

98
st Avenue, Suite 20
e, WA 98104

John Hughes
Research Drive, Suite
Worrough, MA 01581

Bates
North Creek Parkway, Suite 300
Lynn, MA 01904

Urban Engineer
Busson Klemencic Associates
5th Ave, Suite 3200

SE MLK Blvd, Suite

ing Envelope Consult
W 34th St

Liability Consultant
Pacifica
Montalvo Ave. N. C.

Engineer
USA

project manager for

checked by RE
job no. X

ions:

DRAWING S

05/17/20

LINE 1

15
