




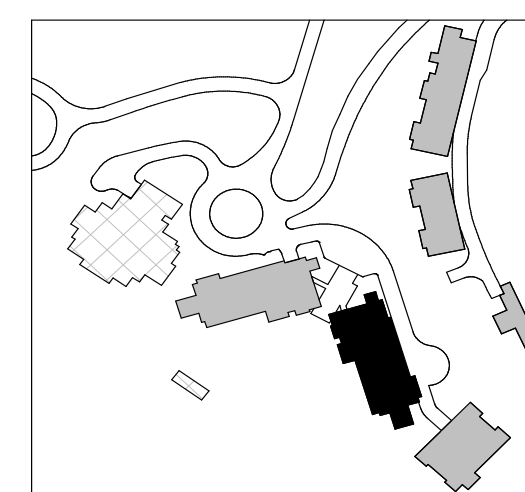

1. SEE THE "GENERAL NOTES" FOR GENERAL REINFORCING REQUIREMENTS.
2. SEE MAT REINFORCEMENT PLACEMENT DIAGRAM FOR LAYER AND DIRECTION KEY FOR MAT REINFORCEMENT PLACEMENT.
3. HOOK OR PROVIDE TERMINATORS AT ALL #11 BARS OR SMALLER AND PROVIDE TERMINATORS AT ALL #14 AND #18 BARS INTERRUPTED AT PITS AND OPENINGS.
4. PLACE BARS ON LAYER 1, UNLESS NOTED OTHERWISE.
5. ALL TOP AND BOTTOM REINFORCEMENT SHOWN ON MAT REINFORCEMENT PLANS SHALL BE GRADE 60 KSI.
6. VERTICAL REINFORCEMENT SHOWN ON MAT REINFORCEMENT PLANS SHALL BE GRADE 60 KSI.

FOUNDATION VERTICAL REINFORCING SCHEDULE			
	TYPE	REINFORCING	REMARKS
A		#7 @ 24" EACH WAY	
B		#8 @ 24" EACH WAY	
C		#9 @ 24" EACH WAY	
D		#7 @ 12" EACH WAY	

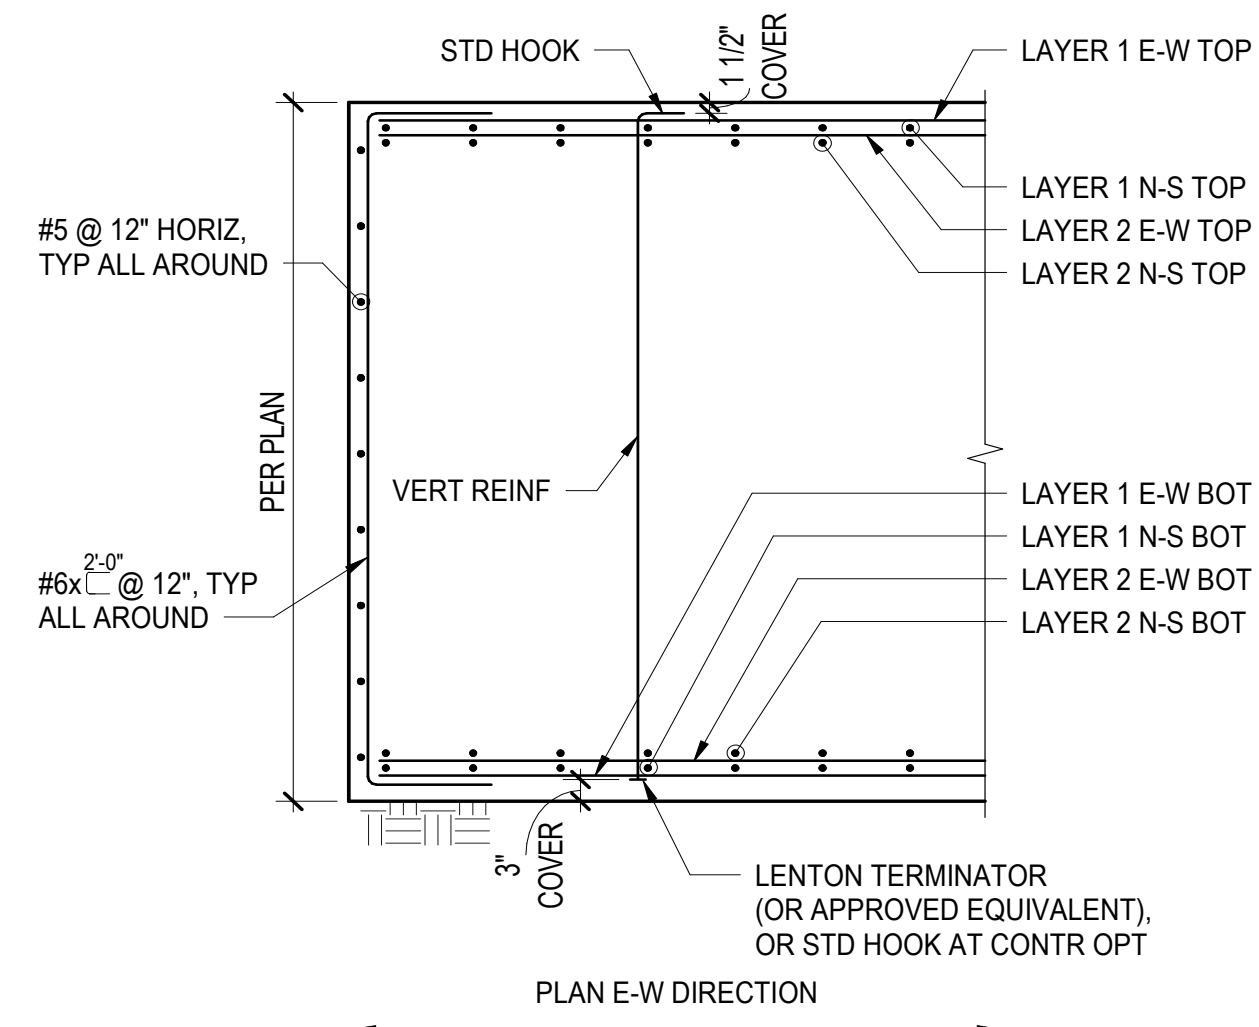

05/17/2024

S2.B.01.B