

1. REFERENCE FLOOR ELEVATION IS 8482' - 2". TOP OF CONCRETE SLAB IS AT THE

2. THE STRUCTURAL SLAB IS A 12-INCH THICK MILD TWO-WAY SLAB UNLESS NOTED

3. COORDINATE LOCATION OF ALL EMBEDS WITH MECHANICAL, ELECTRICAL, PLUMBING,

4. SEE ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL, AND OTHER DISCIPLINES DRAWINGS FOR OPENING SIZES AND LOCATIONS NOT SHOWN ON PLAN. SEE "TYPICAL

OPENINGS AND EMBEDMENTS IN CONCRETE" DETAILS FOR OPENING PLACEMENT

5. REFERENCE ALL CONSTRUCTION DOCUMENTS FOR SIZE, EXTENT, AND LOCATION OF

8 PARTIAL FRAMING PLAN - ELEVATOR OVERRUN

STRUCTURAL DRAWINGS FOR WHICH THE TYPICAL DETAILS DO NOT APPLY.

CRITERIA. NOTIFY THE STRUCTURAL ENGINEER OF ANY OPENINGS NOT SHOWN ON THE

CONCRETE CURBS, HOUSEKEEPING PADS, CMU WALLS, PLANTER WALLS, BOLLARDS, AND

FOR DRAINAGE SLOPES NOT SHOWN.

OTHERWISE. SEE THE TYPICAL MILD SLAB DETAILS.

EDGE ANGLES. REINFORCE PER THE TYPICAL DETAILS.

AND EXTERIOR WALL SYSTEMS PRIOR TO CASTING THE SLAB.

REFERENCE ELEVATION UNLESS NOTED OTHERWISE. SEE ARCHITECTURAL DRAWINGS

NOTES:

(C.6)

√ 3" STL ROOF DĖCK HSS8x6x3/8 - HSS8x6x3/8


(C.5)


(C.4)


NOTES:

- 1. REFERENCE FLOOR ELEVATION IS 8485'-3". REFERENCE TOP OF STRUCTURAL STEEL IS 3-INCHES BELOW THE REFERENCE FLOOR ELEVATION, TYPICAL UNLESS NOTED OTHERWISE.
- 2. ROOF DECK IS MINIMUM 3-INCH x 20 GAUGE STEEL DECKING. DECKING IS TO BE INSTALLED IN MINIMUM THREE SPAN CONDITIONS WHERE POSSIBLE.

9 PARTIAL PLAN - TOP OF CORE

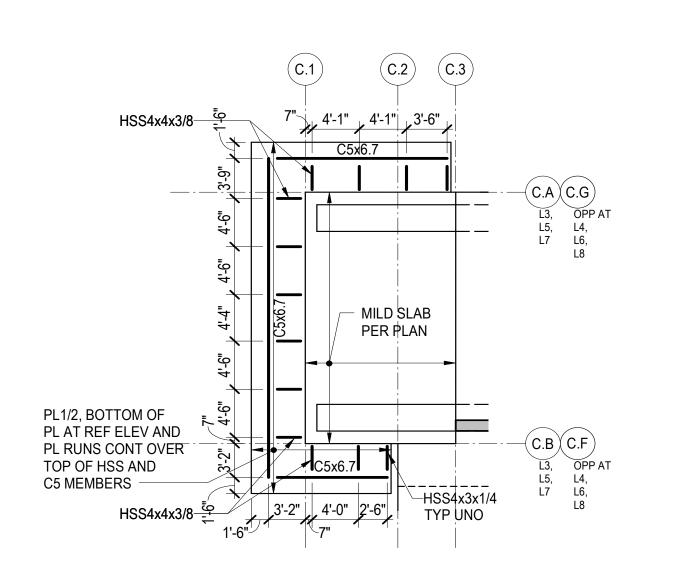

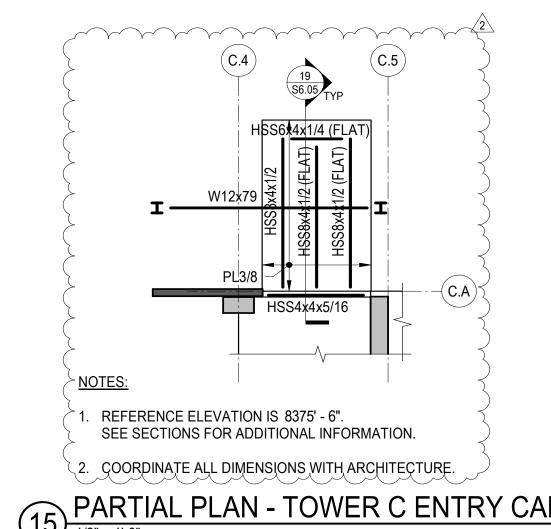

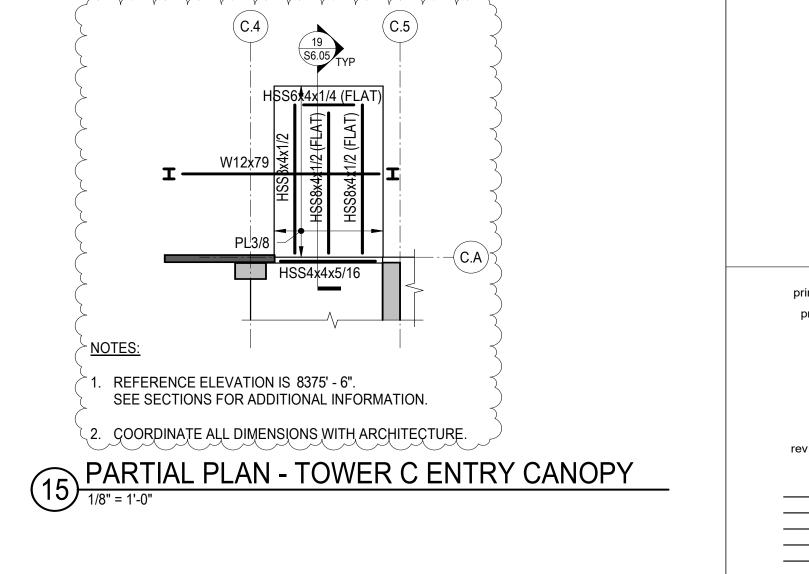

principal architect_ job no. 20052 date 04/08/2024 2 04/08/2024 IFC SET 1 OF 3 1 11/18/2022 95% CD

DAVID CHARLES FIELDS

04/06/24

Reserved for permit stamp

Q

Kundi

MAGNUSSON

KLEMENCIC

ASSOCIATES


Seattle Chicago www.mka.com

206 292 1200

ISSUED FOR CONSTRUCTION SET 1 OF 3 04/08/2024

> TOWER C PARTIAL **PLANS**

S2.C.50

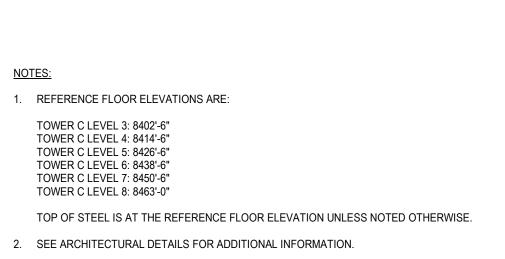

PARTIAL PLAN - TOWER C SUNSHADES

1/8" = 1'-0"