

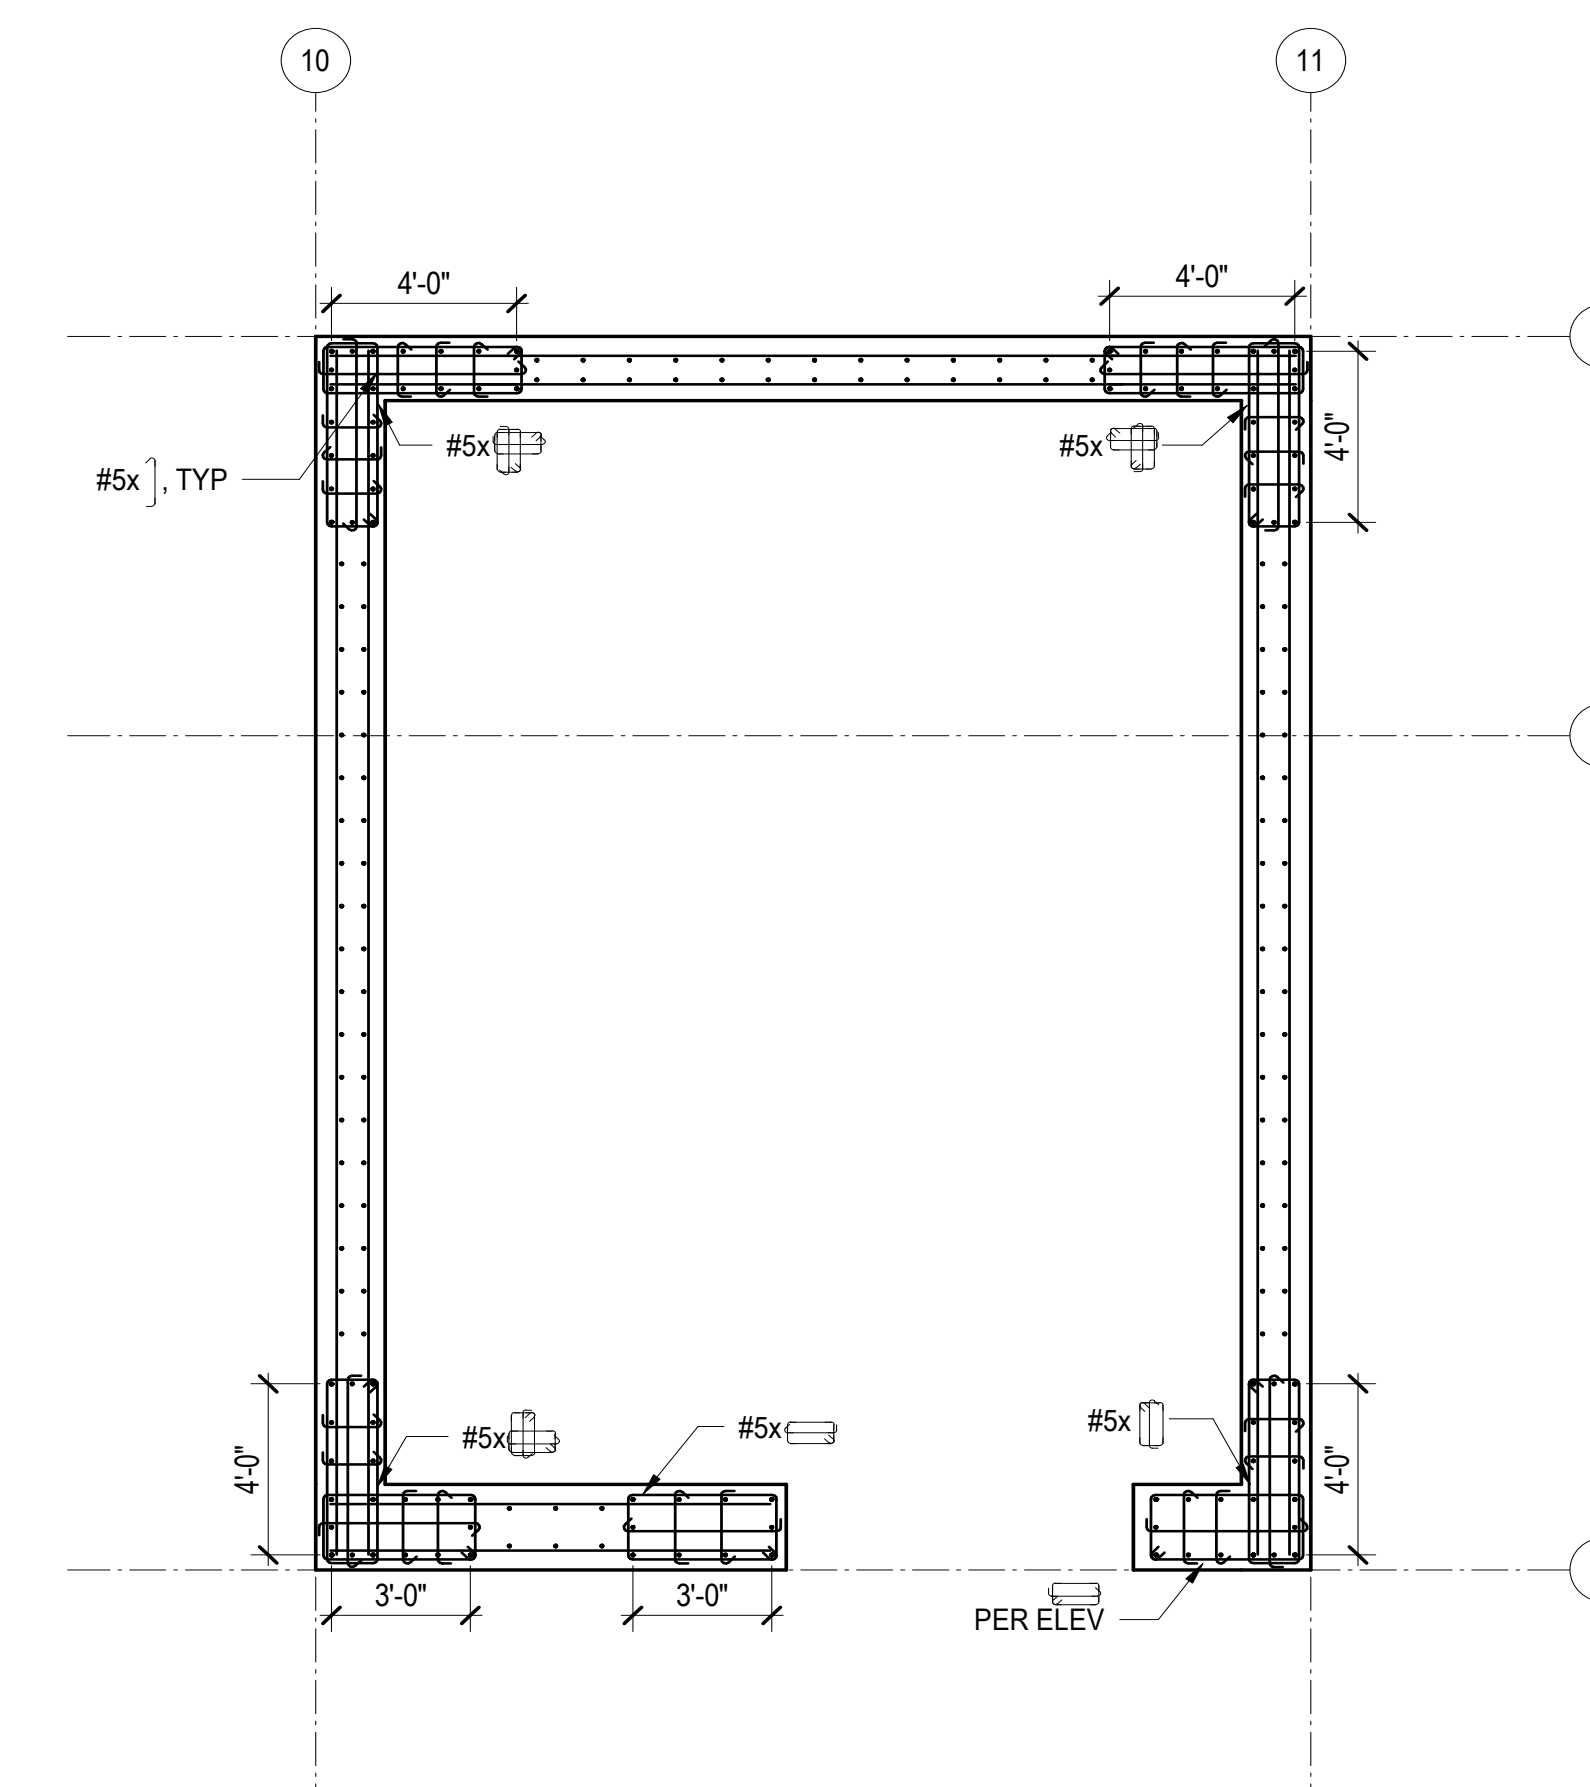
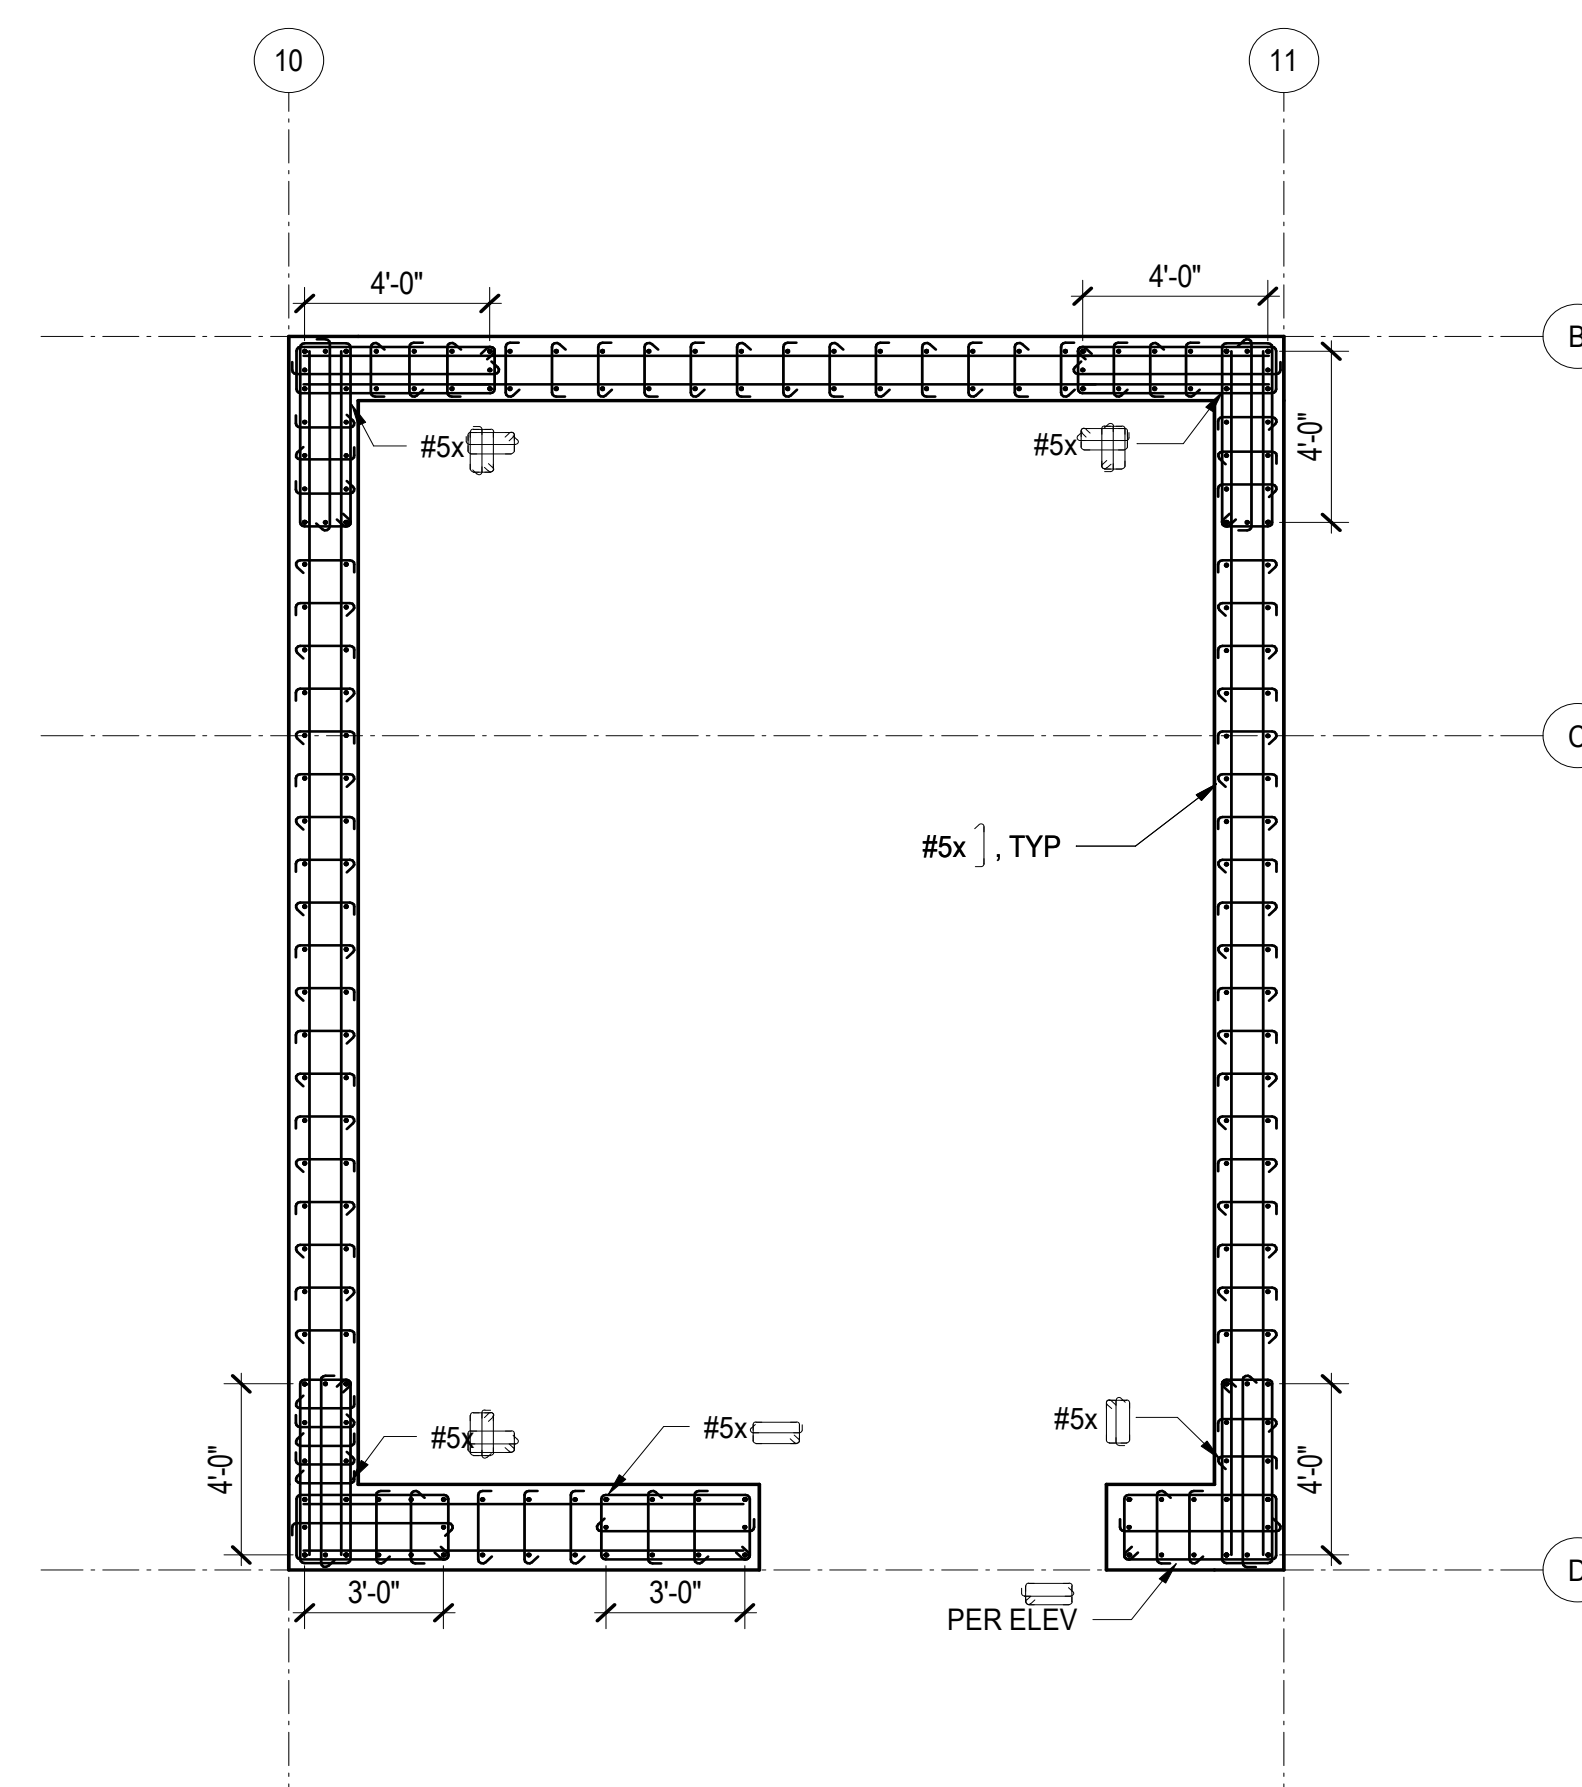
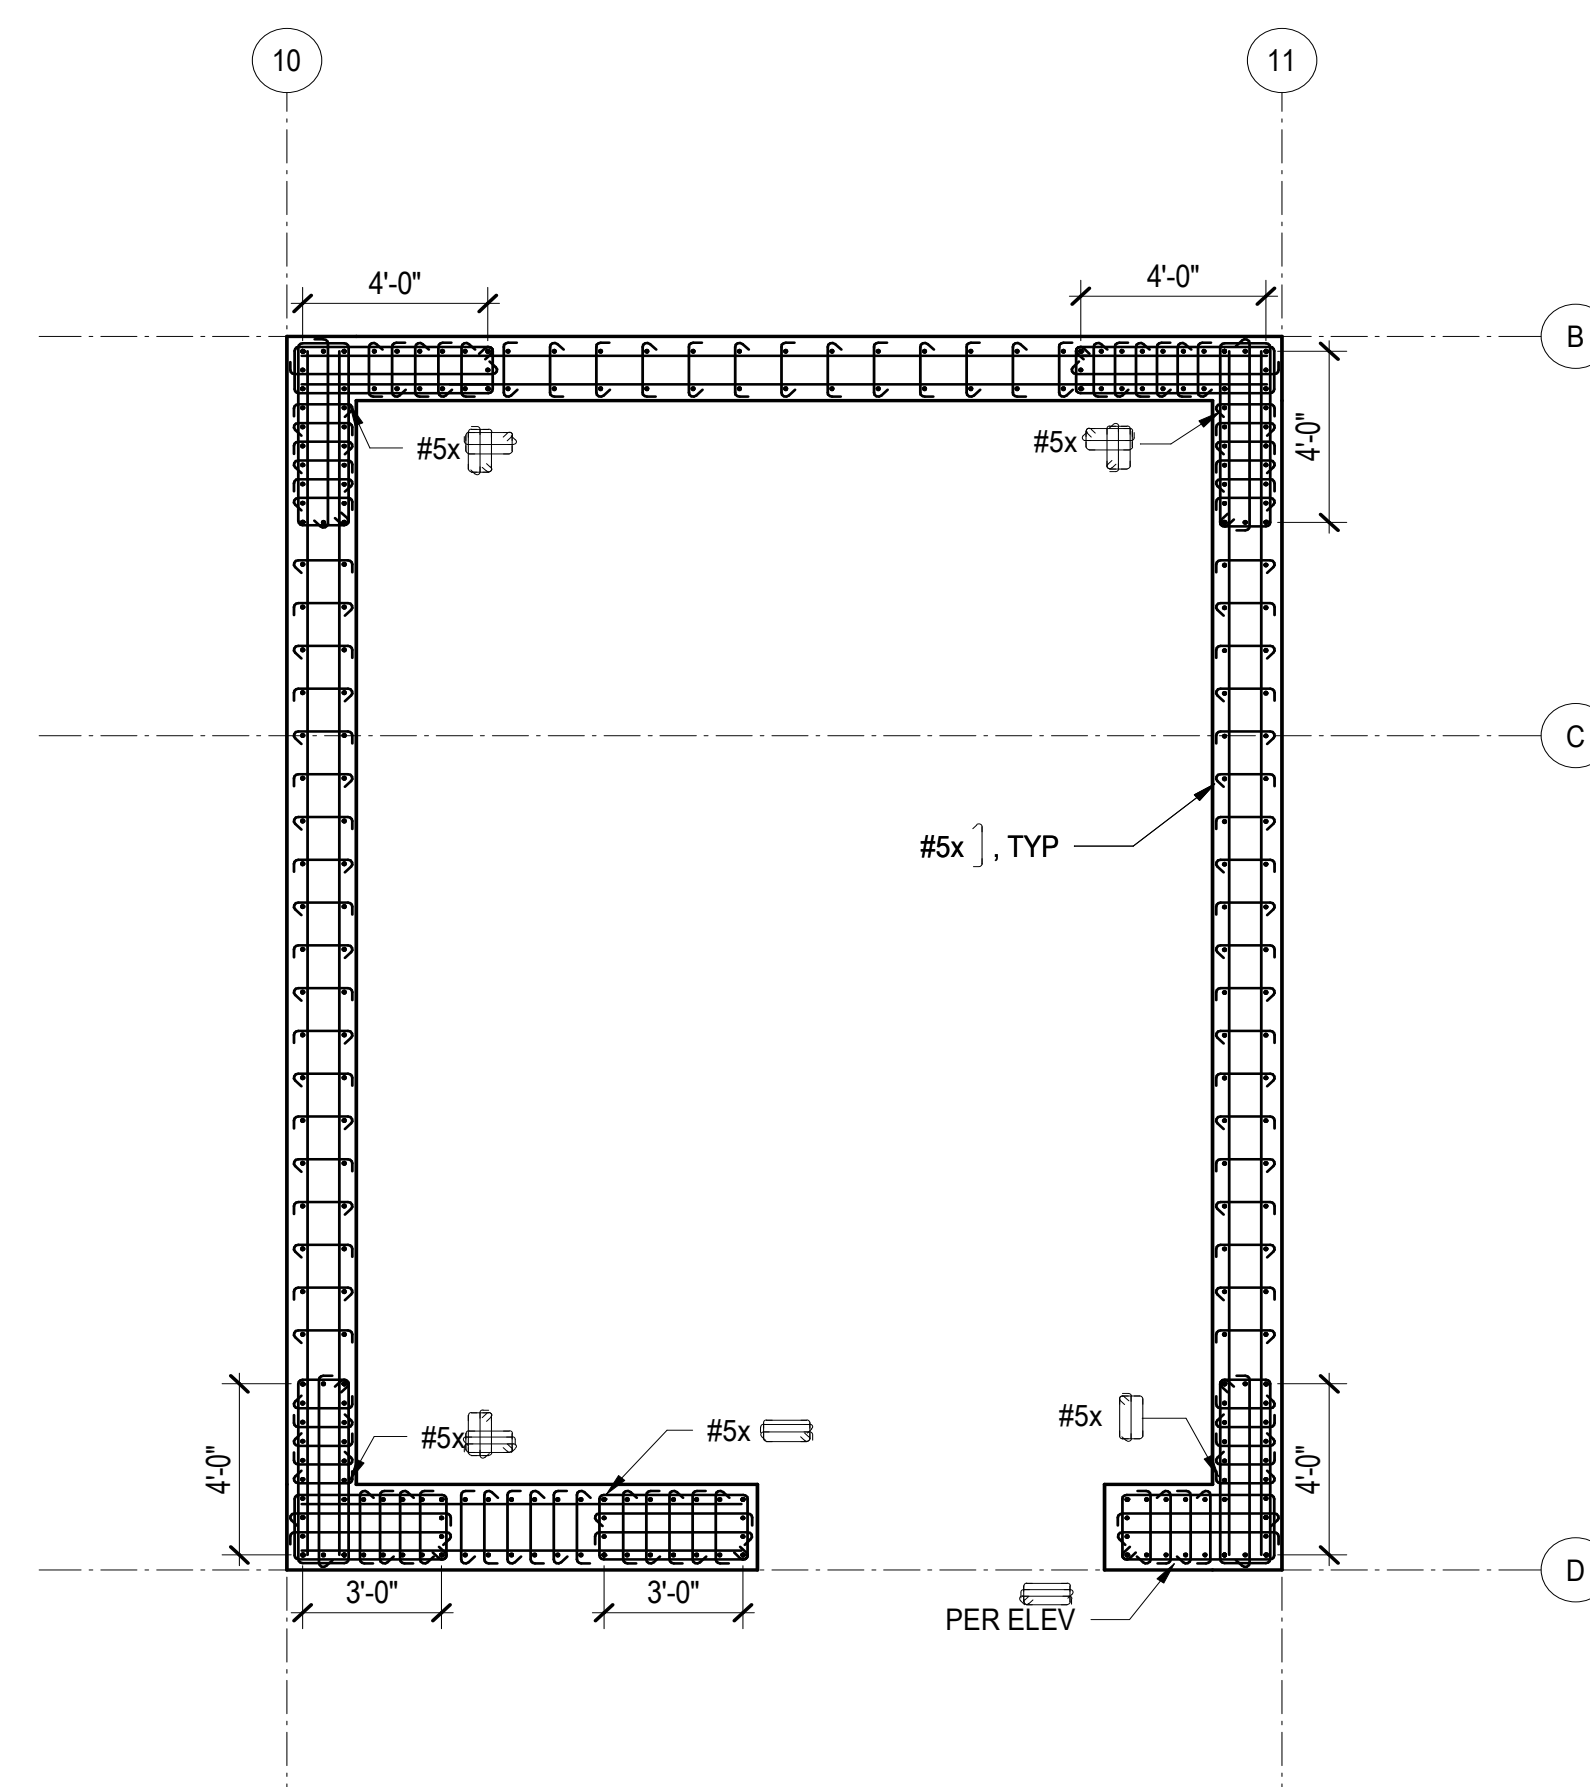
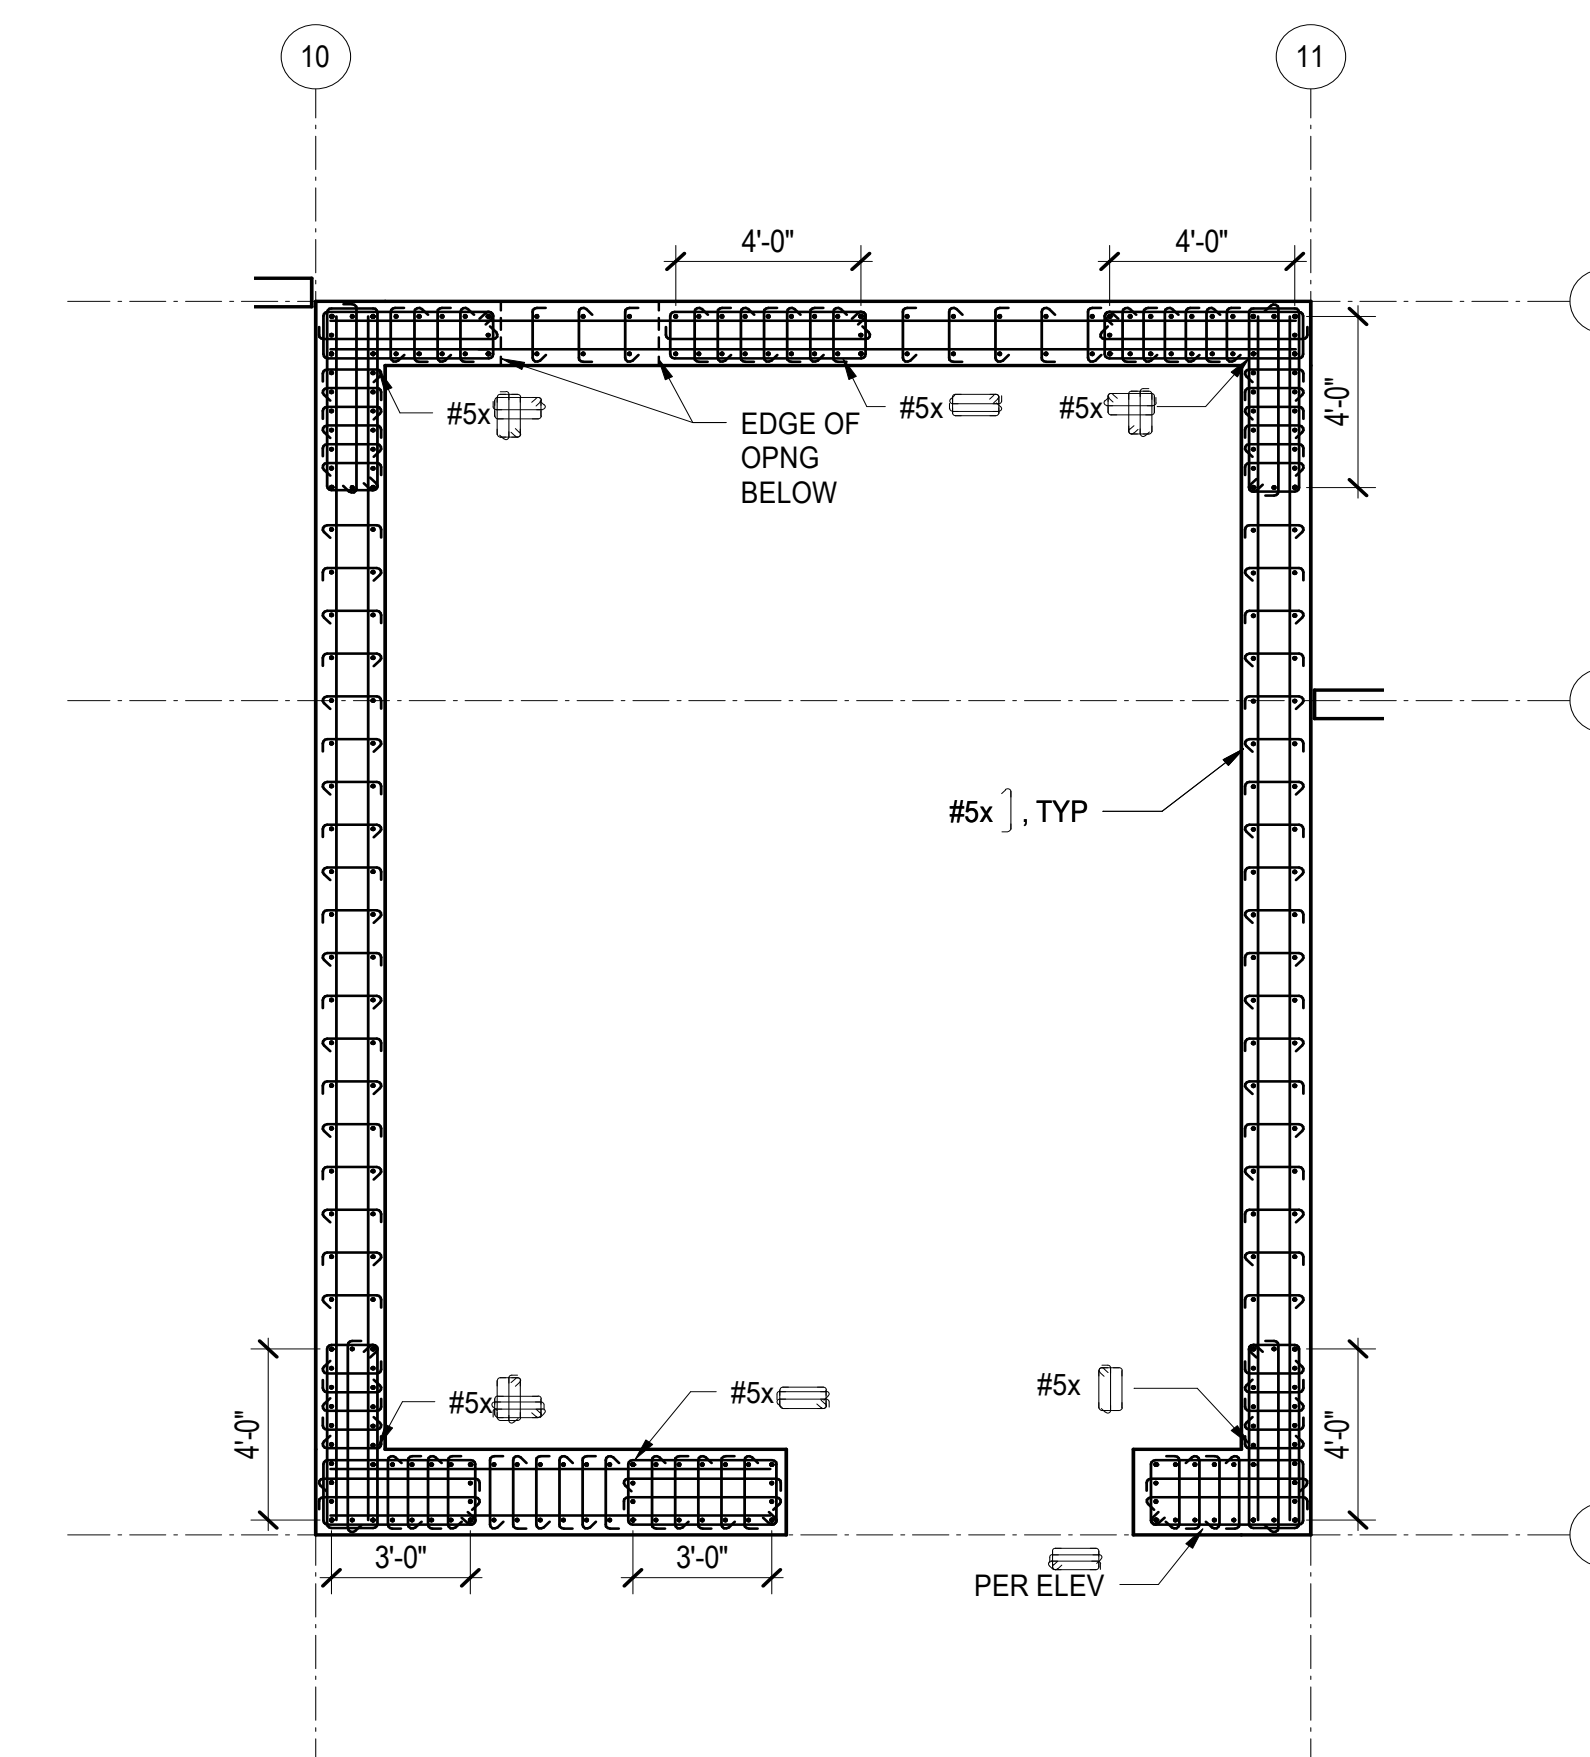
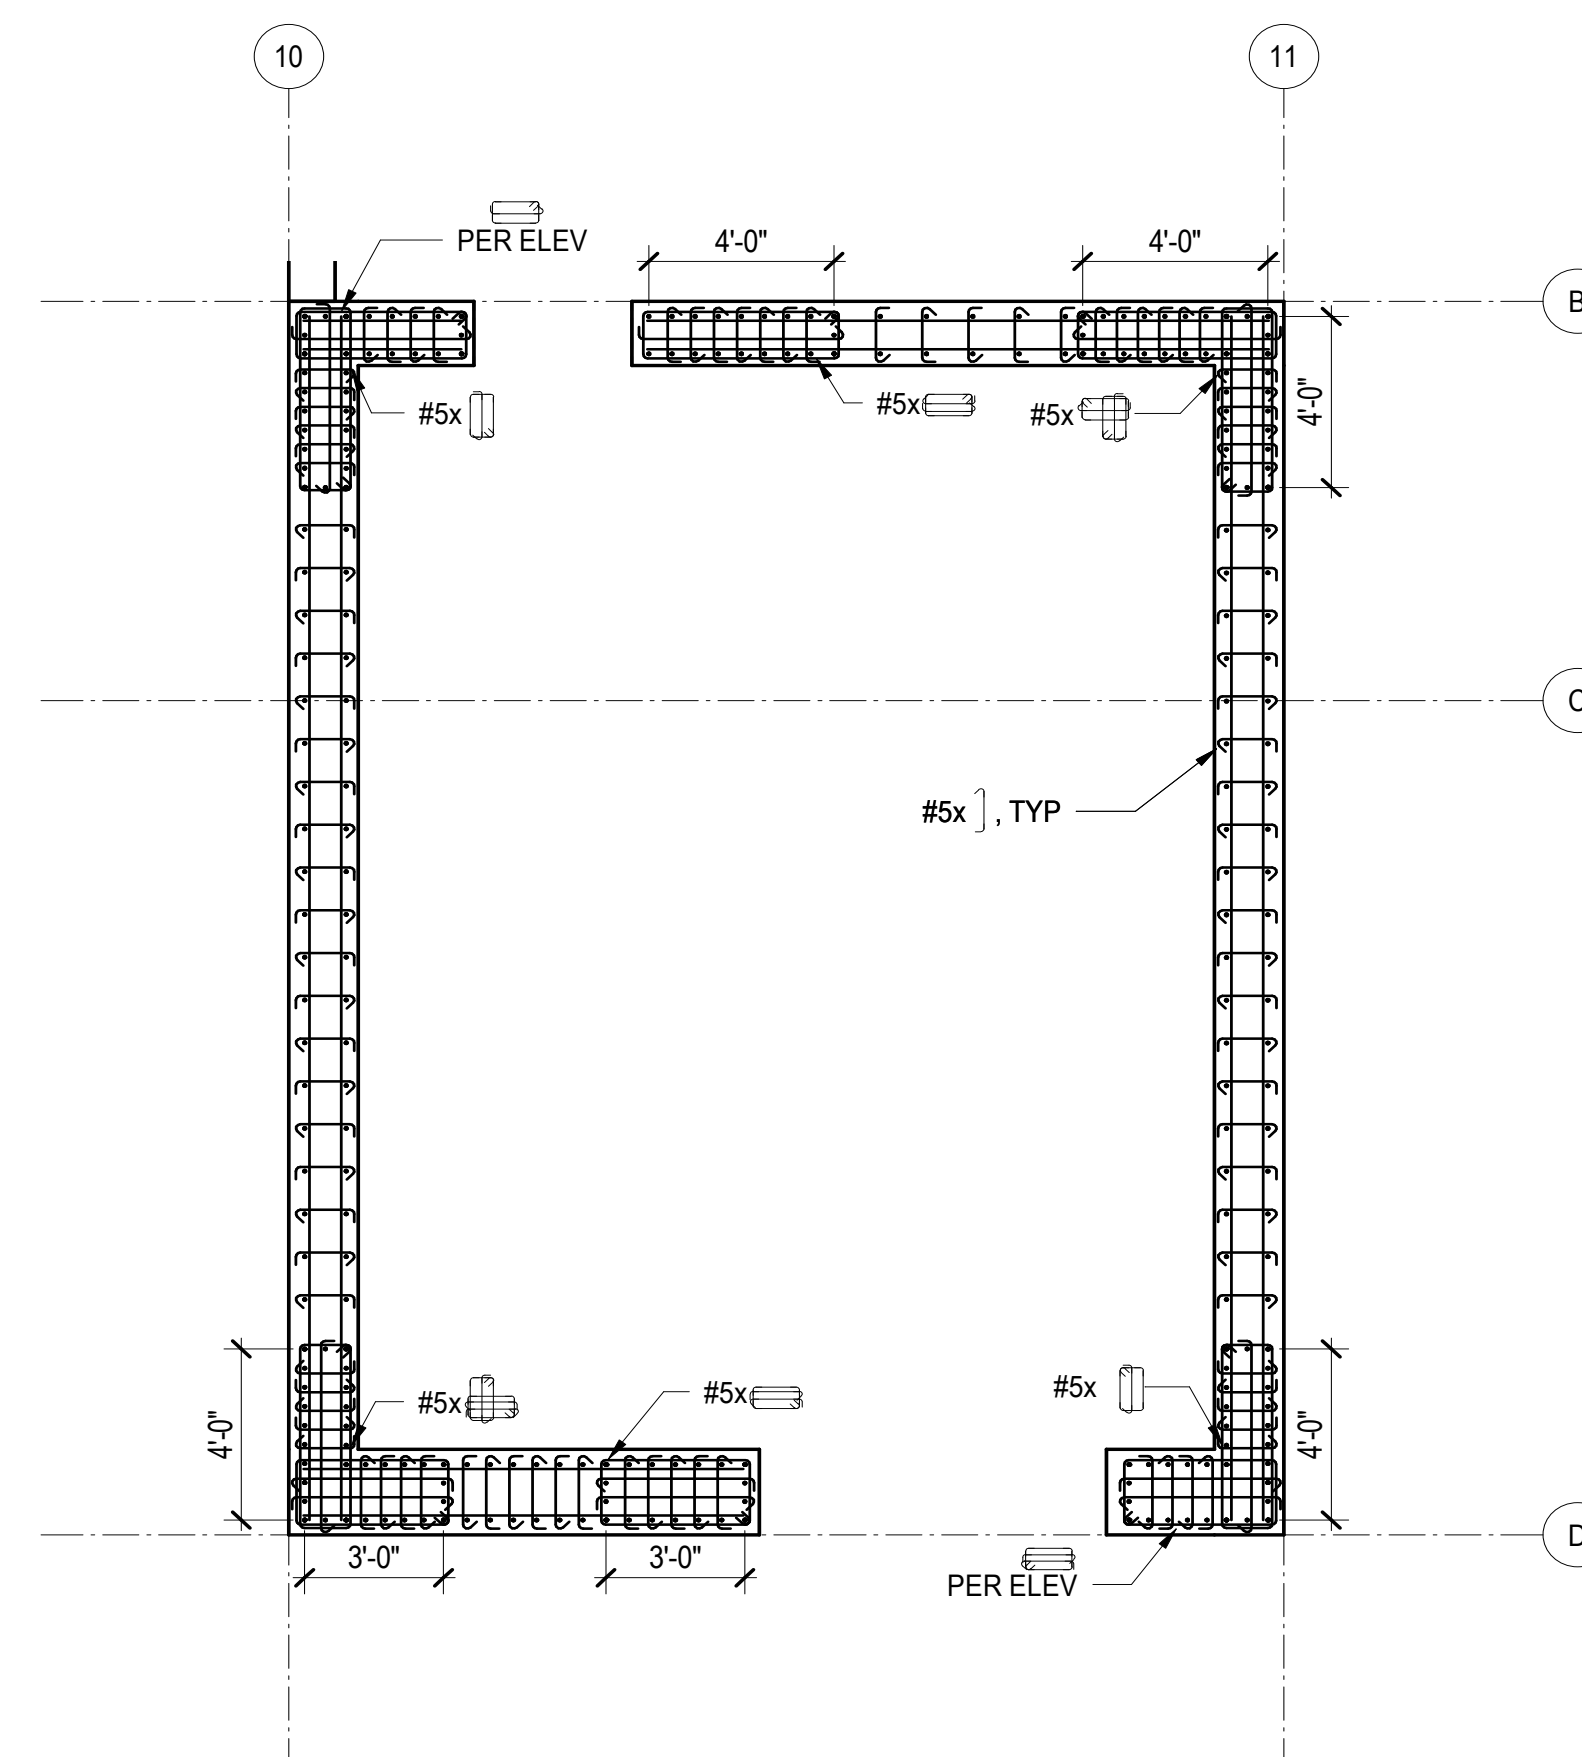


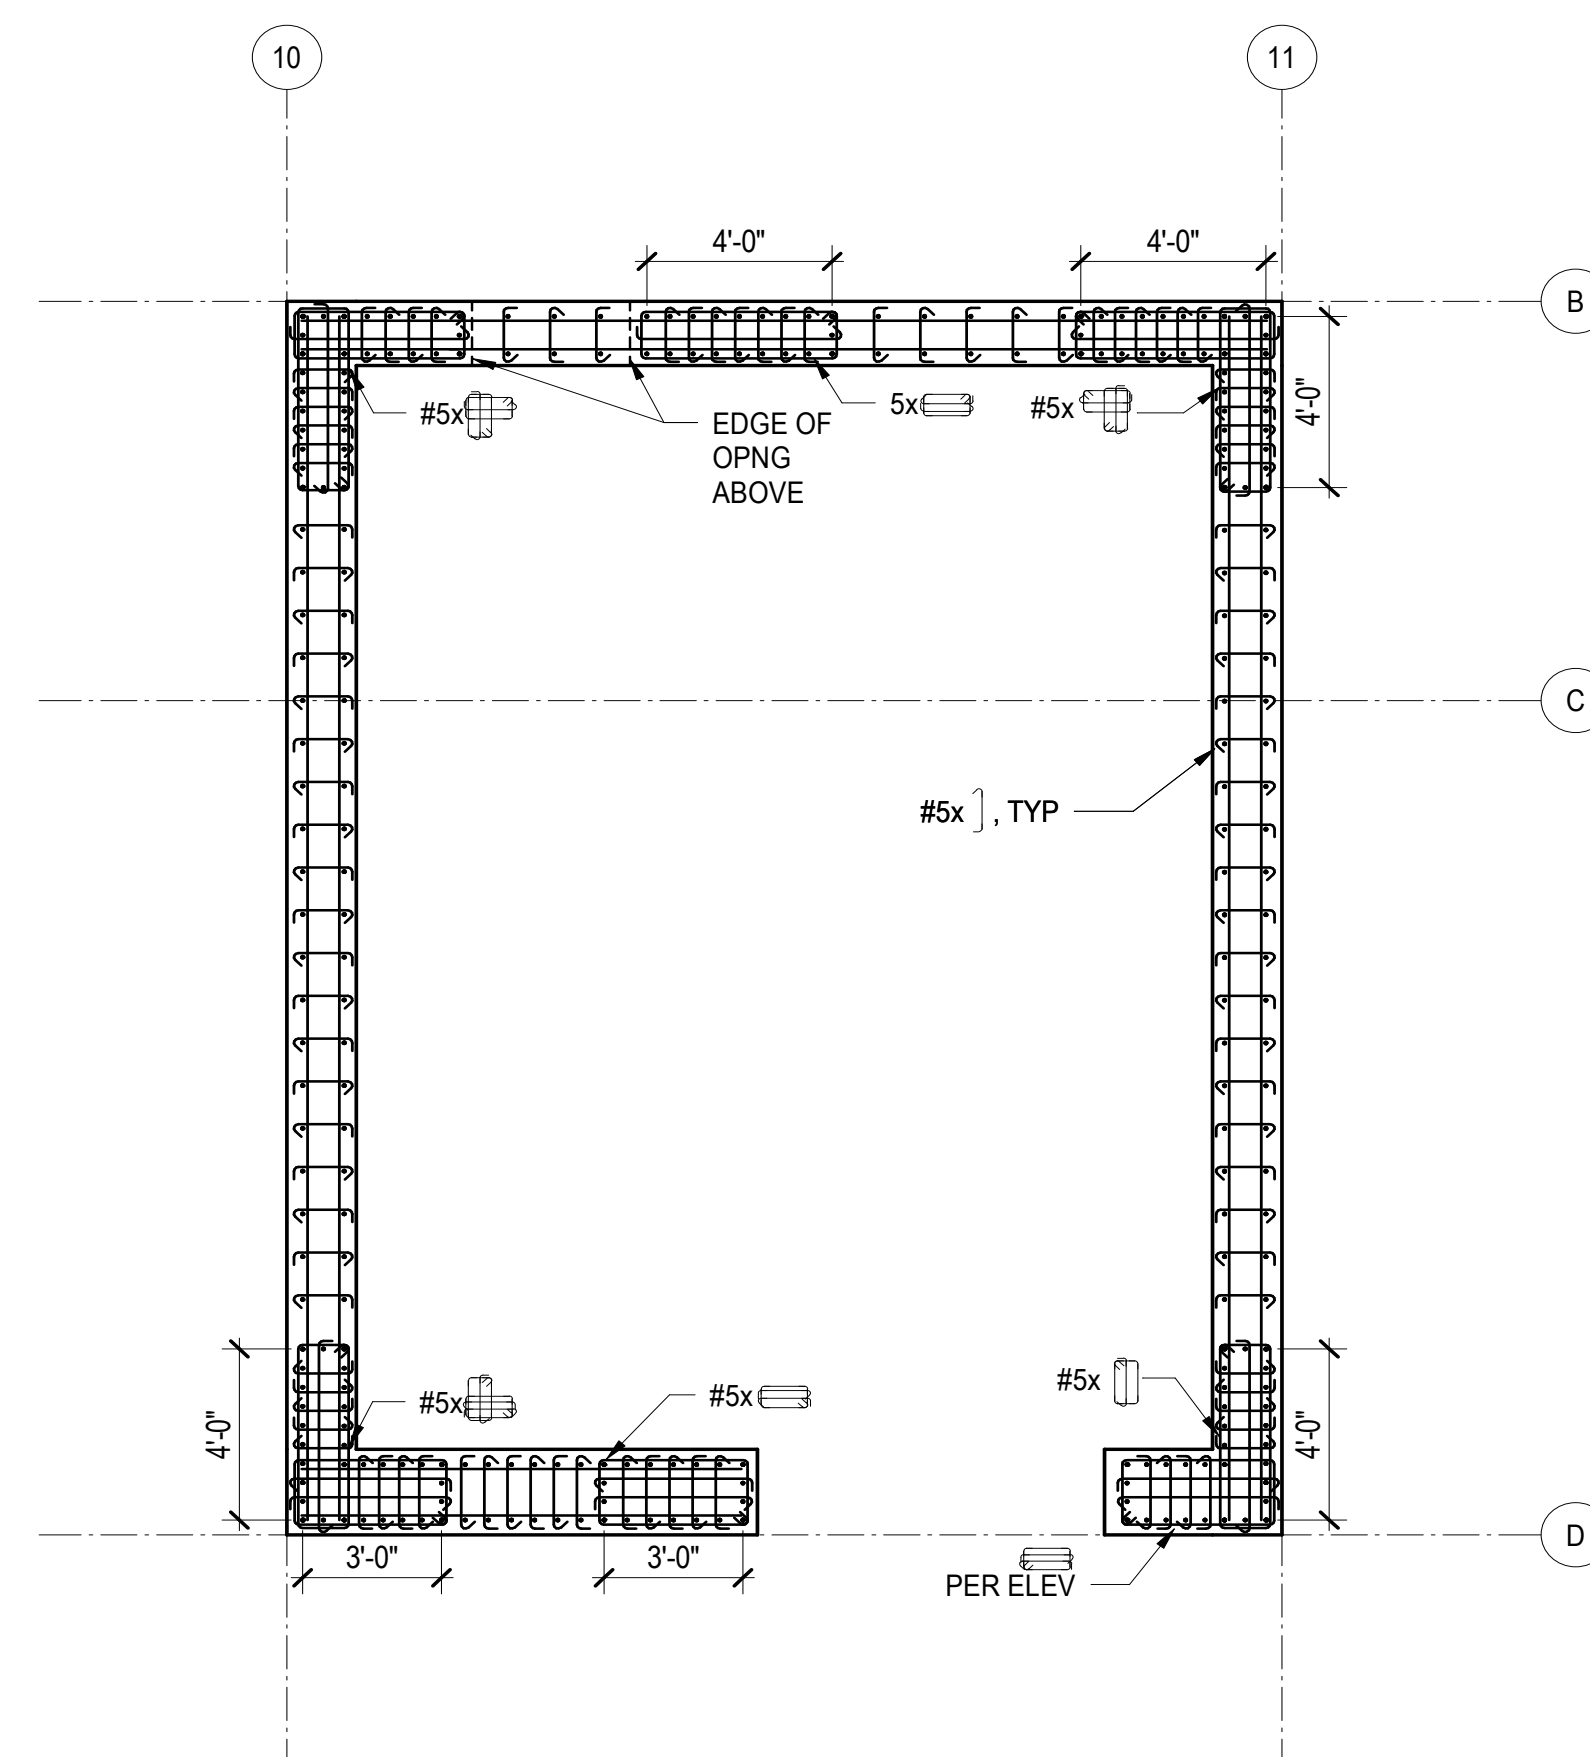

NOTES:

1. ALL HOOKS AND CROSSTIES SHALL BE #5 A615 GRADE 80 PLACED AT 6-INCH VERTICAL SPACING, UNLESS NOTED OTHERWISE. CROSSIES WITH 90 DEGREE HOOKS SHALL HAVE THE CONSECUTIVE CROSSIES ALTERNATED END-FOR-END ALONG THE LONGITUDINAL REINFORCEMENT.
2. CONCRETE COVER TO REINFORCEMENT IS 1-INCH.
3. BAR SIZE OF ADDED VERTICAL BARS TO MATCH SIZE AND GRADE OF ADJACENT REINFORCEMENT, UNLESS NOTED OTHERWISE. AT CORNERS, MATCH REINFORCEMENT SIZE OF THE LARGER OF THE TWO WALLS.

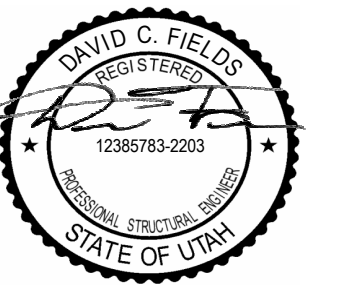

Reserved for permit stamp

159 South Jackson St, Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

Olson Kundig

SOMMET BLANC - ABC
DEER VALLEY, UTAH

MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers
Seattle Chicago
www.mko.com
206.292.1200

principal architect _____

project manager_____

drawn by _____

checked by _____

checked by _____
job no. 20052

date 05/17/2024

revisions:

04/08/2024 IFC SET 1 OF 3

11/18/2022 95% CD

b. date _____ by _____

IFC SET 2 OF 3

05/17/2024

TOWER A EAST
CORE WALL
SECTIONS

S3.A20