


NOTES:

1. ALL HOOPS AND CROSSTIES SHALL BE #5 A615 GRADE 80 PLACED AT 6-INCH VERTICAL SPACING, UNLESS NOTED OTHERWISE. CROSSTIES WITH 90 DEGREE HOOKS SHALL HAVE THE CONSECUTIVE CROSSTIES ALTERNATED END-FO-END ALONG THE LONGITUDINAL REINFORCEMENT.
2. CONCRETE COVER TO REINFORCEMENT IS 1-INCH.
3. BAR SIZE OF ADDED VERTICAL BARS TO MATCH SIZE AND GRADE OF ADJACENT REINFORCEMENT, UNLESS NOTED OTHERWISE. AT CORNERS, MATCH REINFORCEMENT SIZE OF THE LARGER OF THE TWO WALLS.

## SHEAR WALL NOTES

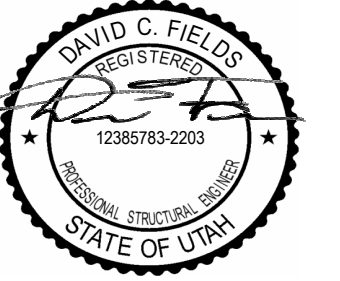

Reserved for permit stamp

159 South Jackson St, Suite 600  
Seattle, Washington 98104 USA  
+1 206 624 5670 [olsonkundig.com](mailto:olsonkundig.com)

Olson Kundig

**SOMMET BLANC - ABC**  
DEER VALLEY, UTAH

MAGNUSSON  
KLEMENCIC  
ASSOCIATES

**Structural + Civil Engineers**  
Seattle Chicago  
www.mko.com  
206.292.1200

principal architect \_\_\_\_\_  
project manager \_\_\_\_\_  
drawn by \_\_\_\_\_  
checked by \_\_\_\_\_  
job no. 20052 \_\_\_\_\_  
date 05/17/2024 \_\_\_\_\_

revisions:

04/08/2024	IFC SET 1 OF 3
11/18/2022	95% CD

o. date by

IFC SET 2 OF 3

05/17/2024

TOWER A EAST  
CORE WALL  
SECTIONS

S3.A21