



NOTES:
- APPLICATION DESIGNED FOR:
TKE - REFER TO MANUFACTURER SHOP DRAWINGS
PIT AND OVERHEAD PLANS INDICATE REACTIONS FOR MACHINE ROOMLESS EQUIPMENT OF VARIOUS ELEVATOR VENDORS. WHERE REACTIONS OF DIFFERENT VENDORS OVERLAP, THE HIGHER REACTION IS INDICATED. REACTIONS FOR ONE VENDOR DO NOT OCCUR WITH THE REACTIONS OF OTHER VENDORS. OVERHEAD PLANS ARE NOT SHOWN FOR VENDORS WITH NO REACTIONS IN THE OVERHEAD.

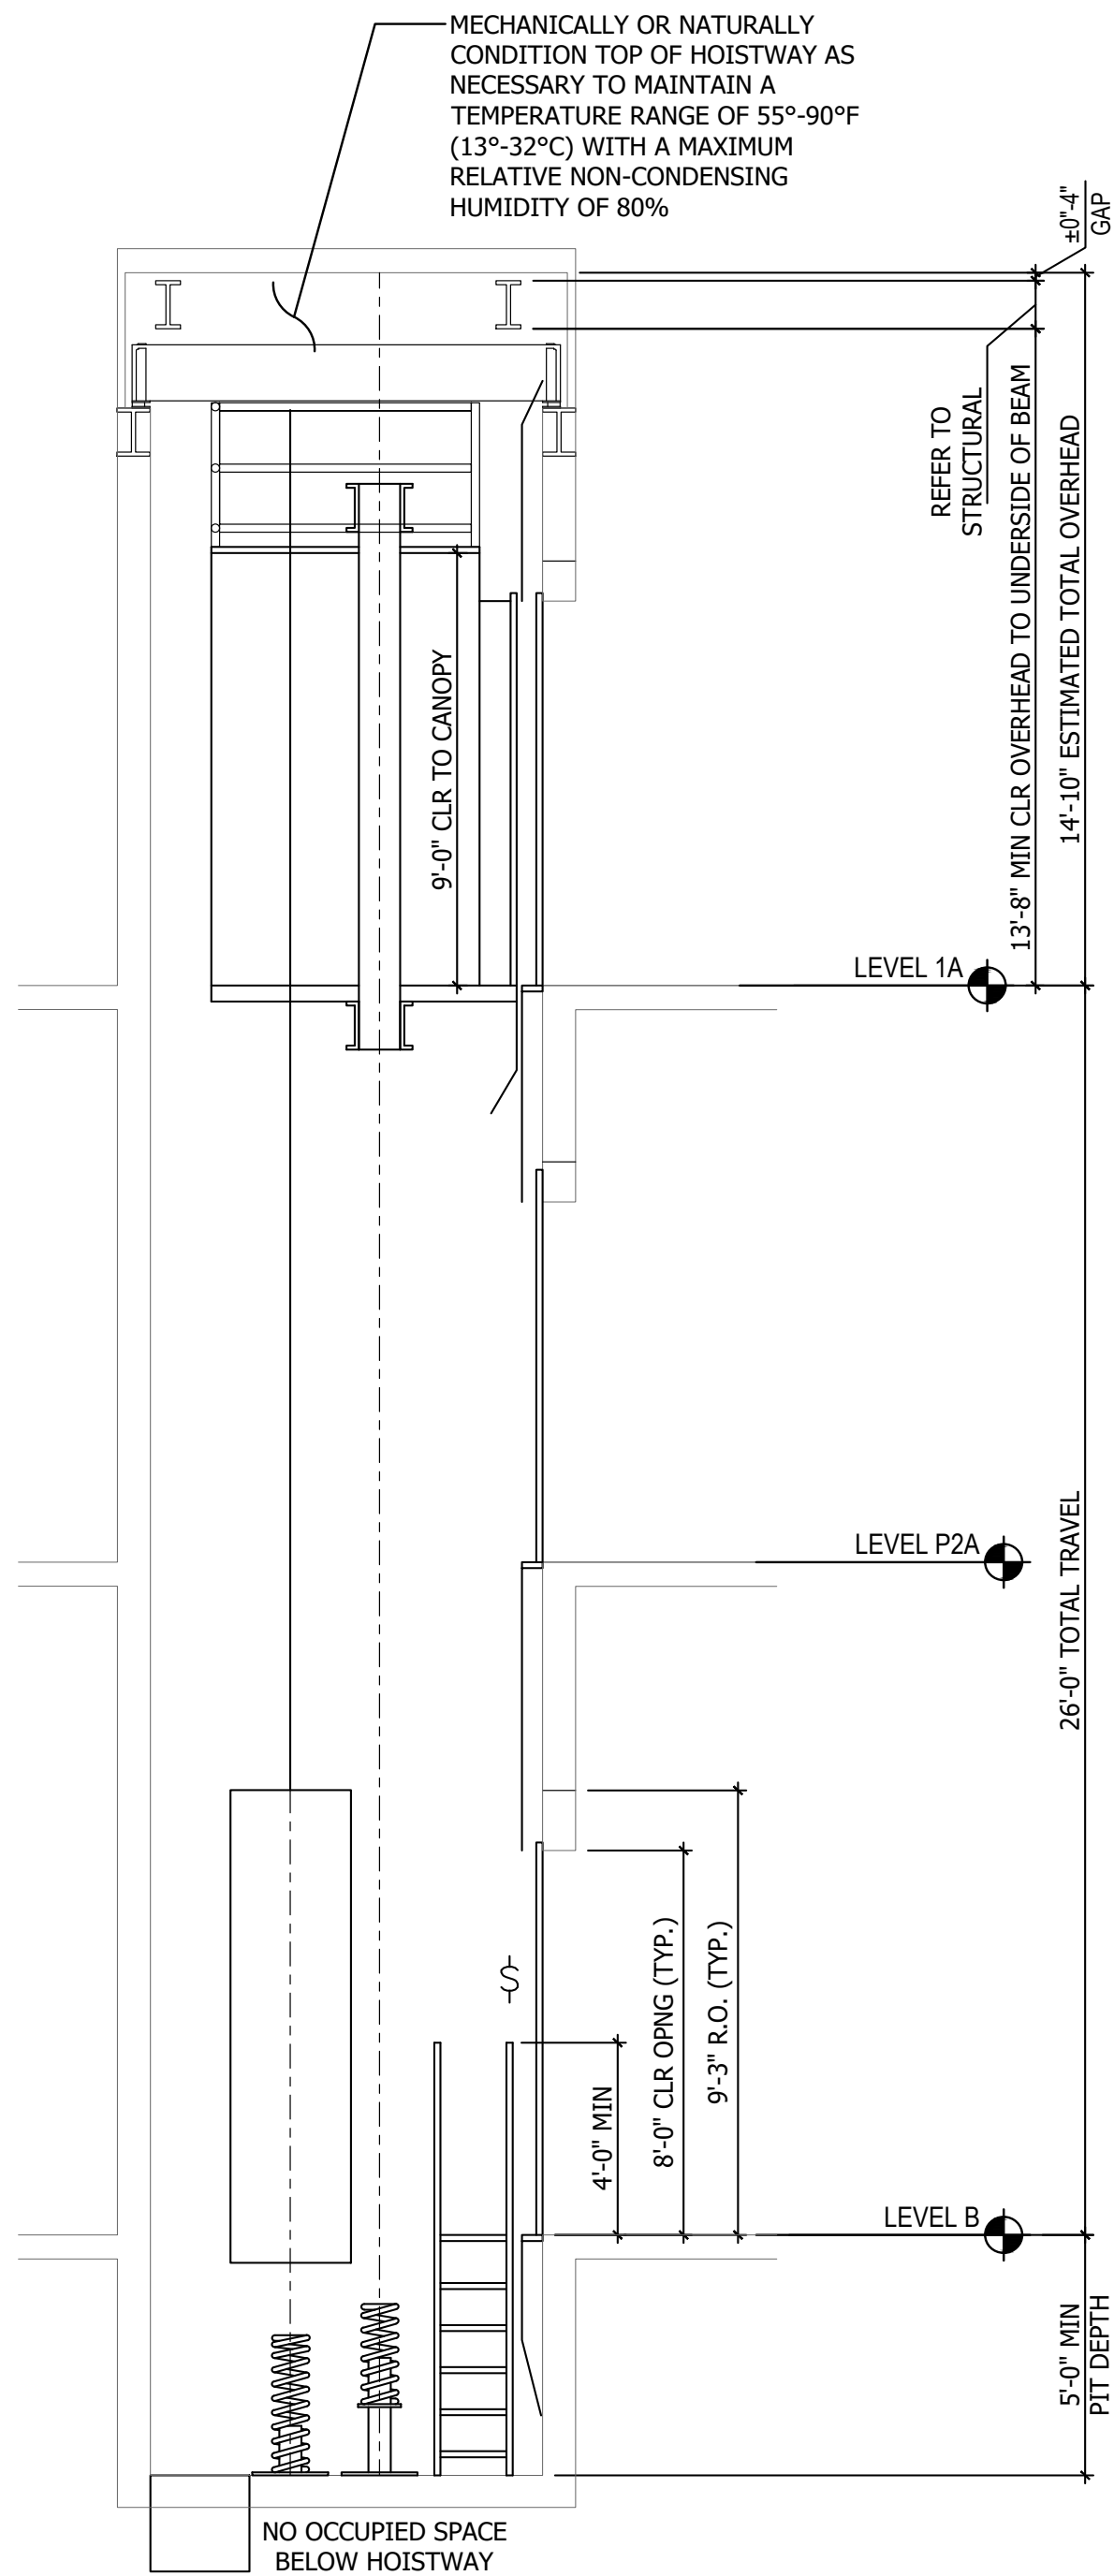


1 HOISTWAY SECTION - KITCHEN SERVICE
SCALE: 1/4" = 1'-0"


ELEVATOR KITCHEN SERVICE		
FLOOR NUMBER	OPENING REAR/FRONT	FLOOR TRAVEL (FEET)
1A	F	0'-0"
P2	N/S	9'-0"
P2A	F	3'-0"
B	F	14'-0"
OPENINGS	0	3
STOPS	3	
TRAVEL		26'-0"

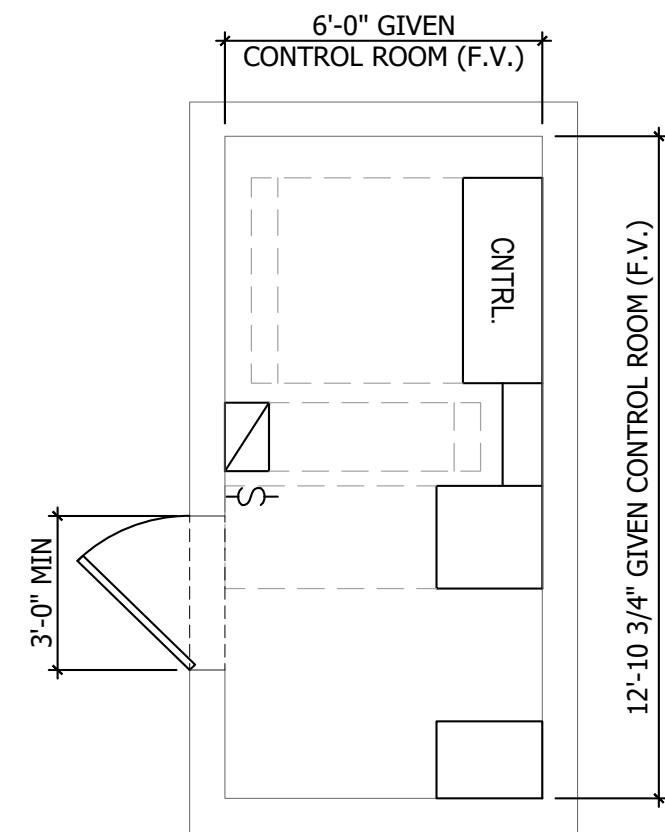


5 REMOTE CONTROL ROOM PLAN
LEVEL B - ELEVATOR KITCHEN SERVICE
SCALE: 1/4" = 1'-0"

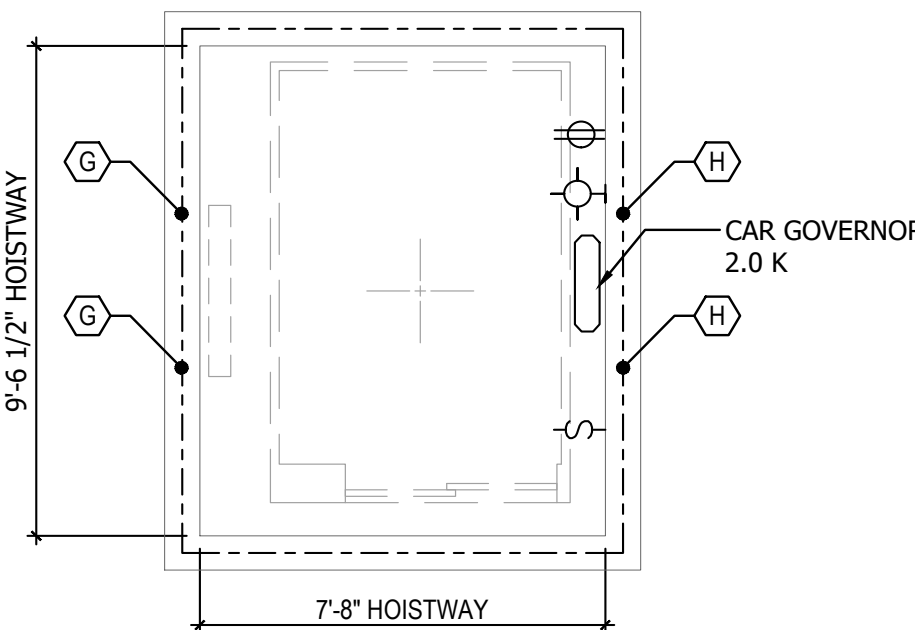

4 OVERHEAD PLAN - LEVEL 1A - KITCHEN SERVICE
SCALE: 1/4" = 1'-0"

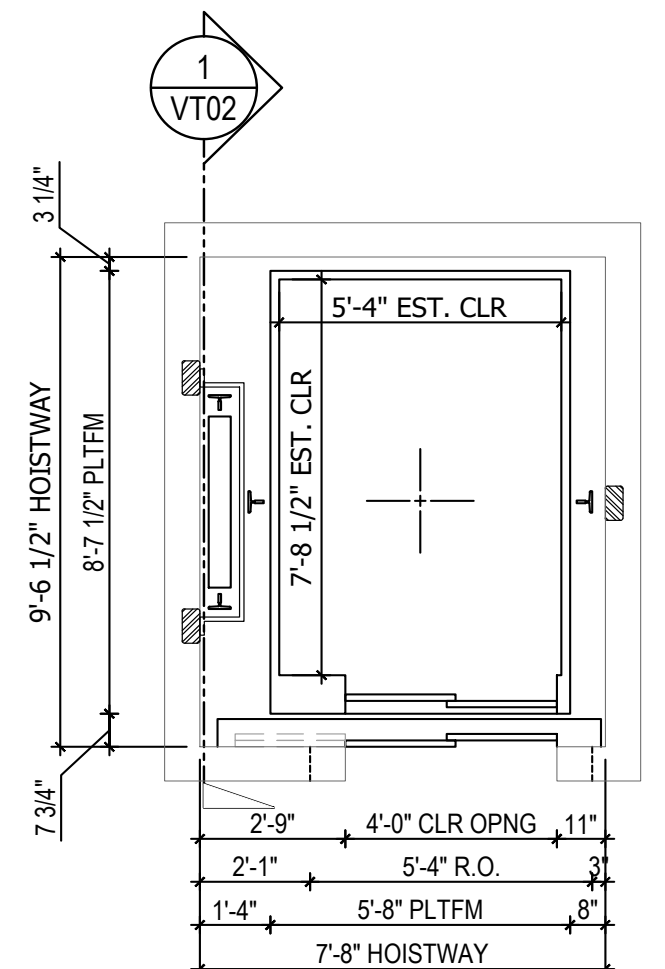

3 HOISTWAY PLAN - LEVEL P2A - KITCHEN SERVICE
SCALE: 1/4" = 1'-0"

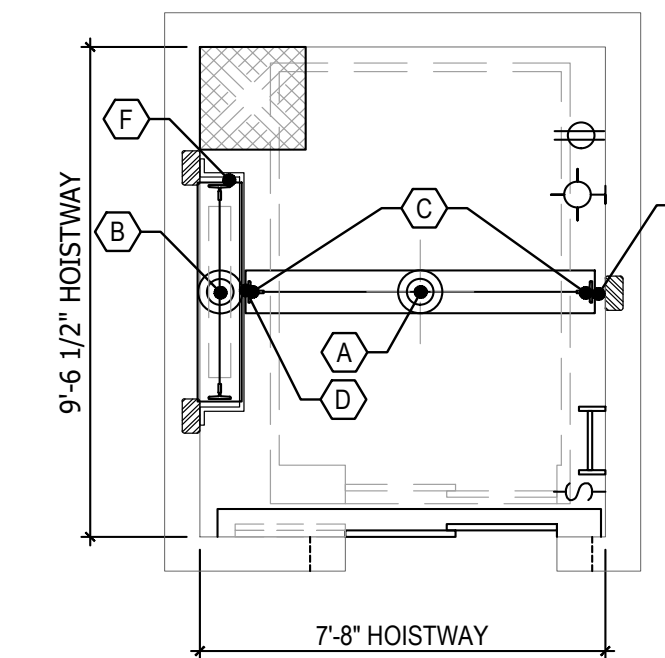

2 PIT PLAN - LEVEL B - KITCHEN SERVICE
SCALE: 1/4" = 1'-0"

ELEVATOR KITCHEN SERVICE 4000# @ 150 FPM MRL

OVERHEAD NOTES:

- PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT TOP OF HOISTWAY.
- PROVIDE LIGHTS, LIGHT SWITCHES AND GFCI- PROTECTED UTILITY OUTLETS. COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR.
- PROVIDE STRUCTURAL SUPPORT TO SUSTAIN REACTIONS INDICATED.
- PROVIDE 2 LIFELINE ATTACHMENTS AT THE TOP FRONT OF EACH HOISTWAY. EACH ATTACHMENT SHALL BE CAPABLE OF WITHSTANDING 5000# (2268 KG) LOAD PER OSHA. COORDINATE LOCATION OF ATTACHMENTS WITH ELEVATOR CONTRACTOR.
- PROVIDE HOIST BEAM SUPPORT 15,000#. COORDINATE HOISTBEAM LOCATION(S) AND LOAD REQUIREMENTS WITH ELEVATOR CONTRACTOR.
- OVERHEAD DIMENSIONS ARE CLEAR FROM F.F. AT TOP LANDING TO STRUCTURE OR ANY OBSTRUCTION ABOVE CAR AND/OR COUNTERWEIGHT.
- MACHINE BEAM SUPPORT. THIS SUPPORT IS REQUIRED FOR ABOVE CAR MACHINE LOCATION. VERIFY MACHINE LOCATION WITH ELEVATOR CONTRACTOR.
- OVERHEAD REACTIONS VARY PER VENDOR BASED ON CWT LOCATION AND METHOD OF SUPPORT FOR HOIST MACHINE AND DEAD END HITCHES. COORDINATE FINAL REACTIONS WITH ELEVATOR SHOP DRAWINGS.

OVERHEAD REACTION TABLE		
DUTY: 4000# @ 150 FPM		
KEY	REACTION (FORCES IN KIPS)	
(A)	18.2	EACH
(B)	11.6	EACH

HOISTWAY NOTES:

- PROVIDE ACCESS PANEL AT TOP TERMINAL WHEN CONTROL ROOM IS REMOTE. COORDINATE SIZE AND LOCATION WITH ELEVATOR CONTRACTOR.
- FOR ABOVE CAR MACHINE LOCATION, ERECT ENTRANCE SIDE HOISTWAY WALL AT ELEVATOR EQUIPMENT STORAGE LEVEL AFTER ELEVATOR EQUIPMENT HAS BEEN INSTALLED IN HOISTWAY.
- PROVIDE SMOKE VENTING PER LOCAL CODE REQUIREMENTS.
- FOR CERTAIN MRL VENDORS, PROVIDE ADDITIONAL LATERAL SUPPORTS ABOVE THE TOP TERMINAL FOR THE LARGE GUIDE RAIL FORCES DUE TO HOIST MACHINE, DEFLECTOR SHEAVE, AND DEAD END HITCH LOADS. COORDINATE LOADING REQUIREMENTS AND LOCATIONS WITH ELEVATOR CONTRACTOR.
- ROUGH OPENINGS VARY BY MANUFACTURER, VERIFY ROUGH OPENING BEFORE CONSTRUCTION.
- 1070 MM (42") CAR TOP RAILING PER CODE BY ELEVATOR CONTRACTOR.
- ABOVE CAR MACHINE LOCATION. VERIFY FINAL LOCATION WITH ELEVATOR CONTRACTOR.
- SIDE CWT MACHINE LOCATION. VERIFY FINAL LOCATION WITH ELEVATOR CONTRACTOR.
- PROVIDE STRUCTURAL SUPPORT, FOR CAR AND CWT GUIDE RAIL FASTENING AT MAX. VERTICAL SPACING THROUGH TOP OF HOISTWAY AS SPECIFIED IN RAIL SUPPORT TABLE. IF THIS SPACING CANNOT BE MAINTAINED, PROVIDE INTERMEDIATE SUPPORT BEAMS OR CONTINUOUS VERTICAL STRUCTURE BETWEEN FLOOR BEAMS.

RAIL SUPPORT TABLE		
15# RAILS		
CAR GUIDE RAIL	10'-6"	MAX SPAN
CWT GUIDE RAIL	10'-6"	MAX SPAN

CONTROL ROOM NOTES:

- PROVIDE SELF-CLOSING, SELF-LOCKING CONTROL ROOM ACCESS DOOR.
- PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT CONTROL ROOM FLOOR.
- PROVIDE 3-PHASE MAINLINE POWER FEEDER WITH DISCONNECTING MEANS FOR EACH ELEVATOR CONTROLLER.
- PROVIDE 1-PHASE FEEDER WITH DISCONNECTING MEANS FOR CAR LIGHTING, VENTILATION SYSTEM AND RECEPTACLE FOR EACH ELEVATOR. THESE DISCONNECTING MEANS SHALL INCLUDE OVERCURRENT PROTECTION, SHALL BE LOCATED IN THE MACHINE ROOM, AND SHALL MEET N.E.C. REQUIREMENTS.
- FOR MOST VENDORS, CONTROLLER MUST BE WITHIN 100' WIRE RUN LENGTH FROM THE CORRESPONDING MACHINE AT THE TOP OF THE HOISTWAY.

PIT NOTES:

- PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 100 LUX (10 FC) ILLUMINATION AT PIT FLOOR.
- PROVIDE PIT ACCESS LADDER(S) OR DOOR(S), LIGHT SWITCH(ES), LIGHT(S), AND GFCI-PROTECTED UTILITY OUTLET(S).
- COORDINATE LIGHT FIXTURES AND UTILITY OUTLETS LOCATION WITH ELEVATOR CONTRACTOR.
- PROVIDE ADEQUATE STRUCTURAL SUPPORT REQUIRED FOR BUFFER AND R3 RAIL FORCE REACTIONS.
- ELEVATOR CONTRACTOR PROVIDE PERMANENT MEANS TO ACCESS UNDERSIDE OF CAR AS REQUIRED.
- PROVIDE INDIRECT PIT DRAIN OR 24"x24"x24" SUMP PUMP, WITH GRATING COVER, LEVEL WITH PIT FLOOR. PROVIDE MINIMUM SUMP PUMP/DRAIN CAPACITY OF 3000 GALLONS/HOUR PER ELEVATOR.
- ELEVATOR CONTRACTOR IS TO PROVIDE A COUNTERWEIGHT GUARD PER CODE.
- ELEVATOR CONTRACTOR TO PROVIDE BUFFER ACCESS PLATFORM AND LADDER AS REQUIRED.
- CAR/CWT BUFFER REACTIONS WILL NOT OCCUR SIMULTANEOUSLY. UNLESS SPECIFIED OTHERWISE.
- REACTIONS HAVE BEEN DOUBLED FOR IMPACT.

PIT REACTION TABLE			
DUTY: 4000# @ 150 FPM			
KEY	REACTION (FORCES IN KIPS)	DESCRIPTION	
(A)	52.3	CAR BUFFER	
(B)	47.8	CWT BUFFER	
(C)	31.2	EACH	CAR SAFETY (SEE CAR R3 RAIL FORCES)
ALTERNATE PIT REACTIONS FOR RAIL SUPPORTED MACHINE			
THE FOLLOWING REACTIONS OCCUR SIMULTANEOUSLY.			
(D)	31.0	EACH	DRIVE MACHINE LOAD ON CAR RAIL COMBINED WITH CWT DEH LOAD ON CWT RAIL
(E)	22.0	EACH	DYNAMIC LOAD ON CAR RAIL
(F)	10.3	EACH	DYNAMIC LOAD ON CWT RAIL

Lerch Bates
BUILDING INSIGHT
Global Support Center
9780 S. Meridian Blvd, Suite 450
Englewood, CO 80112
T - 303.795.7956

Project Office
Pacific North West Office
19515 North Creek Parkway, Suite 304
Bothell, WA 98011
T - 425.205.2205

Office Locations

Atlanta Office - Atlanta, GA
Denver Office - Englewood, CO
Florida Office - Tampa, FL
Great Lakes Office - Chicago, IL
Houston Office - The Woodlands, TX
Los Angeles Office - Pasadena, CA
New England Office - Boston, MA
New York Office - New York, NY
North Central Office - Maple Grove, MN
Ohio Office - Dublin, OH
Pacific North West Office - Bothell, WA
Philadelphia Office - Exton, PA
Phoenix Office - Tempe, AZ
San Francisco Office - Emeryville, CA
South Central Office - Dallas, TX
Tennessee Office - Nashville, TN
Washington DC Office - Annapolis, MD

SOMMET BLANC

DEER VALLEY, UT

No.	Description	Date

Sheet Name

PLANS AND HOISTWAY
SECTION - TOWER A -
ELEVATOR KITCHEN
SERVICE

Issued For:

IFC SET

Project Number: 160-0100033534-01

Governing Codes: ASME A17.1

Date: 11/18/2022

Drawn By: JD

Checked By: BA, JB

Sheet Number:

VT02

Scale AS NOTED

FOR PROCUREMENT ONLY