



1. DIMENSIONS ARE TO FACE OF STUD OF EXTERIOR WALLS, CORRIDOR WALLS & INTERIOR WALLS, UNO.
2. DIMENSIONS ARE TO CENTERLINE OF DEMISING WALLS, UNO.
3. ALL EXPOSED STRUCTURAL STEEL TO RECEIVE 1 HR INFLUMENT SCANTING, UNO.
4. ALL FRAMED EXTERIOR WALLS TO BE FINISHED WITH 1/2" UNO FROM FACE OF CONCRETE TO ALLOW FOR FLUSH ALIGNMENT OF SHEATHING TO EDGE OF SLAB, UNO.
5. CASEWORK TO FINISH TO FACE OF FINISH, UNO.
6. SEE SHEETS 40.10 AND 40.11 FOR ASSEMBLIES.
7. ALL CORRIDOR WALLS ARE TYPE E6, UNO.
8. ALL DEMISING WALLS ARE TYPE J6, UNO.
9. ALL INTERIOR PARTITIONS ARE TYPE A6, UNO.
10. ALL FURRING AROUND CONCRETE STRUCTURAL COLUMNS TYPE G1, UNO.
11. ALL VENT SHAFT WALLS ARE TYPE K4, UNO.
12. REFER TO LIFE SAFETY PLANS A0.30 - A0.34 FOR FULL EXTENT OF FIRE RATED WALLS.
13. UNIFORM LAYOUTS ON SHEETS A2.4A - A2.4R.
14. ALL OWNER PARKING STALLS SHALL INCLUDE EV INFRASTRUCTURE.
15. REFER TO SHEET A0.08 FOR ANSI TYPE B ACCESSIBILITY REQUIREMENTS.
16. REFER TO SHEET A0.07 FOR ANSI TYPE A ACCESSIBILITY REQUIREMENTS.
17. REFER TO SHEET A0.08 FOR ANSI TYPE C ACCESSIBILITY REQUIREMENTS.
18. ALL MECHANICAL EQUIPMENT LOCATED WITHIN ELEVATOR/MECHANICAL EQUIPMENT ENCLOSURES SHALL BE PROTECTED BY 1 HR FIRE RATED WALLS, UNO.

1. REFER TO SHEET A0.08 FOR ANSI OPTION A & OPTION B ACCESSIBILITY REQUIREMENTS.
2. REFER TO SHEET A0.07 FOR ANSI TYPE A ACCESSIBILITY REQUIREMENTS.
3. REFER TO SHEET A0.06 FOR ADA + PUBLIC SPACE ACCESSIBILITY REQUIREMENTS
4. ALL MAX. MIN. ALIGN AND CLEAR DIMENSIONS ARE TO FINISHED FACE OF WALL, U.N.O.
5. WHERE CLEAR AND ALIGN NOTATION CONFLICT WITH SPECIFIC DIMENSIONS, CLEAR AND ALIGN NOTATION ARE TO BE FOLLOWED.
6. GC TO ADD BACKING FOR FIXTURES AS REQUIRED, GC TO COORDINATE.



Olson Kundig

SOMMET BLANC  
3200 MARSAC AVE

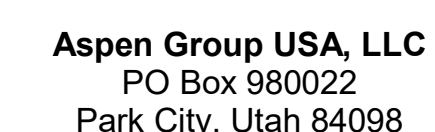

**MEP Engineer**  
**WSP USA**  
1001 Fourth Ave., Suite 3100  
Seattle, WA 98154

JEG-SET 2.05.2

INTERIOR ELEVATIONS -  
TOWER B - APRES SKI  
BAR

A5.1B.30