
(C.1) (15) TENDONS (15) TENDONS TOP OF NON-LOAD BRG 9 WALL BELOW S3.45 (13) TENDONS (10) TENDONS (2) TENDONS \_\_\_\_·

1 TOWER C - LEVEL 2 FRAMING PLAN

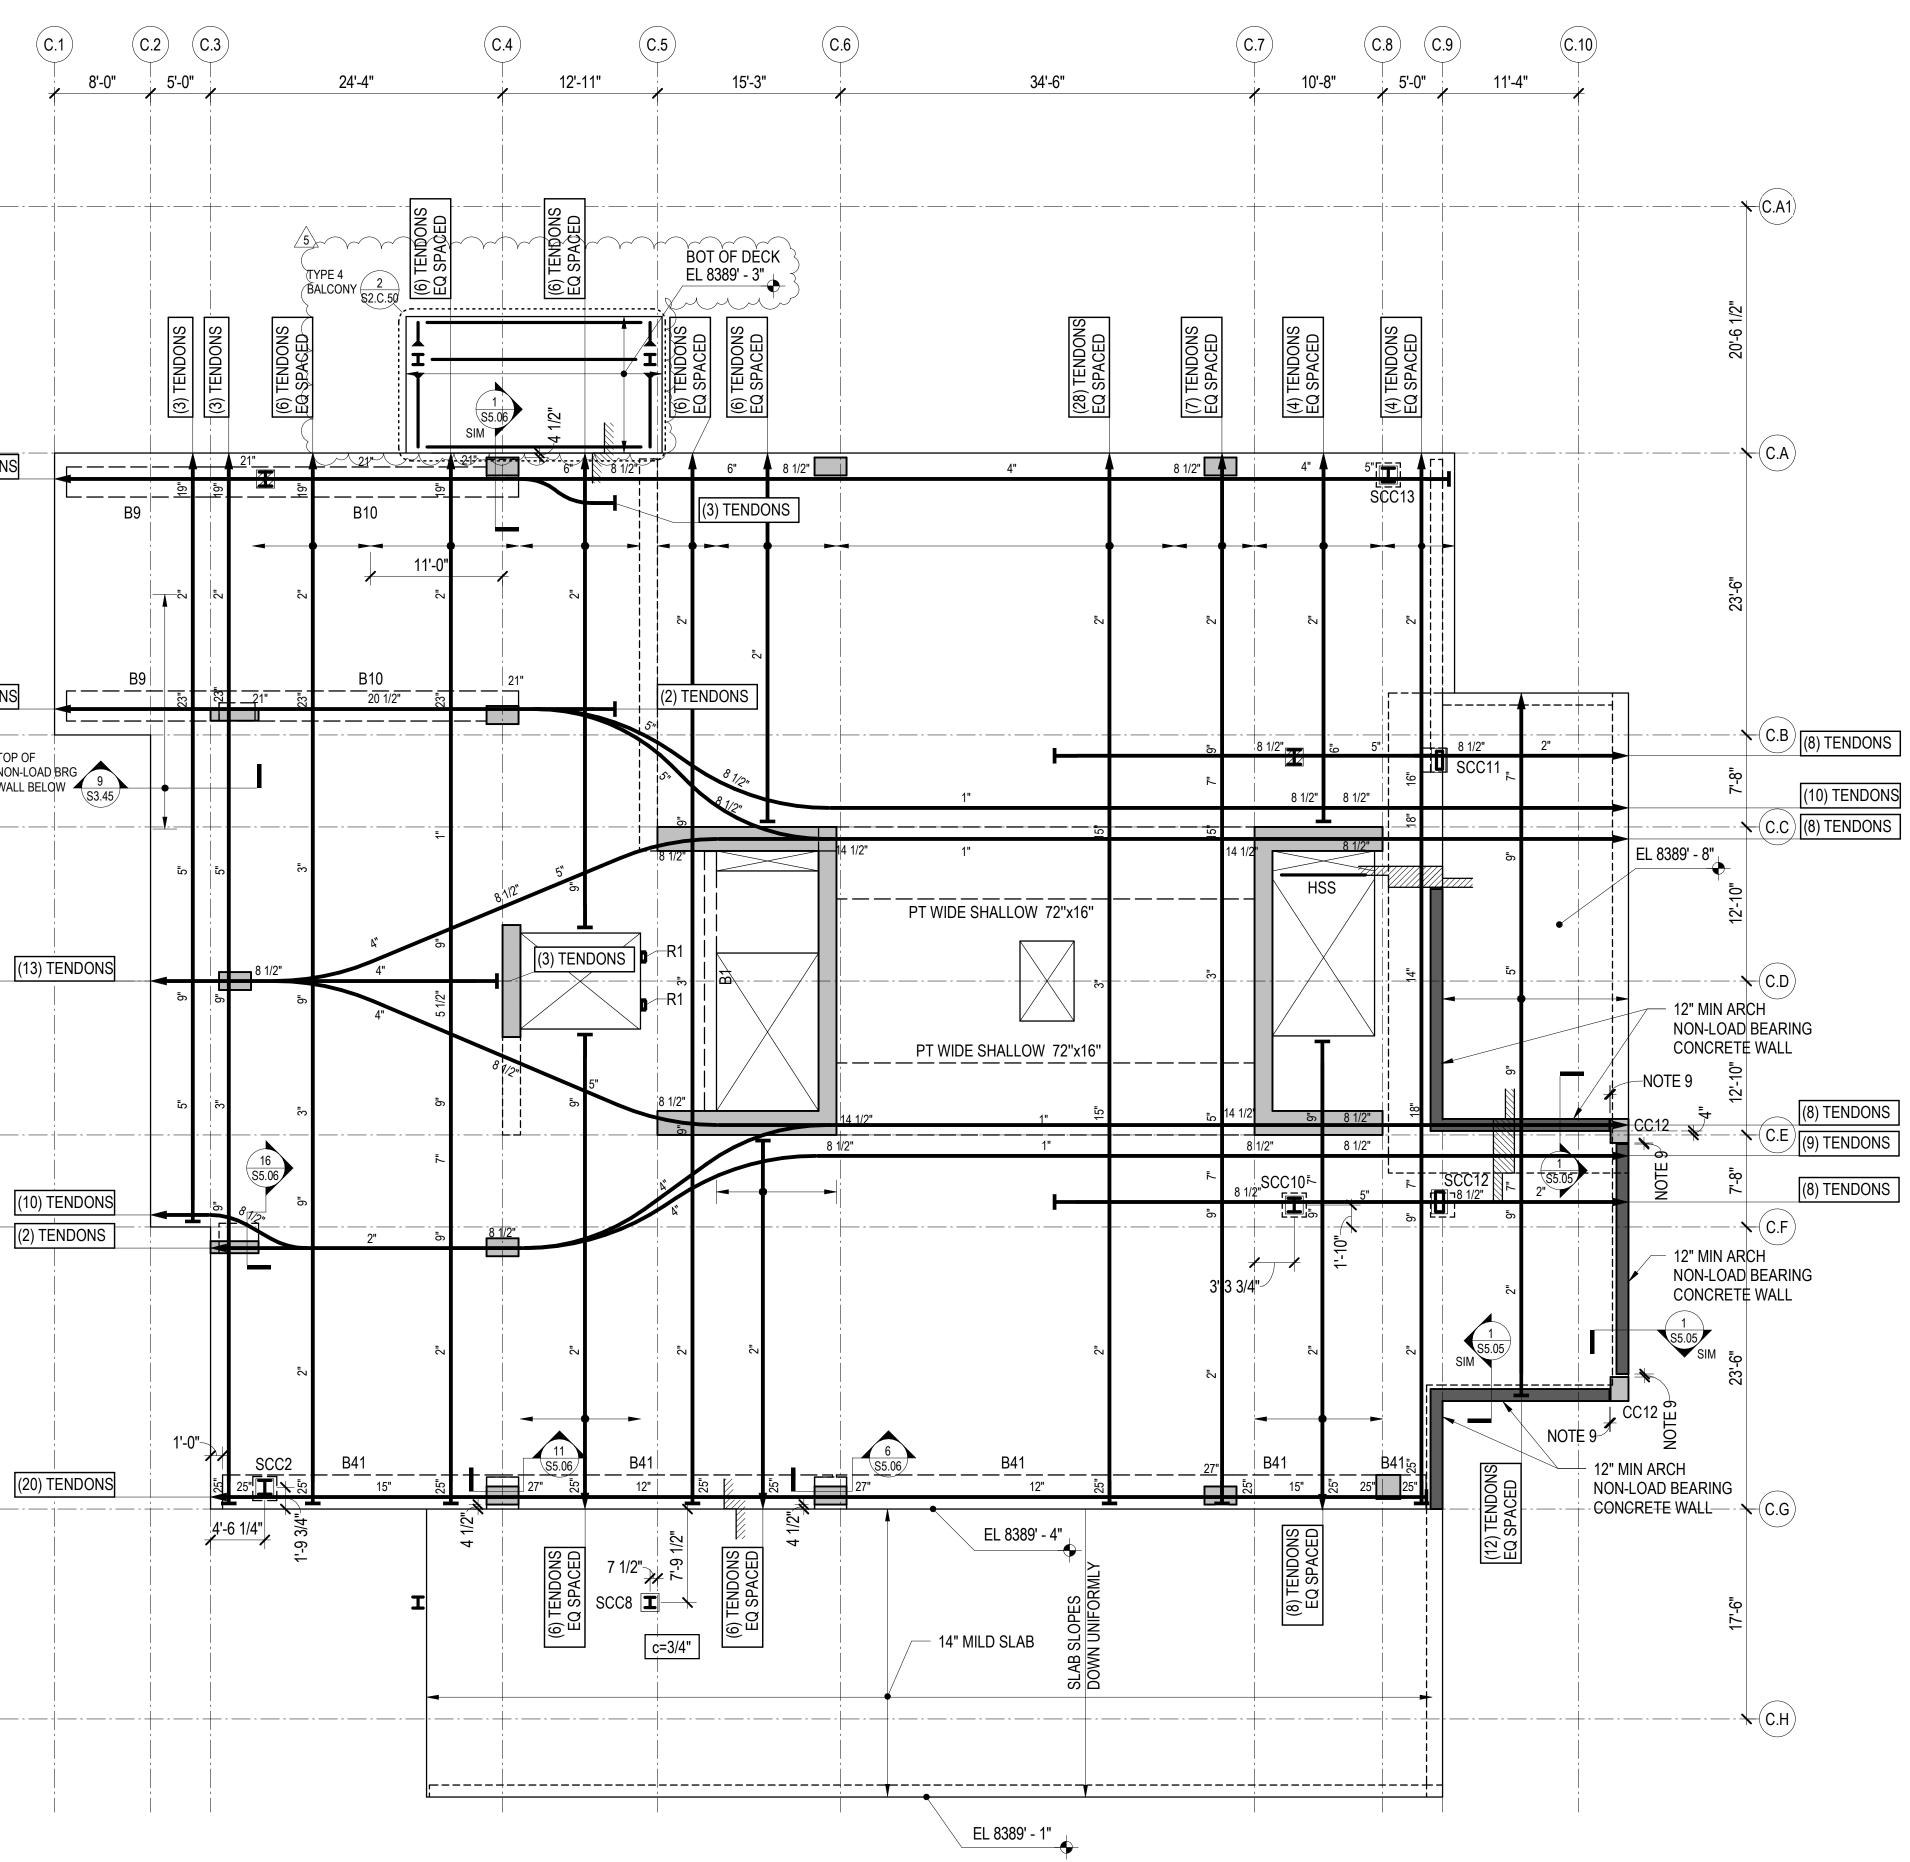

## **REFERENCE DRAWINGS**

- S0.XX DRAWING INDEX, ABBREVIATIONS, LEGENDS, GENERAL NOTES S1.XX LOAD DIAGRAMS S2.XX PLANS S3.XX ELEVATIONS S4.XX TYPICAL DETAILS AND SCHEDULES S5.XX CONCRETE SECTIONS AND DETAILS S6.XX STEEL SECTIONS AND DETAILS NOTES: 1. REFERENCE FLOOR ELEVATION IS 8390' - 6". TOP OF STRUCTURAL CONCRETE SLAB 7. SEE ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL, AND OTHER DISCIPLINES
- IS 8390' 5", UNLESS NOTED OTHERWISE. SEE ARCHITECTURAL DRAWINGS FOR DRAINAGE SLOPES NOT SHOWN.
- 2. STRUCTURAL SLAB IS A 10-INCH THICK UNBONDED POST-TENSIONED TWO-WAY SLAB UNLESS NOTED OTHERWISE. SEE TYPICAL POST-TENSIONED SLAB DETAILS FOR ADDITIONAL INFORMATION.
- 3. THE MINIMUM NUMBER OF REQUIRED POST-TENSIONING TENDONS IS SHOWN ON THE DRAWINGS. FINAL COUNT, LAYOUT, AND LIVE END LOCATION IS PER DEFERRED DESIGN-BUILD SUBMITTAL PROVIDED BY THE CONTRACTOR.
- 4. CONCRETE PLACED IN THE SLAB/SHEAR WALL INTERSECTION, INCLUDING COUPLING BEAMS, SHALL HAVE MINIMUM CONCRETE STRENGTH EQUAL TO THAT SPECIFIED FOR THE SHEAR WALLS.
- 5. CONCRETE PLACED IN THE SLAB/COLUMN INTERSECTION SHALL HAVE MINIMUM CONCRETE STRENGTH AS SHOWN IN THE GENERAL NOTES, BUT NO LESS THAN THAT SPECIFIED FOR THE COLUMNS DIVIDED BY 1.4.
- 6. COORDINATE LOCATION OF ALL EMBEDS WITH MECHANICAL, ELECTRICAL, PLUMBING, AND EXTERIOR WALL SYSTEMS PRIOR TO CASTING THE SLAB.

- DRAWINGS FOR OPENING SIZES AND LOCATIONS NOT SHOWN ON PLAN. SEE "TYPICAL OPENINGS AND EMBEDMENTS IN CONCRETE" DETAILS FOR OPENING PLACEMENT CRITERIA. NOTIFY THE STRUCTURAL ENGINEER OF ANY OPENINGS NOT SHOWN ON THE STRUCTURAL DRAWINGS FOR WHICH THE TYPICAL DETAILS DO NOT APPLY.
- 8. REFERENCE ALL CONSTRUCTION DOCUMENTS FOR SIZE, EXTENT, AND LOCATION OF CONCRETE CURBS, HOUSEKEEPING PADS, CMU WALLS, PLANTER WALLS, BOLLARDS, AND EDGE ANGLES. REINFORCE PER THE TYPICAL DETAILS.
- 9. WHERE NOTED, ARCHITECTURAL CONCRETE WALLS ARE TO MAINTAIN 1" MINIMUM GAP TO PRIMARY STRUCTURAL COLUMNS/WALLS/SLABS.

