



- A. CONFIRM EXACT LOCATION OF ALL WALL DEVICES WITH ARCHITECTURAL ELEVATIONS.
- B. CONFIRM ALL CEILING AND WALL ACCESS DOORS WITH ARCHITECTURAL RCP'S AND WALL ELEVATIONS.
- C. REFER TO M3-2A-01 THROUGH M3-2C-R FOR RADIANT FLOOR HWSIR PIPING ROUTING AND SIZING.
- D. PROVIDE 1-INCH ACQUISTIC LINING FOR ENTIRETY OF MAIN DUCT RUN OFF FAN COIL.
- E. ALL RESIDENTIAL TOILET EXHAUST, DRYER EXHAUST, AND KITCHEN RANGE HOOD EXHAUST TO BE PART OF A SUB-DUCT EXHAUST SYSTEM.
- F. ROUTE 34" CONDENSATE DRAINS FROM FCUS TO NEAREST SINK TAILPIECE.

1 5/8" CONCENTRIC FLUE TO GAS FIREPLACE. PROVIDE OATL IN-LINE 180 POWERVENT (120V/15A).

2 RANGE HOOD EXHAUST FAN TO BE INTEGRAL, WITH RANGE SPECIFIED BY THE ARCHITECT. INTERLOCK CONTROL, WITH MUA-A.

3 ELECTRICAL RADIANT FLOOR TO BE PROVIDED IN MASTER BATHROOM. SEE ELECTRICAL DRAWINGS.

4 RETURN-AIR SLOT

5 OWNER OPTION: PROVIDE 120(16A)/1" CONNECTION FOR APPLIARE 800 HUMIDIFIER DOWNSTREAM OF FAN COIL UNIT. REFER TO ELECTRICAL DRAWINGS FOR DETAILS. REFER TO PLUMBING DRAWINGS FOR 1/2" CW CONNECTION. ROUTE 3/4" CD TO NEAREST SINK TAILPIECE. REFER TO DETAILS MS 048 & MS 0412 FOR INSTALLATION CONNECTION.

6 REMOVE SOUND LINING FROM FCJ AND PROVIDE PRICE RSP 3/4" SOUND ATTENUATOR WITH A MINIMUM INSERTION LOSS OF:

63 125 250 500 1000 2000 4000 8000  
0, 4, 6, 8, 7, 9, 8, 0

CONFIRM WITH OWNER AND ARCHITECT PRIOR TO PROVIDING HUMIDIFIER.

7 OWNER OPTION: PROVIDE 208(16A)/1" CONNECTION FOR APPLIARE 800 HUMIDIFIER DOWNSTREAM OF FAN COIL UNIT. REFER TO ELECTRICAL DRAWINGS FOR DETAILS. REFER TO PLUMBING DRAWINGS FOR 1/2" CW CONNECTION. ROUTE 3/4" CD TO NEAREST SINK TAILPIECE. REFER TO DETAILS MS 048 & MS 0412 FOR INSTALLATION CONNECTION.

8 REMOVE SOUND LINING FROM FCJ AND PROVIDE PRICE RSP 3/4" SOUND ATTENUATOR WITH A MINIMUM INSERTION LOSS OF:

63 125 250 500 1000 2000 4000 8000  
0, 4, 6, 8, 7, 9, 8, 0

CONFIRM WITH OWNER AND ARCHITECT PRIOR TO PROVIDING HUMIDIFIER.

9 FLAT DIFFUSERS TO BE FIT BENEATH LOWERED SLAB

10 CONNECT 4" TO DRYER

11 LOCATION OF STEAM GENERATOR FOR DUCT HUMIDIFIER. CONFIRM EXACT LOCATION WITH ARCHITECT PRIOR TO INSTALLING.

12 FUTURE SNOWMELT HEATER LOCATION, RADIANT HUMIDIFIER, SNOWMELT SYSTEM TO BE DESIGNED/BUILT BY OTHERS


13 FUTURE SNOWMELT AREA, RADIANT HUMIDIFIER SNOWMELT SYSTEM TO BE DESIGN-BUILT BY OTHERS

Reserved for permit stamp

159 South Jackson St, Suite 800  
Seattle, Washington 98104 USA  
+1 206 624 5670 [olsonkundig.com](mailto:olsonkundig.com)

Olson Kundig

Project: **SOMMET BLANC**  
3300 Marsac Ave (B2 East Parcel)

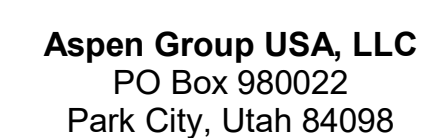

Pool Consultant  
**Cloward H2O**  
2696 N University Ave, Suite 290  
Provo, UT 84604

Landscape Architect  
**EPG Design**  
6949 South High Tech Drive, Suite 100  
Midvale, Utah 84047

Specifications Writer  
**Friday Group**  
88 Mainelli Road  
Middlebury, VT

**Code Consultant**  
**Holmes**  
600 1st Avenue, Suite 200A  
Seattle, WA 98104

Fire Protection Engineer  
**Jensen Hughes**  
One Research Drive, Suite 305C  
Westborough, MA 01581

Vertical Transportation Consultant  
**Lerch Bates**  
19515 North Creek Parkway, Suite 304  
Bothell, WA 98011

Structural Engineer  
Magnusson Klemencic Associates  
1301 5th Ave, Suite 3200  
Seattle, WA 98101

Lighting Designer  
O-  
1319 SE MLK Blvd, Suite 210  
Portland, Oregon 97219

**Building Envelope Consultant**  
**RDH**  
2101 N 34th St  
Seattle, WA 98103

**Accessibility Consultant**  
**Studio Pacifica**  
2144 Westlake Ave N, Suite F  
Seattle, WA 98109

**MEP Engineer**  
**WSP USA**  
1001 Fourth Ave., Suite 3100  
Seattle, WA 98154

principal architect \_\_\_\_\_  
project manager \_\_\_\_\_  
drawn by \_\_\_\_\_  
checked by Checker  
job no. \_\_\_\_\_  
date 5/31/2024

revisions:

J 01/10/2025 ASI 6

no.	date	
-----	------	--

IFC Set 3 of 3  
5/31/2024

ENLARGED  
MECHANICAL PLAN -  
UNIT H

M2.4.H