


- A. ALL CHILLED WATER AND HOT WATER BRANCH PIPING SHALL BE SIZED AT 1" FOR ALL FAN COIL UNITS UNLESS OTHERWISE NOTED.
- B. REFER TO MANUFACTURER SPECIFICATIONS FOR REFRIGERANT PIPING SIZING FOR SPLIT SYSTEM FAN COILS.
- C. ROUTE 3/4" CONDENSATE FROM FCU TO NEAREST SINK TAILPIECE PER DETAIL MS.06/8.

1 FUTURE SNOWMELT HEADER LOCATION, RADIANT HYDRONIC SNOWMELT SYSTEM TO BE DESIGN-BUILD BY OTHERS
2 FUTURE SNOWMELT AREA, RADIANT HYDRONIC SNOWMELT SYSTEM TO BE DESIGN-BUILD BY OTHERS

Seattle, Washington 98104 USA
+1 206 624 5670 oisonkundig.com

Olson Kundig

SOMMET BLANC
9300 Marsac Ave (B2 East Parcel)
Park City, Utah 84060

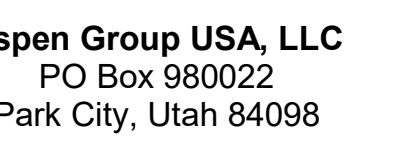

principal architect _____
project manager _____
drawn by _____
checked by Checker _____
job no. _____
date 5/31/2024


[illegible]

no.	date	by
-----	------	----

IFC Set 3 of 3
5/31/2024

POWER A - LVL 3
MECHANICAL PIPING
PLAN

M3.2A.13

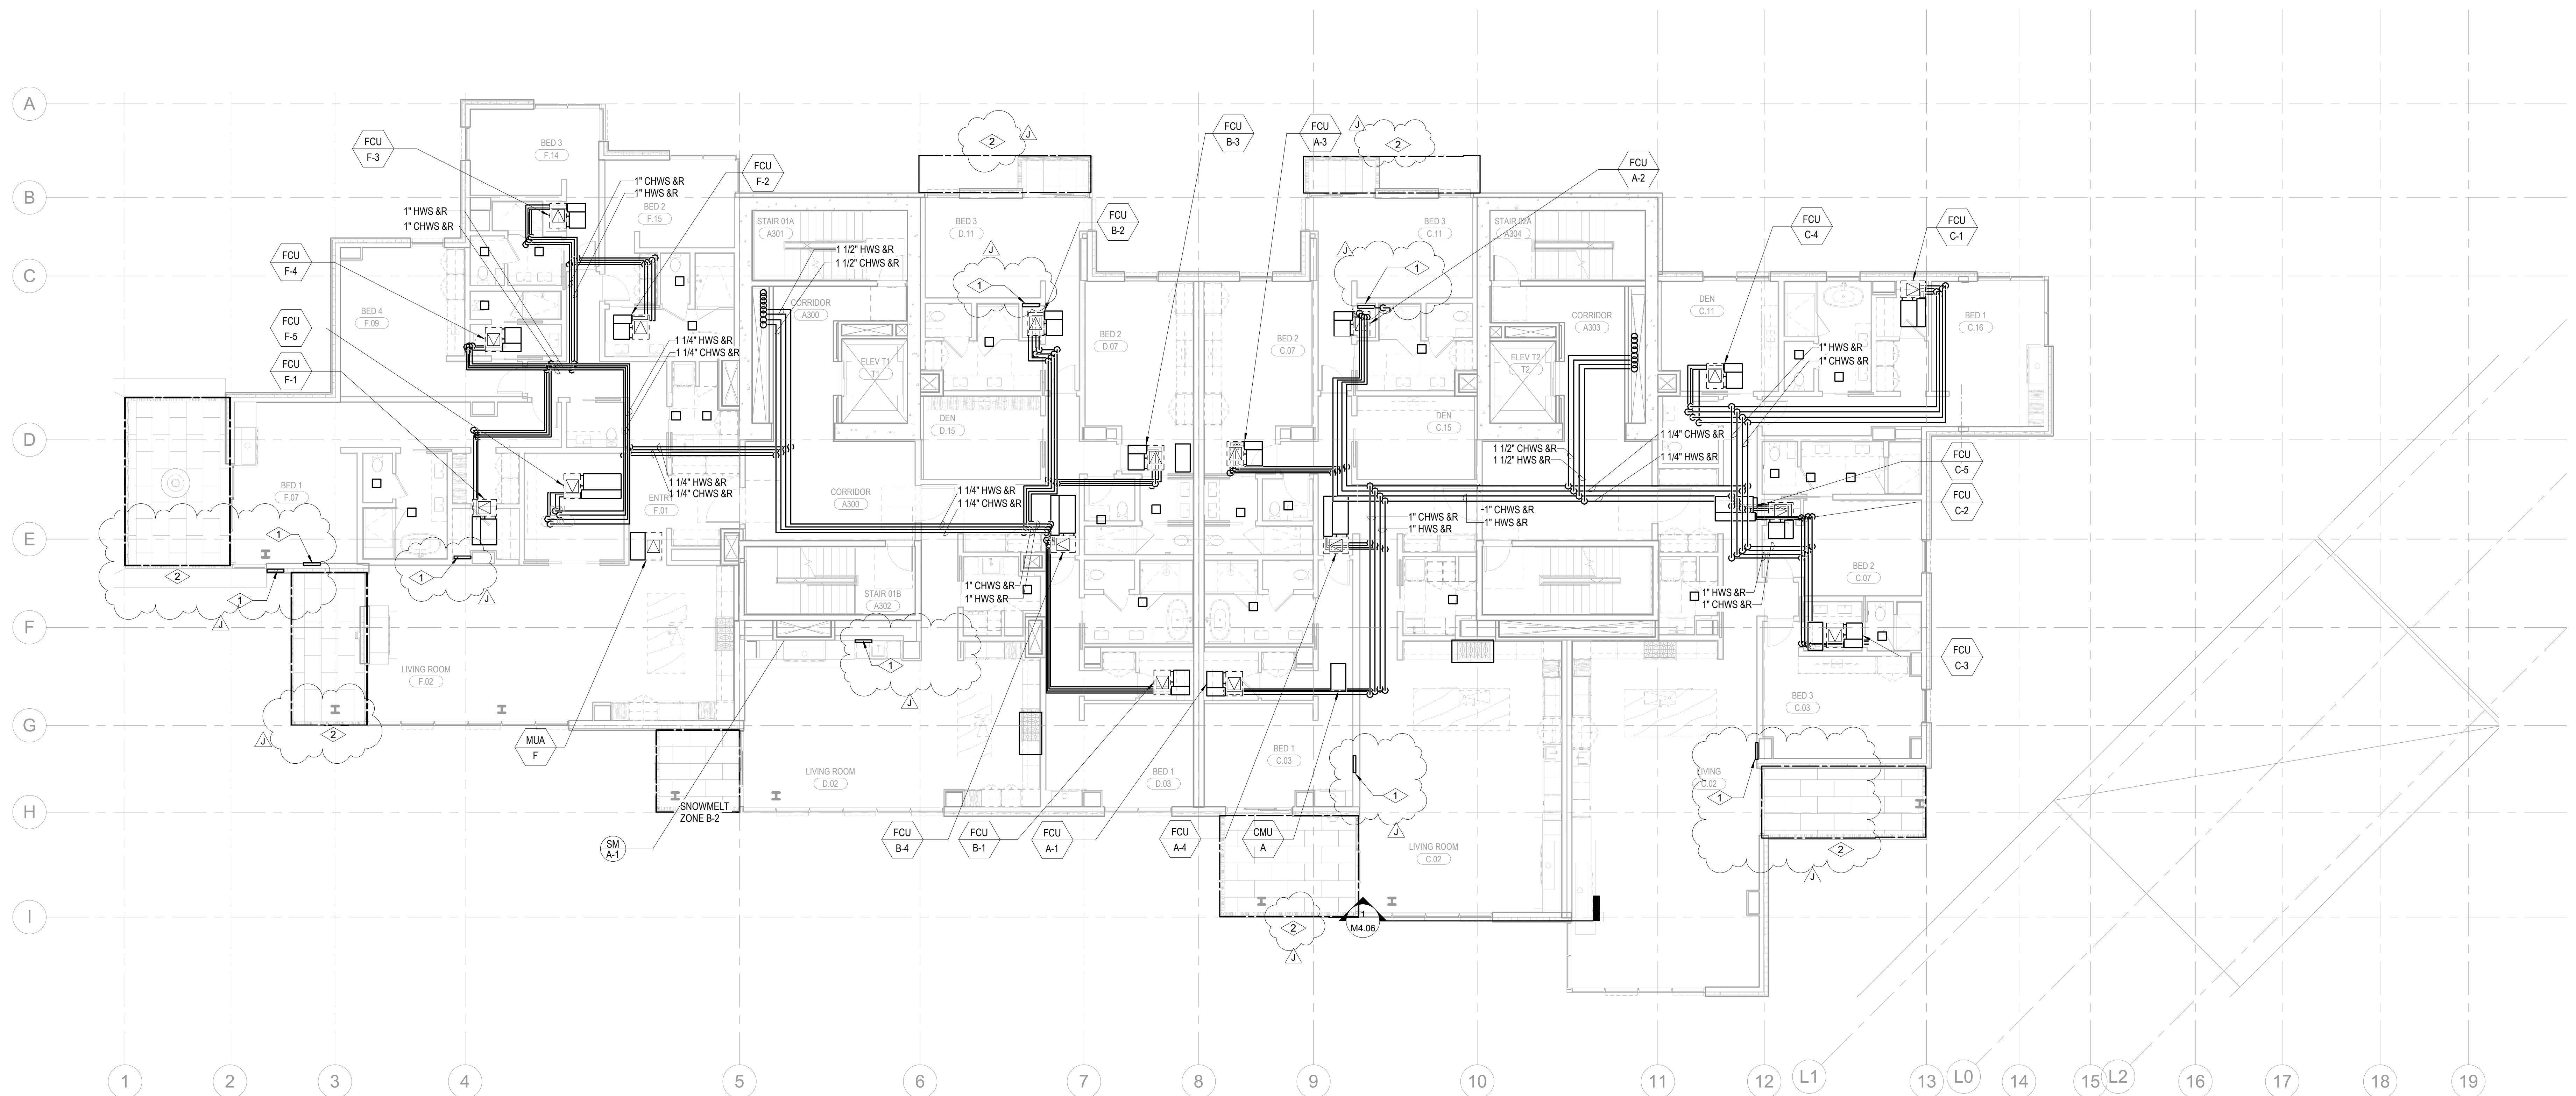

1 TOWER A - LEVEL 3 MECHANICAL PIPING PLAN
SCALE: 1/8" = 1'-0"

