

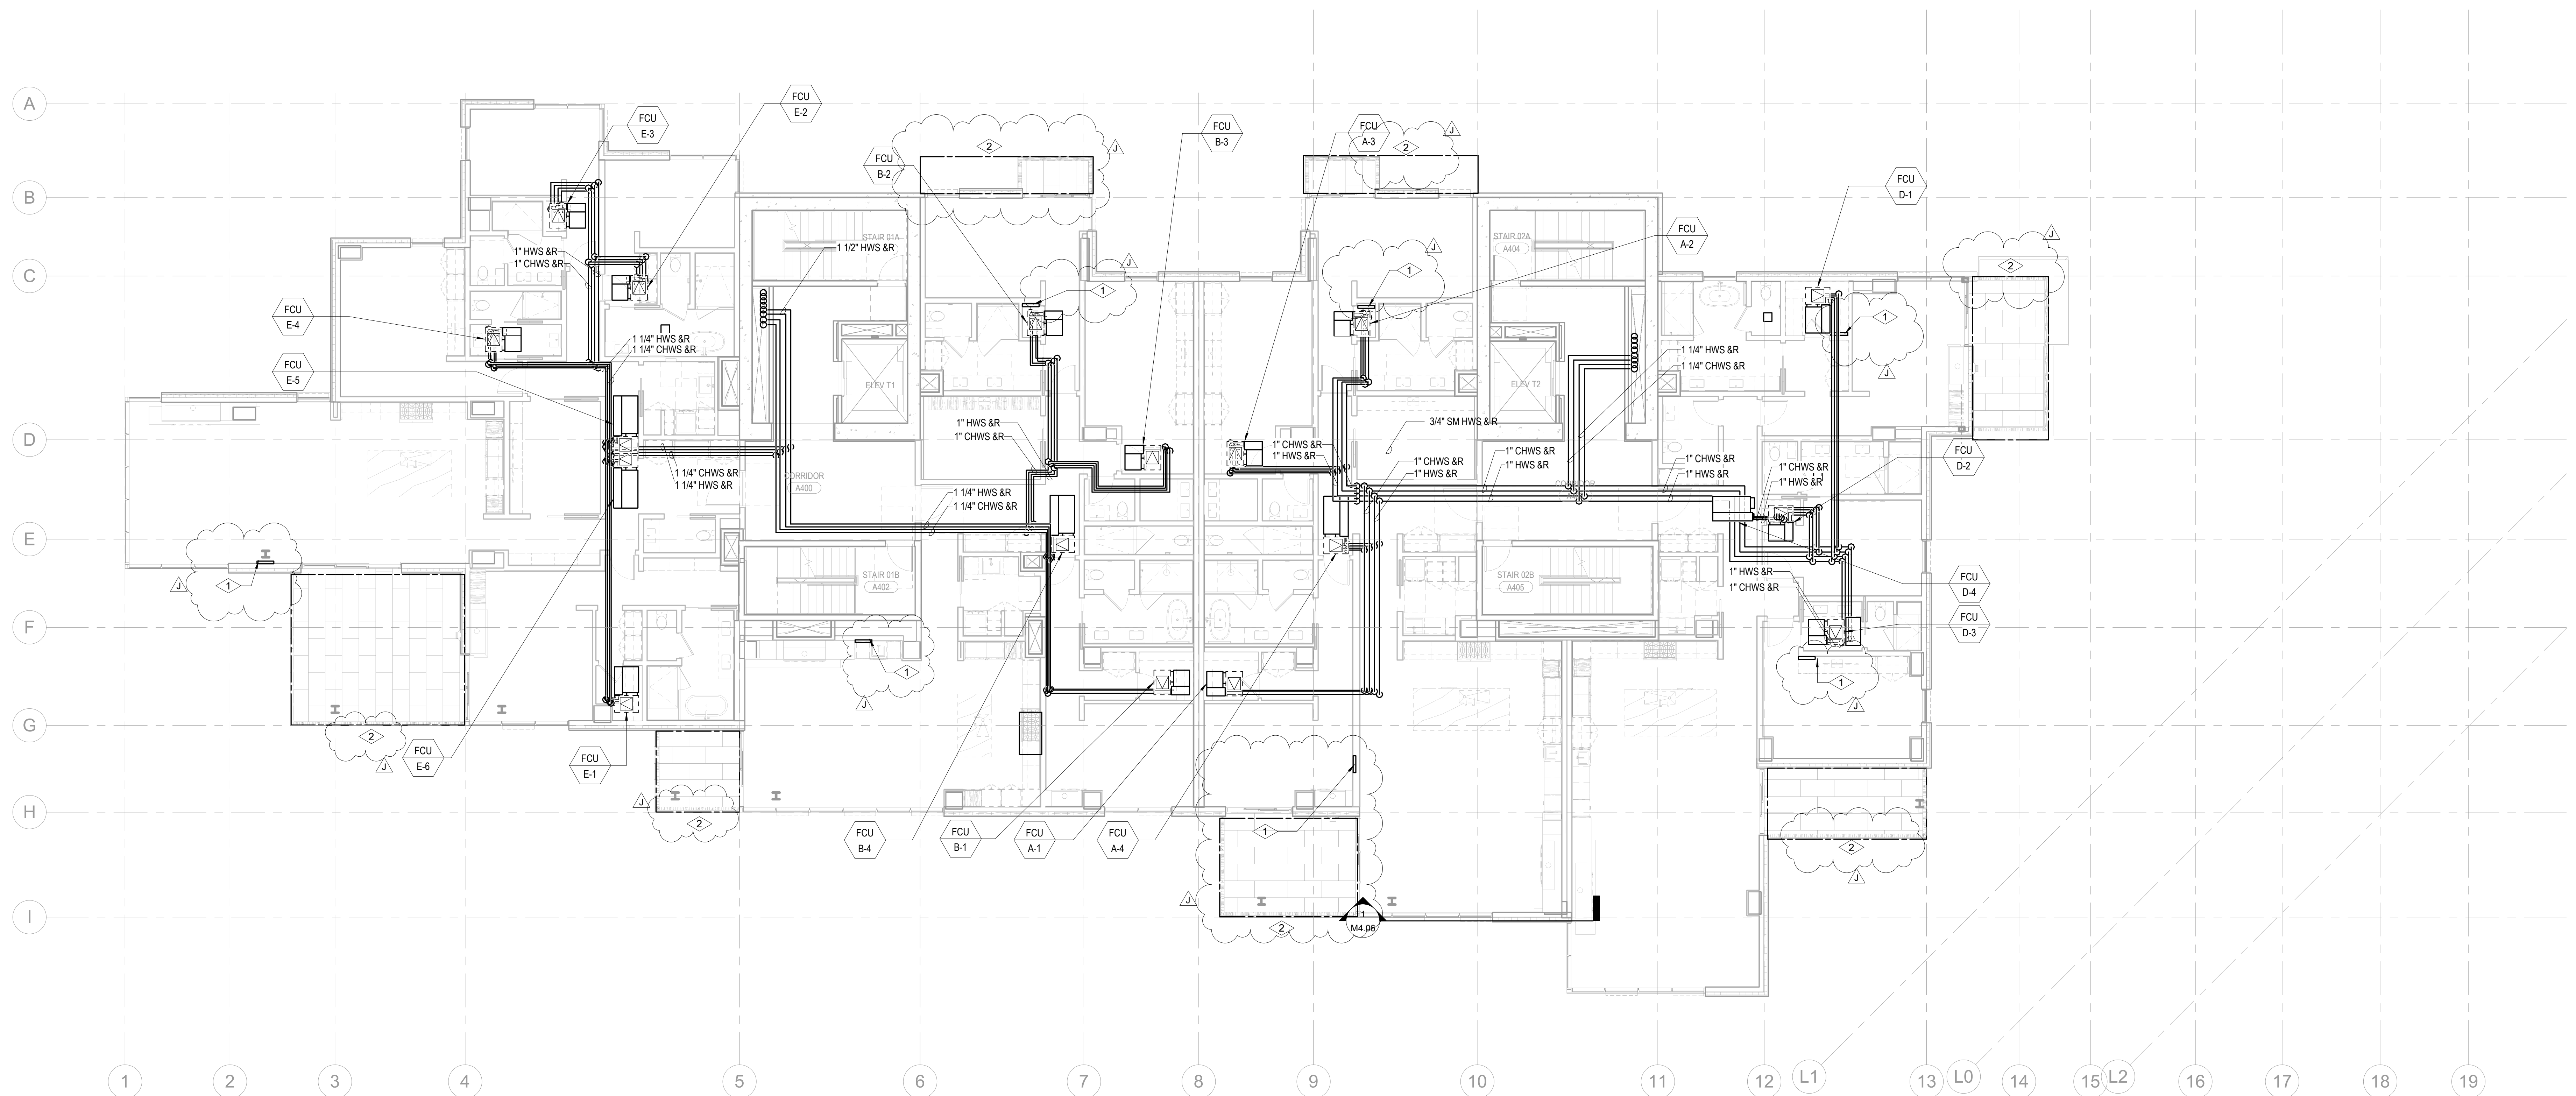


- A. ALL CHILLED WATER AND HOT WATER BRANCH PIPING SHALL BE SIZED AT 1" FOR ALL FAN COIL UNITS UNLESS OTHERWISE NOTED.
- B. REFER TO MANUFACTURER SPECIFICATIONS FOR REFRIGERANT PIPING SIZING FOR SPLIT SYSTEM FAN COILS.
- C. ROUTE 3/4" CONDENSATE FROM FCU TO NEAREST SINK TAILPIECE PER DETAIL M5.06/8.

1 FUTURE SNOWMELT HEADER LOCATION, RADIANT HYDRONIC SNOWMELT SYSTEM TO BE DESIGN-BUILD BY OTHERS
2 FUTURE SNOWMELT AREA, RADIANT HYDRONIC SNOWMELT SYSTEM TO BE DESIGN-BUILD BY OTHERS

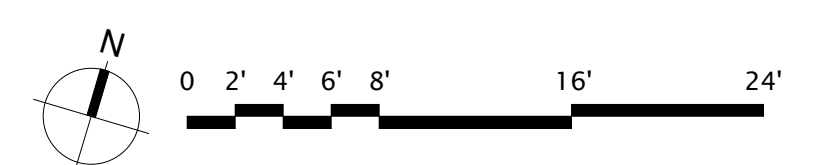

1 TOWER A - LEVEL 4 MECHANICAL PIPING PLAN
SCALE: 1/8" = 1'-0"

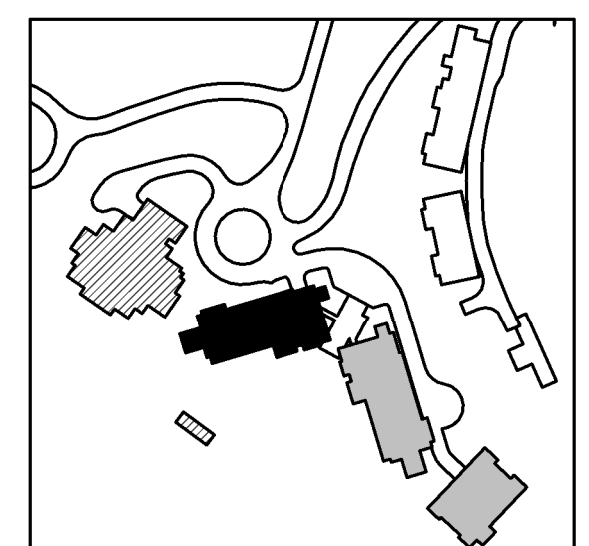

served for permit stamp

Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

Olson Kundig

SOMMET BLANC
9300 Marsac Ave (B2 East Parcel)
Park City, Utah 84060



Spensen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward H2O
696 N University Ave, Suite 290
Provo, UT 84604

PG Design
949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
8 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
100 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Merch Bates
9515 North Creek Parkway, Suite 304
Bothell, WA 98011

Magnusson Klemencic Associates
301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
1144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect _____
project manager _____
drawn by _____
checked by Checker
job no. _____
date 5/31/2024

[illegible]

no.	date	by
-----	------	----

IFC Set 3 of 3
5/31/2024

POWER A - LVL 4
MECHANICAL PIPING
PLAN

M3.2A.14