

Reserved for permit stamp

100 South Jackson St., Suite 800
Seattle, Washington 98104 USA
+1 206 834 2670 olsonkundig.com

Olson Kundig

project
SOMMET BLANC
9300 Marzac Ave (B2 East Parcel)
Park City, Utah 84060



Aspen Group USA, LLC
PO Box 980022
Park City, Utah 84098

Pool Consultant
Cloward M20
2696 N University Ave., Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6948 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
86 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave., Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect _____
project manager _____
drawn by _____
checked by _____
job no. _____
date 05/31/2024

revisions:

J 1/10/2024 ASI 6

no. date by

IFC Set 3 of 3
05/31/2024

TOWER C - LVL 5
MECHANICAL PIPING
PLAN


M3.2C.15

SHEET NOTES:

- A. ALL BRANCH PIPING SIZE OF CHILLED WATER AND HOT WATER TO FAN COIL UNIT IS 1" UNLESS OTHERWISE NOTED.
- B. ALL BRANCH PIPING SIZE OF HOT WATER TO FAN POWERED TERMINAL UNIT IS 1" UNLESS OTHERWISE NOTED.
- C. REFER TO MANUFACTURER SPECIFICATIONS FOR REFRIGERANT PIPING SIZING FOR SPLIT SYSTEM FAN COILS.

NUMBERED NOTES:

- 1 FUTURE SNOWMELT HEADER LOCATION, RADIANT HYDRONIC SNOWMELT SYSTEM TO BE DESIGN-BUILD BY OTHERS
- 2 FUTURE SNOWMELT AREA, RADIANT HYDRONIC SNOWMELT SYSTEM TO BE DESIGN-BUILD BY OTHERS

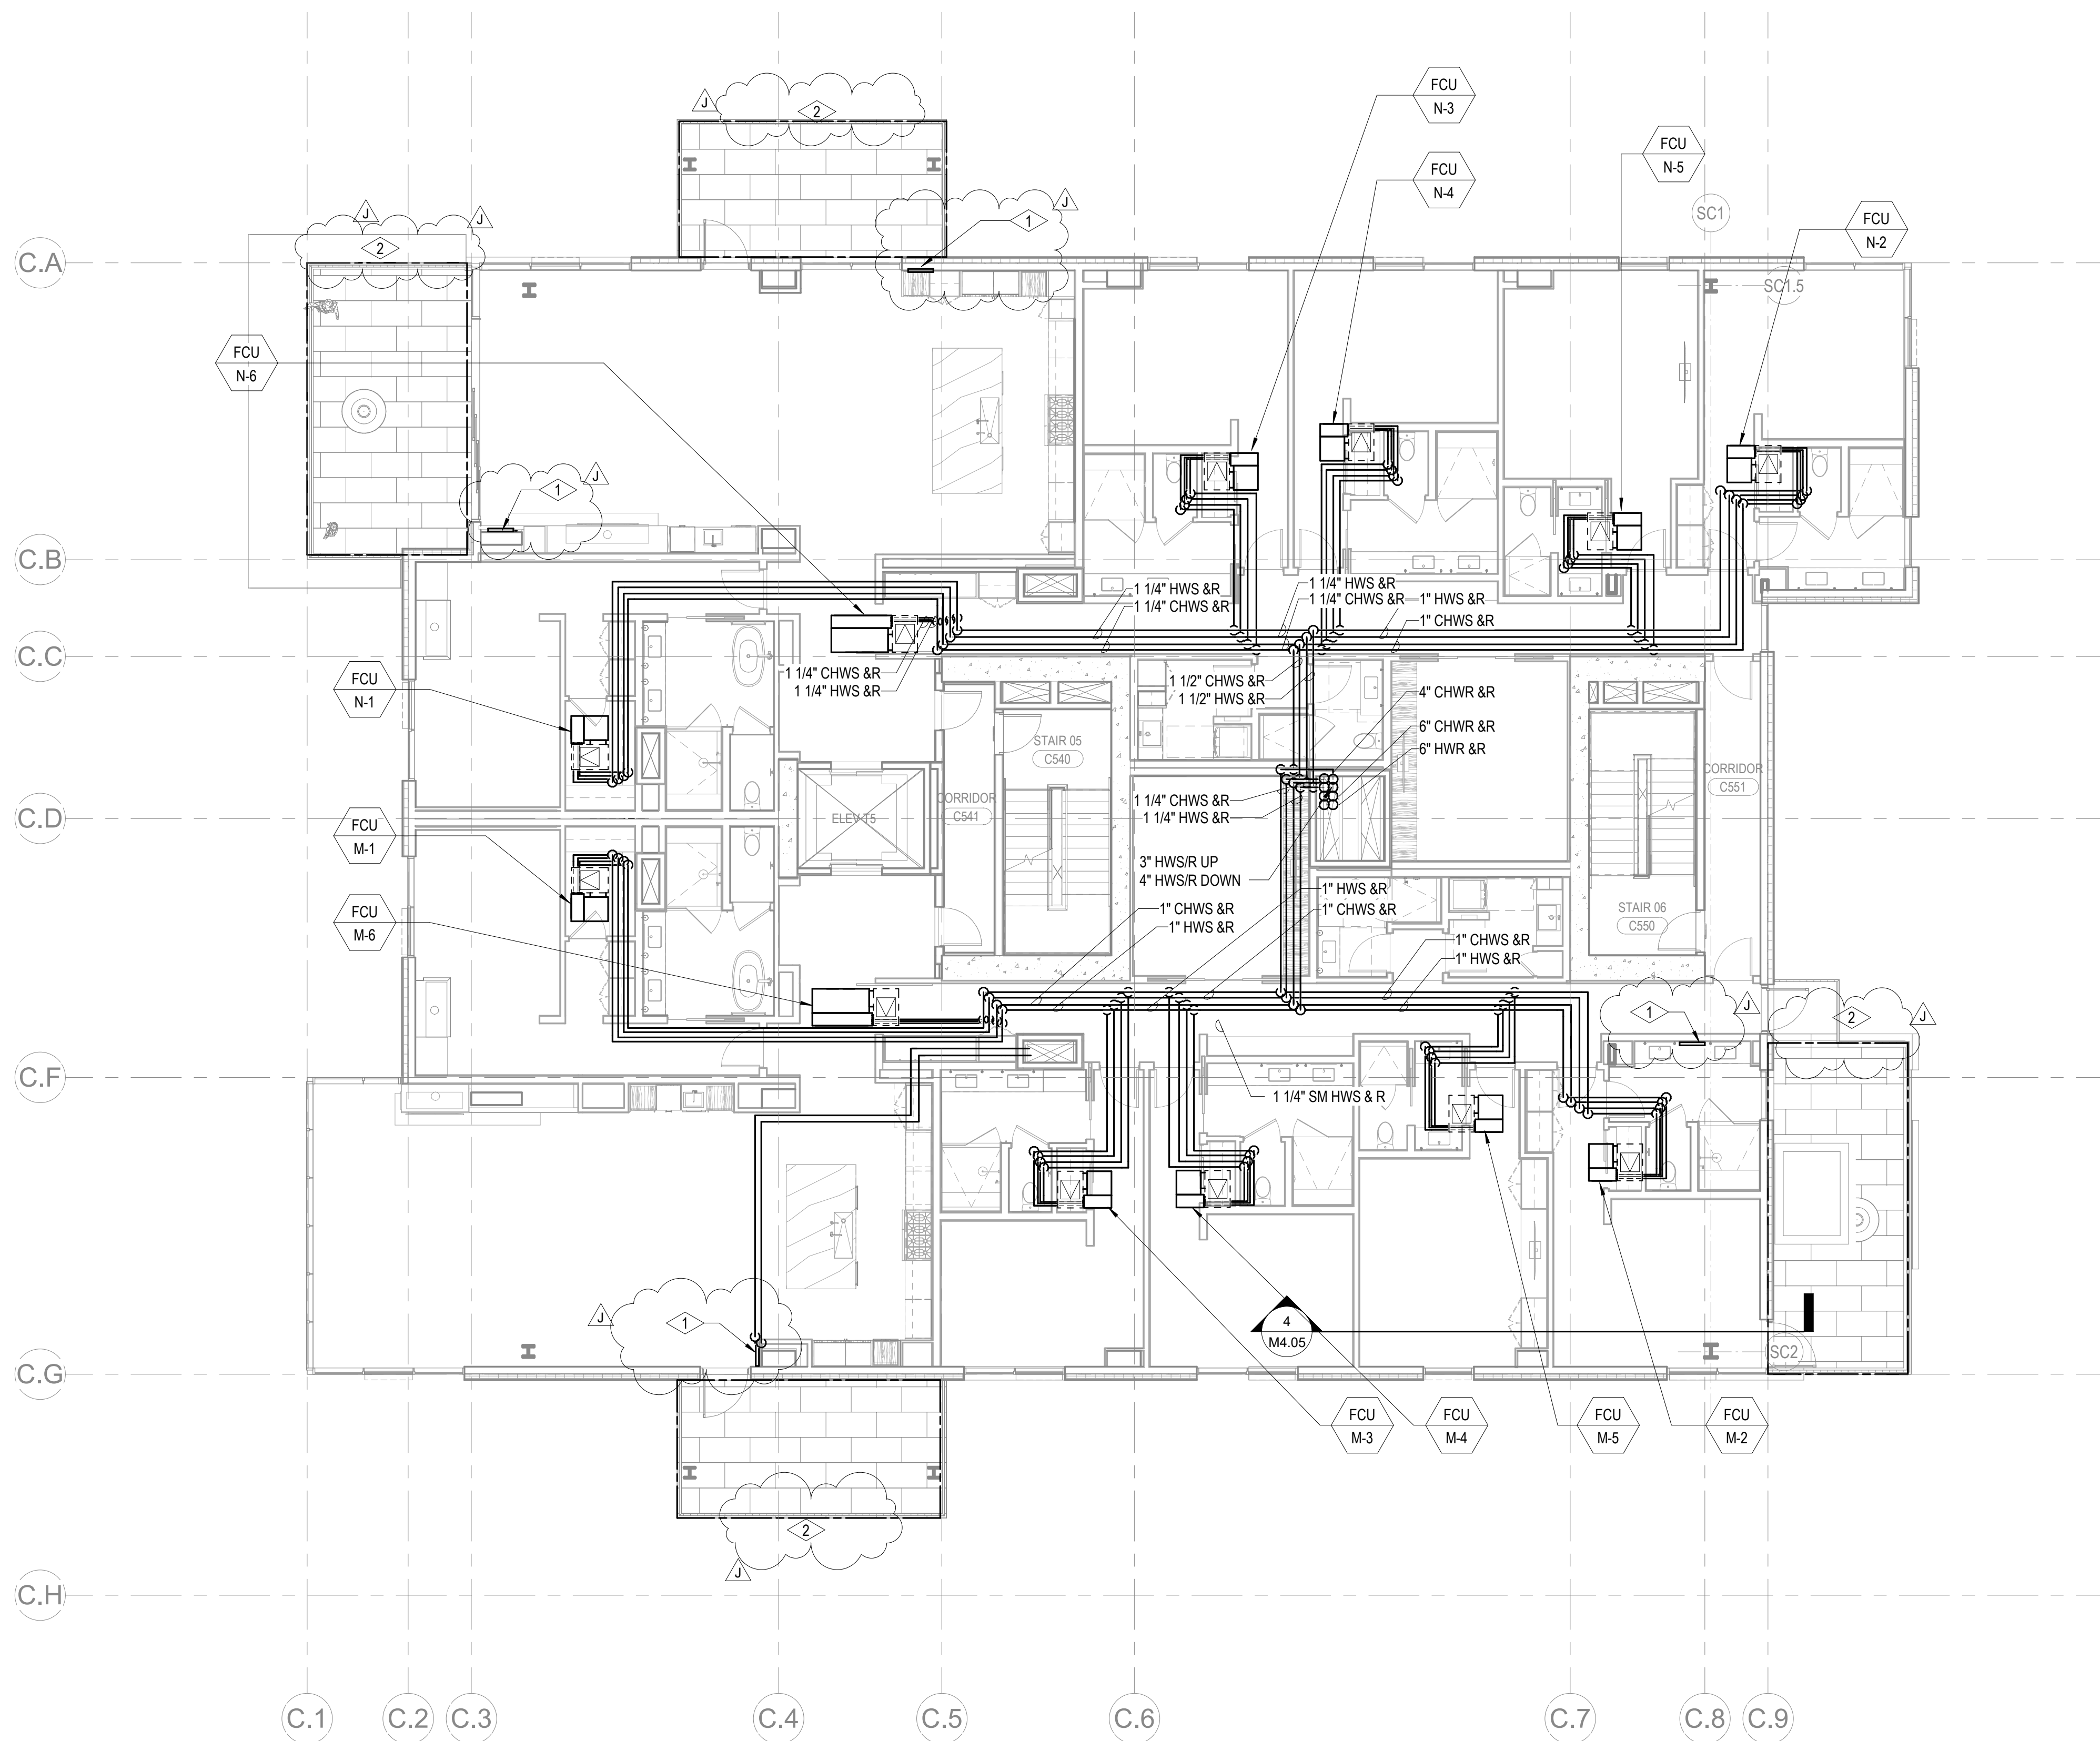

1 TOWER C - LEVEL 5 MECHANICAL PIPING PLAN
SCALE: 1/8" = 1'-0"

