


- A. ALL CHILLED WATER AND HOT WATER BRANCH PIPING SHALL BE SIZED AT 1" FOR ALL FAN COIL UNITS UNLESS OTHERWISE NOTED.
- B. REFER TO MANUFACTURER SPECIFICATIONS FOR REFRIGERANT PIPING SIZING FOR SPLIT SYSTEM FAN COILS.

1 PROVIDE HEAT TRACE ON ALL EXPOSED PIPING. REFER TO ELECTRICAL DRAWINGS FOR 120/1 CONNECTION

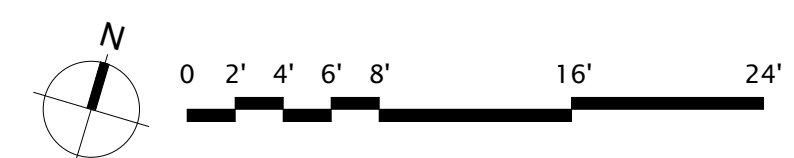

Olson Kundig

Olson Ku

project:
SOMMET BLANC
9300 Marsac Ave (B2 East Parcel)
Park City, Utah 84060



WSP USA
001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect _____
project manager _____
drawn by _____
checked by Checker
job no. _____
date 5/31/2024

revisions:

L	2/5/2025	ASI 6.1
J	01/16/2025	ASI 6
I	01/03/2025	ASI 6 old

no.	date	by
-----	------	----

IFC Set 3 of 3
5/31/2024

POWER B - ROOF MECHANICAL PIPING PLAN

M3.2B.R