- A. REFER TO M2.4 SERIES FOR ENLARGED PLANS. B. FIREPLACE FLUE ROUTING SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING AND SIZING DETAIL.
- MECHANICAL EQUIPMENT SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR DETAIL.
 ALL RESIDENTIAL TOILET EXHAUST, DRYER EXHAUST, AND KITCHEN RANGE HOOD EXHAUST TO BE PART
 OF A SUB-DUCT EXHAUST SYSTEM.

Reserved for permit stamp

• —

ASPEN GROUP Aspen Group USA, LLC PO Box 980022 Park City, Utah 84098

Pool Consultant
Cloward H20
2696 N University Ave, Suite 290
Provo, UT 84604 <u>Landscape Architect</u> **EPG Design**6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer Friday Group 88 Mainelli Road Middlebury, VT Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consulatant
Lerch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011 Structural Engineer

Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

<u>Lighting Designer</u> **O-**1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant RDH 2101 N 34th St Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154 principal architect_____

checked by <u>Checker</u>


M 4/7/2025 ASI 10

no. date

IFC Set 3 of 3

5/31/2024

TOWER A - LVL 6 MECHANICAL DUCT PLAN M2.2A.16

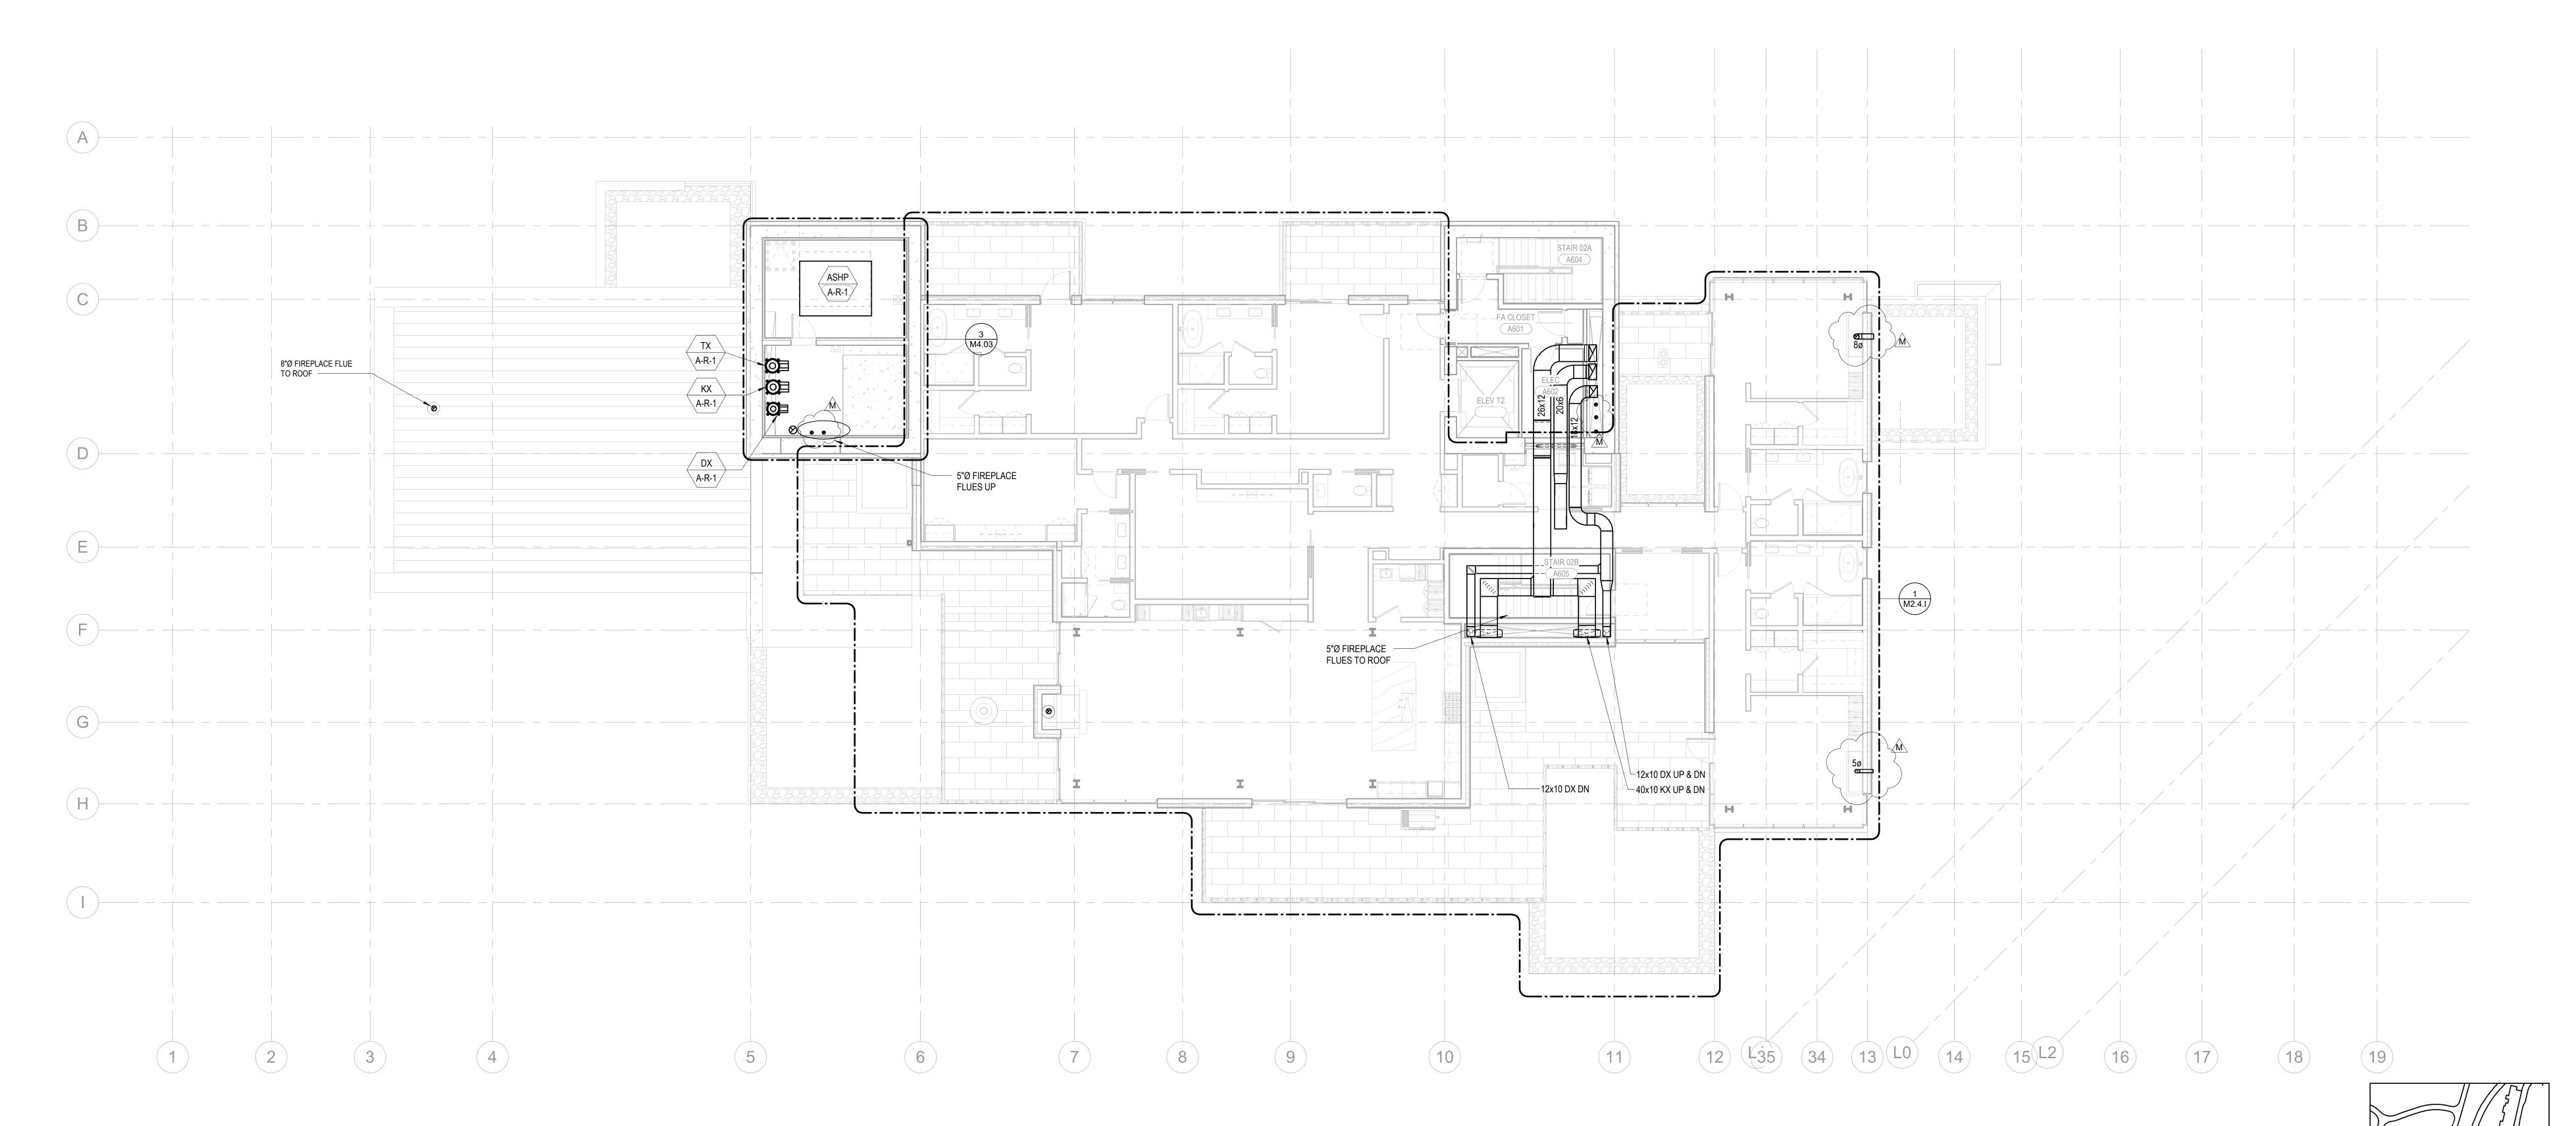

1 TOWER A - LEVEL 6 MECHANICAL DUCT PLAN

SCALE: 1/8" = 1'-0"