

159 South Jackson St, Suite 600
Seattle, Washington 98104 USA
+1 206 624 5670 osontkundg.com

Olson Kundaig

SUMME I BLANC
9300 Marsac Ave (B2 East Parcel)
Park City, Utah 84060



P Engineer
P USA
1 Fourth Ave., Suite 3100

principal architect _____
project manager _____
drawn by _____
checked by Checker _____
job no. _____
date 5/31/2024

198:

[illegible]

2/2025 ASI-011 - WSP

date by

IFC Set 3 of 3
5/31/2024

POWER A - LVL 1
ELECTRICAL LIGHTING
PLAN

3.2A.11

A. DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT DIMENSIONS. DIMENSIONS SHALL BE DETERMINED BY THE CONTRACTOR FROM THE PLANS USING STANDARD INDUSTRY SYMBOLS, BEFORE ORDERING MATERIALS OR COMMENCEMENT WITH WORK. VARY MEASUREMENTS PERTAINING THERETO AND OBTAINING REQUIRED MATERIALS SHALL BE THE CONTRACTOR'S RESPONSIBILITY.

B. DRAWINGS AND CONDITIONS IN THE FIELD SHALL BE SUBMITTED TO THE CONSTRUCTION MANAGER FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

C. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL MATERIALS REQUIRED TO INSTALL A COMPLETE ELECTRICAL SYSTEM AS INDICATED ON DRAWINGS AND SPECIFICATIONS. THE CONTRACTOR SHALL OBTAIN ALL NECESSARY PERMITS AND NOTICES NOTED AS EMERGENCY POWER ELECTRICAL SYSTEMS AS INDICATED ON PLANS.


D. REFER TO LUMINAIR SCHEDULE FOR INFORMATION.

E. FEATURE CATALOG NUMBERS MAY VARY FROM THE CHANGE BY MANUFACTURER. REFER TO FEATURE CATALOG NUMBERS FOR ACCURACY.

F. VARY EQUIPMENT SIZES AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY OTHERS.

G. ELECTRICAL CONDUITS IN FINISHED SPACES SHALL BE CONCEALED, COORDINATE WITH OTHER TRADES AND USE CHASES AND CEILING SPACES. LOCATIONS OF ELECTRICAL JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO POUR-IN.

#

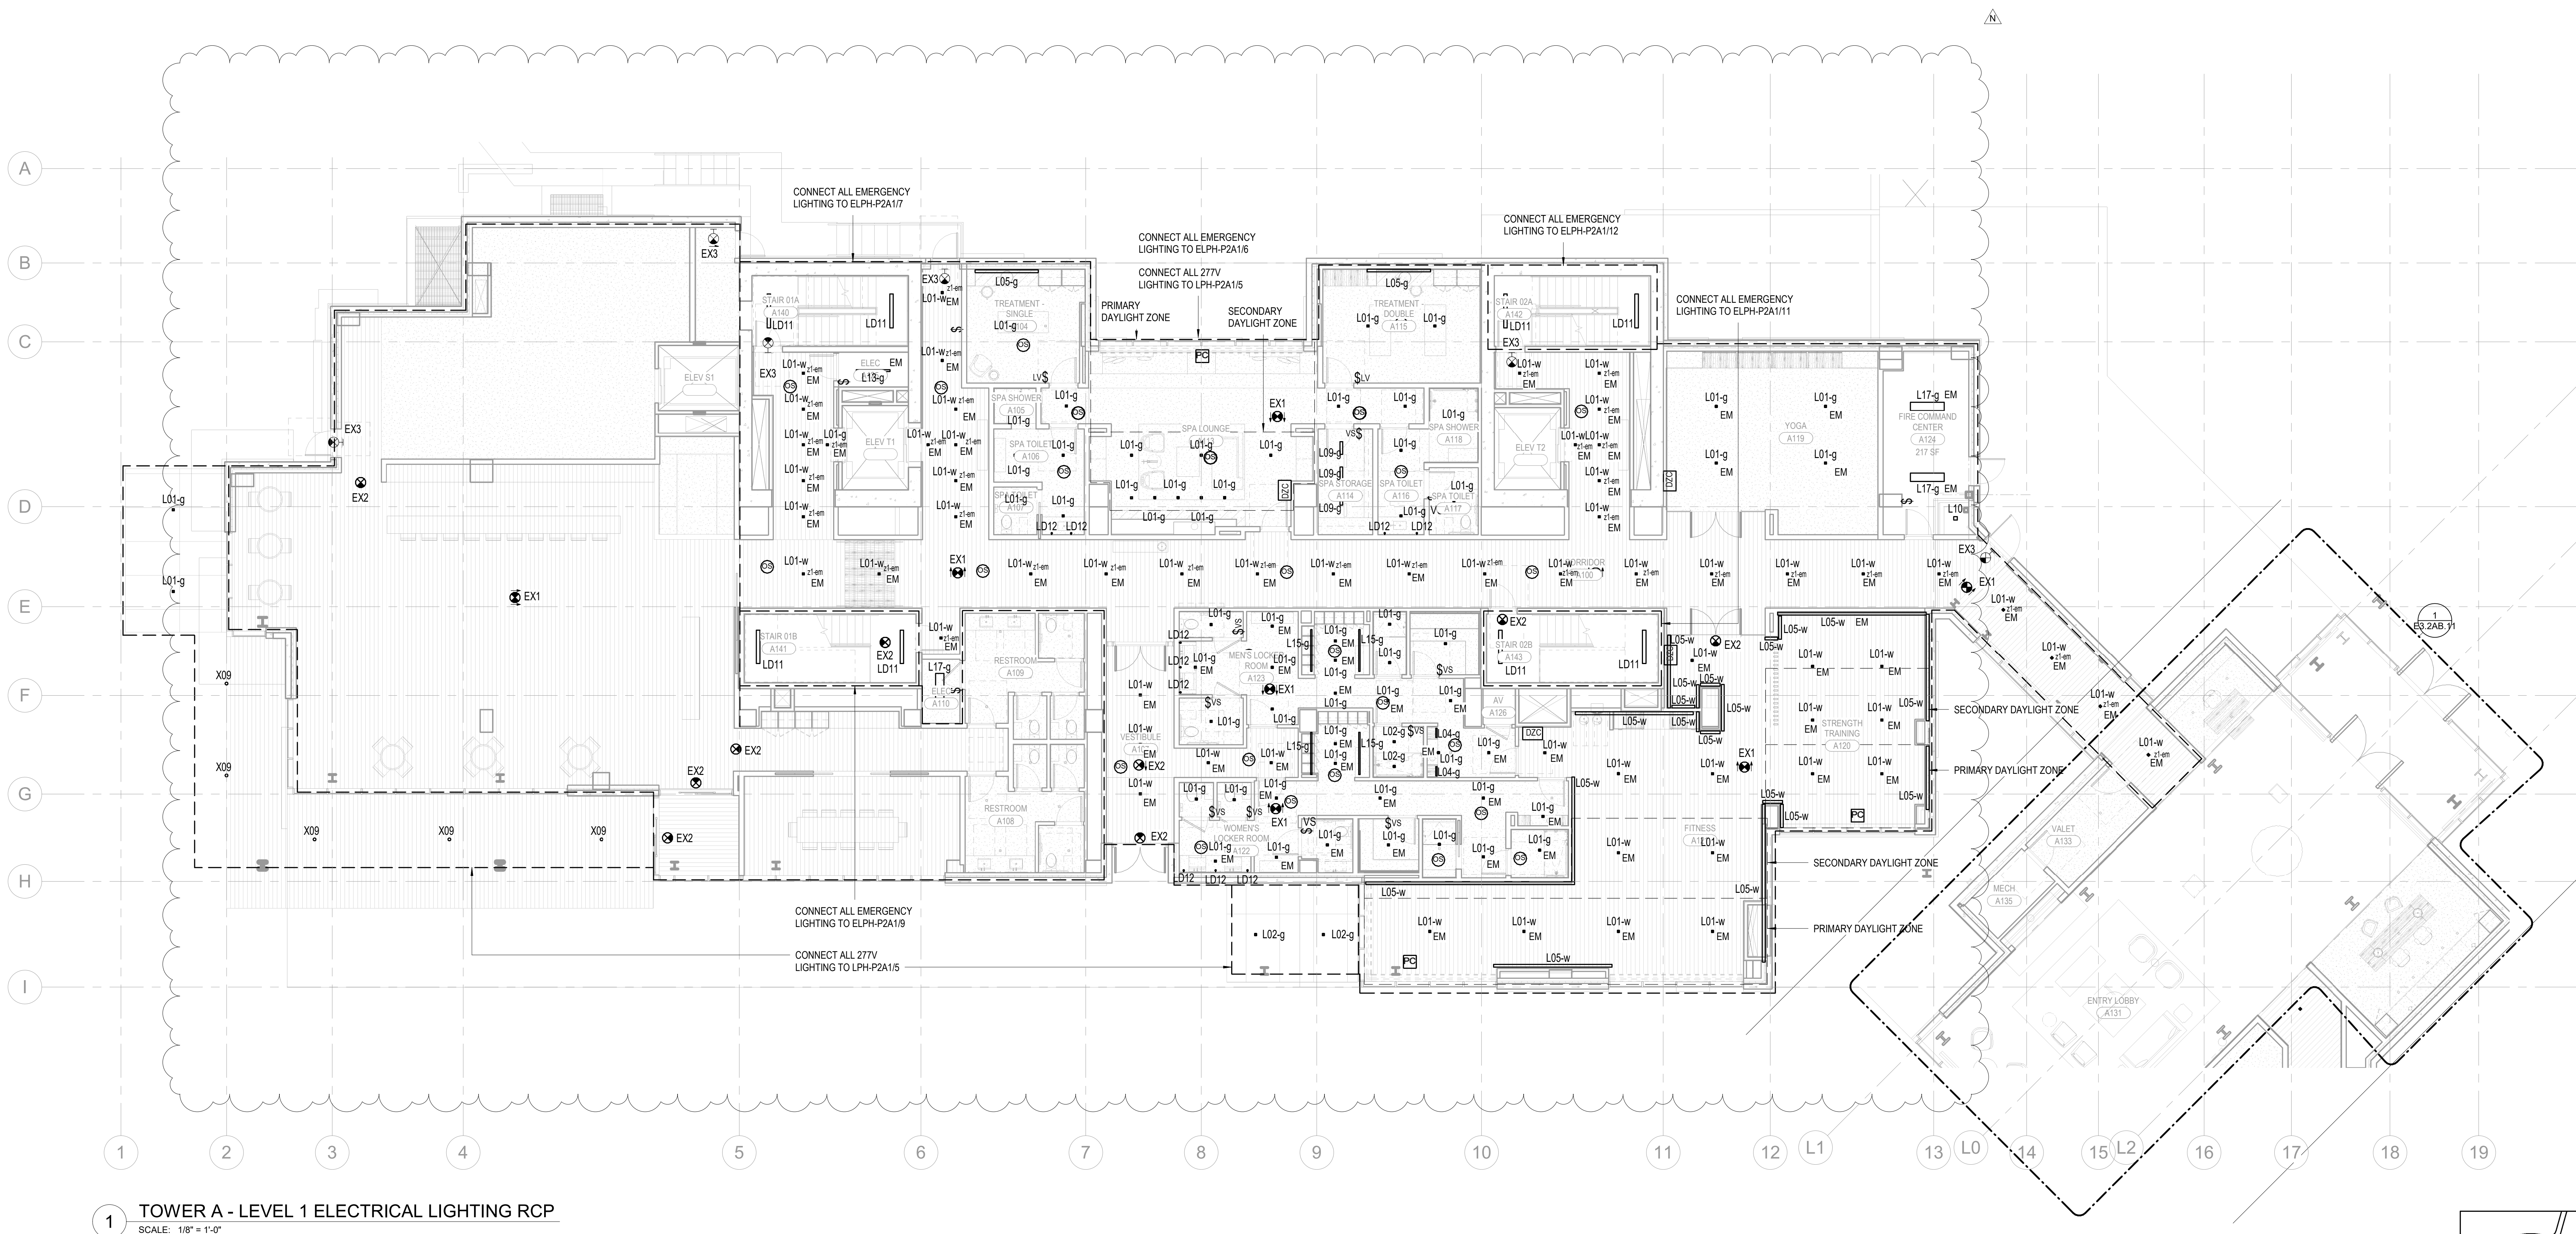

1 TOWER A - LEVEL 1 ELECTRICAL LIGHTING RCP
SCALE: 1/8" = 1'-0"

