


159 South Jackson St, Suite 800
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

project:
SOMMET BLANC
9300 Marsac Ave (B2 East Parcel)
Park City, Utah 84060

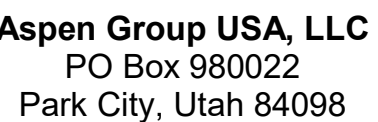

P Engineer
P USA
1 Fourth Ave., Suite 3100
Seattle, WA 98154

ions:

5/2/2025	ASI-011 - WSP
5/31/2024	IFC 3

date	b
------	---

POWER A/B ELECTRICAL
LIGHTING PLAN - UNIT F

E3.4.F

A. DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATION OF WORK WHERE CONDITIONS IN THE FIELD DIFFER FROM THOSE SHOWN ON PLANS USING STANDARD INDUSTRY SYMBOLS. BEFORE ORDERING MATERIALS OR COMMENCEMENT WITH WORK, VERY MEASUREMENTS PERTAINING THERETO AND ASSUME RESPONSIBILITY THEREFOR, ANY SUBSTANTIAL DIFFERENCES BETWEEN DRAWING CONDITIONS IN THE FIELD, AND THE FIELD CONDITIONS. THE CONSTRUCTION MANAGER FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

B. WORK PERFORMANCE INCLUDES LABOR, MATERIALS, AND EQUIPMENT REQUIRED TO INSTALL A COMPLETE SYSTEM. ALL MATERIALS AND EQUIPMENT TO BE SUBMITTED TO THE PROJECT FOR TYPE, SIZE, AND QUANTITY. ALL MATERIALS AND EQUIPMENT TO BE SUBMITTED TO THE PROJECT FOR TYPE, SIZE, AND QUANTITY.

C. PROVIDE EXTERIOR SIGNS AND CONNECT EXTERIOR SIGNS AND LUMINAIRES NOTED AS EMERGENCY TO EMERGENCY POWER SOURCE AS INDICATED ON PLANS.

D. REFER TO MATERIALS SCHEDULE FOR INFORMATION ON PLANS.

E. FIXTURE CATALOG NUMBERS AND SPECIFICATIONS TO BE SUBMITTED BY MANUFACTURER, VERY FIXTURE CATALOG NUMBERS FOR ACCURACY.


F. VERY EQUIPMENT TYPES AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY OTHERS.

G. ELECTRICAL CONDITIONS IN FINISHED SPACES SHALL BE CONCEALED. COORDINATE WITH OTHER TRADES AND USE CHASES AND CEILING SPACES. LOCATIONS OF ELECTRICAL JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO ROUGH-IN.

H. COORDINATE REMOTE DRIVER MOUNTING LOCATIONS WITH ARCHITECT PRIOR TO ROUGH-IN.

I. COORDINATE LUMINAIRE VOLTAGE WITH ARCHITECT AND OWNER PRIOR TO PURCHASE AND INSTALLATION TYPE FOR ALL UNIT LIGHTING.

- 1 LUTRON WIRELESS PICO CONTROL SWITCH IS TO BE SUPPLIED AND INSTALLED FOR SHADE CONTROL.
- 2 LIGHT FIXTURE LOCATED IN CLOSETS ARE TO BE CONTROLLED BY CLOSET DOOR JAMB SWITCH.
- 3 SUPPLY AND INSTALL LUTRON RADIO RAZ SYSTEM TO PROVIDE PARTIAL LIGHTING IN THE RESIDENTIAL ZONES. MASTER BEDROOM (INCLUDED AS BED 1) AND ALL ROOMS WITH MORE THAN THREE (3) LIGHTING CONTROL ZONES ARE TO BE CONTROLLED BY THE LUTRON RADIO RAZ SYSTEM. ALL ROOMS WITH THREE (3) LIGHTING CONTROL ZONES OR LESS ARE TO BE CONTROLLED BY LOCAL DIMMERS.
- 4 SUPPLY AND INSTALL CEILING MOUNTED JUNCTION BOX COMPLETE WITH CAPPED LIGHTING CIRCUIT WIRING FOR INSTALLATION OF FUTURE CLOSET LIGHT FIXTURE.
- 5 COORDINATE WITH ARCHITECTURAL DRAWINGS AND ELEVATIONS FOR EXACT DIMENSION AND MOUNTING LOCATION OF LIGHT FIXTURE TYPE, LOW. COORDINATE WITH MILLWORK CONTRACTOR PRIOR TO INSTALLATION.

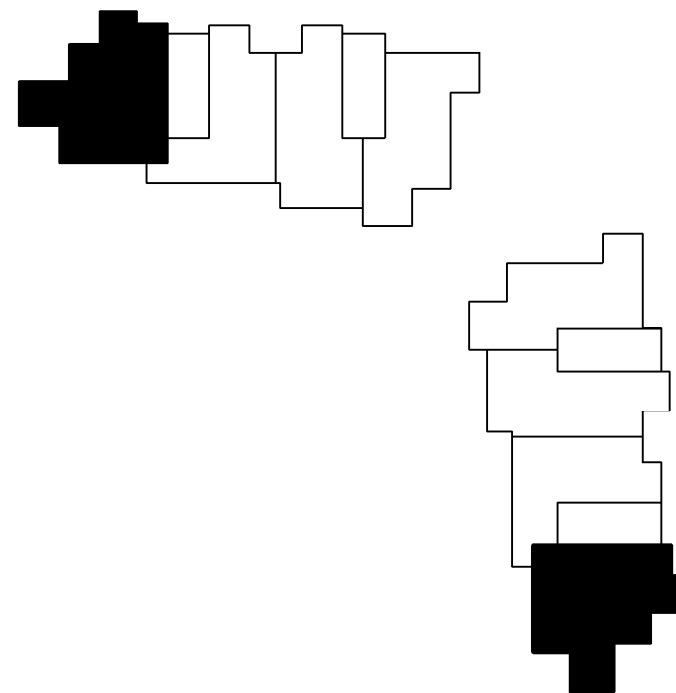

TOWER A/B - ELECTRICAL LIGHTING PLAN - UNIT F