


159 South Jackson St, Suite 800  
Seattle, Washington 98104 USA  
+1 206 624 5670 [disontkunding.com](mailto:disontkunding.com)

project:  
**SOMMET BLANC**  
9300 Marsac Ave (B2 East Parcel)  
County: Clark City: Las Vegas 89109

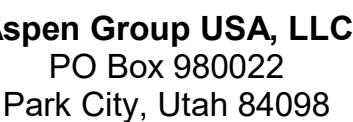

A. DRAWINGS ARE INTENDED TO SHOW GENERAL ARRANGEMENT, DESIGN, AND EXTENT OF WORK AND ARE DIAGRAMMATIC. DRAWINGS ARE NOT INTENDED TO SHOW EXACT LOCATIONS EXCEPT WHERE DIMENSIONS ARE SHOWN. ELECTRICAL WORK IS SHOWN ON PLANS AND IN ELEVATIONS. CONTRACTOR SHALL BE RESPONSIBLE FOR THE LOCATION, COMMENCEMENT WITH WORK, VERY MEASUREMENTS PERTAINING THERETO AND ASSUME RESPONSIBILITY THEREFOR, ANY SUBSTANTIAL DIFFERENCES BETWEEN DRAWINGS AND CONDITIONS IN THE FIELD SHALL BE SUBMITTED TO THE CONSTRUCTION MANAGER FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

B. WORK PERFORMANCE INCLUDES LABOR, MATERIALS, AND EQUIPMENT REQUIRED TO INSTALL ELECTRICAL SYSTEMS. CONTRACTOR SHALL BE RESPONSIBLE FOR THE LOCATION, COMMENCEMENT WITH WORK, VERY MEASUREMENTS PERTAINING THERETO AND ASSUME RESPONSIBILITY THEREFOR, ANY SUBSTANTIAL DIFFERENCES BETWEEN DRAWINGS AND CONDITIONS IN THE FIELD SHALL BE SUBMITTED TO THE CONSTRUCTION MANAGER FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

C. PROVIDE CABLES AND CONNECT EXISTING SIGNALS AND LUMINAIRES NOTED AS INSTANT TO EMERGENCY POWER SOURCE AS INDICATED ON PLANS.

D. REFER TO LUMINAIRE SCHEDULE FOR INFORMATION.

E. FIVE (5) CABLE NUMBERS ARE LISTED TO CHANGE BY MANUFACTURER, VERIFY CATALOG NUMBERS FOR ACCURACY.


F. VERIFY EQUIPMENT SIZES AND POWER REQUIREMENTS FOR EQUIPMENT PROVIDED BY OTHERS.

G. ELECTRICAL CONDUITS IN FINISHED SPACES SHALL BE CONCEALED. COORDINATE WITH OTHER TRADES AND USE CHASES AND CEILING SPACES. LOCATIONS OF ELECTRICAL JUNCTION BOXES IN FINISHED SPACES SHALL BE APPROVED BY ARCHITECT PRIOR TO ROUTING.

H. COORDINATE REMOTE DRIVER MOUNTING LOCATIONS WITH ARCHITECT PRIOR TO ROUTING.

I. COORDINATE LUMINAIRE VOLTAGE WITH ARCHITECT AND OWNER PRIOR TO PURCHASE AND INSTALLATION TYPE, FOR ALL UNIT LIGHTING.

1 LIGHT FIXTURE LOCATED IN CLOSETS ARE TO BE CONTROLLED BY CLOSEST DOOR JAMB SWITCH.  
2 LUTRON WIRELESS PIR CONTROL SWITCH IS TO BE SUPPLIED AND INSTALLED IN EACH CLOSET.  
3 SUPPLY AND INSTALL LUTRON RADIO RAS2 SYSTEM TO PROVIDE PARTIAL LIGHTING CONTROL. IN THE RESIDENTIAL UNITS, MASTER  
4 BEDROOM (DESIGNATED AS BED 1) AND ALL ROOMS WITH MORE THAN THREE (3) LIGHTING CONTROL ZONES ARE TO BE  
5 CONTROLLED BY THE LUTRON RADIO RAS2 SYSTEM. ALL ROOMS WITH THREE (3) LIGHTING CONTROL ZONES OR LESS ARE TO  
6 BE CONTROLLED BY LOCAL DIMMERS.  
7 SUPPLY AND INSTALL CEILING MOUNTED JUNCTION BOX COMPLETE WITH CAPPED LIGHTING CIRCUIT WIRING FOR INSTALLATION  
8 OF FUTURE CLOSET LIGHT FIXTURE.  
9 REFER TO ARCHITECTURAL DRAWINGS AND ELEVATIONS FOR EXACT DIMENSION AND MOUNTING LOCATION OF LIGHT FIXTURE  
10 TYPE, LOW COORDINATE WITH MILLWORK CONTRACTOR PRIOR TO INSTALLATION.

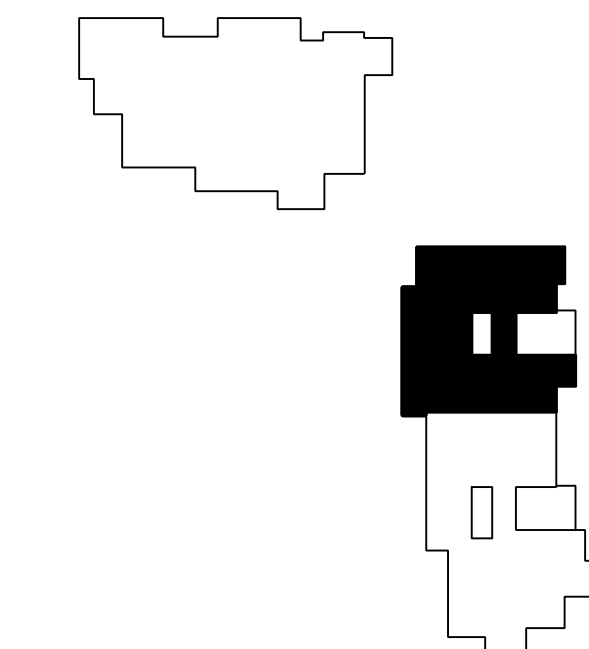

SCALE: 1/4" = 1'-0"