


Olson Kundig

project:
SOMMET BLANC
9300 Marsac Ave (B2 East Parcel)

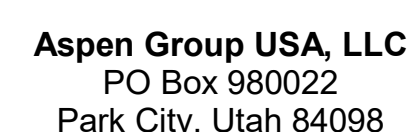

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

revisions

0 5/9/2025 AS-012

no.	date	
-----	------	--

IFC Set 3 of 3
5/31/2024


TOWER B - LVL B
MECHANICAL DUCT
PLAN

M2.2B.01

NUMBERED NOTES:

- | | |
|----|---|
| B. | REFER TO M2.4 SERIES FOR ENLARGED PLANS. |
| A. | FIREPLACE FLUE ROUTING SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR ROUTING AND DETAILED SIZING. |
| C. | MECHANICAL EQUIPMENT SHOWN FOR REFERENCE. REFER TO ENLARGED UNIT PLANS FOR DETAIL. |
| D. | ARCHITECT SHALL PROVIDE 1" SOFT N/A OPENINGS IN ALL FULL HEIGHT, NON-RATED WALLS FOR RETURN AIR PATHS IF NO DUCT TRANSFER IS SHOWN. |
| E. | MECHANICAL EQUIPMENT SHOWN FOR REFERENCE. FLEX DUCT IN THE PLENUM SHALL BE PLENUM RATED. |
| F. | FLEX DUCT SHALL NOT BE INSTALLED ABOVE FINISHED HARD-CEILING CEILINGS. |
| G. | PROVIDE BUTTON TYPE TEMPERATURE SENSOR IN PUBLIC AREAS. SEE DETAIL-13, SHEET M5.04. |
| H. | PROVIDE BATTERY OPERATED TEMPERATURE SENSOR IN DIFFUSERS ABOVE HARD-CEILING CEILINGS. SEE DETAIL-9, SHEET M5.04. |

- 1 PREFACE 44X10 TRANSFER DUCT INTO MECH ROOM
- 2 GRILL AND DUCTWORK BACK TO BRANCH LINE SHALL BE
- 3 STAINLESS STEEL CONSTRUCTION
- 4 3" FREE AIR GAP ALONG THIS WALL FOR RETURN AIR. SEE
- 5 ARCH DRAWINGS
- 6 WALL GRILL SHALL BE ABOVE FINISHED CEILING. FSD
- 7 ACCESS IN ELECTRICAL ROOM
- 8 REMAINING 3" GAP NOT OCCUPIED BY LINEAR DIFFUSER IN
- 9 THIS LINE SHALL BE BLANKED OFF TO RETURN AIR AT THIS
- 10 LOCATION
- 11 DISCHARGE AND/OR INTAKE ABOVE CEILING PLENUM.
- 12 PROTECT OPENING WITH WMS

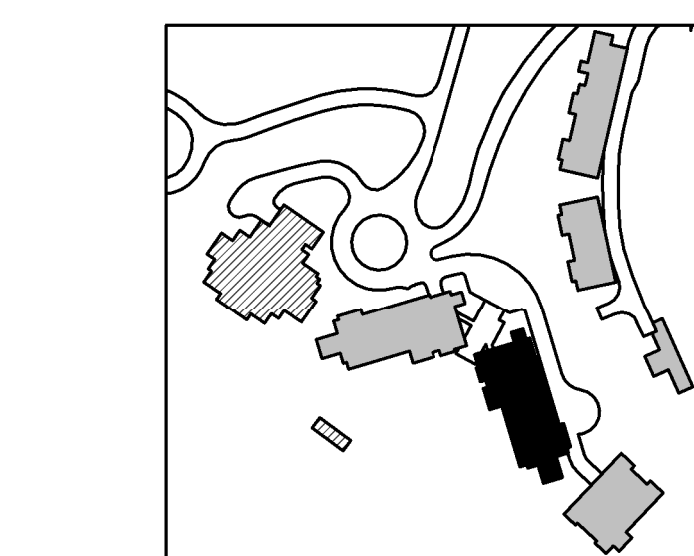

1 TOWER B - LEVEL B1 MECHANICAL DUCT PLAN
SCALE: 1/8" = 1'-0"