

1. SCOPE OF WORK INCLUDES SPRINKLER PROTECTION THROUGHOUT ALL AREAS IN ACCORDANCE WITH NFPA 13. SPRINKLERS ARE INDICATED IN AREAS WITH FINISHED CEILINGS FOR COORDINATION PURPOSES. INSTALLING CONTRACTOR SHALL BE RESPONSIBLE FOR DETAILED DESIGN OF BRANCH PIPING AND UPRIGHT SPRINKLERS IN AREAS WITHOUT FINISHED CEILINGS. 2. REFER TO TYPICAL UNIT PLANS FOR SPRINKLER LAYOUTS ON RESIDENTIAL FLOORS.

SHEET KEYED NOTES:

- 1 1.5" CONNECTION FOR KITCHEN PCU. PROVIDE ACCESS PANEL FOR ISOLATION VALVE.



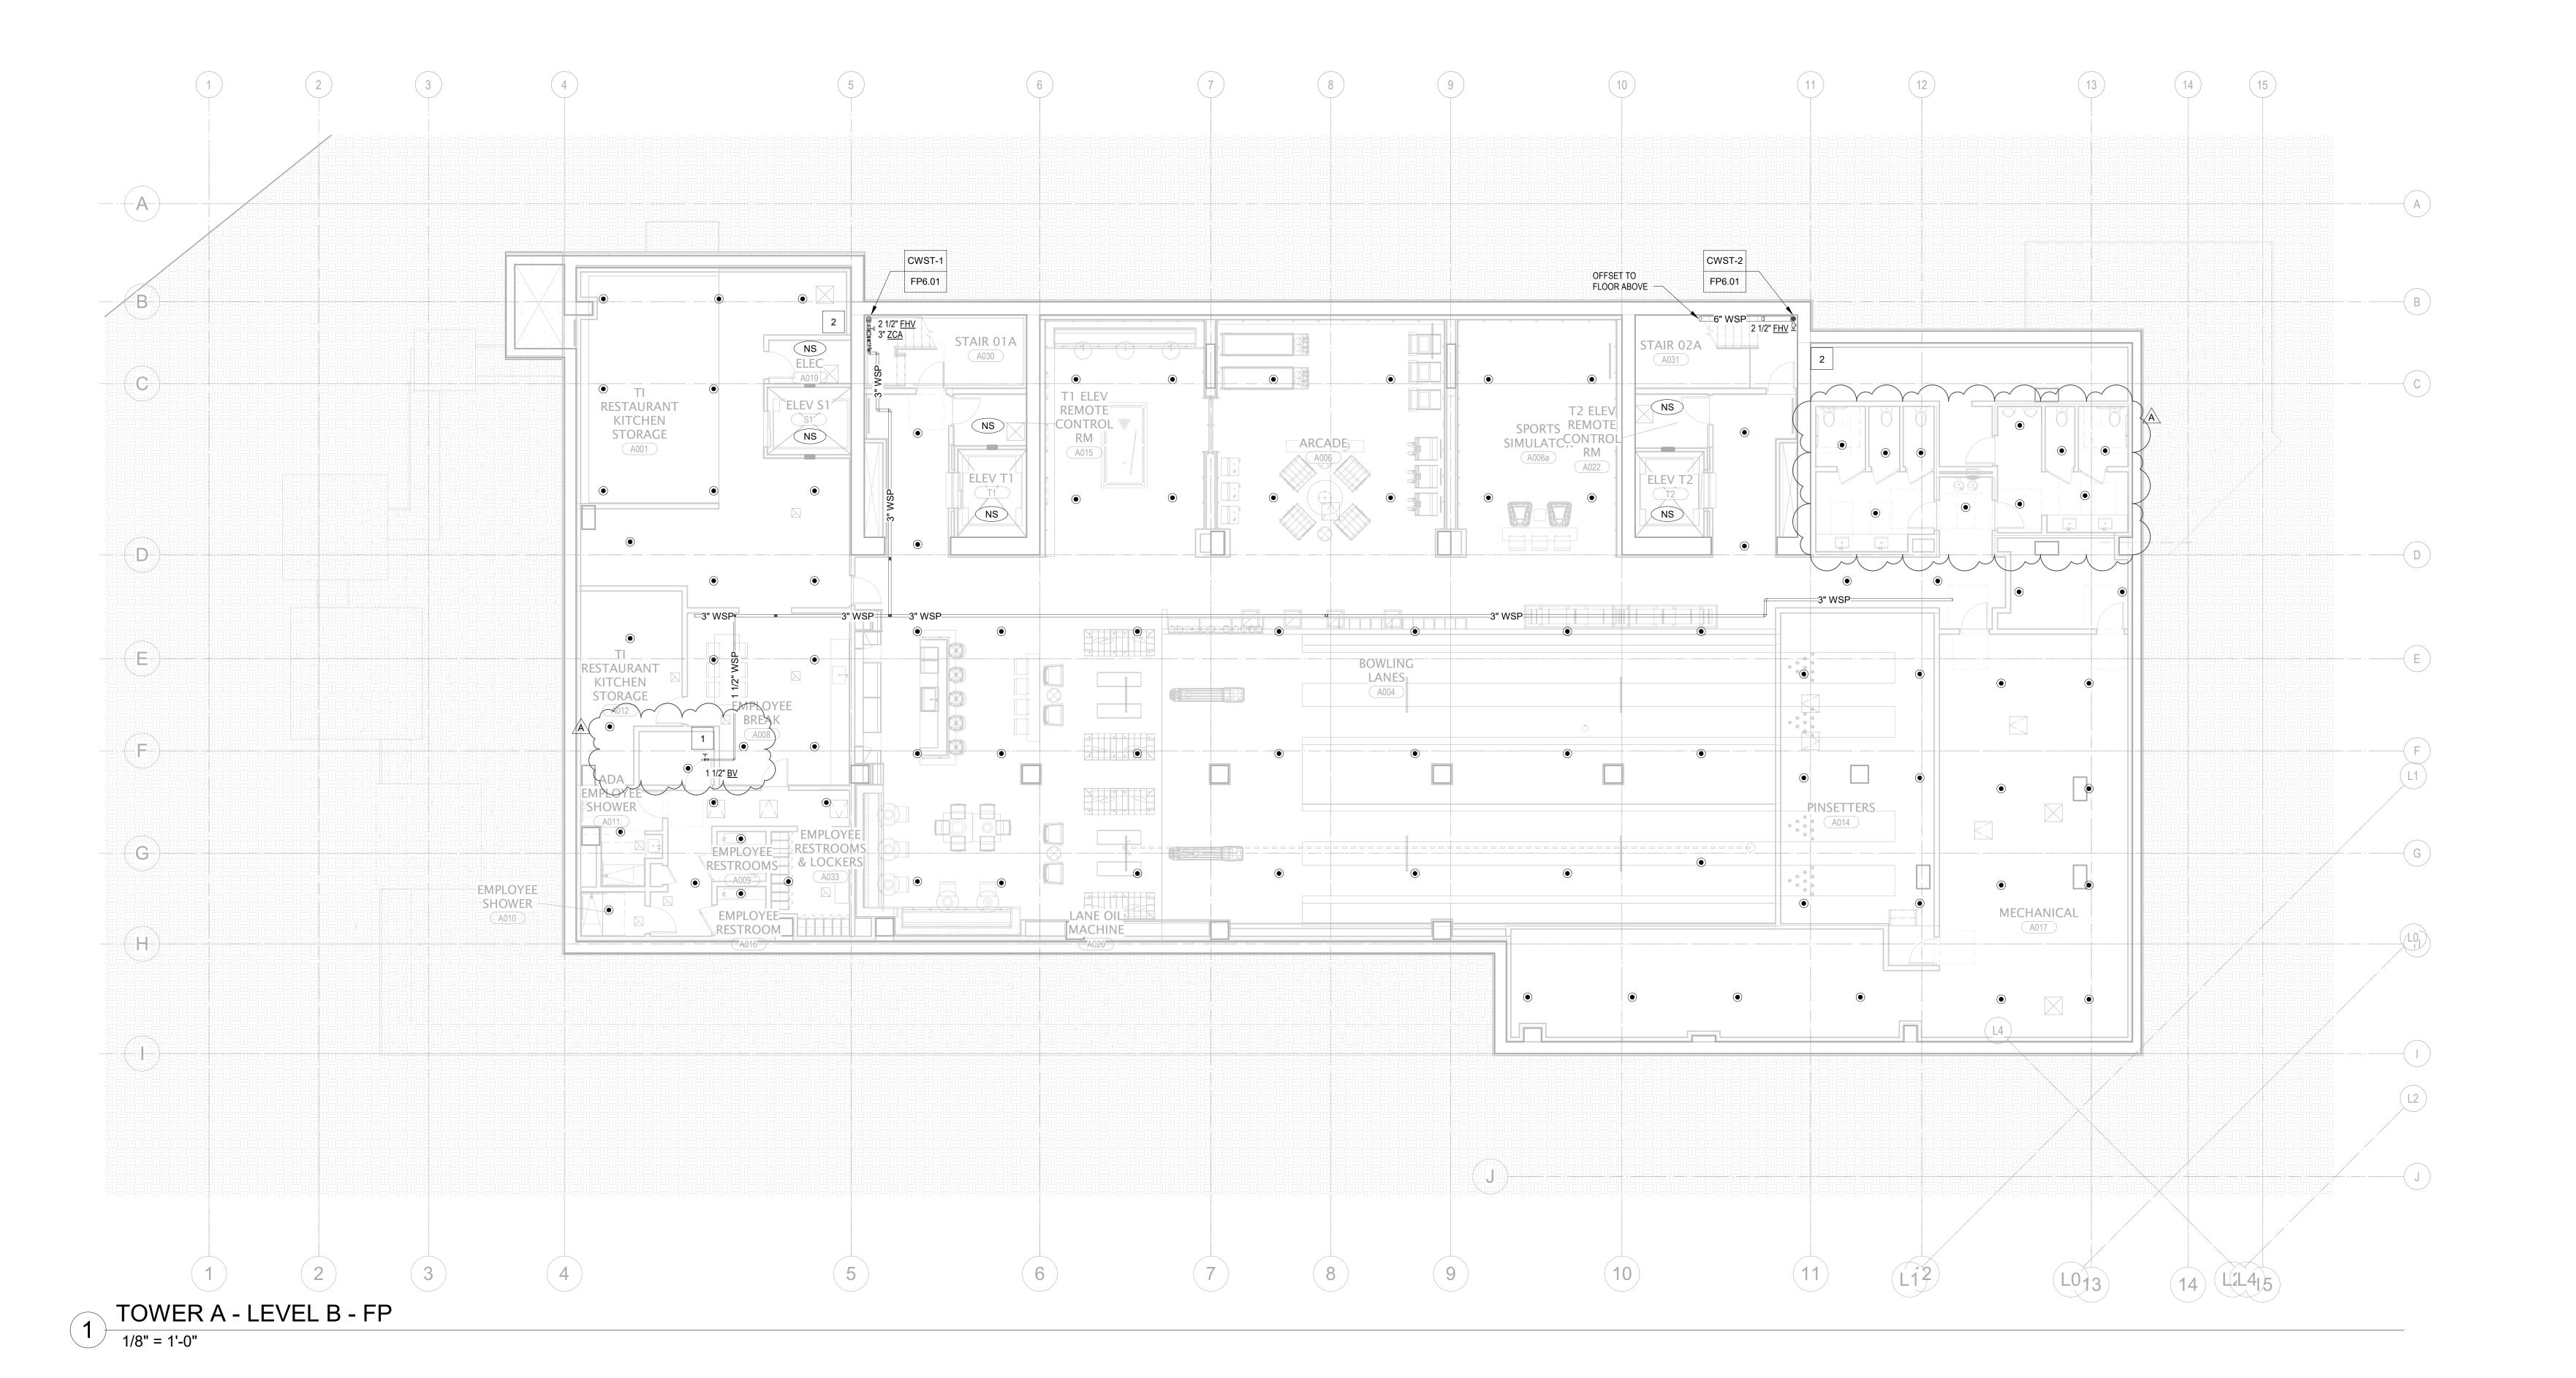



Reserved for permit stamp

<u>Q</u>

Aspen Group USA, LLC PO Box 980022 Park City, Utah 84098

Pool Consultant
Cloward H20
2696 N University Ave, Suite 290
Provo, UT 84604 <u>Landscape Architect</u> **EPG Design**6949 South High Tech Drive, Suite 100
Midvale, Utah 84047 Specifications Writer Friday Group 88 Mainelli Road Middlebury, VT Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104 Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581 Vertical Transportation Consulatant Lerch Bates 19515 North Creek Parkway, Suite 304 Bothell, WA 98011 Structural Engineer

Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101 <u>Lighting Designer</u> **O-**1319 SE MLK Blvd, Suite 210 Portland, Oregon 97219 Building Envelope Consultant RDH 2101 N 34th St Seattle, WA 98103 Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109 MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect_____ project manager <u>JCC</u>

drawn by <u>CRB, SMK</u> checked by Checker job no. 20052 A 05/08/25 ASI-012 - JH no. date

> IFC Set 2 of 3 05/17/2024

FIRE PROTECTION PLAN
- TOWER A - LVL B FP2.2A.01