
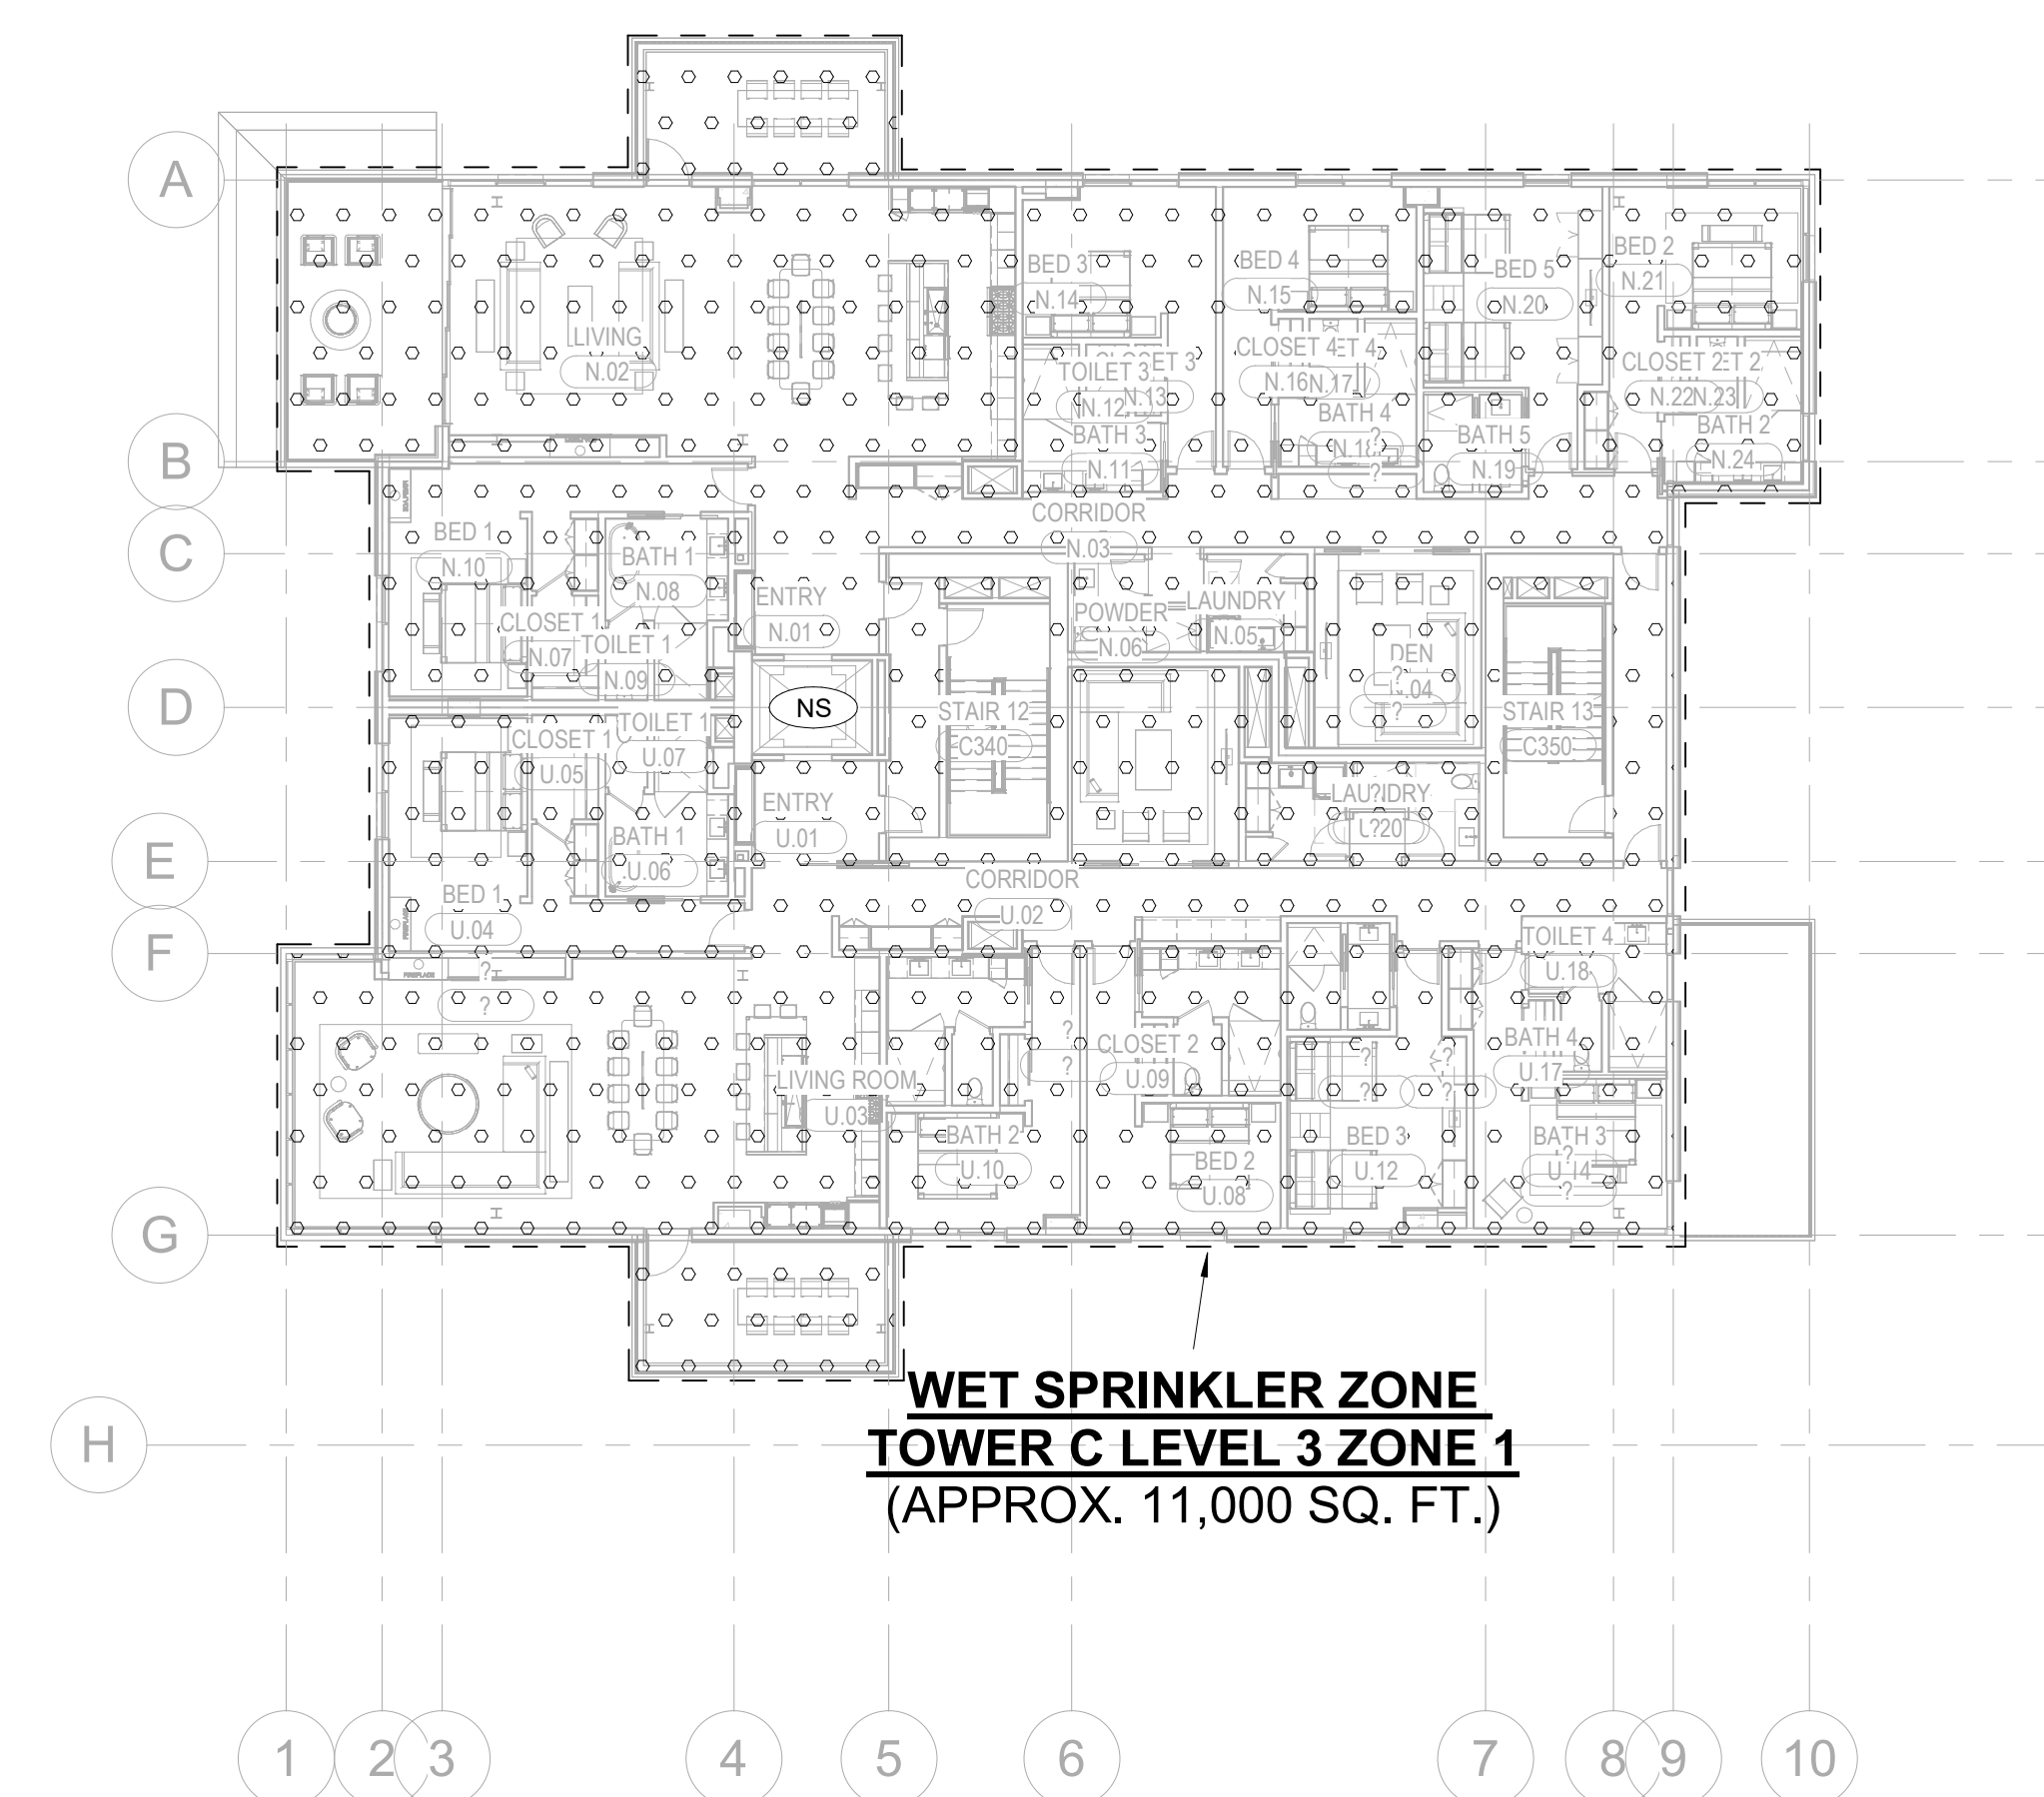
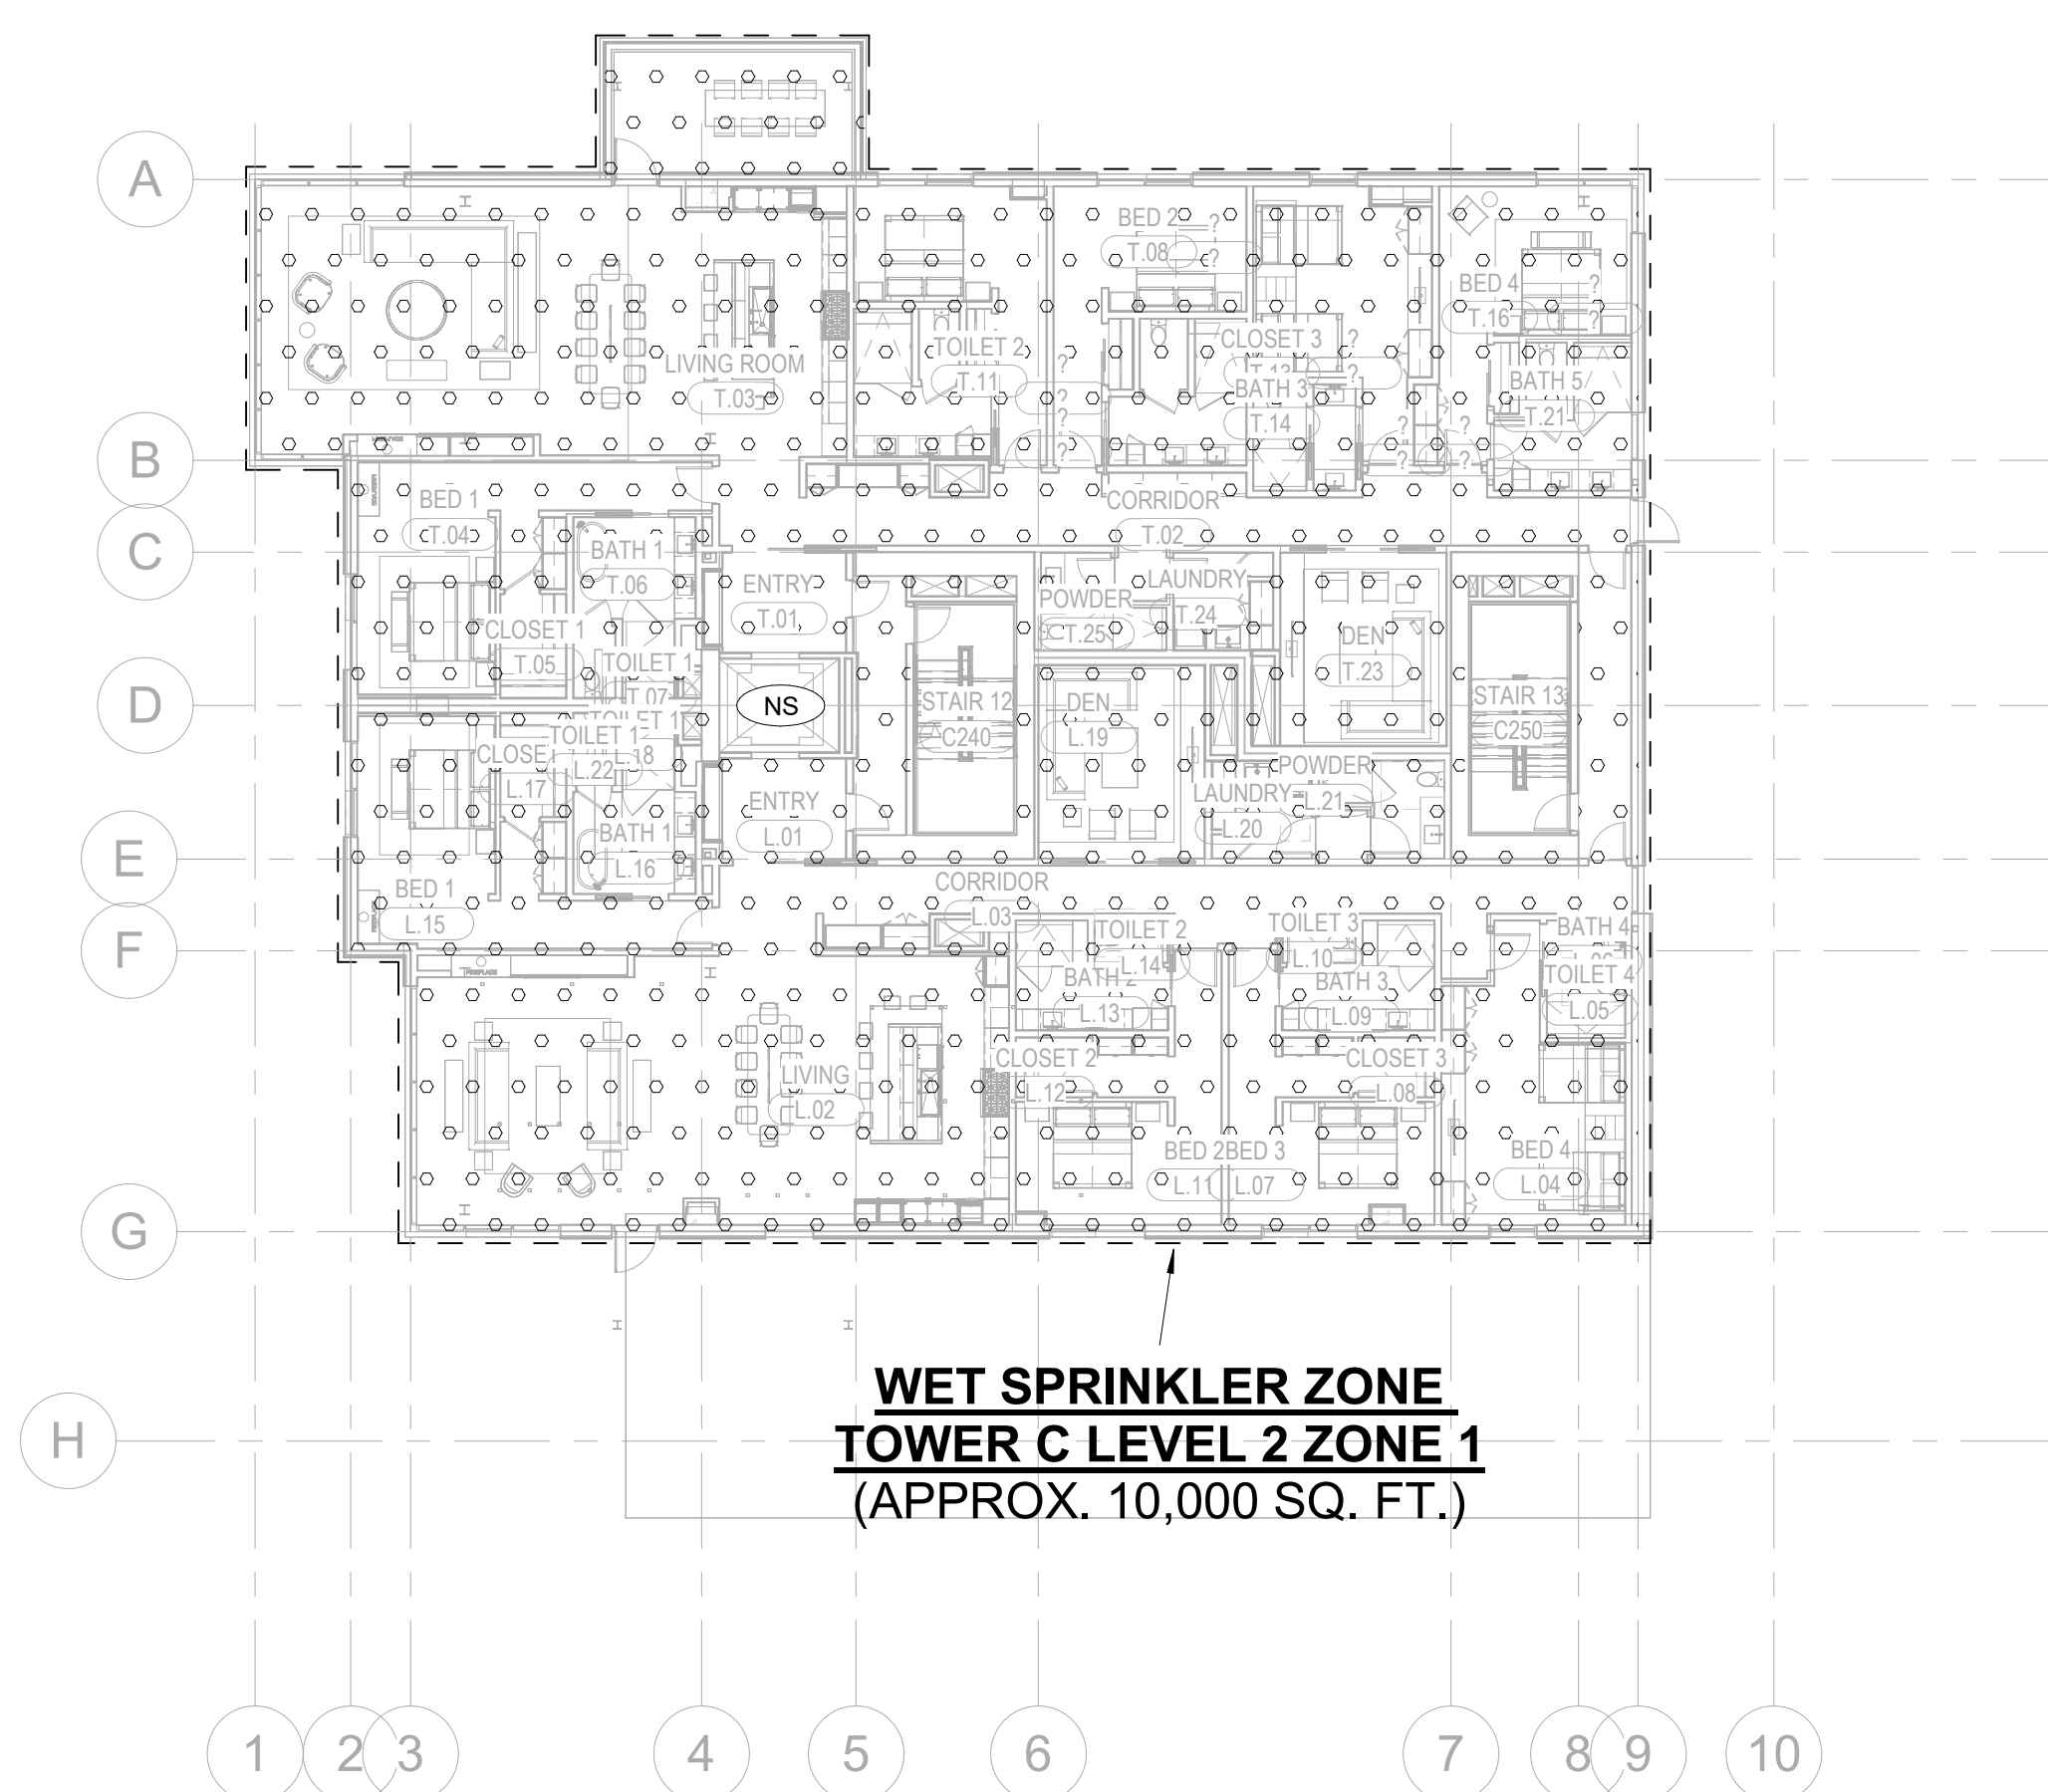
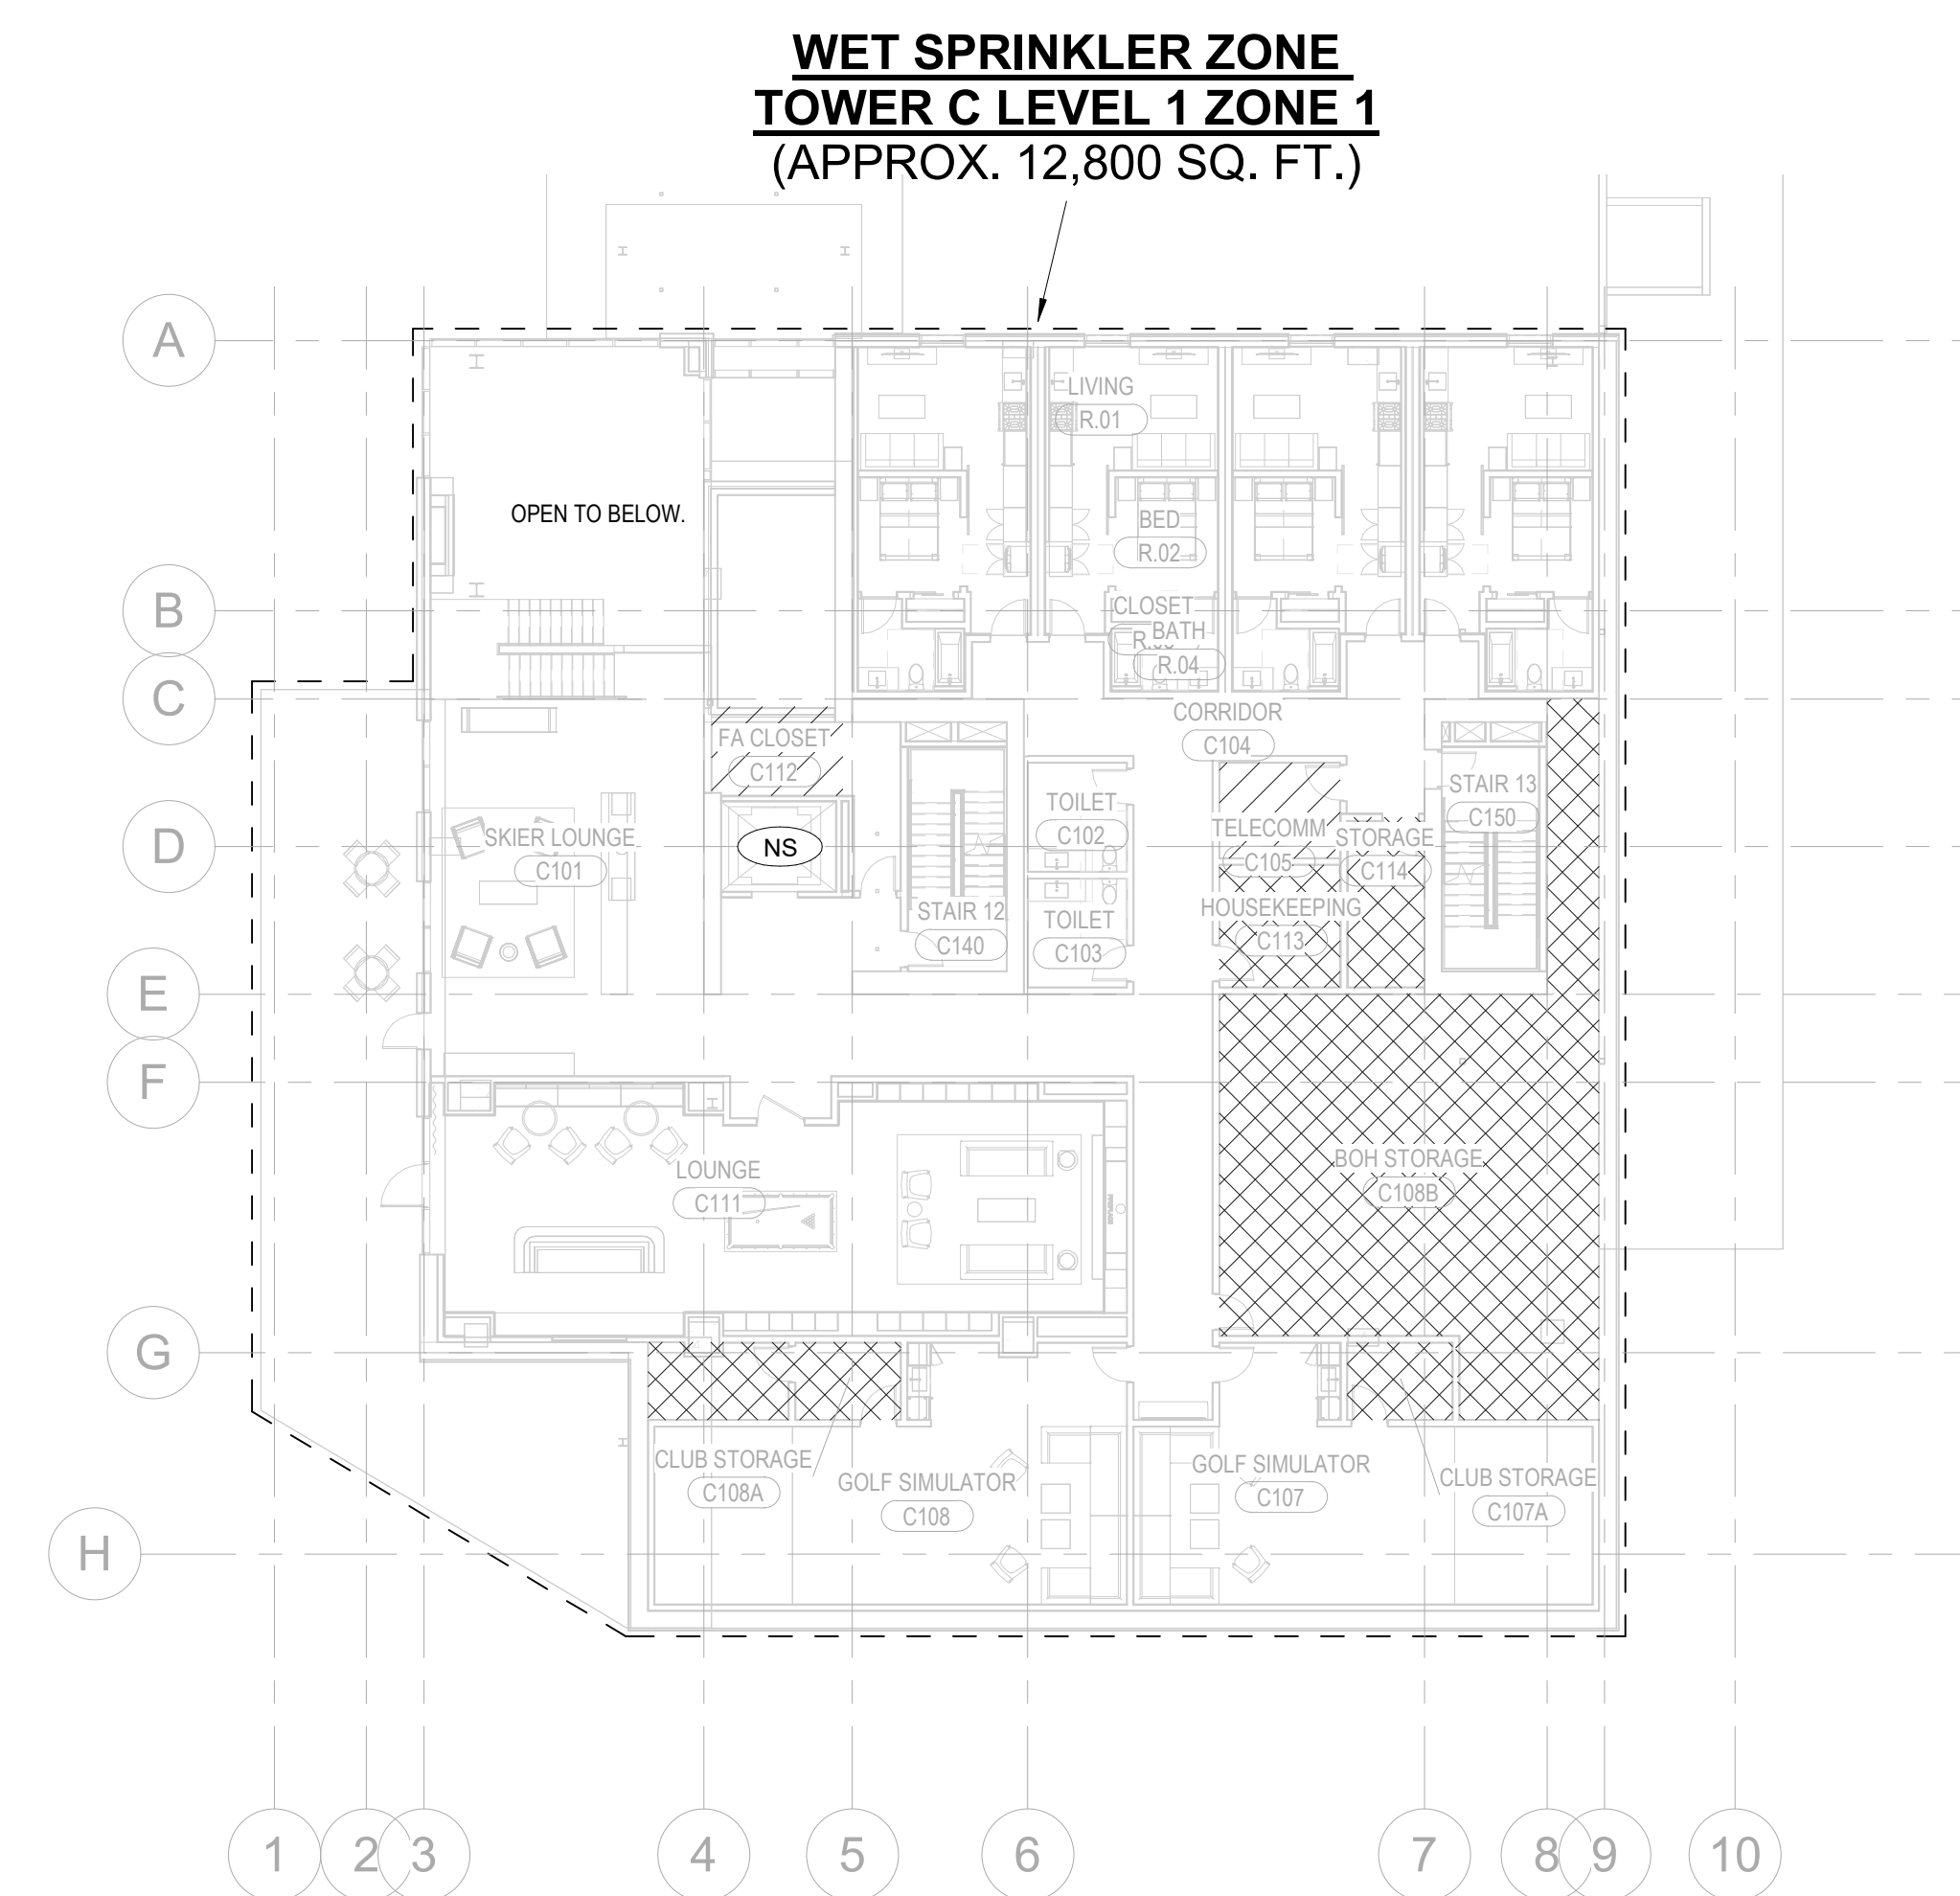


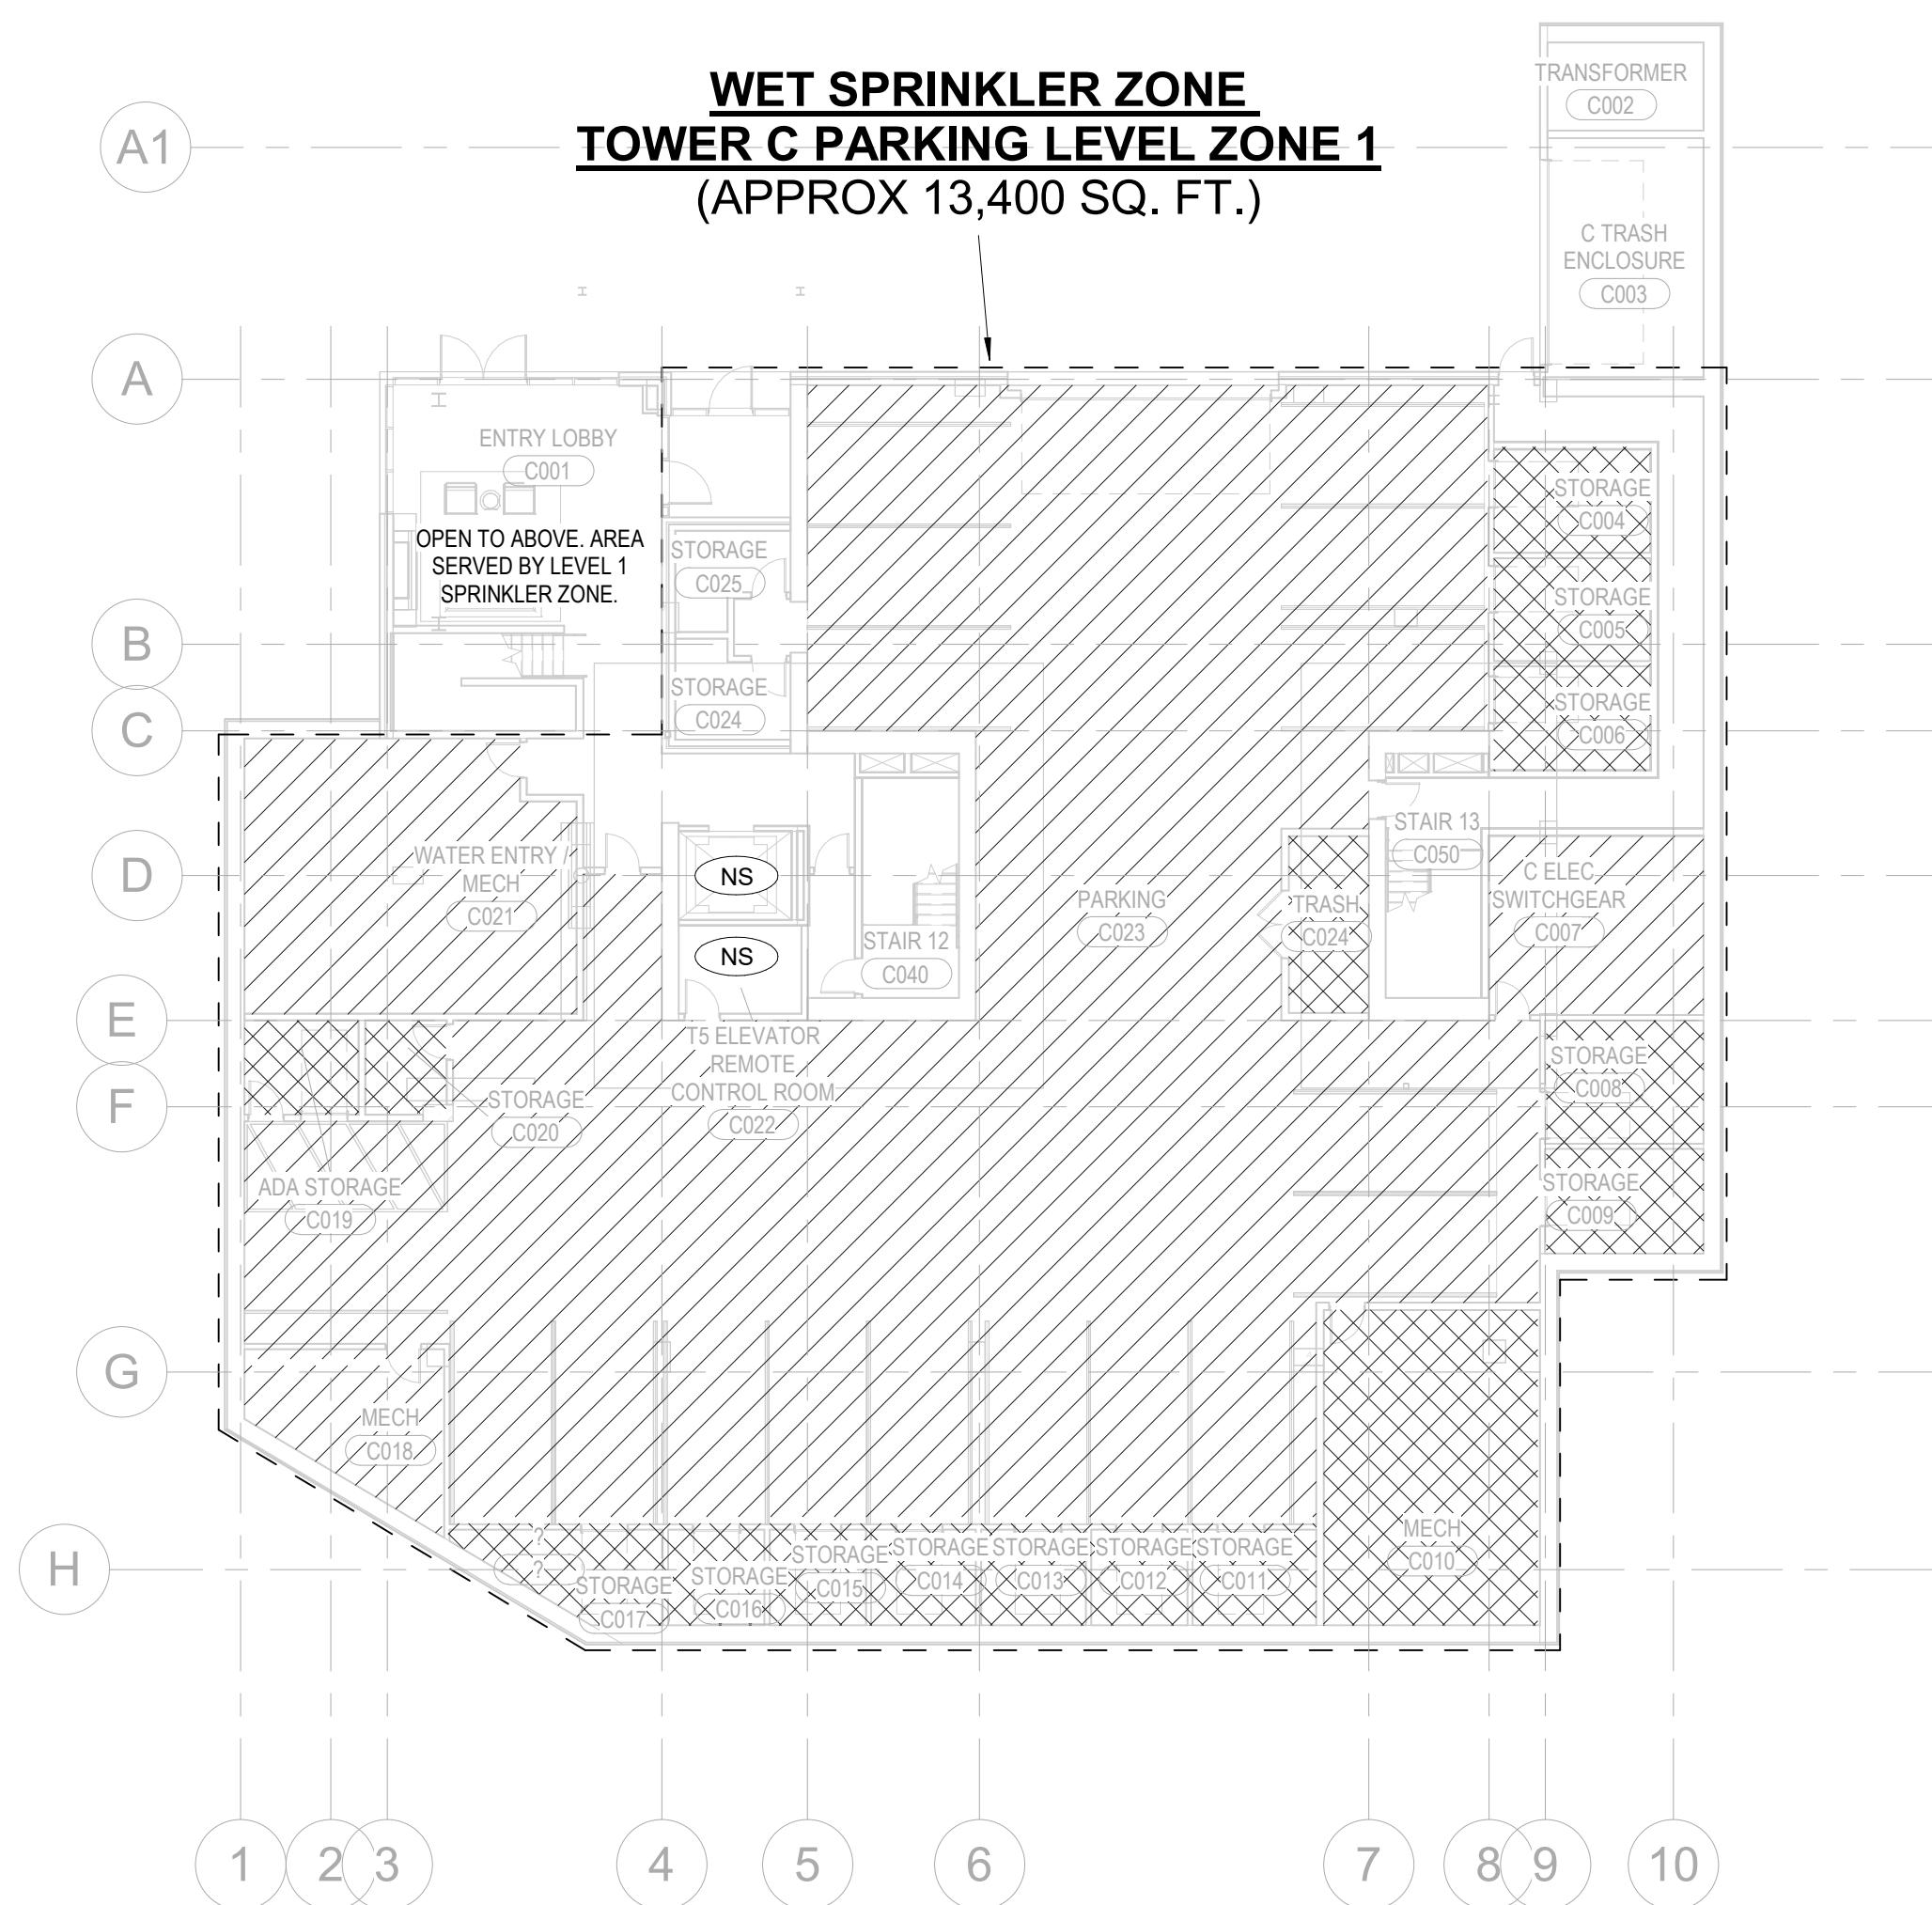


FIRE PROTECTION DESIGN HATCH LEGEND

		LNH	LIGHT HAZARD; SYSTEM PROVIDING A DENSITY OF .10 GPM/SQ.FT. OVER DESIGN AREA OF 1,500 SQ. FT. WITH 100 GPM HOSE ALLOWANCE
		RES	RESIDENTIAL HAZARD; SYSTEM PROVIDING A DENSITY OF .10 GPM/SQ.FT. OVER DESIGN AREA OF 4 SPRINKLERS, WITH 100 GPM HOSE ALLOWANCE
		OH1	ORDINARY HAZARD GROUP 1; SYSTEM PROVIDING A DENSITY OF .15 GPM/SQ.FT. OVER DESIGN AREA OF 1,500 SQ. FT. WITH 250 GPM HOSE ALLOWANCE
		OH2	ORDINARY HAZARD GROUP 2; SYSTEM PROVIDING A DENSITY OF .20 GPM/SQ.FT. OVER DESIGN AREA OF 1,500 SQ. FT. WITH 250 GPM HOSE ALLOWANCE
		EXT	EXTRA HAZARD GROUP 1; SYSTEM PROVIDING A DENSITY OF .30 GPM/SQ.FT. OVER DESIGN AREA OF THE ENTIRE ROOM WITH 500 GPM HOSE ALLOWANCE
		NS	NON-SPRINKLERED AREA

159 South Jackson St, Suite 800
Seattle, Washington 98104 USA
+1 206 624 5670 olsonkundig.com

Olson Kundig

project: **SOMMET BLANC - C**
DEER VALLEY, UTAH



White Summit Development, LLC
PO Box 980022
Park City, Utah 84098

Acoustic Consultant
BRC Acoustics
1932 1st Ave, Suite 620
Seattle, WA 98101

Pool Consultant
Cloward H2O
2696 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6949 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
88 Mainelli Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Lerch Bates
19515 North Creek Parkway, Suite 300
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O-
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect TK
project manager JCC
drawn by CRB, SMK

checked by Checker
job no. 20052
date 11/18/2022

revisions:

no.	date
-----	------

ISSUE FOR
CONSTRUCTION

11/18/2022

FIRE PROTECTION -
TOWER C - ZONING
PLANS


FP1.07

Reserved for permit stamp

100 South Jackson St., Suite 600
Seattle, Washington 98104 USA
+1 206 834 2877 olsonkundig.com

Olson Kundig

project
SOMMET BLANC - C
DEER VALLEY, UTAH



White Summit Development, LLC
PO Box 980022
Park City, Utah 84098

Acoustic Consultant
BRC Acoustics
1932 1st Ave, Suite 620
Seattle, WA 98101

Pool Consultant
Cloward #20
2698 N University Ave, Suite 290
Provo, UT 84604

Landscape Architect
EPG Design
6948 South High Tech Drive, Suite 100
Midvale, Utah 84047

Specifications Writer
Friday Group
86 Mainell Road
Middlebury, VT

Code Consultant
Holmes
600 1st Avenue, Suite 200A
Seattle, WA 98104

Fire Protection Engineer
Jensen Hughes
One Research Drive, Suite 305C
Westborough, MA 01581

Vertical Transportation Consultant
Larch Bates
19515 North Creek Parkway, Suite 304
Bothell, WA 98011

Structural Engineer
Magnusson Klemencic Associates
1301 5th Ave, Suite 3200
Seattle, WA 98101

Lighting Designer
O
1319 SE MLK Blvd, Suite 210
Portland, Oregon 97219

Building Envelope Consultant
RDH
2101 N 34th St
Seattle, WA 98103

Accessibility Consultant
Studio Pacifica
2144 Westlake Ave N, Suite F
Seattle, WA 98109

MEP Engineer
WSP USA
1001 Fourth Ave., Suite 3100
Seattle, WA 98154

principal architect: JKL
project manager: JCC
drawn by: CRB_SMM

checked by: Checker
job no. 2052
date 11/18/2022

revisions:

no. date by


ISSUE FOR
CONSTRUCTION

11/18/2022

FIRE PROTECTION -
TOWER C - ZONING
PLANS

FP1.09

WET SPRINKLER ZONE
TOWER C LEVEL 8 ZONE 1
(APPROX. 10,700 SQ. FT.)

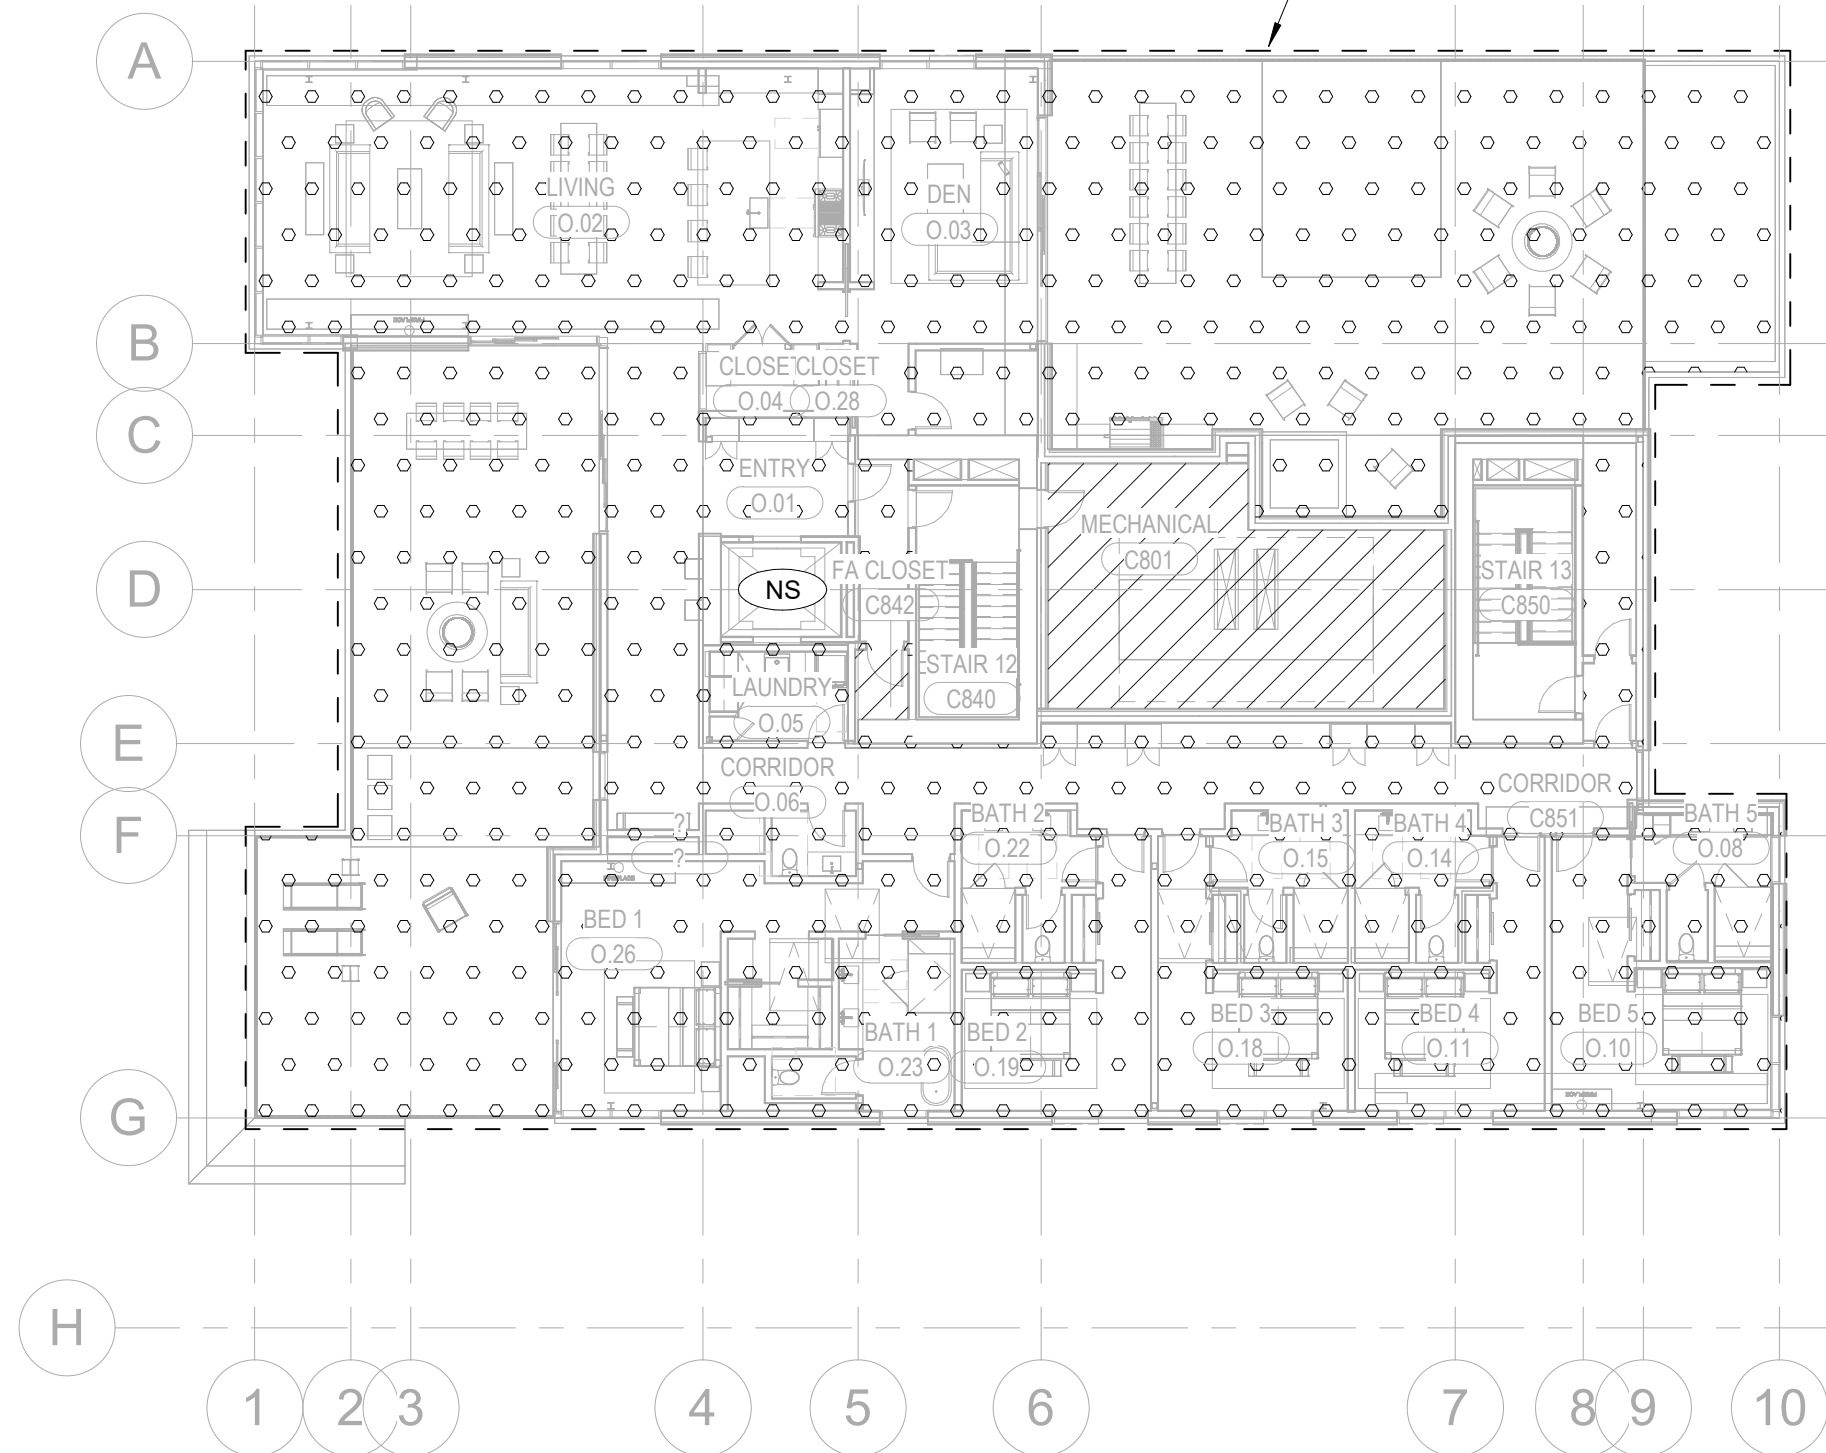

1 TOWER C - LEVEL 8 - ZONING PLAN

1/16" = 1'-0"

FIRE PROTECTION DESIGN HATCH LEGEND

	LH	LIGHT HAZARD; SYSTEM PROVIDING A DENSITY OF .10 GPM/SQFT. OVER DESIGN AREA OF 1,500 SQ. FT. WITH 100 GPM HOSE ALLOWANCE
	RES	RESIDENTIAL HAZARD; SYSTEM PROVIDING A DENSITY OF .10 GPM/SQFT. OVER DESIGN AREA OF 4 SPRINKLERS. WITH 100 GPM HOSE ALLOWANCE
	OH1	ORDINARY HAZARD GROUP 1; SYSTEM PROVIDING A DENSITY OF .15 GPM/SQFT. OVER DESIGN AREA OF 1,500 SQ. FT. WITH 250 GPM HOSE ALLOWANCE
	OH2	ORDINARY HAZARD GROUP 2; SYSTEM PROVIDING A DENSITY OF .20 GPM/SQFT. OVER DESIGN AREA OF 1,500 SQ. FT. WITH 250 GPM HOSE ALLOWANCE
	EX1	EXTRA HAZARD GROUP 1; SYSTEM PROVIDING A DENSITY OF .30 GPM/SQFT. OVER DESIGN AREA OF THE ENTIRE ROOM WITH 500 GPM HOSE ALLOWANCE
	NS	NON-SPRINKLERED AREA