

RESIDENTIAL FAN COIL UNITS HVAC LOADS (CONT)



Aspen Group USA, LLC PO Box 980022 Park City, Utah 84098


2696 N University Ave, Suite 290 6949 South High Tech Drive, Suite 100 One Research Drive, Suite 305C Vertical Transportation Consulatant

principal architect_____ project manager_____ drawn by_____ ____ checked by <u>Checker</u> date 11/18/2022

_____ _____ _____

CONSTRUCTION

CALCULATION

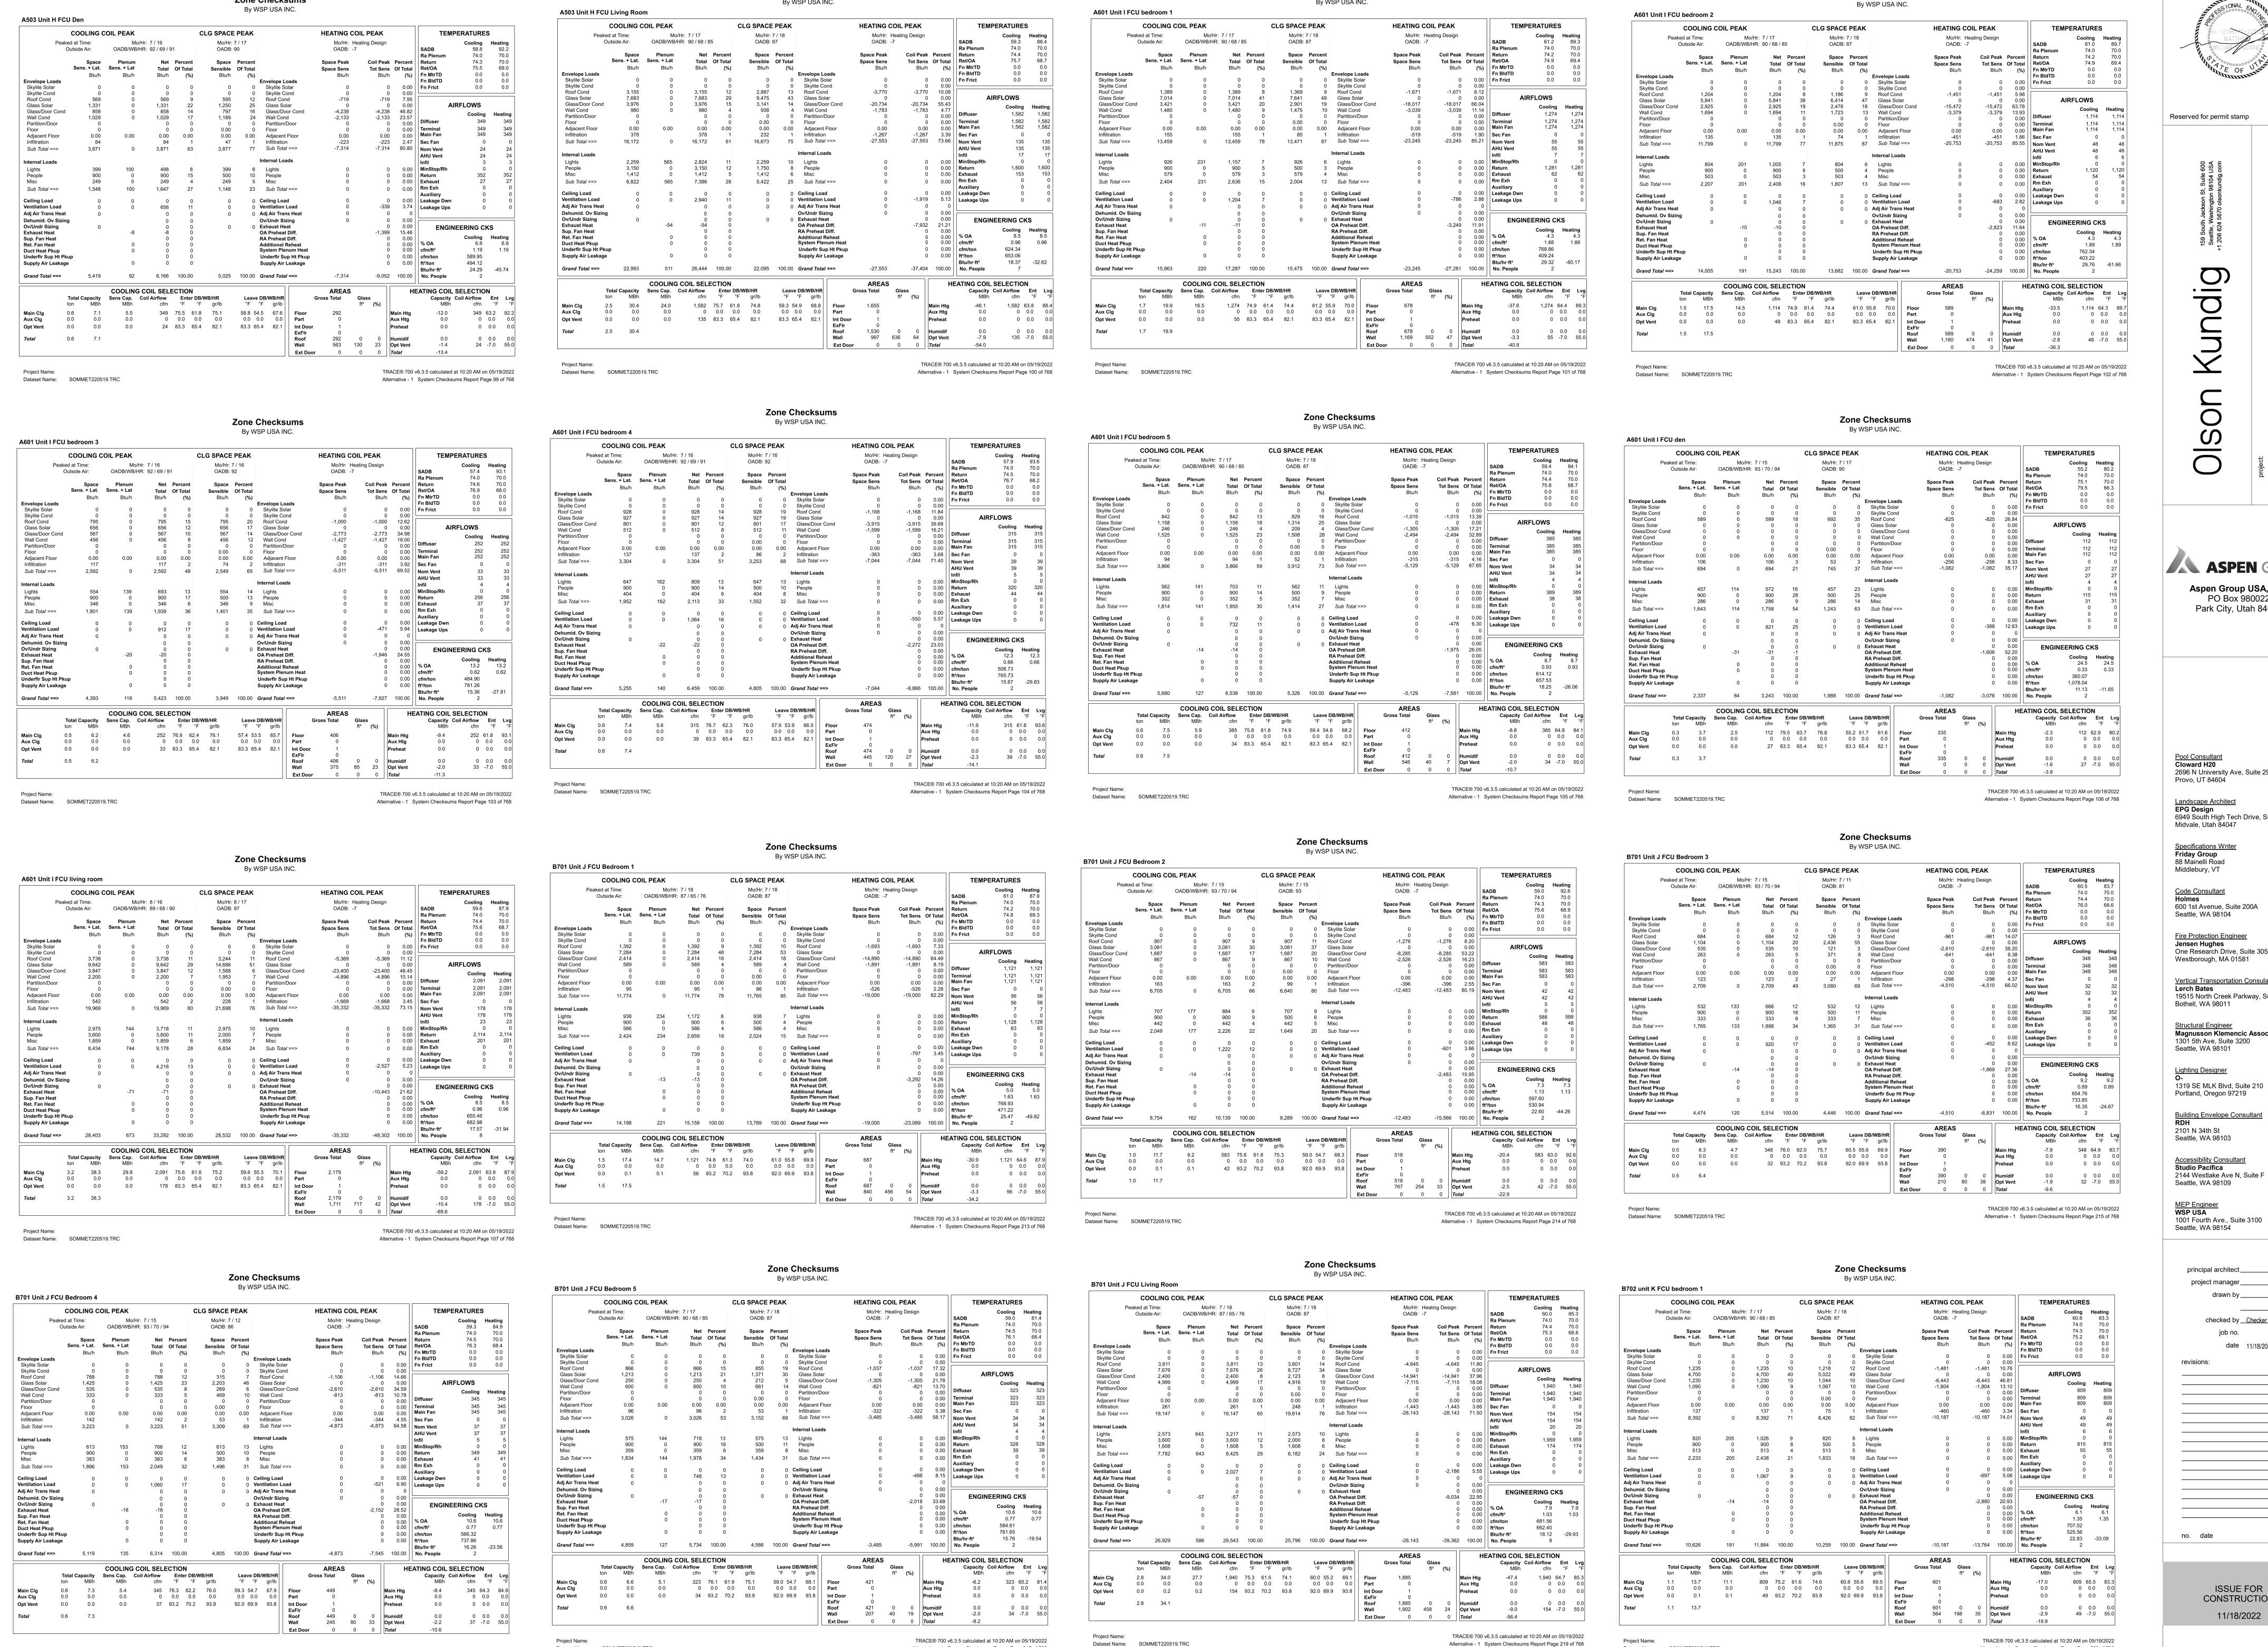

Alternative - 1 System Checksums Report Page 217 of 768

Zone Checksums

By WSP USA INC.

Zone Checksums

By WSP USA INC.

RESIDENTIAL FAN COIL UNITS HVAC LOADS (CONT)

Project Name:

Dataset Name: SOMMET220519.TRC

Zone Checksums

TRACE® 700 v6.3.5 calculated at 10:20 AM on 05/19/2022

Alternative - 1 System Checksums Report Page 216 of 768

Dataset Name: SOMMET220519.TRC

Zone Checksums

Dataset Name: SOMMET220519.TRC

Aspen Group USA, LLC PO Box 980022 Park City, Utah 84098

2696 N University Ave, Suite 290 6949 South High Tech Drive, Suite 100

One Research Drive, Suite 305C Vertical Transportation Consulatant 19515 North Creek Parkway, Suite 304

Magnusson Klemencic Associates

principal architect_____ project manager_____ drawn by_____ date 11/18/2022

____ checked by <u>Checker</u> _____

_____ .____

CONSTRUCTION

HVAC LOAD CALCULATION

Alternative - 1 System Checksums Report Page 220 of 768